

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		3650.4 cd per klm. 0.0 degrees vertical 4.0 degrees horizontal
Beam Spread	At 10% of Imax	51.6V x 48.1H
	At 50% of Imax	29.1V x 29.6H
	At 90% of Imax	7.0V x 13.1H
Beam Flux	Total	995.8 lumens per klm.
	To 10% of Imax	870.0 lumens per klm.
	To 50% of Imax	533.6 lumens per klm.
	To 90% of Imax	76.2 lumens per klm.
	Upward LOR	0.0 %
	Downward LOR	99.6 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.25V I:0.0508A P:5.3392W PF:0.4769 Freq:50.00Hz Lamp Flux:189.487x1 lm		
NAME: 6144	TYPE:	WEIGHT:144g
SPEC.:5W	DIM.: 13* Φ 3cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

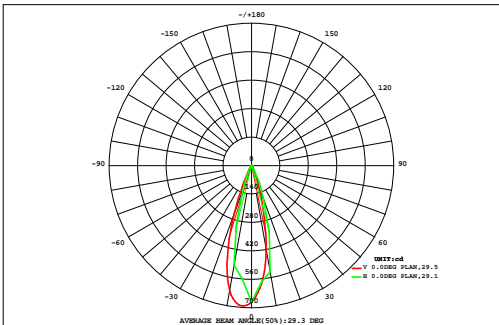

DATA OF LAMP		Eff:35.49lm/W	
MODEL		Imax(cd)	691.7
NOMINAL POWER(W)		AVAILABILITY(%)	88.4
RATED VOLTAGE(V)		Avai. FLUX(lm)	167.5
NOMINAL FLUX(lm)	189.487	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	189.5
TEST VOLTAGE(V)	0	q @50%(H,V)	30,29DEG

AREA FLUX DIAGRAM																UNIT:lm		F t	F a			
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
80	0.00	0.01	0.01	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.01	0.01	0.00	0.38	0.00			
70	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.01	0.01	0.01	0.00	0.32	0.00		
60	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.04	0.04	0.03	0.03	0.02	0.02	0.01	0.01	0.01	0.00	0.35	0.00		
50	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.04	0.06	0.07	0.06	0.04	0.03	0.02	0.01	0.01	0.01	0.00	0.48	0.00		
40	0.00	0.01	0.01	0.02	0.02	0.03	0.05	0.12	0.22	0.27	0.21	0.12	0.05	0.02	0.01	0.01	0.01	0.00	1.19	0.00		
30	0.00	0.01	0.01	0.02	0.03	0.05	0.15	0.48	1.22	1.75	1.12	0.39	0.12	0.04	0.02	0.01	0.01	0.00	5.41	2.31		
20	0.00	0.01	0.01	0.02	0.03	0.10	0.40	1.87	5.92	8.43	5.41	1.38	0.25	0.06	0.02	0.01	0.01	0.00	23.9	21.1		
10	0.00	0.01	0.01	0.02	0.04	0.16	0.81	4.69	14.2	18.7	12.5	3.04	0.39	0.08	0.03	0.01	0.01	0.00	54.7	52.5		
0	0.00	0.01	0.01	0.02	0.04	0.18	1.02	5.83	15.6	19.5	13.4	3.33	0.41	0.08	0.03	0.01	0.01	0.00	59.5	57.4		
-10	0.00	0.01	0.01	0.02	0.04	0.14	0.70	3.42	9.08	11.3	6.72	1.49	0.26	0.06	0.02	0.01	0.01	0.00	33.3	31.0		
-20	0.00	0.01	0.01	0.02	0.03	0.07	0.26	0.90	1.91	2.17	1.14	0.37	0.12	0.04	0.02	0.01	0.01	0.00	7.07	3.08		
-30	0.00	0.01	0.01	0.02	0.02	0.03	0.08	0.15	0.23	0.26	0.19	0.10	0.05	0.02	0.02	0.01	0.01	0.00	1.21	0.00		
-40	0.00	0.01	0.01	0.01	0.02	0.03	0.03	0.05	0.07	0.07	0.06	0.04	0.02	0.02	0.01	0.01	0.01	0.00	0.47	0.00		
-50	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.01	0.01	0.01	0.00	0.35	0.00		
-60	0.00	0.01	0.01	0.01	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.01	0.01	0.01	0.00	0.36	0.00		
-70	0.00	0.01	0.01	0.01	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.01	0.01	0.01	0.00	0.31	0.00		
-80	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.14	0.00		
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
	-90	-80	-70	-60	-50	-40	-30	-20	HORIZONTAL(DEG)	20	30	40	50	60	70	80	90					
F t	0.04	0.11	0.19	0.29	0.42	0.96	3.72	17.7	48.7	62.7	41.0	10.5	1.85	0.58	0.29	0.19	0.11	0.04	189	---		
F a	0.00	0.00	0.00	0.00	0.00	0.00	0.59	14.3	46.3	60.9	38.4	7.06	0.00	0.00	0.00	0.00	0.00	0.00	---	167		


one-half-peak spread: U:15.1,D:14.1 , L:15.9,R:13.8 NEMA Beam Type: Type 4

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.25V I:0.0508A P:5.3392W PF:0.4769 Freq:50.00Hz Lamp Flux:189.487x1 lm		
NAME: 6144	TYPE:	WEIGHT:144g
SPEC.:5W	DIM.: 13*φ3cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

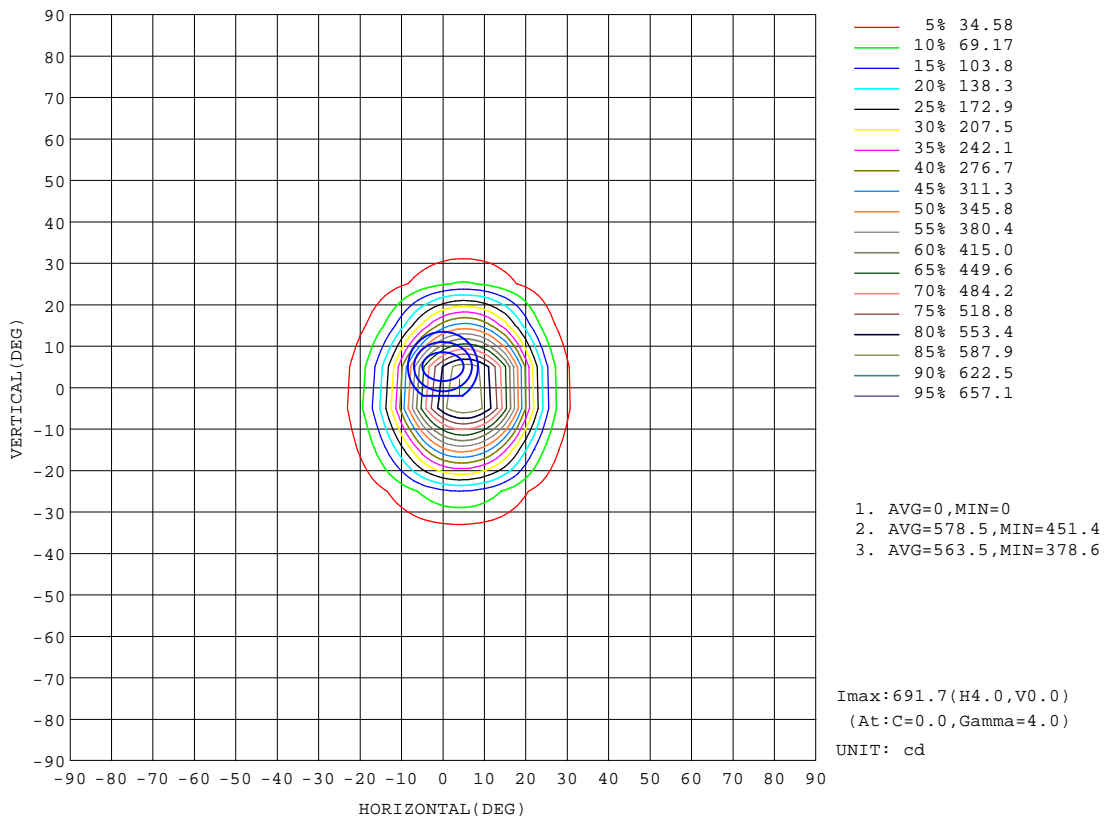


H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:NORDECOR
 Test Date:2024-10-31

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM


Test:U:220.25V I:0.0508A P:5.3392W PF:0.4769 Freq:50.00Hz Lamp Flux:189.487x1 lm		
NAME: 6144	TYPE:	WEIGHT:144g
SPEC.:5W	DIM.: 13*φ3cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

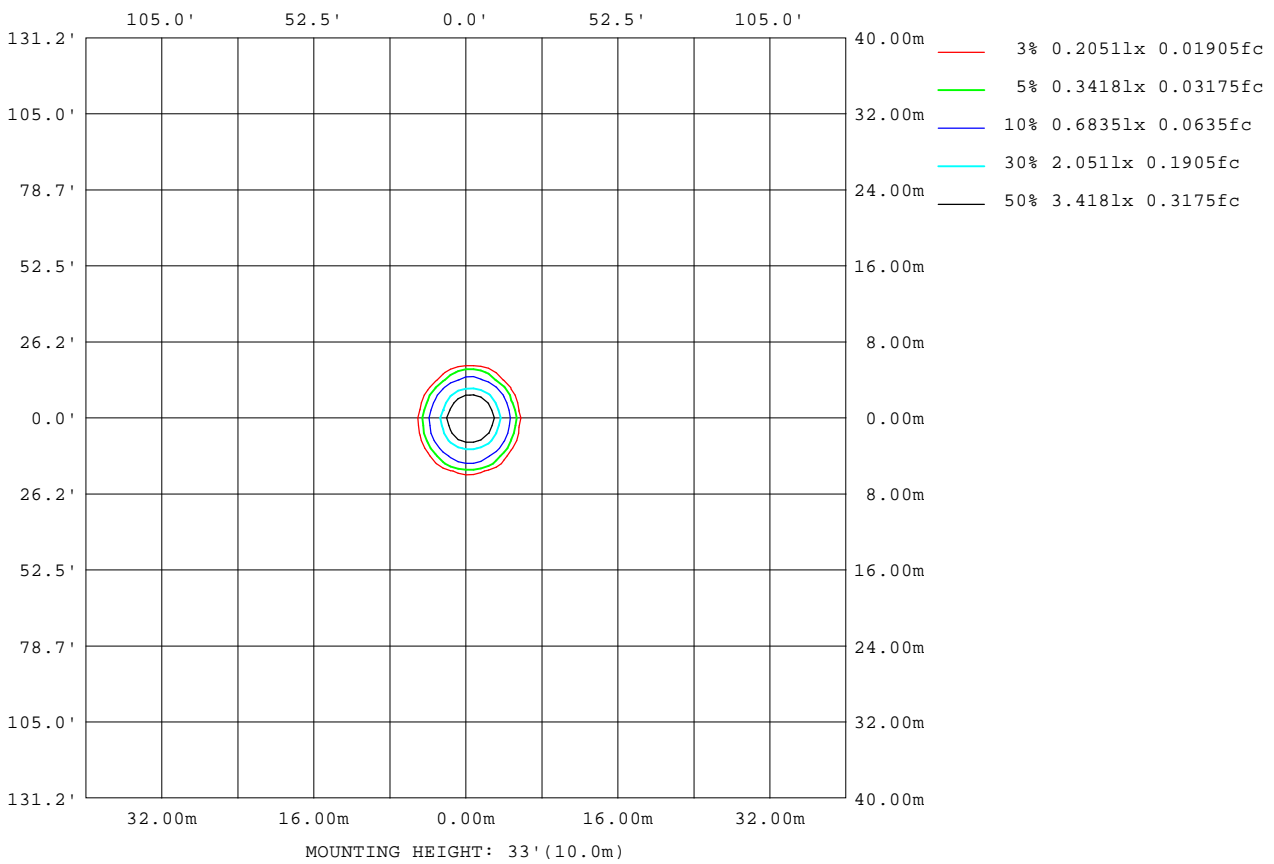

H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:NORDECOR
 Test Date:2024-10-31

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

Planar Illuminance Curve

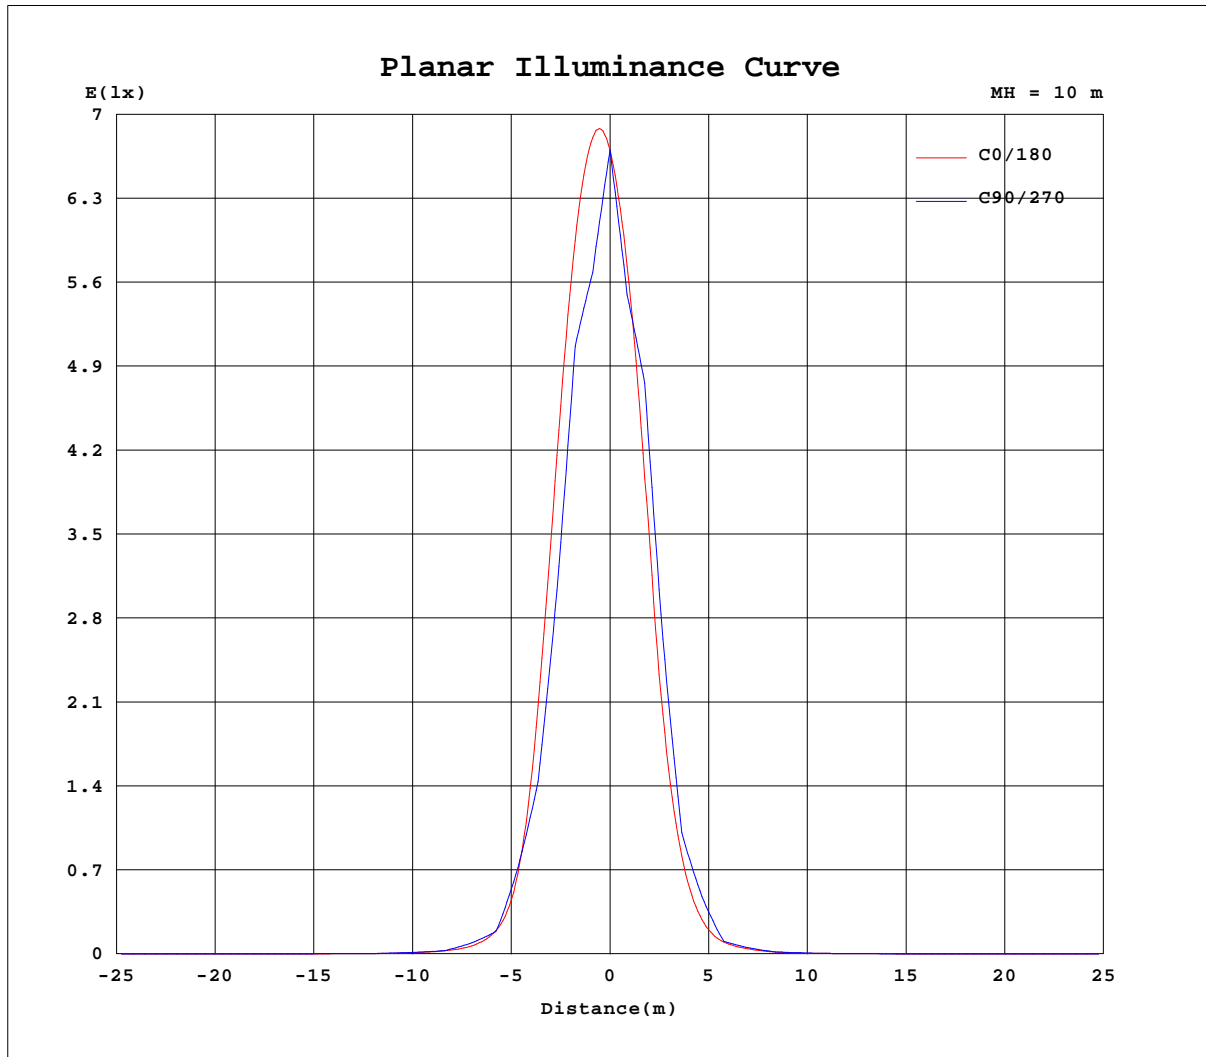


H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:NORDECOR
 Test Date:2024-10-31

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

AAI Figure

Test:U:220.25V I:0.0508A P:5.3392W PF:0.4769 Freq:50.00Hz Lamp Flux:189.487x1 lm		
NAME: 6144	TYPE:	WEIGHT:144g
SPEC.:5W	DIM.: 13*#3cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Flux out:100.7 lm

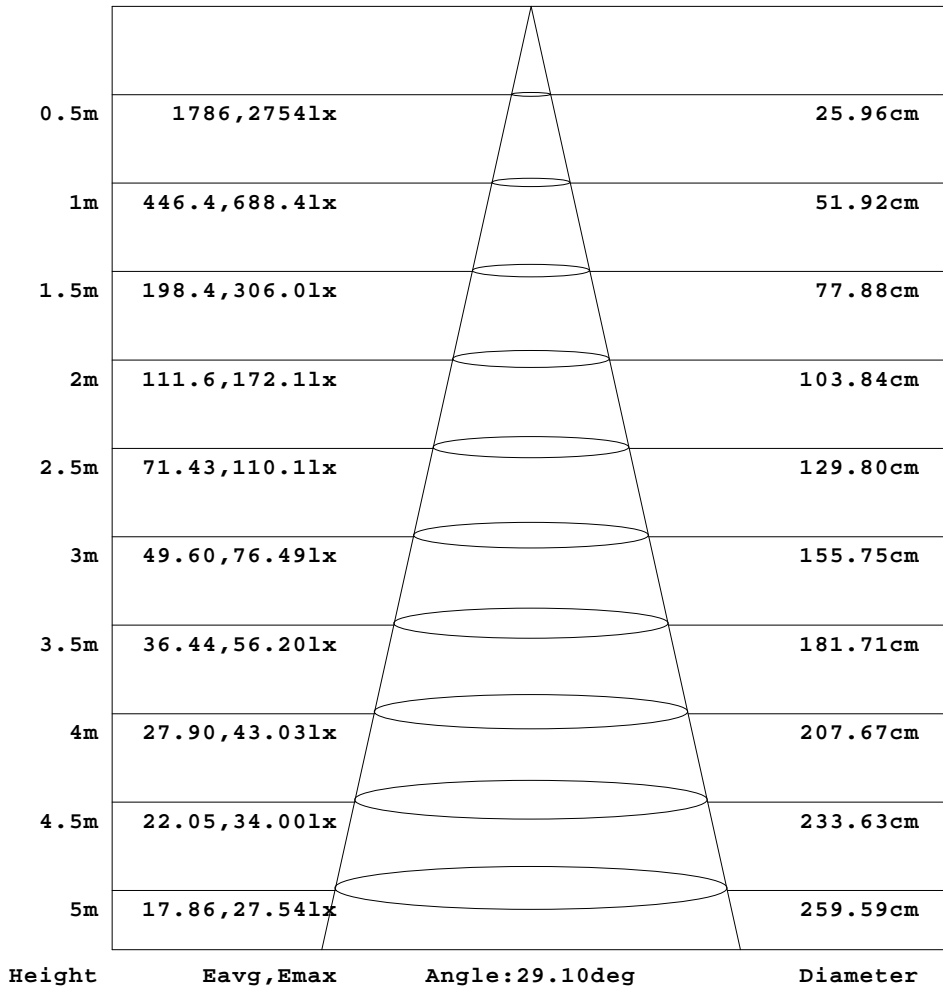

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.25V I:0.0508A P:5.3392W PF:0.4769 Freq:50.00Hz Lamp Flux:189.487x1 lm		
NAME: 6144	TYPE:	WEIGHT:144g
SPEC.:5W	DIM.: 13*#3cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--1

UNIT: cd

H(DEG) V(DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.74	0.76	0.77	0.78	0.78	0.76	0.77	0.78	0.79	0.79	0.81	0.80	0.81	0.82	0.83	0.83	0.83	0.84	0.85
-75	0.78	0.79	0.79	0.79	0.80	0.80	0.80	0.83	0.82	0.83	0.84	0.85	0.86	0.88	0.88	0.90	0.92	0.93	0.95
-70	0.80	0.82	0.83	0.83	0.82	0.83	0.85	0.86	0.87	0.88	0.90	0.92	0.94	0.96	0.97	0.99	1.02	1.03	1.04
-65	0.80	0.80	0.81	0.80	0.81	0.84	0.84	0.86	0.87	0.89	0.90	0.92	0.97	1.00	1.04	1.09	1.14	1.17	1.21
-60	0.76	0.82	0.83	0.79	0.80	0.85	0.86	0.87	0.89	0.92	0.95	0.98	1.02	1.08	1.14	1.23	1.30	1.35	1.38
-55	0.81	0.80	0.80	0.80	0.81	0.84	0.84	0.86	0.86	0.89	0.92	0.97	1.06	1.11	1.19	1.30	1.43	1.49	1.57
-50	0.82	0.81	0.83	0.82	0.82	0.83	0.84	0.85	0.87	0.90	0.94	1.04	1.10	1.22	1.33	1.46	1.60	1.66	1.79
-45	0.80	0.81	0.82	0.82	0.83	0.84	0.84	0.86	0.86	0.90	0.96	1.04	1.15	1.25	1.50	2.13	2.99	3.62	4.01
-40	0.82	0.80	0.82	0.83	0.82	0.85	0.85	0.87	0.88	0.97	1.03	1.12	1.24	1.43	2.08	3.50	4.93	5.91	6.39
-35	0.80	0.82	0.84	0.85	0.85	0.88	0.89	0.92	0.95	1.04	1.11	1.21	1.55	2.82	4.64	7.20	10.6	14.5	17.3
-30	0.83	0.84	0.86	0.88	0.90	0.92	0.95	0.99	1.09	1.18	1.26	1.42	2.65	5.53	9.04	13.5	19.5	25.7	29.1
-25	0.82	0.84	0.86	0.90	0.92	0.95	1.00	1.06	1.18	1.30	1.43	1.97	4.01	7.86	14.9	28.7	49.7	75.6	96.6
-20	0.86	0.86	0.90	0.93	0.97	1.02	1.08	1.21	1.38	1.53	1.78	3.83	7.93	14.7	30.1	59.4	100	145	174
-15	0.83	0.86	0.87	0.93	0.96	1.02	1.09	1.22	1.42	1.61	1.94	3.98	8.33	16.7	38.7	85.5	162	261	337
-10	0.84	0.86	0.90	0.95	1.00	1.07	1.17	1.38	1.61	1.88	3.13	7.09	13.8	31.7	77.9	167	300	450	530
-5	0.85	0.86	0.89	0.94	0.98	1.06	1.14	1.33	1.56	1.81	2.44	5.69	11.1	24.1	61.8	144	289	460	575
0	0.85	0.87	0.92	0.96	1.02	1.10	1.23	1.45	1.70	2.05	3.74	7.94	15.5	38.5	98.5	222	415	580	670
5	0.86	0.86	0.89	0.92	0.98	1.04	1.13	1.31	1.53	1.79	2.38	5.36	10.3	21.8	55.1	130	270	437	556
10	0.83	0.86	0.88	0.94	0.99	1.06	1.16	1.35	1.55	1.81	2.80	6.14	11.4	24.4	59.0	133	260	406	498
15	0.84	0.85	0.87	0.90	0.95	1.01	1.07	1.18	1.36	1.56	1.85	3.43	6.74	12.7	27.8	61.8	126	215	292
20	0.83	0.86	0.87	0.92	0.95	1.02	1.05	1.17	1.30	1.46	1.69	2.93	5.79	9.88	18.0	34.6	61.0	94.5	122
25	0.82	0.83	0.85	0.87	0.91	0.94	0.98	1.02	1.13	1.25	1.36	1.73	3.08	5.39	9.35	16.9	29.5	46.8	64.3
30	0.82	0.83	0.83	0.86	0.88	0.88	0.92	0.95	1.04	1.11	1.20	1.35	1.95	3.55	5.65	8.08	11.0	14.1	16.2
35	0.81	0.81	0.82	0.83	0.85	0.85	0.87	0.89	0.93	0.98	1.06	1.14	1.35	1.99	3.10	4.46	6.18	8.10	9.73
40	0.79	0.79	0.80	0.82	0.82	0.81	0.83	0.84	0.86	0.92	0.98	1.04	1.13	1.29	1.57	2.13	2.88	3.58	4.00
45	0.79	0.80	0.79	0.80	0.81	0.81	0.82	0.83	0.83	0.86	0.91	0.94	1.04	1.12	1.27	1.53	1.91	2.32	2.62
50	0.79	0.78	0.80	0.79	0.80	0.81	0.82	0.82	0.82	0.84	0.87	0.93	1.00	1.06	1.14	1.22	1.28	1.34	1.40
55	0.78	0.80	0.80	0.80	0.80	0.82	0.82	0.82	0.84	0.85	0.86	0.90	0.95	0.99	1.04	1.09	1.14	1.19	1.22
60	0.80	0.81	0.81	0.81	0.82	0.83	0.82	0.85	0.86	0.86	0.89	0.89	0.92	0.95	0.96	1.00	1.04	1.08	1.07
65	0.80	0.82	0.81	0.82	0.83	0.84	0.84	0.85	0.86	0.87	0.88	0.90	0.91	0.93	0.95	0.96	0.98	1.00	1.01
70	0.83	0.83	0.84	0.84	0.83	0.84	0.86	0.86	0.88	0.87	0.90	0.89	0.92	0.94	0.92	0.94	0.95	0.94	0.95
75	0.83	0.83	0.82	0.83	0.84	0.84	0.84	0.86	0.86	0.86	0.88	0.88	0.89	0.90	0.90	0.90	0.91	0.91	0.92
80	0.83	0.84	0.84	0.83	0.84	0.84	0.83	0.84	0.84	0.84	0.86	0.86	0.86	0.87	0.89	0.87	0.88	0.88	0.88
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.25V I:0.0508A P:5.3392W PF:0.4769 Freq:50.00Hz Lamp Flux:189.487x1 lm		
NAME: 6144	TYPE:	WEIGHT:144g
SPEC.:5W	DIM.: 13*#3cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--2

UNIT: cd

H(DEG) V(DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.86	0.84	0.85	0.84	0.84	0.82	0.83	0.82	0.82	0.81	0.80	0.78	0.79	0.78	0.78	0.76	0.75	0.74
-75	0.95	0.94	0.95	0.94	0.92	0.91	0.90	0.88	0.86	0.85	0.84	0.83	0.81	0.80	0.79	0.78	0.78	0.76
-70	1.04	1.04	1.03	1.03	1.00	0.98	0.95	0.93	0.89	0.88	0.86	0.83	0.82	0.83	0.80	0.79	0.79	0.76
-65	1.21	1.21	1.20	1.17	1.13	1.07	1.03	0.97	0.93	0.90	0.87	0.85	0.83	0.82	0.80	0.79	0.78	0.77
-60	1.39	1.38	1.33	1.28	1.21	1.14	1.06	0.99	0.93	0.87	0.86	0.84	0.82	0.80	0.79	0.79	0.78	0.77
-55	1.56	1.55	1.50	1.42	1.31	1.21	1.08	1.00	0.92	0.90	0.84	0.81	0.80	0.79	0.78	0.77	0.77	0.76
-50	1.75	1.72	1.60	1.48	1.33	1.19	1.05	0.96	0.94	0.85	0.80	0.78	0.76	0.76	0.75	0.75	0.75	0.76
-45	4.07	3.86	3.41	2.82	2.17	1.64	1.23	1.05	0.94	0.88	0.83	0.79	0.76	0.77	0.76	0.76	0.76	0.76
-40	6.30	5.69	4.76	3.66	2.56	1.74	1.23	1.03	0.94	0.86	0.81	0.77	0.76	0.76	0.76	0.76	0.76	0.76
-35	17.7	15.6	12.3	8.69	5.78	3.83	2.46	1.60	1.13	0.94	0.89	0.85	0.80	0.79	0.80	0.79	0.79	0.79
-30	27.9	23.1	16.8	11.2	7.23	4.70	2.85	1.70	1.13	0.99	0.93	0.88	0.83	0.83	0.83	0.82	0.80	0.79
-25	103	89.7	63.8	37.4	19.8	10.4	5.62	3.24	1.85	1.21	1.04	0.97	0.92	0.87	0.86	0.84	0.83	0.82
-20	172	137	88.3	47.2	23.3	11.3	6.11	3.52	1.92	1.26	1.10	1.01	0.94	0.90	0.87	0.87	0.86	0.84
-15	359	327	247	140	61.1	24.4	10.8	5.55	3.08	1.71	1.27	1.13	1.03	0.95	0.92	0.91	0.88	0.88
-10	533	464	320	160	60.7	23.3	10.1	5.25	2.92	1.64	1.30	1.15	1.05	0.98	0.95	0.93	0.91	0.87
-5	616	580	461	277	116	39.7	15.8	7.29	3.99	2.16	1.44	1.23	1.10	1.00	0.96	0.94	0.92	0.91
0	689	623	462	250	90.2	30.2	12.4	6.07	3.38	1.83	1.36	1.20	1.06	0.98	0.94	0.94	0.92	0.92
5	604	570	453	269	109	37.6	15.3	7.15	3.92	2.14	1.43	1.22	1.09	1.00	0.95	0.93	0.92	0.90
10	514	440	300	144	51.9	21.0	9.57	5.06	2.80	1.62	1.29	1.15	1.03	0.97	0.93	0.91	0.89	0.89
15	322	296	223	124	51.3	21.3	9.99	5.15	2.91	1.67	1.23	1.08	0.99	0.91	0.88	0.88	0.85	0.86
20	125	99.4	62.9	34.9	18.7	9.97	5.57	3.20	1.76	1.22	1.04	0.96	0.88	0.84	0.85	0.76	0.77	0.83
25	72.0	63.8	45.2	27.2	15.6	8.82	5.03	2.89	1.75	1.20	1.01	0.91	0.87	0.82	0.82	0.82	0.79	0.80
30	16.5	14.8	11.8	8.76	6.11	4.05	2.51	1.57	1.16	0.98	0.90	0.85	0.80	0.80	0.80	0.80	0.79	0.71
35	10.4	9.85	8.35	6.46	4.69	3.28	2.19	1.49	1.11	0.95	0.87	0.82	0.79	0.78	0.78	0.77	0.77	0.76
40	4.12	3.90	3.39	2.69	2.05	1.53	1.23	1.02	0.92	0.84	0.79	0.76	0.75	0.75	0.75	0.74	0.75	0.75
45	2.75	2.70	2.48	2.13	1.74	1.42	1.18	1.01	0.92	0.85	0.80	0.76	0.76	0.75	0.74	0.72	0.72	0.73
50	1.40	1.37	1.33	1.25	1.17	1.08	1.00	0.92	0.86	0.81	0.77	0.76	0.74	0.73	0.74	0.68	0.73	0.68
55	1.24	1.24	1.21	1.16	1.11	1.06	0.98	0.93	0.89	0.84	0.81	0.79	0.78	0.76	0.76	0.74	0.73	0.74
60	1.09	1.10	1.07	1.03	1.01	0.96	0.93	0.89	0.87	0.85	0.84	0.81	0.81	0.79	0.78	0.78	0.78	0.74
65	1.03	1.02	1.00	1.00	0.98	0.97	0.93	0.90	0.89	0.86	0.85	0.84	0.82	0.80	0.81	0.80	0.78	0.78
70	0.96	0.95	0.95	0.93	0.94	0.94	0.92	0.90	0.89	0.89	0.86	0.85	0.83	0.84	0.82	0.82	0.81	0.83
75	0.92	0.92	0.91	0.92	0.91	0.92	0.90	0.90	0.89	0.88	0.88	0.86	0.85	0.85	0.84	0.83	0.82	0.82
80	0.89	0.88	0.89	0.88	0.89	0.89	0.88	0.88	0.87	0.88	0.87	0.87	0.87	0.86	0.86	0.86	0.84	0.84
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(β) Range:-80 - 80DEG
V(β) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks: