

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		3591.4 cd per klm. 0.0 degrees vertical -2.0 degrees horizontal
Beam Spread	At 10% of Imax	48.8V x 46.2H
	At 50% of Imax	24.7V x 23.5H
	At 90% of Imax	13.5V x 8.5H
Beam Flux	Total	999.0 lumens per klm.
	To 10% of Imax	725.0 lumens per klm.
	To 50% of Imax	380.8 lumens per klm.
	To 90% of Imax	90.9 lumens per klm.
Upward LOR		0.0 %
Downward LOR		99.9 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.30V I:0.0646A P:6.3670W PF:0.4472 Freq:50.00Hz Lamp Flux:266.732x1 lm		
NAME: 6316	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

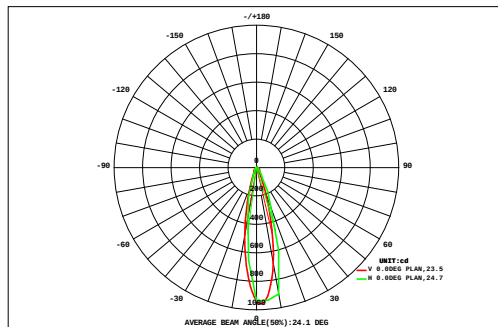

DATA OF LAMP		Eff:41.89lm/W	
MODEL		Imax(cd)	957.9
NOMINAL POWER(W)		AVAILABILITY(%)	73.2
RATED VOLTAGE(V)		Avai. FLUX(lm)	195.3
NOMINAL FLUX(lm)	266.732	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	266.7
TEST VOLTAGE(V)	0	q @50%(H,V)	23,25DEG

VERTICAL (DEG)	AREA FLUX DIAGRAM																UNIT:lm			F t	F a
	90	80	70	60	50	40	30	20	10	0	-10	-20	-30	-40	-50	-60	-70	-80	-90		
	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
	0.00	0.01	0.02	0.02	0.03	0.04	0.05	0.05	0.06	0.06	0.05	0.05	0.04	0.03	0.02	0.02	0.01	0.00	0.57		
	0.00	0.01	0.02	0.03	0.04	0.07	0.09	0.11	0.12	0.13	0.12	0.10	0.07	0.04	0.03	0.02	0.01	0.00	0.99		
	0.00	0.01	0.02	0.04	0.09	0.15	0.20	0.25	0.28	0.28	0.26	0.21	0.15	0.09	0.05	0.02	0.01	0.00	2.11		
	0.00	0.01	0.03	0.07	0.15	0.25	0.33	0.42	0.48	0.49	0.44	0.35	0.26	0.16	0.08	0.03	0.01	0.00	3.58		
	0.00	0.01	0.04	0.11	0.22	0.34	0.50	0.65	0.76	0.78	0.69	0.55	0.38	0.23	0.12	0.05	0.01	0.00	5.44		
	0.00	0.01	0.06	0.15	0.28	0.46	0.69	1.00	1.38	1.46	1.11	0.77	0.53	0.30	0.16	0.06	0.01	0.00	8.46		
	0.00	0.02	0.07	0.19	0.35	0.58	0.99	2.34	4.92	5.23	2.82	1.16	0.67	0.39	0.19	0.08	0.02	0.00	20.0		
	0.00	0.02	0.08	0.21	0.39	0.68	1.70	6.28	15.7	16.2	7.28	1.94	0.77	0.45	0.21	0.09	0.02	0.00	52.1		
	0.00	0.02	0.09	0.22	0.40	0.75	2.37	10.5	26.4	25.7	10.4	2.37	0.80	0.46	0.22	0.09	0.02	0.00	80.9		
	0.00	0.02	0.08	0.20	0.38	0.71	2.18	8.23	18.3	17.0	6.90	1.74	0.72	0.42	0.20	0.08	0.02	0.00	57.2		
	0.00	0.02	0.07	0.17	0.33	0.58	1.33	3.04	4.12	3.77	2.23	0.96	0.61	0.33	0.16	0.07	0.02	0.00	17.8		
	0.00	0.02	0.06	0.14	0.26	0.43	0.65	1.04	1.33	1.13	0.75	0.61	0.45	0.25	0.13	0.05	0.01	0.00	7.32		
	0.00	0.01	0.04	0.10	0.20	0.32	0.48	0.64	0.71	0.67	0.58	0.45	0.30	0.18	0.09	0.04	0.01	0.00	4.84		
	0.00	0.01	0.03	0.07	0.13	0.21	0.30	0.35	0.36	0.36	0.34	0.27	0.20	0.12	0.06	0.03	0.01	0.00	2.86		
	0.00	0.01	0.02	0.04	0.08	0.12	0.17	0.21	0.23	0.22	0.20	0.16	0.11	0.07	0.04	0.02	0.01	0.00	1.70		
	0.00	0.01	0.02	0.02	0.04	0.06	0.07	0.09	0.09	0.09	0.09	0.07	0.05	0.03	0.02	0.01	0.01	0.00	0.78		
	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.14		
-90 -80 -70 -60 -50 -40 -30 -20 HORIZONTAL (DEG) 20 30 40 50 60 70 80 90																					
F t	0.05	0.22	0.74	1.81	3.38	5.77	12.1	35.2	75.3	73.6	34.3	11.8	6.10	3.58	1.79	0.74	0.21	0.05	267	---	
F a	0.00	0.00	0.00	0.00	0.00	0.00	3.12	27.8	67.9	66.6	27.3	2.58	0.00	0.00	0.00	0.00	0.00	0.00	---	195	

one-half-peak spread: U:17.0,D:7.9 , L:11.6,R:12.1


NEMA Beam Type: Type 4

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V_(B) Range: -80 - 80DEG
V_(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.30V I:0.0646A P:6.3670W PF:0.4472 Freq:50.00Hz Lamp Flux:266.732x1 lm		
NAME: 6316	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

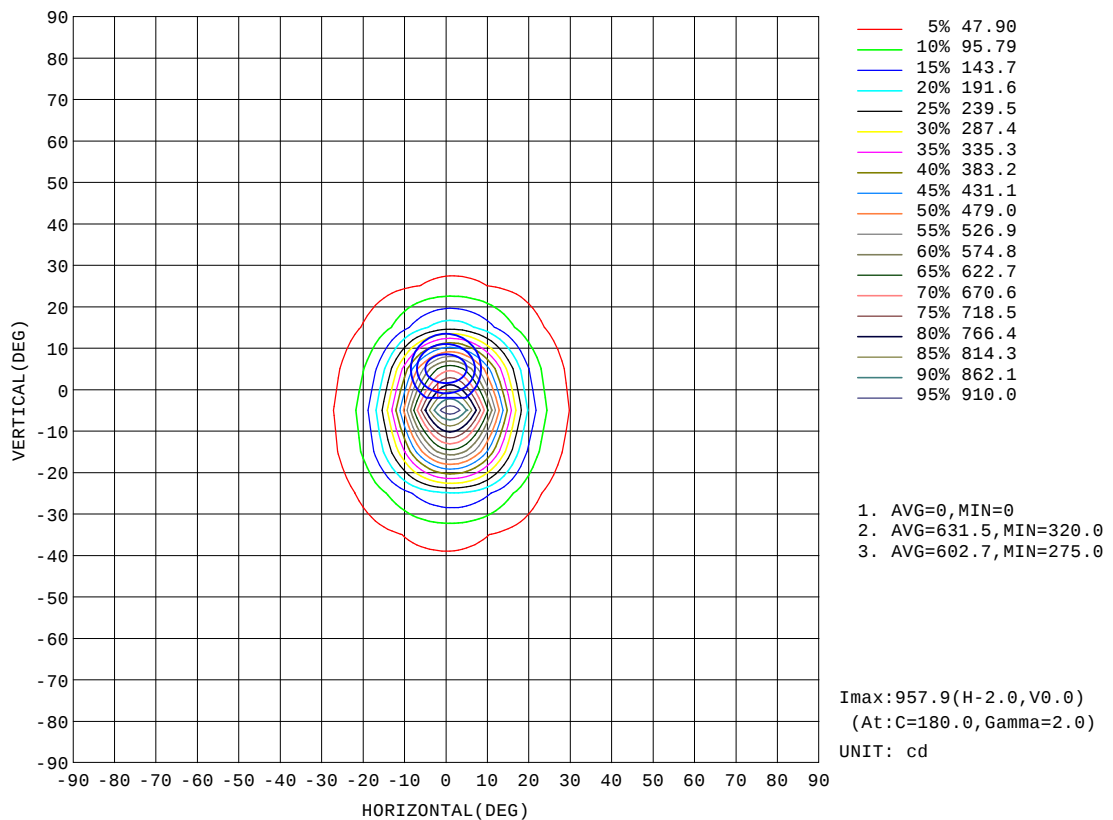


H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


Test:U:220.30V I:0.0646A P:6.3670W PF:0.4472 Freq:50.00Hz Lamp Flux:266.732x1 lm		
NAME: 6316	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

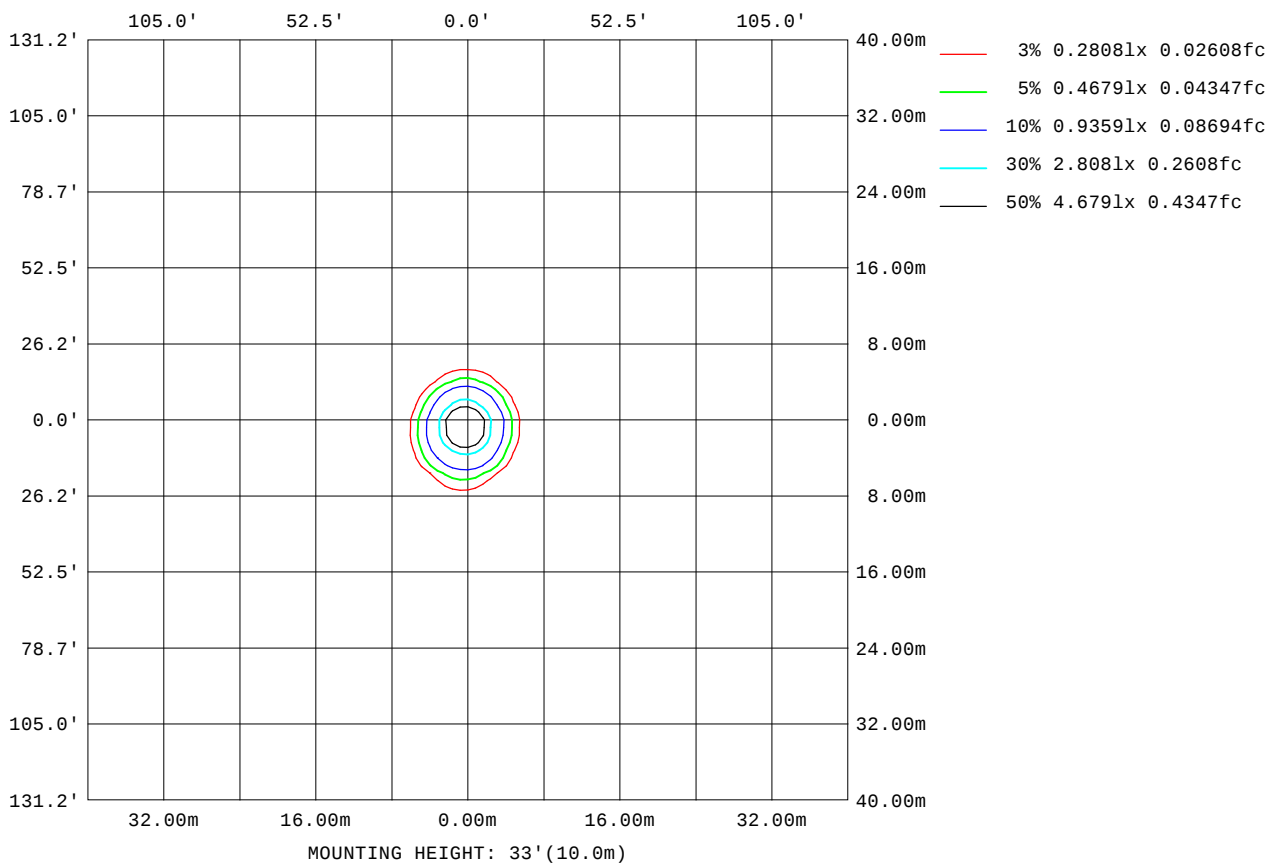

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: AED
Test Date: 2024-05-26

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

Planar Illuminance Curve

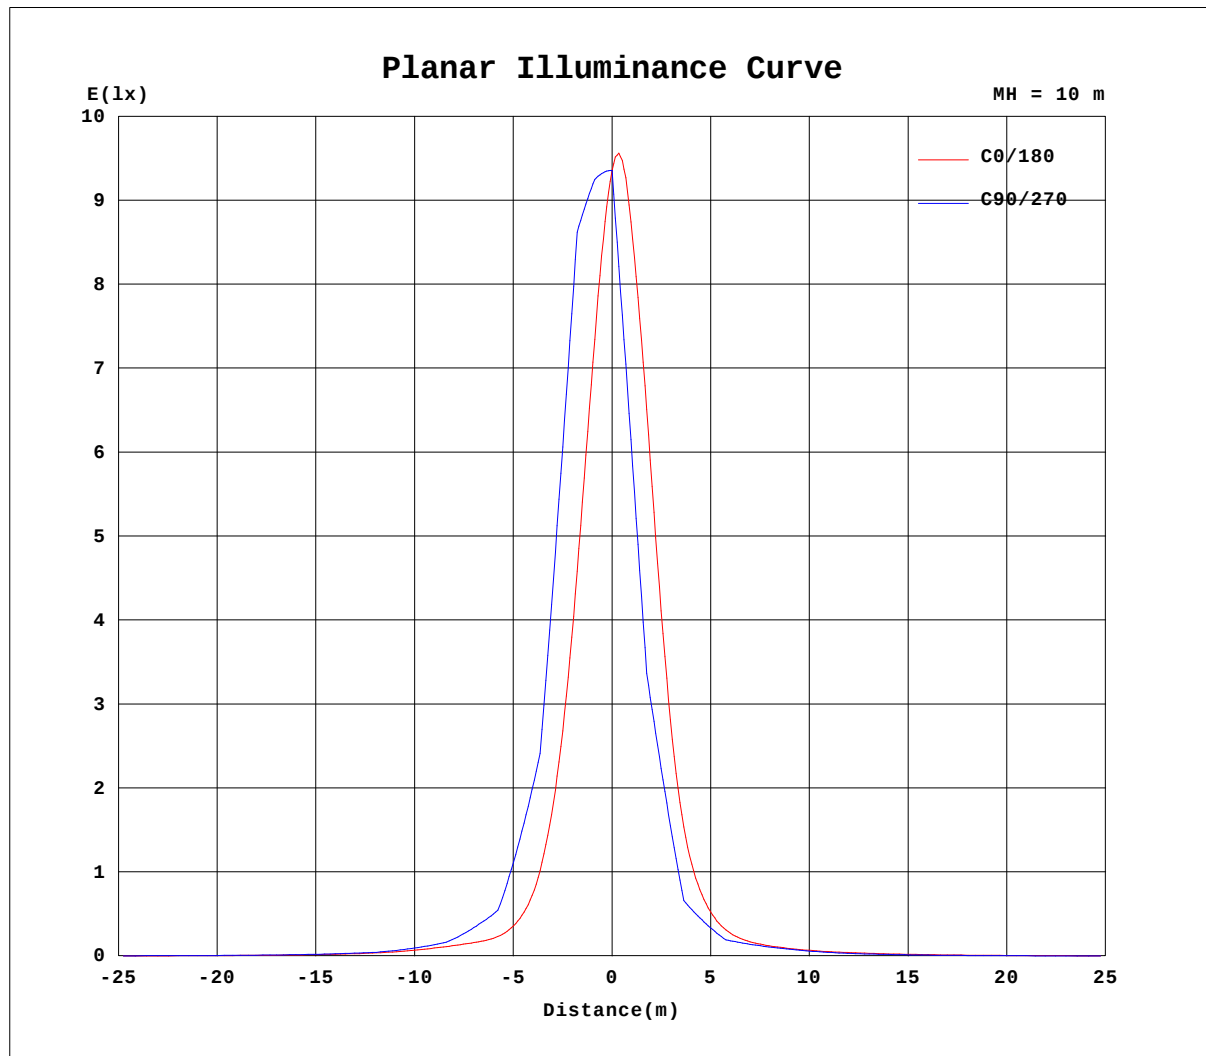


H_b Range: -90 - 90DEG
H_b Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: AED
Test Date: 2024-05-26

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.30V I:0.0646A P:6.3670W PF:0.4472 Freq:50.00Hz Lamp Flux:266.732x1 lm		
NAME: 6316	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Flux out:90.71 lm

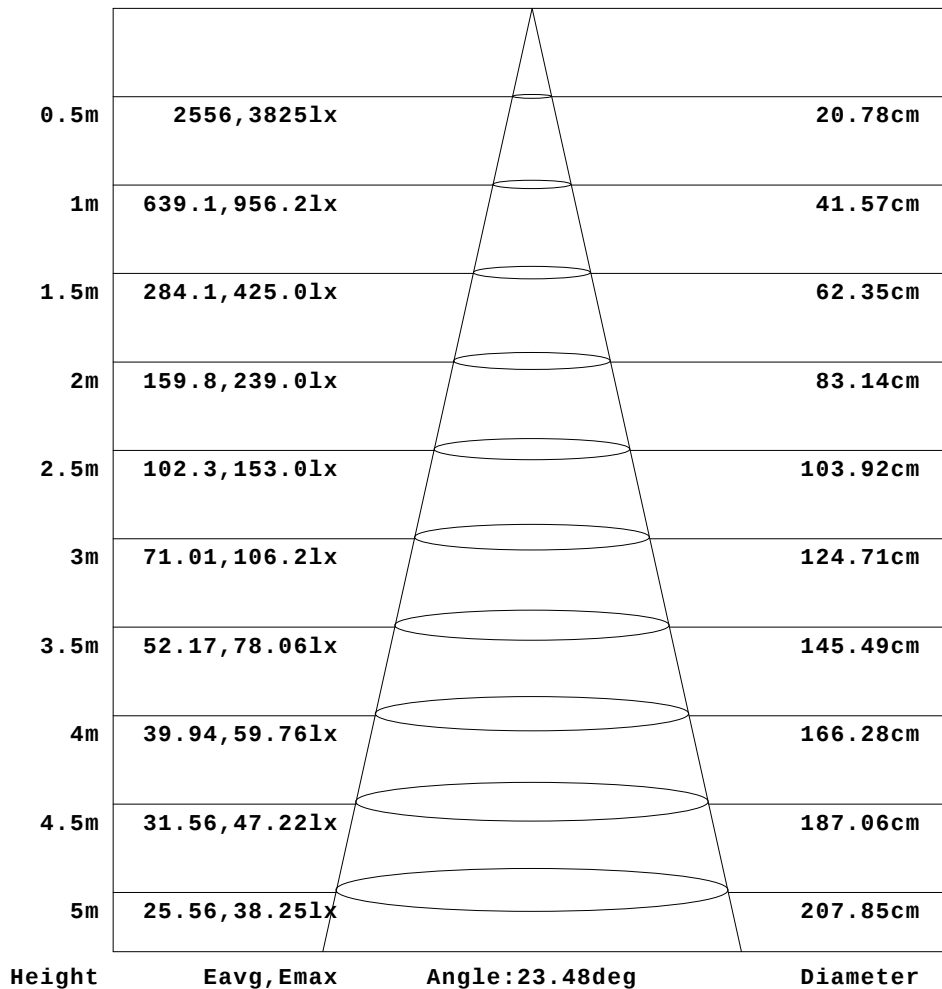

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.30V I:0.0646A P:6.3670W PF:0.4472 Freq:50.00Hz Lamp Flux:266.732x1 lm		
NAME: 6316	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--1

UNIT: cd

H(°) \ V(°)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.00	1.02	1.04	1.05	1.06	1.08	1.08	1.10	1.13	1.15	1.28	1.39	1.47	1.51	1.55	1.58	1.61	1.61	1.62
-75	1.03	1.03	1.06	1.07	1.09	1.13	1.27	1.38	1.55	1.76	1.98	2.23	2.52	2.77	2.97	3.10	3.21	3.29	3.34
-70	1.04	1.08	1.09	1.12	1.16	1.38	1.58	1.83	2.25	2.61	2.98	3.42	3.89	4.28	4.53	4.75	4.93	5.02	5.05
-65	1.04	1.06	1.09	1.11	1.23	1.41	1.81	2.20	2.77	3.43	4.01	4.61	5.30	5.94	6.55	7.01	7.33	7.58	7.69
-60	1.06	1.08	1.11	1.18	1.53	1.90	2.52	3.16	4.14	4.92	5.76	6.59	7.47	8.35	9.15	9.67	10.1	10.3	10.3
-55	1.05	1.06	1.09	1.15	1.46	1.96	2.62	3.56	4.54	5.65	6.82	8.12	9.36	10.5	11.5	12.3	13.0	13.5	13.7
-50	1.05	1.07	1.11	1.46	1.95	2.72	3.86	5.04	6.29	7.72	9.51	11.1	12.7	13.9	14.9	15.9	16.6	17.0	17.1
-45	1.06	1.08	1.11	1.31	1.81	2.64	3.80	5.18	6.64	8.51	10.4	12.2	14.1	16.4	18.7	21.6	24.4	26.3	27.2
-40	1.09	1.12	1.22	1.71	2.60	3.87	5.37	7.01	9.04	11.7	13.6	15.6	18.2	21.6	26.0	30.8	34.9	36.9	36.7
-35	1.09	1.11	1.16	1.60	2.31	3.55	5.31	7.05	9.09	11.6	13.7	16.1	19.2	23.0	28.9	38.2	49.3	58.3	61.8
-30	1.10	1.16	1.44	2.13	3.44	5.36	7.28	9.46	12.1	14.1	16.6	20.2	24.4	30.8	42.3	58.8	75.7	85.3	84.2
-25	1.12	1.14	1.22	1.83	2.84	4.53	6.64	8.89	11.6	14.1	16.8	20.6	26.2	36.6	57.9	91.1	130	166	187
-20	1.14	1.20	1.65	2.46	4.07	6.32	8.62	11.4	14.4	17.1	21.3	27.0	38.4	64.9	111	169	230	278	291
-15	1.12	1.16	1.25	1.93	3.17	5.20	7.79	10.4	13.5	16.0	19.6	24.6	33.3	54.8	103	194	335	502	604
-10	1.14	1.20	1.61	2.48	4.46	7.40	10.0	13.1	15.6	18.9	23.6	31.0	49.0	94.3	192	376	648	879	903
-5	1.12	1.17	1.26	1.97	3.27	5.42	8.40	11.2	14.2	17.0	21.0	26.2	36.0	62.0	122	253	491	767	936
0	1.16	1.23	1.63	2.49	4.47	7.38	10.0	13.1	16.0	19.5	24.1	31.1	48.0	90.5	185	396	681	905	936
5	1.13	1.16	1.26	1.94	3.14	5.23	8.15	10.8	13.8	16.7	20.6	25.2	32.7	51.1	93.8	185	355	541	654
10	1.14	1.20	1.52	2.34	4.22	6.84	9.41	12.2	15.1	18.3	22.4	26.9	35.2	55.3	94.6	165	264	342	353
15	1.12	1.14	1.22	1.81	2.76	4.65	7.30	9.75	12.4	15.1	18.3	22.1	26.5	34.2	50.5	80.2	130	186	218
20	1.12	1.17	1.37	2.12	3.57	5.53	8.11	10.4	12.9	15.5	18.7	22.3	25.6	30.0	38.1	50.7	65.3	77.1	79.7
25	1.08	1.11	1.17	1.56	2.27	3.78	5.81	8.11	10.2	12.5	15.0	17.8	20.9	24.2	28.2	34.1	42.1	49.8	54.7
30	1.08	1.11	1.19	1.84	2.66	4.24	6.30	8.29	10.3	12.3	14.5	17.0	20.1	22.8	24.8	26.8	28.5	29.5	29.9
35	1.03	1.07	1.11	1.27	1.87	2.75	4.17	6.00	7.86	9.64	11.5	13.4	15.5	17.9	19.8	21.6	23.4	24.8	25.6
40	1.04	1.06	1.11	1.46	1.97	2.89	4.20	5.88	7.62	9.15	10.7	12.2	13.8	15.3	17.0	18.7	20.2	21.2	21.6
45	1.05	1.04	1.07	1.12	1.46	1.97	2.78	3.90	5.36	6.70	8.15	9.53	10.7	12.0	13.1	14.3	15.4	16.3	16.9
50	1.01	1.04	1.07	1.13	1.58	1.98	2.59	3.66	4.71	5.99	7.31	8.31	9.20	9.98	10.7	11.3	11.8	12.1	12.3
55	1.08	1.05	1.07	1.10	1.19	1.47	1.84	2.47	3.12	3.86	4.90	5.85	6.62	7.30	7.92	8.50	8.96	9.33	9.52
60	1.08	1.07	1.11	1.12	1.17	1.33	1.78	2.08	2.38	2.96	3.71	4.32	4.87	5.38	5.85	6.27	6.57	6.76	6.82
65	1.07	1.08	1.09	1.11	1.14	1.17	1.35	1.55	1.69	1.90	2.34	2.83	3.22	3.55	3.87	4.14	4.35	4.49	4.58
70	1.09	1.10	1.11	1.13	1.14	1.16	1.18	1.20	1.23	1.32	1.59	1.81	1.98	2.10	2.21	2.26	2.31	2.34	2.37
75	1.09	1.09	1.09	1.10	1.11	1.12	1.13	1.14	1.16	1.18	1.26	1.40	1.51	1.58	1.64	1.68	1.71	1.73	1.75
80	1.07	1.08	1.08	1.09	1.10	1.09	1.11	1.11	1.11	1.12	1.12	1.12	1.13	1.12	1.13	1.13	1.14	1.14	1.13
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.30V I:0.0646A P:6.3670W PF:0.4472 Freq:50.00Hz Lamp Flux:266.732x1 lm																	
NAME: 6316									TYPE:						WEIGHT:280g		
SPEC.:7W									DIM.: 9*6*4cm						SERIAL No.:01		
MFR.: NORDECOR									SUR.:						Shielding Angle:24°		

Table--2

UNIT: cd

H(°) \ V(°)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.60	1.57	1.54	1.49	1.42	1.29	1.13	1.10	1.08	1.07	1.04	1.03	1.01	1.00	1.01	1.01	0.98	0.97
-75	3.32	3.25	3.18	3.04	2.86	2.62	2.26	1.99	1.76	1.52	1.37	1.25	1.07	1.04	1.02	1.02	1.02	0.99
-70	4.96	4.85	4.64	4.39	4.03	3.56	3.03	2.61	2.16	1.76	1.56	1.20	1.09	1.06	1.04	1.03	1.02	1.00
-65	7.62	7.42	7.13	6.69	6.19	5.59	4.93	4.26	3.66	3.03	2.39	1.93	1.44	1.24	1.05	1.04	1.03	1.02
-60	10.1	9.68	9.09	8.41	7.63	6.85	6.01	5.20	4.43	3.50	2.67	1.98	1.56	1.09	1.05	1.03	1.03	1.01
-55	13.6	13.3	12.6	11.7	10.7	9.64	8.45	7.27	6.17	5.10	4.01	3.08	2.20	1.61	1.18	1.03	1.02	1.01
-50	16.8	16.1	15.0	13.8	12.5	11.0	9.46	8.02	6.62	5.36	4.25	3.01	2.15	1.53	1.05	1.02	1.01	1.00
-45	26.4	24.4	21.9	19.4	17.3	15.1	13.0	10.9	8.97	7.32	5.83	4.49	3.21	2.15	1.46	1.04	1.02	1.00
-40	33.8	29.7	25.7	22.4	19.5	16.7	13.9	11.4	9.28	7.46	5.80	4.40	2.91	1.90	1.21	1.03	1.01	0.99
-35	58.2	49.0	38.4	30.4	25.5	22.2	19.1	15.6	12.4	9.87	7.85	6.13	4.53	2.94	1.82	1.11	1.05	1.03
-30	72.3	55.3	40.7	31.9	27.3	24.1	20.2	15.8	12.3	9.80	7.77	6.00	4.05	2.50	1.58	1.10	1.07	1.02
-25	182	151	107	65.8	40.9	30.3	25.4	21.1	16.5	12.6	9.79	7.65	5.75	3.73	2.19	1.25	1.09	1.07
-20	260	194	121	65.3	39.6	29.9	25.7	20.9	15.7	11.8	9.15	7.03	4.97	3.02	1.82	1.14	1.08	1.07
-15	566	429	265	135	68.3	40.1	29.7	25.4	20.6	15.5	11.7	9.02	6.79	4.39	2.43	1.38	1.17	1.14
-10	724	465	236	113	57.1	35.1	28.4	24.4	19.2	14.3	10.9	8.33	5.64	3.31	1.93	1.25	1.21	1.16
-5	863	631	373	184	87.5	46.6	31.7	27.4	22.9	17.3	12.9	9.87	7.42	4.75	2.51	1.42	1.21	1.18
0	743	480	256	123	60.2	36.0	29.3	25.2	19.8	14.6	11.1	8.46	5.79	3.42	1.94	1.22	1.18	1.19
5	604	448	274	145	72.8	41.6	30.8	26.9	22.2	16.6	12.5	9.62	7.21	4.62	2.45	1.35	1.17	1.14
10	291	203	122	68.3	41.3	31.1	27.4	23.2	17.7	13.3	10.3	7.95	5.32	3.03	1.80	1.17	1.13	1.06
15	205	162	110	67.9	43.3	32.2	27.5	23.8	19.0	14.4	11.2	8.74	6.39	4.09	2.24	1.21	1.10	1.08
20	71.5	57.4	43.6	33.9	29.7	26.7	23.3	18.7	14.5	11.4	9.01	6.87	4.54	2.47	1.48	1.08	1.05	1.06
25	53.7	47.8	40.0	33.0	28.2	25.5	22.2	18.6	14.7	11.7	9.38	7.35	5.16	3.19	1.93	1.10	1.04	1.02
30	29.7	29.0	27.6	25.7	23.4	20.4	16.8	13.7	11.1	9.12	7.35	5.21	3.40	2.05	1.14	1.03	1.00	1.01
35	25.7	25.2	24.2	22.5	20.6	18.5	15.8	13.2	11.0	9.07	7.33	5.55	3.76	2.31	1.48	1.02	0.98	0.98
40	21.3	20.3	18.9	17.2	15.5	13.4	11.6	9.93	8.43	6.96	5.20	3.72	2.22	1.62	1.00	0.95	0.95	0.97
45	16.9	16.5	15.7	14.5	13.3	12.0	10.6	9.19	7.81	6.48	5.12	3.61	2.55	1.71	1.11	0.99	0.97	0.97
50	12.1	11.8	11.1	10.4	9.61	8.79	7.94	6.81	5.54	4.42	3.19	2.21	1.75	1.07	1.01	0.98	0.97	1.00
55	9.54	9.33	8.97	8.45	7.86	7.18	6.52	5.74	4.71	3.78	3.07	2.20	1.62	1.25	1.04	1.02	1.00	0.99
60	6.74	6.52	6.20	5.79	5.28	4.80	4.24	3.50	2.66	2.29	1.95	1.33	1.11	1.07	1.04	1.03	1.02	1.05
65	4.59	4.51	4.36	4.15	3.87	3.53	3.17	2.70	2.19	1.83	1.66	1.44	1.15	1.09	1.06	1.05	1.04	1.03
70	2.36	2.34	2.29	2.18	2.04	1.86	1.55	1.29	1.19	1.16	1.14	1.12	1.10	1.08	1.07	1.06	1.06	1.08
75	1.75	1.74	1.72	1.68	1.63	1.54	1.44	1.27	1.18	1.14	1.13	1.11	1.10	1.09	1.08	1.07	1.07	1.07
80	1.14	1.12	1.13	1.12	1.12	1.12	1.11	1.11	1.11	1.10	1.11	1.09	1.09	1.09	1.09	1.09	1.09	1.07
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_(b) Range: -90 - 90DEGH_(b) Interval: 1.0DEG

Test Speed: HIGH

Temperature:25.3DEG

Operators:AED

Test Date:2024-05-26

V(B) Range: -80 - 80DEG

V(B) Interval: 5.0DEG

Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411

Humidity:65.0%

Test Distance:5.780m [K=1.0000]

Remarks: