

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		3996.9 cd per klm. 0.0 degrees vertical -5.0 degrees horizontal
Beam Spread	At 10% of Imax	47.5V x 44.7H
	At 50% of Imax	25.4V x 24.5H
	At 90% of Imax	8.9V x 8.9H
Beam Flux	Total	998.0 lumens per klm.
	To 10% of Imax	729.4 lumens per klm.
	To 50% of Imax	374.5 lumens per klm.
	To 90% of Imax	34.4 lumens per klm.
Upward LOR		0.0 %
Downward LOR		99.8 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.31V I:0.0647A P:6.3902W PF:0.4480 Freq:50.00Hz Lamp Flux:271.818x1 lm		
NAME: 6317	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

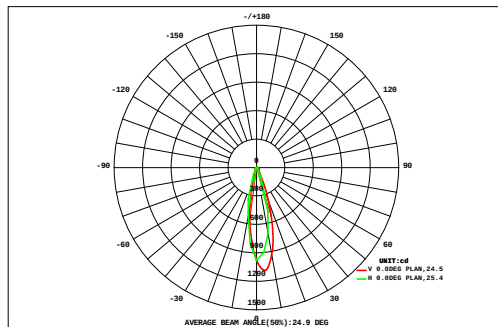

DATA OF LAMP		Eff:42.54lm/W	
MODEL		Imax(cd)	1086
NOMINAL POWER(W)		AVAILABILITY(%)	73.8
RATED VOLTAGE(V)		Avai. FLUX(lm)	200.5
NOMINAL FLUX(lm)	271.818	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	271.8
TEST VOLTAGE(V)	0	q @50%(H,V)	24,25DEG

AREA FLUX DIAGRAM																	UNIT:lm	F t	F a
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80	0.00	0.01	0.02	0.03	0.04	0.06	0.07	0.08	0.08	0.07	0.05	0.04	0.03	0.02	0.02	0.01	0.00	0.72	0.00
70	0.00	0.01	0.02	0.05	0.08	0.12	0.15	0.17	0.18	0.17	0.14	0.11	0.08	0.04	0.02	0.01	0.01	1.38	0.00
60	0.00	0.01	0.03	0.08	0.14	0.20	0.26	0.30	0.32	0.31	0.27	0.21	0.15	0.09	0.04	0.02	0.01	2.44	0.00
50	0.00	0.01	0.05	0.11	0.19	0.29	0.40	0.50	0.55	0.53	0.45	0.33	0.23	0.14	0.07	0.02	0.01	3.90	0.00
40	0.00	0.02	0.07	0.15	0.26	0.42	0.61	0.78	0.88	0.86	0.72	0.53	0.33	0.19	0.10	0.03	0.01	5.96	0.00
30	0.00	0.02	0.08	0.18	0.34	0.57	0.85	1.44	2.09	1.79	1.08	0.73	0.47	0.24	0.12	0.04	0.01	10.1	0.79
20	0.00	0.03	0.10	0.22	0.41	0.67	1.57	5.20	9.14	6.93	2.44	0.89	0.58	0.31	0.15	0.05	0.01	28.7	21.2
10	0.00	0.03	0.11	0.24	0.44	0.81	3.26	13.5	23.9	17.7	5.37	1.16	0.62	0.34	0.16	0.06	0.01	67.8	62.0
0	0.00	0.03	0.11	0.24	0.43	0.88	4.22	16.7	29.5	21.9	6.27	1.24	0.61	0.35	0.16	0.06	0.01	82.7	77.2
-10	0.00	0.03	0.09	0.21	0.38	0.75	2.88	8.99	14.8	10.7	3.20	0.95	0.57	0.31	0.14	0.05	0.01	44.0	37.9
-20	0.00	0.02	0.07	0.17	0.31	0.59	1.44	2.09	2.13	1.80	1.16	0.70	0.46	0.23	0.11	0.04	0.01	11.3	1.44
-30	0.00	0.02	0.06	0.13	0.24	0.38	0.52	0.70	0.75	0.63	0.58	0.52	0.31	0.17	0.09	0.03	0.01	5.15	0.00
-40	0.00	0.01	0.04	0.09	0.17	0.27	0.38	0.46	0.51	0.52	0.46	0.32	0.20	0.12	0.06	0.02	0.01	3.65	0.00
-50	0.00	0.01	0.03	0.07	0.11	0.18	0.24	0.29	0.31	0.30	0.25	0.18	0.13	0.08	0.04	0.02	0.01	2.24	0.00
-60	0.00	0.01	0.02	0.04	0.07	0.10	0.12	0.14	0.15	0.14	0.12	0.10	0.07	0.04	0.02	0.01	0.01	1.16	0.00
-70	0.00	0.01	0.01	0.02	0.03	0.04	0.05	0.06	0.06	0.05	0.05	0.04	0.03	0.02	0.02	0.01	0.01	0.52	0.00
-80	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.14	0.00
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-90 -80 -70 -60 -50 -40 -30 -20 HORIZONTAL(DEG) 20 30 40 50 60 70 80 90																			
F t	0.05	0.28	0.92	2.04	3.67	6.33	17.0	51.5	85.3	64.4	22.6	8.07	4.87	2.70	1.32	0.51	0.16	0.05	272
F a	0.00	0.00	0.00	0.00	0.00	0.00	7.48	43.9	78.5	56.9	13.7	0.00	0.00	0.00	0.00	0.00	0.00	0.00	201


one-half-peak spread: U:14.6,D:11.0 , L:12.0, ~~NEVA~~ Beam Type: Type 3 x 4 (H x V)

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V_(B) Range: -80 - 80DEG
V_(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.31V I:0.0647A P:6.3902W PF:0.4480 Freq:50.00Hz Lamp Flux:271.818x1 lm		
NAME: 6317	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

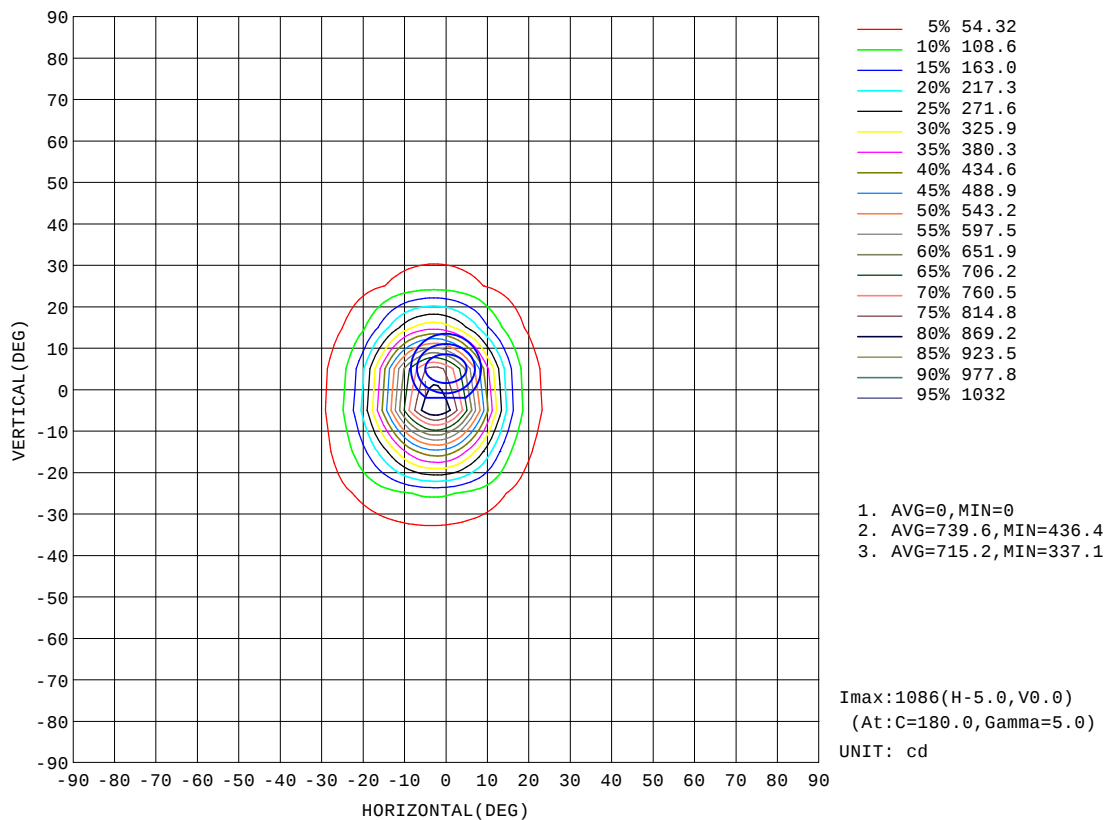


H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


Test:U:220.31V I:0.0647A P:6.3902W PF:0.4480 Freq:50.00Hz Lamp Flux:271.818x1 lm		
NAME: 6317	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

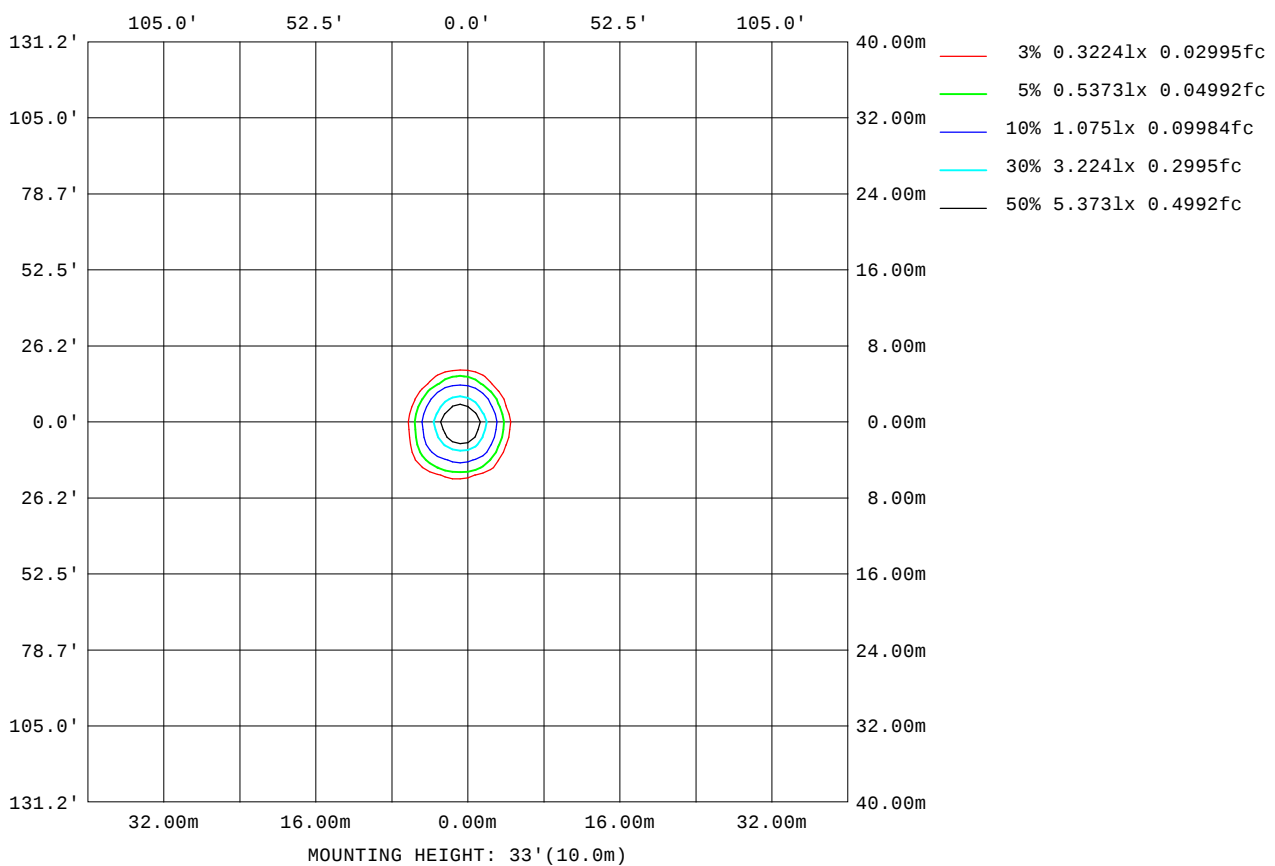

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: AED
Test Date: 2024-05-26

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

Planar Illuminance Curve

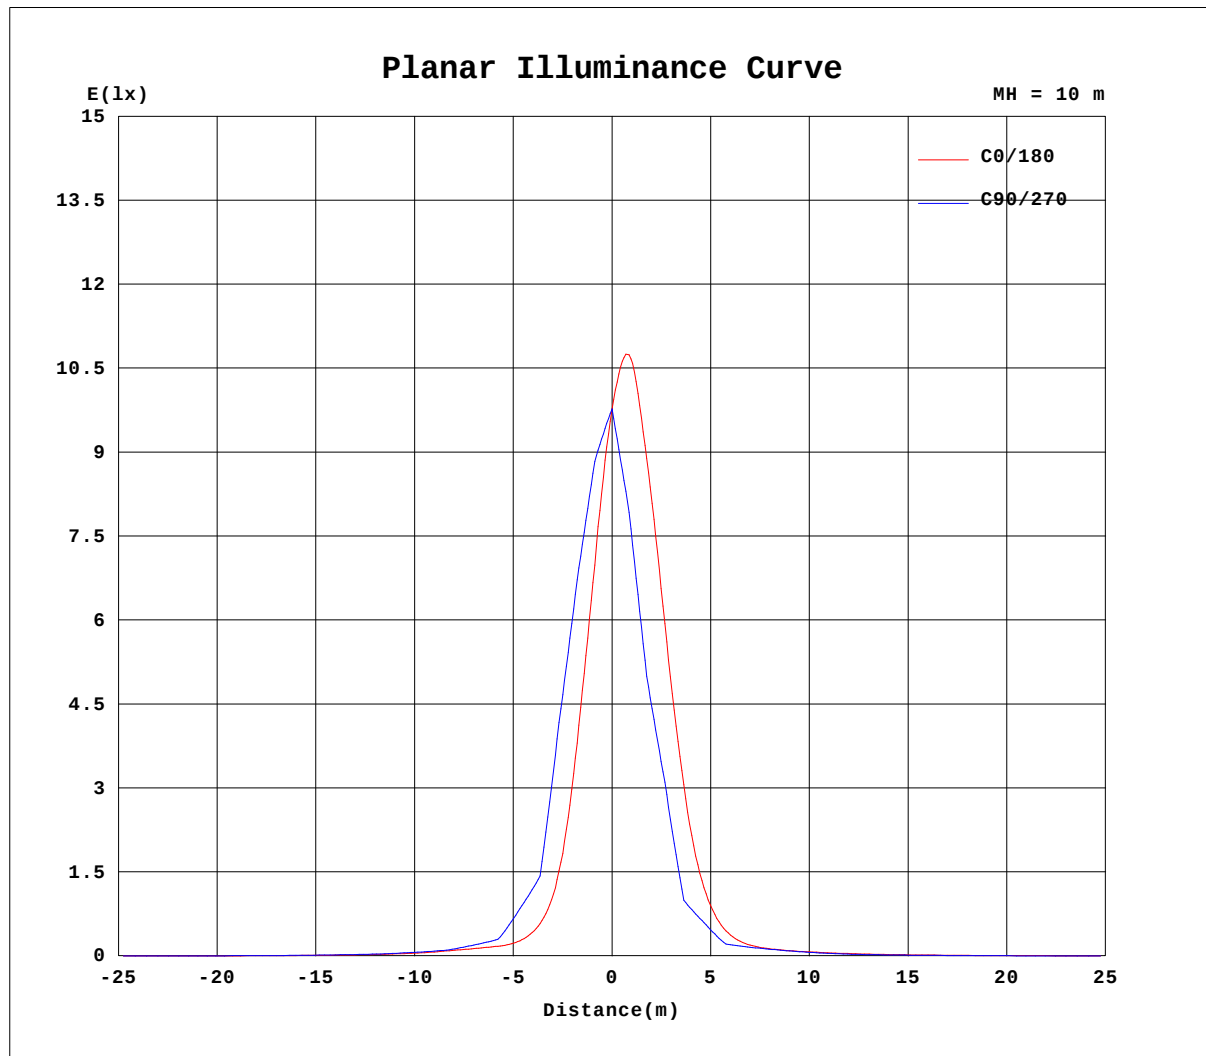


H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: AED
Test Date: 2024-05-26

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.31V I:0.0647A P:6.3902W PF:0.4480 Freq:50.00Hz Lamp Flux:271.818x1 lm		
NAME: 6317	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Flux out:103.2 lm

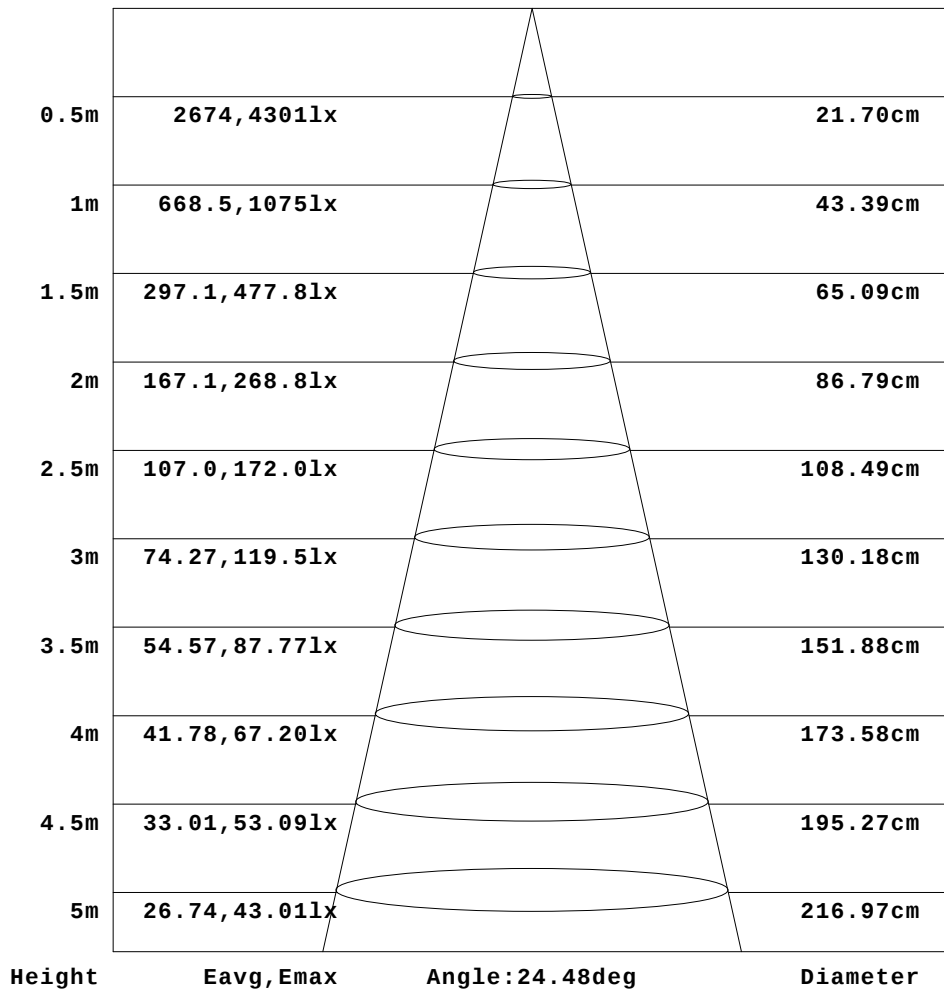

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.31V I:0.0647A P:6.3902W PF:0.4480 Freq:50.00Hz Lamp Flux:271.818x1 lm		
NAME: 6317	TYPE:	WEIGHT:280g
SPEC.:7W	DIM.: 9*6*4cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--1

UNIT: cd

H(°) \ V(°)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.98	1.01	1.02	1.02	1.04	1.03	1.06	1.07	1.08	1.07	1.10	1.11	1.14	1.20	1.23	1.24	1.24	1.19	1.15
-75	1.02	1.03	1.05	1.07	1.08	1.12	1.26	1.34	1.46	1.59	1.71	1.81	1.89	2.01	2.09	2.15	2.18	2.18	2.12
-70	1.05	1.08	1.08	1.11	1.14	1.33	1.53	1.71	1.97	2.20	2.41	2.57	2.74	2.90	3.03	3.10	3.15	3.11	3.06
-65	1.04	1.06	1.09	1.13	1.30	1.46	1.90	2.23	2.59	3.08	3.47	3.81	4.20	4.51	4.80	4.95	5.15	5.20	5.15
-60	1.06	1.09	1.12	1.21	1.54	1.95	2.44	2.95	3.63	4.29	4.81	5.39	5.91	6.39	6.76	7.05	7.20	7.28	7.19
-55	1.00	1.06	1.10	1.24	1.63	2.12	2.83	3.56	4.29	5.16	6.02	6.85	7.70	8.53	9.25	9.81	10.4	10.7	10.7
-50	1.03	1.04	1.10	1.51	2.11	2.75	3.76	4.66	5.67	6.72	7.85	9.04	10.1	11.3	12.2	13.1	13.8	14.2	14.1
-45	1.02	1.06	1.10	1.46	2.11	2.97	3.99	5.11	6.35	7.69	9.13	10.5	11.9	13.7	15.4	16.8	18.1	18.8	19.0
-40	1.04	1.11	1.30	1.86	2.76	4.00	5.15	6.51	8.10	9.81	11.5	13.2	15.0	17.4	19.7	21.7	23.1	23.8	23.6
-35	1.09	1.09	1.16	1.77	2.75	3.99	5.39	6.96	8.77	10.6	12.5	14.8	17.5	21.1	25.9	31.0	35.3	37.1	36.1
-30	1.10	1.14	1.47	2.41	3.67	5.15	6.83	8.76	11.0	12.9	15.2	18.6	22.5	28.3	36.2	44.4	49.8	50.2	46.0
-25	1.10	1.14	1.32	2.15	3.44	5.03	6.86	8.97	11.3	13.5	16.3	20.2	28.6	45.0	65.0	85.4	104	116	114
-20	1.15	1.16	1.73	2.89	4.53	6.32	8.47	11.1	13.3	16.1	20.0	27.0	46.1	77.0	110	142	169	182	173
-15	1.13	1.16	1.49	2.59	4.30	6.45	8.70	11.3	13.8	16.6	20.2	25.6	40.3	79.8	149	251	373	459	463
-10	1.14	1.23	2.06	3.74	5.87	8.30	10.9	13.7	16.2	19.8	23.9	32.3	58.6	130	262	454	664	759	704
-5	1.14	1.18	1.58	2.85	4.90	7.49	9.95	12.9	15.5	19.1	22.8	29.1	47.8	106	235	454	711	894	894
0	1.18	1.25	2.13	3.86	6.18	8.56	11.2	14.3	17.4	21.4	25.6	35.7	69.6	164	369	659	930	1086	978
5	1.14	1.19	1.56	2.83	4.98	7.51	9.94	12.9	15.8	19.6	23.3	28.8	45.3	94.9	209	420	658	814	802
10	1.15	1.23	2.07	3.80	6.01	8.32	10.8	13.8	16.9	21.0	24.5	30.7	49.1	98.0	205	379	533	585	523
15	1.13	1.18	1.43	2.63	4.67	7.03	9.23	11.9	14.7	18.1	21.9	25.6	33.3	54.0	99.4	190	294	353	345
20	1.15	1.21	1.93	3.34	5.23	7.41	9.54	12.1	14.9	18.4	22.1	25.0	29.5	40.0	60.5	89.2	118	132	120
25	1.11	1.14	1.28	2.32	4.08	6.06	7.97	10.0	12.5	15.2	18.5	21.8	25.2	30.0	39.4	53.3	69.4	81.1	80.5
30	1.10	1.15	1.63	2.56	4.32	6.29	7.98	9.87	12.1	14.6	17.6	21.2	23.9	26.0	28.4	30.6	32.5	33.4	32.7
35	1.09	1.09	1.15	1.97	3.23	4.78	6.47	8.07	9.82	11.8	14.1	16.8	19.4	21.6	24.0	26.1	27.8	28.9	28.9
40	1.06	1.04	1.15	2.01	3.37	4.65	6.29	7.74	9.12	10.8	12.6	14.7	16.6	19.1	21.4	23.2	24.2	24.7	24.6
45	1.02	1.06	1.05	1.52	2.35	3.57	4.92	6.19	7.47	8.77	10.2	11.6	13.1	14.6	16.3	17.7	18.6	19.1	19.0
50	1.01	1.03	1.07	1.57	2.27	3.45	4.50	5.83	6.85	7.88	8.88	9.75	10.7	11.5	12.5	13.1	13.5	13.5	13.2
55	1.03	1.06	1.07	1.20	1.74	2.56	3.42	4.41	5.33	6.18	7.10	7.92	8.62	9.28	9.87	10.4	10.7	10.8	10.7
60	1.08	1.10	1.12	1.17	1.76	2.24	3.04	3.79	4.48	5.22	6.00	6.62	7.09	7.47	7.77	8.02	8.12	8.10	7.98
65	1.10	1.10	1.12	1.16	1.33	1.65	2.12	2.75	3.25	3.72	4.26	4.79	5.21	5.56	5.80	6.01	6.10	6.12	6.03
70	1.12	1.12	1.14	1.15	1.19	1.29	1.79	2.12	2.37	2.65	2.97	3.34	3.64	3.86	4.00	4.11	4.13	4.10	3.99
75	1.13	1.13	1.13	1.15	1.16	1.18	1.37	1.59	1.73	1.87	2.01	2.19	2.36	2.50	2.59	2.64	2.66	2.66	2.61
80	1.11	1.12	1.14	1.13	1.15	1.16	1.15	1.16	1.18	1.20	1.20	1.20	1.20	1.23	1.23	1.22	1.20	1.21	1.19
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.31V I:0.0647A P:6.3902W PF:0.4480 Freq:50.00Hz Lamp Flux:271.818x1 lm																	
NAME: 6317									TYPE:						WEIGHT:280g		
SPEC.:7W									DIM.: 9*6*4cm						SERIAL No.:01		
MFR.: NORDECOR									SUR.:						Shielding Angle:24°		

Table--2

UNIT: cd

H(°) \ V(°)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.09	1.08	1.07	1.06	1.05	1.03	1.02	1.01	1.00	0.99	0.98	0.97	0.98	0.97	0.97	0.97	0.95	0.94
-75	2.05	1.96	1.85	1.75	1.64	1.52	1.39	1.29	1.21	1.11	1.03	1.01	1.01	0.99	0.99	1.00	0.99	0.96
-70	2.93	2.75	2.58	2.37	2.14	1.89	1.66	1.50	1.36	1.11	1.07	1.04	1.04	1.03	1.02	1.02	1.00	0.96
-65	5.00	4.72	4.49	4.14	3.76	3.34	2.90	2.40	2.02	1.70	1.39	1.25	1.08	1.04	1.02	1.02	1.02	1.01
-60	6.93	6.63	6.13	5.63	5.03	4.45	3.72	2.93	2.43	1.98	1.59	1.36	1.08	1.06	1.04	1.03	1.02	1.02
-55	10.4	9.84	9.14	8.12	7.20	6.31	5.44	4.51	3.68	2.95	2.20	1.75	1.30	1.11	1.04	1.03	1.02	1.01
-50	13.6	12.6	11.3	9.89	8.62	7.51	6.38	5.37	4.34	3.29	2.40	1.78	1.39	1.06	1.02	1.01	1.00	1.02
-45	18.6	17.6	16.2	14.2	12.2	10.4	8.70	7.12	5.87	4.71	3.53	2.50	1.79	1.30	1.04	1.01	1.00	0.99
-40	22.8	21.6	19.7	16.9	14.4	11.9	9.54	7.85	6.48	5.17	3.85	2.55	1.75	1.32	1.02	0.99	0.99	0.99
-35	32.4	28.2	24.9	22.3	19.3	16.6	13.3	10.4	8.24	6.60	5.14	3.67	2.41	1.62	1.14	1.02	1.02	1.00
-30	38.7	32.0	28.1	25.4	22.2	18.7	14.4	11.1	8.64	6.87	5.31	3.74	2.33	1.55	1.09	1.04	1.01	1.00
-25	98.3	76.0	52.5	35.0	26.5	23.2	18.9	14.9	11.2	8.51	6.66	4.95	3.19	2.02	1.33	1.06	1.03	1.00
-20	141	100	60.9	36.2	27.6	24.2	20.6	15.4	11.4	8.55	6.64	4.81	2.93	1.79	1.11	0.98	1.03	1.05
-15	374	243	120	59.9	35.0	26.8	23.1	19.2	14.4	10.8	8.32	6.33	4.16	2.51	1.58	1.14	1.09	1.05
-10	507	273	118	58.4	33.4	26.2	23.2	19.1	14.5	10.8	8.37	6.23	3.88	2.20	1.29	1.19	1.15	1.12
-5	711	445	205	86.4	43.4	28.4	25.0	21.7	16.5	12.4	9.42	7.24	4.77	2.85	1.77	1.22	1.17	1.13
0	706	399	169	70.1	36.8	27.2	24.5	20.4	15.2	11.3	8.65	6.47	4.03	2.26	1.31	1.20	1.17	1.12
5	633	391	188	79.9	41.1	28.2	25.3	21.8	16.3	12.2	9.31	7.16	4.73	2.80	1.74	1.22	1.18	1.13
10	377	202	97.2	49.1	30.8	26.4	23.6	18.9	14.1	10.5	8.22	6.09	3.80	2.17	1.25	1.17	1.14	1.11
15	270	167	89.8	48.3	32.0	26.5	23.9	19.4	14.5	10.9	8.54	6.59	4.30	2.48	1.53	1.15	1.12	1.08
20	91.1	61.1	40.5	30.4	27.1	24.6	20.8	15.7	11.8	9.20	7.33	5.27	3.34	1.96	1.15	1.08	1.05	1.04
25	67.7	51.1	38.0	29.9	26.4	23.4	19.6	15.1	11.6	9.12	7.33	5.46	3.55	2.10	1.24	1.07	1.02	1.00
30	31.0	29.5	27.9	25.8	23.7	19.1	14.8	11.5	9.26	7.59	5.97	3.99	2.43	1.65	1.09	0.99	0.98	1.01
35	28.1	26.7	24.9	22.4	20.1	17.0	13.5	11.0	8.92	7.33	5.71	4.05	2.59	1.70	1.07	1.01	0.97	0.96
40	24.0	22.6	20.0	17.1	14.3	12.1	10.0	8.61	7.25	5.88	4.21	2.87	1.86	1.07	0.98	0.98	0.95	0.94
45	18.6	17.7	16.2	14.3	12.5	10.8	9.17	7.91	6.66	5.35	3.98	2.72	1.84	1.24	0.99	0.95	0.96	0.96
50	12.6	11.9	10.9	10.0	9.04	8.21	7.22	6.27	5.02	3.83	2.66	1.88	1.20	1.01	1.00	0.96	0.96	0.89
55	10.4	9.86	9.22	8.56	7.80	7.01	6.14	5.26	4.30	3.27	2.52	1.65	1.33	1.03	0.99	0.98	0.98	0.97
60	7.75	7.42	7.02	6.54	5.92	5.14	4.35	3.60	2.68	2.13	1.71	1.12	1.06	1.03	1.03	1.02	1.00	1.03
65	5.87	5.60	5.22	4.78	4.36	3.91	3.37	2.80	2.17	1.72	1.51	1.19	1.08	1.06	1.05	1.04	1.03	1.02
70	3.81	3.51	3.10	2.69	2.46	2.23	1.95	1.49	1.20	1.15	1.13	1.09	1.10	1.07	1.08	1.07	1.06	1.06
75	2.54	2.41	2.22	2.00	1.85	1.75	1.61	1.42	1.19	1.14	1.13	1.12	1.10	1.10	1.09	1.08	1.07	1.06
80	1.19	1.19	1.18	1.17	1.15	1.14	1.13	1.12	1.11	1.12	1.11	1.12	1.11	1.11	1.10	1.09	1.11	1.08
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-26

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks: