

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		2244.8 cd per klm. 10.0 degrees vertical 2.0 degrees horizontal
Beam Spread	At 10% of Imax	65.1V x 63.4H
	At 50% of Imax	36.9V x 35.3H
	At 90% of Imax	16.0V x 15.1H
Beam Flux	Total	999.1 lumens per klm.
	To 10% of Imax	883.0 lumens per klm.
	To 50% of Imax	503.1 lumens per klm.
	To 90% of Imax	121.0 lumens per klm.
	Upward LOR	0.0 %
	Downward LOR	99.9 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H( $\beta$ ) Range:-90 - 90DEG  
H( $\beta$ ) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:NORDECOR  
Test Date:2024-11-10

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.25V I:0.0443A P:4.5409W PF:0.4657 Freq:50.00Hz Lamp Flux:241.24lx1 lm		
NAME: 6854	TYPE:	WEIGHT:130g
SPEC.:4W	DIM.: 5.5*3.6*7.1cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:35°

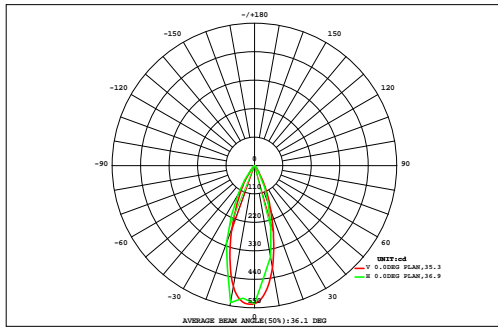

DATA OF LAMP		Eff:53.13lm/W	
MODEL		Imax(cd)	541.5
NOMINAL POWER(W)		AVAILABILITY(%)	89.6
RATED VOLTAGE(V)		Avai. FLUX(lm)	216.1
NOMINAL FLUX(lm)	241.241	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	241.2
TEST VOLTAGE(V)	0	q @50%(H,V)	35,37DEG

AREA FLUX DIAGRAM																		UNIT:lm		F t	F a	
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80	0.00	0.01	0.02	0.02	0.03	0.04	0.05	0.05	0.06	0.06	0.06	0.05	0.04	0.03	0.02	0.01	0.01	0.00	0.54	0.00	0.00	0.00
70	0.00	0.01	0.01	0.02	0.03	0.05	0.06	0.07	0.07	0.08	0.07	0.06	0.04	0.03	0.02	0.01	0.01	0.00	0.64	0.00	0.00	0.00
60	0.00	0.01	0.01	0.02	0.04	0.06	0.08	0.09	0.10	0.10	0.10	0.08	0.06	0.04	0.02	0.01	0.01	0.00	0.84	0.00	0.00	0.00
50	0.00	0.01	0.02	0.03	0.05	0.07	0.10	0.17	0.25	0.29	0.26	0.17	0.09	0.05	0.03	0.01	0.01	0.00	1.62	0.00	0.00	0.00
40	0.00	0.01	0.02	0.04	0.07	0.10	0.24	0.70	1.48	1.83	1.45	0.67	0.22	0.07	0.03	0.02	0.01	0.00	6.95	3.90	0.00	0.00
30	0.00	0.01	0.02	0.05	0.08	0.20	0.77	2.63	5.24	6.33	4.77	2.15	0.59	0.11	0.04	0.02	0.01	0.00	23.0	20.7	0.00	0.00
	0.00	0.01	0.03	0.06	0.10	0.38	1.81	5.79	10.7	12.7	9.41	4.29	1.14	0.18	0.05	0.02	0.01	0.00	46.7	44.8	0.00	0.00
	0.00	0.01	0.03	0.06	0.12	0.53	2.64	7.75	14.5	16.8	12.2	5.35	1.50	0.22	0.06	0.02	0.01	0.00	61.7	60.0	0.00	0.00
	0.00	0.01	0.03	0.06	0.12	0.51	2.38	6.84	12.3	13.9	10.2	4.67	1.32	0.21	0.06	0.02	0.01	0.00	52.7	51.0	0.00	0.00
	0.00	0.01	0.03	0.06	0.10	0.34	1.39	3.94	6.83	7.75	5.68	2.70	0.75	0.14	0.05	0.02	0.01	0.00	29.8	27.8	0.00	0.00
	0.00	0.01	0.02	0.05	0.08	0.17	0.51	1.42	2.40	2.68	2.05	1.00	0.33	0.08	0.04	0.02	0.01	0.00	10.9	7.77	0.00	0.00
-30	0.00	0.01	0.02	0.04	0.07	0.09	0.19	0.30	0.44	0.52	0.45	0.27	0.12	0.06	0.03	0.01	0.01	0.00	2.64	0.00	0.00	0.00
-40	0.00	0.01	0.02	0.03	0.06	0.08	0.09	0.10	0.15	0.17	0.15	0.09	0.07	0.05	0.03	0.01	0.01	0.00	1.10	0.00	0.00	0.00
-50	0.00	0.01	0.01	0.03	0.04	0.06	0.08	0.10	0.10	0.09	0.09	0.09	0.07	0.04	0.02	0.01	0.01	0.00	0.85	0.00	0.00	0.00
-60	0.00	0.01	0.01	0.02	0.03	0.05	0.06	0.07	0.08	0.08	0.08	0.06	0.04	0.03	0.02	0.01	0.01	0.00	0.67	0.00	0.00	0.00
-70	0.00	0.01	0.01	0.02	0.02	0.03	0.04	0.04	0.05	0.05	0.05	0.04	0.03	0.02	0.02	0.01	0.01	0.00	0.43	0.00	0.00	0.00
-80	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.15	0.00	0.00	0.00
-90	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.15	0.00	0.00	0.00
	-90	-80	-70	-60	-50	-40	-30	-20	HORIZONTAL( DEG)	20	30	40	50	60	70	80	90					
F t	0.04	0.14	0.31	0.62	1.03	2.77	10.5	30.1	54.8	63.4	47.1	21.8	6.41	1.37	0.54	0.26	0.12	0.04	241	---		
F a	0.00	0.00	0.00	0.00	0.00	0.08	6.92	27.7	52.7	61.5	45.3	18.9	2.99	0.00	0.00	0.00	0.00	0.00	---	216		


one-half-peak spread: U:24.6,D:12.6 , L:18.0,R:17.6 NEMA Beam Type: Type 4

H(h) Range:-90 - 90DEG  
H(h) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:NORDECOR  
Test Date:2024-11-10

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.25V I:0.0443A P:4.5409W PF:0.4657 Freq:50.00Hz Lamp Flux:241.24lx1 lm		
NAME: 6854	TYPE:	WEIGHT:130g
SPEC.:4W	DIM.: 5.5*3.6*7.1cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:35°

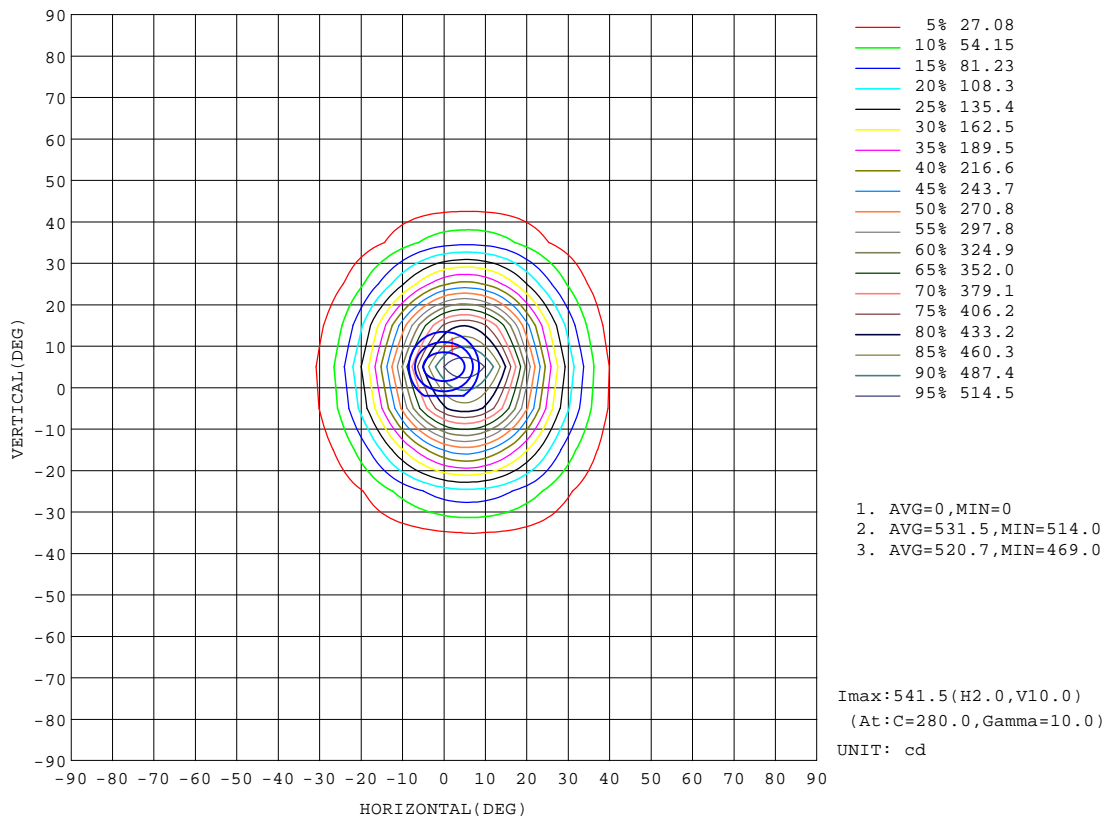


H(h) Range:-90 - 90DEG  
 H(h) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:NORDECOR  
 Test Date:2024-11-10

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

ISOLUX DIAGRAM


Test:U:220.25V I:0.0443A P:4.5409W PF:0.4657 Freq:50.00Hz Lamp Flux:241.24lx1 lm		
NAME: 6854	TYPE:	WEIGHT:130g
SPEC.:4W	DIM.: 5.5*3.6*7.1cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:35°

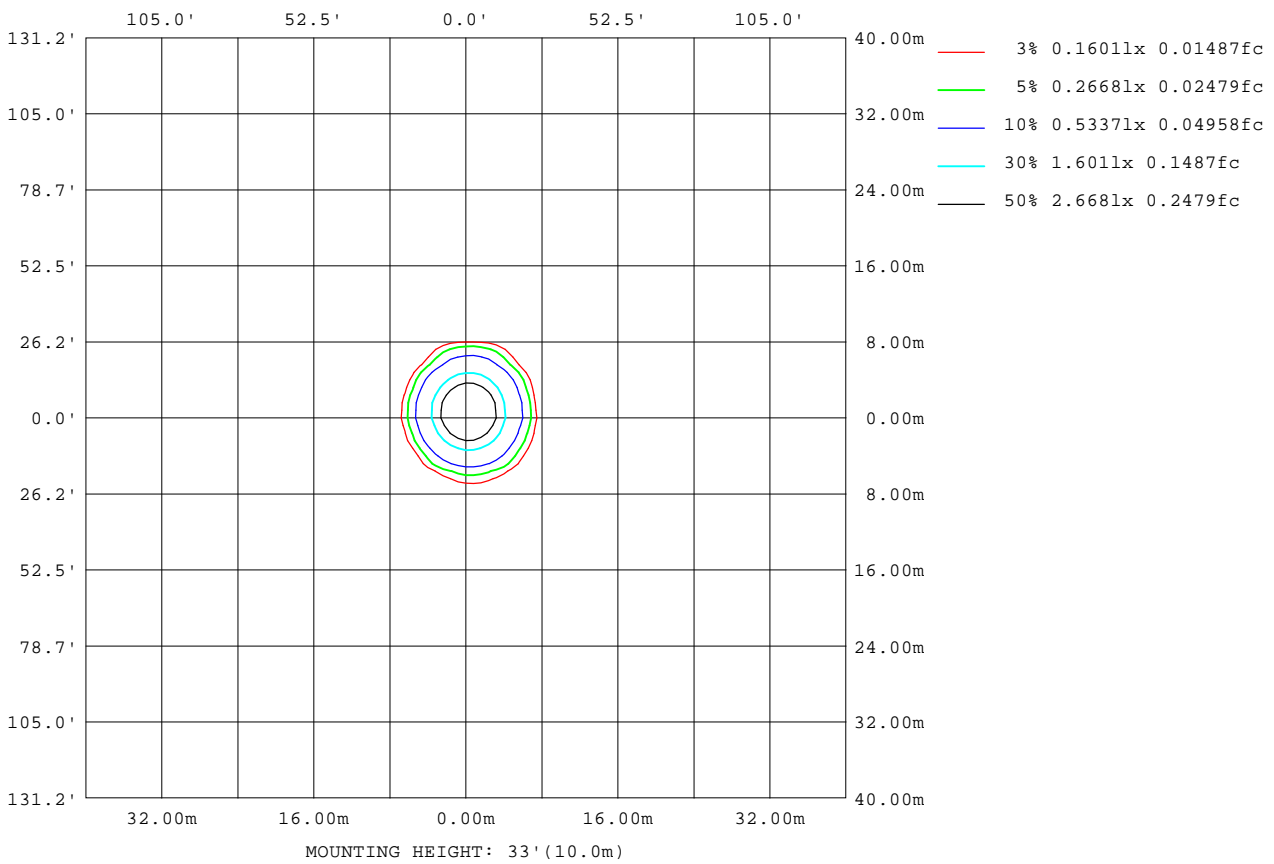

H( $\beta$ ) Range:-90 - 90DEG  
H( $\beta$ ) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:NORDECOR  
Test Date:2024-11-10

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

Planar Illuminance Curve

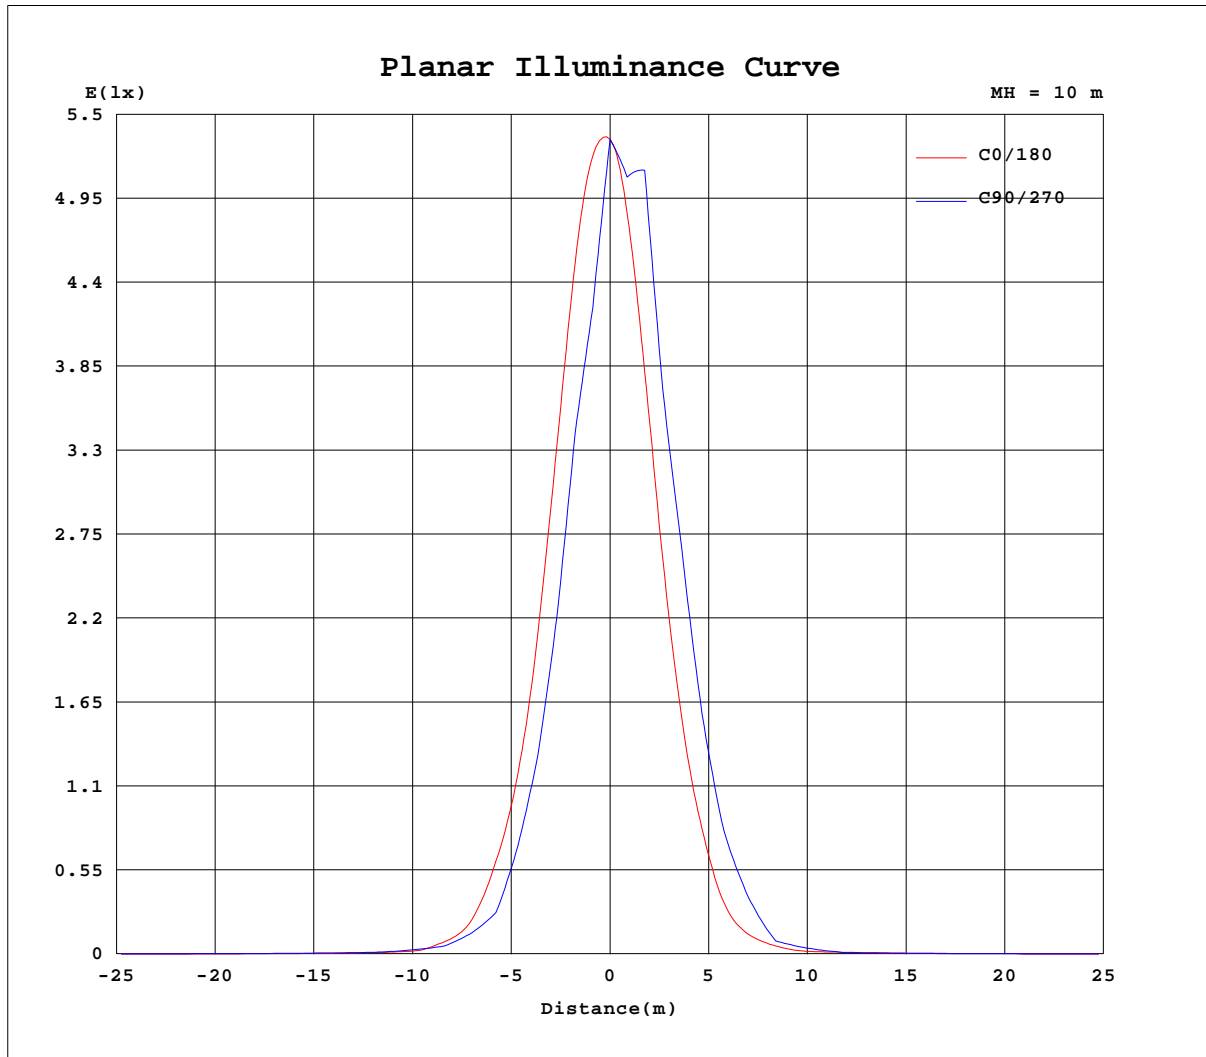


H( $\beta$ ) Range:-90 - 90DEG  
H( $\beta$ ) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:NORDECOR  
Test Date:2024-11-10

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

AAI Figure

Test:U:220.25V I:0.0443A P:4.5409W PF:0.4657 Freq:50.00Hz Lamp Flux:241.24lx1 lm		
NAME: 6854	TYPE:	WEIGHT:130g
SPEC.:4W	DIM.: 5.5*3.6*7.1cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:35°

Flux out:116.4 lm

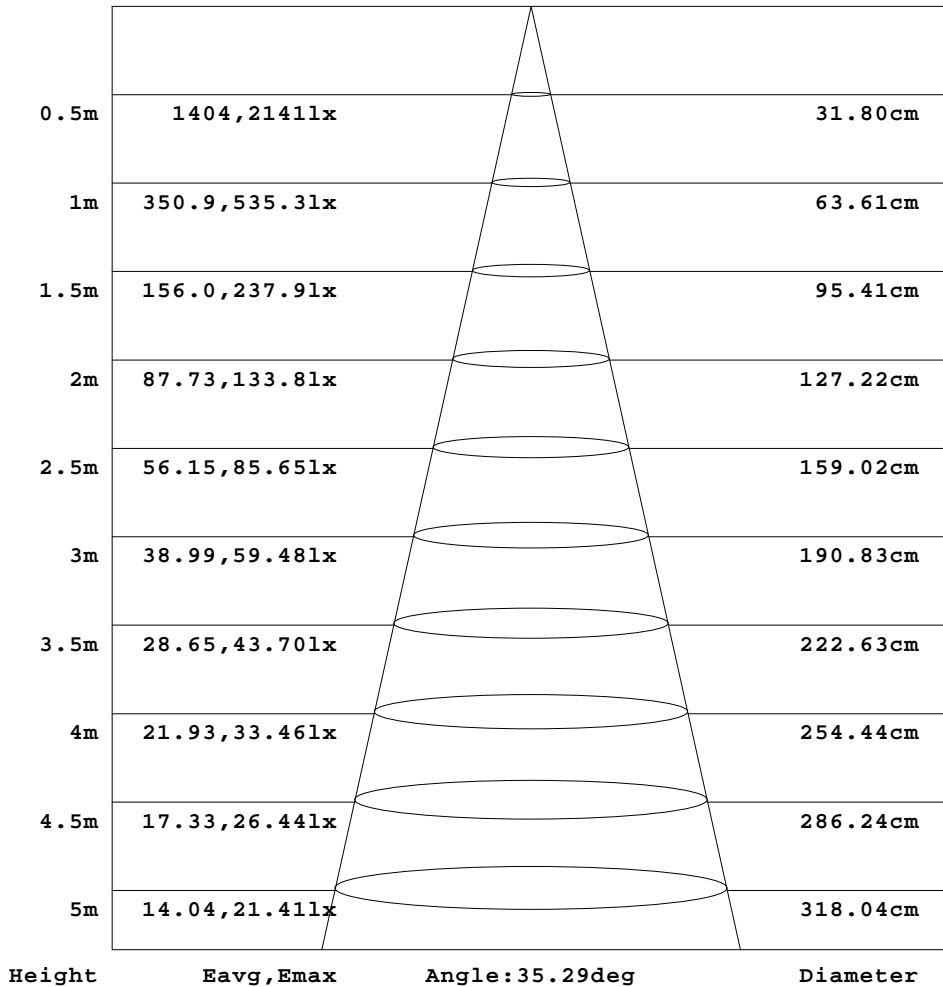

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(B) Range:-90 - 90DEG  
H(B) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:NORDECOR  
Test Date:2024-11-10

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.25V I:0.0443A P:4.5409W PF:0.4657 Freq:50.00Hz Lamp Flux:241.24lx1 lm		
NAME: 6854	TYPE:	WEIGHT:130g
SPEC.:4W	DIM.: 5.5*3.6*7.1cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:35°

Table--1

UNIT: cd

H( DEG) V( DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.82	0.84	0.85	0.85	0.84	0.84	0.86	0.86	0.87	0.88	0.90	0.92	0.95	1.02	1.10	1.17	1.19	1.22	1.21
-75	0.86	0.85	0.86	0.87	0.88	0.88	0.89	0.92	0.94	0.97	1.07	1.16	1.26	1.36	1.45	1.52	1.58	1.62	1.64
-70	0.86	0.90	0.91	0.91	0.92	0.94	0.96	0.99	1.05	1.18	1.36	1.54	1.70	1.81	1.89	1.96	2.02	2.06	2.08
-65	0.89	0.90	0.92	0.92	0.94	0.95	0.98	1.06	1.20	1.37	1.59	1.81	1.99	2.15	2.29	2.41	2.51	2.59	2.65
-60	0.91	0.94	0.94	0.96	0.98	1.02	1.08	1.27	1.54	1.82	2.10	2.31	2.49	2.65	2.83	2.99	3.10	3.19	3.25
-55	0.92	0.92	0.94	0.95	0.98	1.01	1.13	1.34	1.63	1.94	2.25	2.50	2.74	2.96	3.18	3.37	3.53	3.66	3.75
-50	0.92	0.94	0.96	0.97	1.01	1.12	1.40	1.73	2.09	2.43	2.71	2.98	3.27	3.52	3.76	3.96	4.13	4.25	4.33
-45	0.92	0.92	0.94	0.96	1.00	1.09	1.37	1.72	2.09	2.46	2.79	3.08	3.37	3.65	3.91	4.30	5.60	6.86	7.71
-40	0.92	0.92	0.95	1.00	1.06	1.35	1.74	2.16	2.55	2.88	3.20	3.51	3.82	4.10	4.37	6.12	8.69	10.6	11.7
-35	0.93	0.93	0.96	0.98	1.05	1.28	1.68	2.13	2.56	2.95	3.27	3.59	4.01	6.33	9.00	12.3	16.8	21.5	25.3
-30	0.92	0.94	0.98	1.04	1.25	1.67	2.15	2.63	3.07	3.41	3.71	4.00	6.73	11.7	17.3	23.6	30.6	37.4	41.9
-25	0.93	0.95	0.98	1.04	1.16	1.54	2.04	2.58	3.09	3.48	3.81	5.10	8.67	15.0	25.7	43.3	63.0	80.8	95.2
-20	0.96	1.00	1.04	1.13	1.48	2.00	2.57	3.17	3.62	3.98	4.56	10.3	17.6	29.6	53.9	87.5	117	143	158
-15	0.94	0.97	1.01	1.09	1.29	1.78	2.39	3.06	3.61	4.03	4.72	9.54	18.3	34.3	66.7	111	161	209	246
-10	0.97	1.01	1.07	1.21	1.64	2.28	3.02	3.66	4.14	4.57	9.44	18.6	34.9	74.4	129	195	265	324	358
-5	0.96	0.98	1.04	1.12	1.38	1.94	2.63	3.39	3.97	4.45	6.12	14.3	27.7	60.0	116	189	278	365	428
0	0.98	1.02	1.10	1.25	1.74	2.41	3.20	3.87	4.39	5.01	11.9	24.0	51.9	110	186	286	399	491	534
5	0.97	0.98	1.04	1.13	1.39	1.96	2.68	3.44	4.05	4.55	6.63	15.4	30.5	69.9	135	220	326	435	515
10	0.94	1.01	1.08	1.22	1.70	2.34	3.12	3.78	4.29	4.84	11.1	22.2	47.4	105	181	278	387	486	538
15	0.96	0.97	1.02	1.10	1.32	1.84	2.50	3.21	3.79	4.25	5.38	12.2	23.8	51.0	104	176	258	343	409
20	0.95	0.99	1.06	1.16	1.53	2.11	2.75	3.37	3.84	4.24	6.82	14.4	26.2	56.5	112	170	232	288	320
25	0.92	0.95	0.99	1.05	1.20	1.62	2.17	2.76	3.29	3.68	4.03	6.82	13.2	24.5	49.7	87.5	132	177	212
30	0.92	0.96	0.99	1.07	1.31	1.77	2.30	2.81	3.23	3.55	3.81	6.02	11.5	18.8	32.1	57.3	87.5	112	124
35	0.91	0.93	0.96	1.00	1.08	1.35	1.79	2.25	2.70	3.05	3.33	3.61	5.81	8.92	14.5	25.1	41.1	57.4	68.5
40	0.92	0.95	0.96	1.00	1.11	1.43	1.83	2.24	2.61	2.90	3.14	3.35	3.54	4.89	7.99	11.5	14.9	17.7	19.4
45	0.90	0.91	0.93	0.96	1.00	1.12	1.42	1.78	2.14	2.47	2.74	2.95	3.16	3.39	4.63	6.36	8.21	9.90	11.1
50	0.89	0.91	0.93	0.95	0.98	1.12	1.42	1.76	2.08	2.36	2.59	2.78	2.98	3.17	3.33	3.47	3.58	3.66	3.72
55	0.89	0.90	0.91	0.93	0.95	0.99	1.12	1.35	1.65	1.93	2.21	2.42	2.60	2.76	2.91	3.05	3.17	3.26	3.32
60	0.89	0.90	0.91	0.92	0.96	0.99	1.07	1.29	1.56	1.83	2.08	2.26	2.42	2.55	2.67	2.78	2.87	2.94	2.98
65	0.89	0.90	0.92	0.92	0.94	0.95	0.99	1.08	1.22	1.41	1.63	1.83	2.00	2.13	2.23	2.33	2.41	2.47	2.52
70	0.91	0.92	0.93	0.94	0.95	0.96	0.99	1.02	1.10	1.25	1.42	1.59	1.74	1.85	1.91	1.98	2.01	2.06	2.09
75	0.90	0.92	0.91	0.91	0.95	0.94	0.96	0.98	1.02	1.04	1.13	1.23	1.36	1.47	1.55	1.61	1.66	1.68	1.71
80	0.92	0.93	0.88	0.93	0.93	0.94	0.96	0.95	0.95	0.95	0.98	1.00	1.11	1.18	1.27	1.31	1.32	1.33	1.34
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG  
H(h) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:NORDECOR  
Test Date:2024-11-10

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.25V I:0.0443A P:4.5409W PF:0.4657 Freq:50.00Hz Lamp Flux:241.24lx1 lm		
NAME: 6854	TYPE:	WEIGHT:130g
SPEC.:4W	DIM.: 5.5*3.6*7.1cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:35°

Table--2

UNIT: cd

H( DEG) V( DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.20	1.18	1.12	1.03	0.96	0.90	0.90	0.88	0.88	0.88	0.87	0.87	0.86	0.85	0.84	0.85	0.84	0.81
-75	1.65	1.64	1.59	1.52	1.41	1.28	1.18	1.09	1.01	0.95	0.92	0.91	0.89	0.88	0.87	0.86	0.86	0.84
-70	2.08	2.06	2.00	1.88	1.72	1.53	1.35	1.18	1.04	0.98	0.95	0.93	0.91	0.90	0.89	0.87	0.86	0.84
-65	2.68	2.66	2.61	2.53	2.37	2.15	1.90	1.65	1.42	1.22	1.08	0.98	0.94	0.92	0.90	0.89	0.88	0.86
-60	3.27	3.23	3.15	3.01	2.77	2.48	2.15	1.82	1.53	1.29	1.09	0.97	0.94	0.92	0.90	0.88	0.88	0.85
-55	3.80	3.79	3.72	3.60	3.43	3.16	2.80	2.40	2.01	1.65	1.35	1.12	0.98	0.91	0.90	0.88	0.88	0.86
-50	4.33	4.30	4.18	4.02	3.78	3.44	2.97	2.49	2.04	1.64	1.32	1.07	0.91	0.89	0.88	0.87	0.86	0.84
-45	8.13	8.16	7.70	6.69	5.23	4.04	3.64	3.15	2.61	2.10	1.67	1.33	1.06	0.91	0.87	0.87	0.87	0.86
-40	12.1	11.6	10.2	7.65	5.01	4.15	3.73	3.15	2.54	2.01	1.59	1.25	0.99	0.87	0.87	0.86	0.86	0.85
-35	27.3	27.0	24.5	20.2	15.3	10.8	7.08	4.49	3.26	2.58	2.02	1.58	1.23	0.98	0.89	0.87	0.86	0.85
-30	42.7	39.8	33.9	26.8	19.9	12.8	7.17	3.98	3.13	2.44	1.90	1.47	1.13	0.93	0.90	0.86	0.87	0.86
-25	101	97.7	85.8	68.5	48.7	30.1	17.4	9.05	4.29	3.19	2.46	1.89	1.45	1.12	0.95	0.91	0.90	0.88
-20	158	143	117	87.5	53.7	30.9	16.9	7.58	3.93	3.03	2.30	1.76	1.34	1.04	0.96	0.96	0.94	0.94
-15	261	247	212	165	113	67.4	36.1	17.6	6.94	3.88	2.96	2.24	1.70	1.29	1.03	1.00	0.98	0.95
-10	354	313	252	181	113	63.5	30.6	14.1	4.83	3.59	2.70	2.04	1.54	1.17	1.06	1.03	1.00	0.97
-5	449	427	363	274	183	111	59.2	25.3	10.4	4.43	3.35	2.51	1.88	1.41	1.11	1.06	1.03	0.99
0	529	474	370	255	159	93.8	40.8	17.9	5.55	3.91	2.95	2.19	1.62	1.23	1.08	1.04	1.02	1.01
5	539	512	431	318	206	126	66.9	26.4	10.9	4.52	3.41	2.55	1.90	1.42	1.12	1.06	1.03	1.00
10	529	466	357	241	149	85.7	34.8	16.2	5.05	3.72	2.80	2.09	1.58	1.19	1.07	1.03	1.00	0.97
15	432	407	342	253	167	99.2	49.3	21.0	7.85	4.05	3.09	2.33	1.75	1.32	1.06	1.02	1.00	0.97
20	316	280	222	158	98.8	48.8	22.6	10.4	4.15	3.18	2.42	1.82	1.39	1.07	1.00	0.97	0.95	0.95
25	224	213	181	135	89.3	51.1	25.5	12.5	4.71	3.29	2.56	1.97	1.51	1.15	0.97	0.96	0.94	0.93
30	125	112	86.6	55.8	31.9	19.2	10.8	4.17	3.13	2.47	1.95	1.52	1.17	0.96	0.94	0.92	0.91	0.87
35	72.6	70.1	60.0	44.2	27.9	16.6	9.97	5.44	3.13	2.52	2.02	1.59	1.24	0.98	0.91	0.90	0.89	0.88
40	19.4	18.0	15.4	12.2	8.79	5.40	3.42	2.90	2.38	1.93	1.55	1.22	0.96	0.88	0.87	0.86	0.86	0.86
45	11.7	11.3	10.4	8.85	7.12	5.32	3.57	2.85	2.37	1.95	1.58	1.26	1.01	0.88	0.86	0.86	0.84	0.84
50	3.72	3.67	3.59	3.49	3.31	3.01	2.62	2.22	1.86	1.51	1.22	0.99	0.86	0.85	0.84	0.84	0.84	0.82
55	3.36	3.35	3.30	3.21	3.06	2.83	2.51	2.17	1.82	1.52	1.24	1.02	0.90	0.86	0.85	0.85	0.84	0.83
60	3.00	2.97	2.91	2.78	2.56	2.29	1.99	1.70	1.42	1.17	0.98	0.89	0.87	0.87	0.86	0.85	0.85	0.85
65	2.55	2.55	2.51	2.41	2.26	2.05	1.81	1.58	1.35	1.14	1.00	0.93	0.89	0.89	0.86	0.85	0.87	0.86
70	2.10	2.06	2.01	1.87	1.70	1.52	1.32	1.18	1.04	0.94	0.93	0.91	0.89	0.90	0.86	0.87	0.88	0.87
75	1.72	1.73	1.67	1.59	1.47	1.35	1.24	1.14	1.06	0.97	0.92	0.93	0.92	0.92	0.88	0.88	0.89	0.89
80	1.34	1.32	1.25	1.16	1.08	1.03	1.01	1.00	0.99	0.93	0.94	0.96	0.93	0.92	0.92	0.90	0.89	0.83
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(β) Range:-90 - 90DEG  
H(β) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:NORDECOR  
Test Date:2024-11-10

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks: