

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		1996.3 cd per klm. 0.0 degrees vertical -2.0 degrees horizontal
Beam Spread	At 10% of Imax	69.4V x 68.9H
	At 50% of Imax	33.8V x 34.0H
	At 90% of Imax	11.7V x 15.7H
Beam Flux	Total	1000.2 lumens per klm.
	To 10% of Imax	767.6 lumens per klm.
	To 50% of Imax	394.0 lumens per klm.
	To 90% of Imax	70.3 lumens per klm.
	Upward LOR	0.0 %
	Downward LOR	100.0 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-30

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.10V I:0.0882A P:8.8953W PF:0.4583 Freq:50.00Hz Lamp Flux:527.968x1 lm		
NAME: 6142	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:

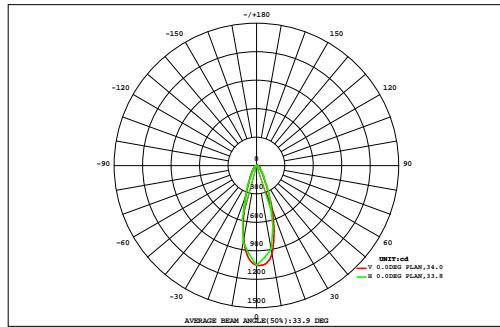

DATA OF LAMP		Eff:59.35lm/W	
MODEL		I _{max} (cd)	1054
NOMINAL POWER(W)		AVAILABILITY(%)	76.7
RATED VOLTAGE(V)		Avai. FLUX(lm)	404.9
NOMINAL FLUX(lm)	527.968	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	528.0
TEST VOLTAGE(V)	0	q @50%(H,V)	34,34DEG

VERTICAL(DEG)	AREA FLUX DIAGRAM															UNIT:lm		F t	F a				
	90	80	70	60	50	40	30	20	10	0	10	20	30	40	50	60	70			80	90		
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80	0.01	0.02	0.03	0.06	0.09	0.12	0.15	0.18	0.20	0.20	0.19	0.16	0.13	0.10	0.06	0.04	0.02	0.01	1.75	0.00			
70	0.00	0.02	0.05	0.10	0.16	0.24	0.31	0.36	0.39	0.40	0.37	0.32	0.25	0.17	0.11	0.05	0.02	0.00	3.31	0.00			
60	0.00	0.02	0.07	0.15	0.26	0.39	0.53	0.65	0.72	0.73	0.67	0.55	0.41	0.28	0.16	0.08	0.03	0.00	5.71	0.00			
50	0.00	0.03	0.10	0.22	0.39	0.61	0.87	1.13	1.31	1.33	1.18	0.93	0.65	0.41	0.23	0.10	0.03	0.00	9.55	0.00			
40	0.01	0.04	0.13	0.30	0.54	0.93	1.47	2.06	2.53	2.59	2.19	1.58	1.01	0.59	0.31	0.14	0.04	0.01	16.4	1.52			
30	0.01	0.05	0.16	0.37	0.74	1.39	2.41	3.94	5.77	6.18	4.51	2.69	1.52	0.80	0.39	0.17	0.05	0.01	31.2	20.9			
	0.01	0.06	0.19	0.44	0.94	1.92	3.86	8.57	14.9	15.6	9.94	4.54	2.12	1.02	0.47	0.19	0.06	0.01	64.8	57.3			
	0.01	0.06	0.20	0.50	1.11	2.39	5.81	15.8	27.1	27.3	16.8	6.60	2.62	1.18	0.52	0.21	0.06	0.01	108	102			
	0.01	0.06	0.21	0.51	1.16	2.56	6.67	17.8	29.1	29.2	17.9	6.96	2.72	1.22	0.53	0.21	0.06	0.01	117	110			
	0.01	0.06	0.20	0.49	1.07	2.30	5.35	12.5	20.0	19.6	11.6	5.08	2.34	1.11	0.49	0.20	0.06	0.01	82.4	75.1			
	0.01	0.05	0.18	0.42	0.89	1.76	3.33	5.82	8.21	7.82	5.25	3.15	1.77	0.91	0.43	0.18	0.05	0.01	40.2	31.3			
-30	0.01	0.05	0.15	0.35	0.68	1.23	2.03	2.87	3.29	3.14	2.64	1.94	1.22	0.68	0.34	0.14	0.04	0.01	20.8	6.78			
-40	0.01	0.04	0.11	0.26	0.49	0.81	1.21	1.60	1.81	1.79	1.56	1.19	0.80	0.49	0.26	0.11	0.03	0.00	12.6	0.00			
-50	0.00	0.03	0.08	0.19	0.34	0.52	0.72	0.90	0.99	0.99	0.88	0.70	0.51	0.33	0.18	0.08	0.03	0.00	7.47	0.00			
-60	0.00	0.02	0.06	0.12	0.20	0.31	0.41	0.49	0.53	0.53	0.48	0.40	0.30	0.20	0.11	0.06	0.02	0.00	4.24	0.00			
-70	0.00	0.01	0.03	0.06	0.10	0.14	0.18	0.22	0.24	0.23	0.21	0.18	0.14	0.10	0.06	0.03	0.01	0.00	1.96	0.00			
-80	0.00	0.01	0.01	0.01	0.02	0.03	0.03	0.04	0.04	0.04	0.03	0.03	0.02	0.02	0.01	0.01	0.00	0.00	0.35	0.00			
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.09	0.61	1.96	4.54	9.18	17.7	35.4	74.9	117	118	76.4	37.0	18.5	9.59	4.68	2.00	0.61	0.09	528	---			
F a	0.00	0.00	0.00	0.00	0.00	4.19	23.1	65.2	107	109	65.7	26.0	4.81	0.00	0.00	0.00	0.00	0.00	---	405			


one-half-peak spread: U:18.0,D:16.0 , L:17.0,R:17.2 NEMA Beam Type: Type 4

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-30

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.10V I:0.0882A P:8.8953W PF:0.4583 Freq:50.00Hz Lamp Flux:527.968x1 lm		
NAME: 6142	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:

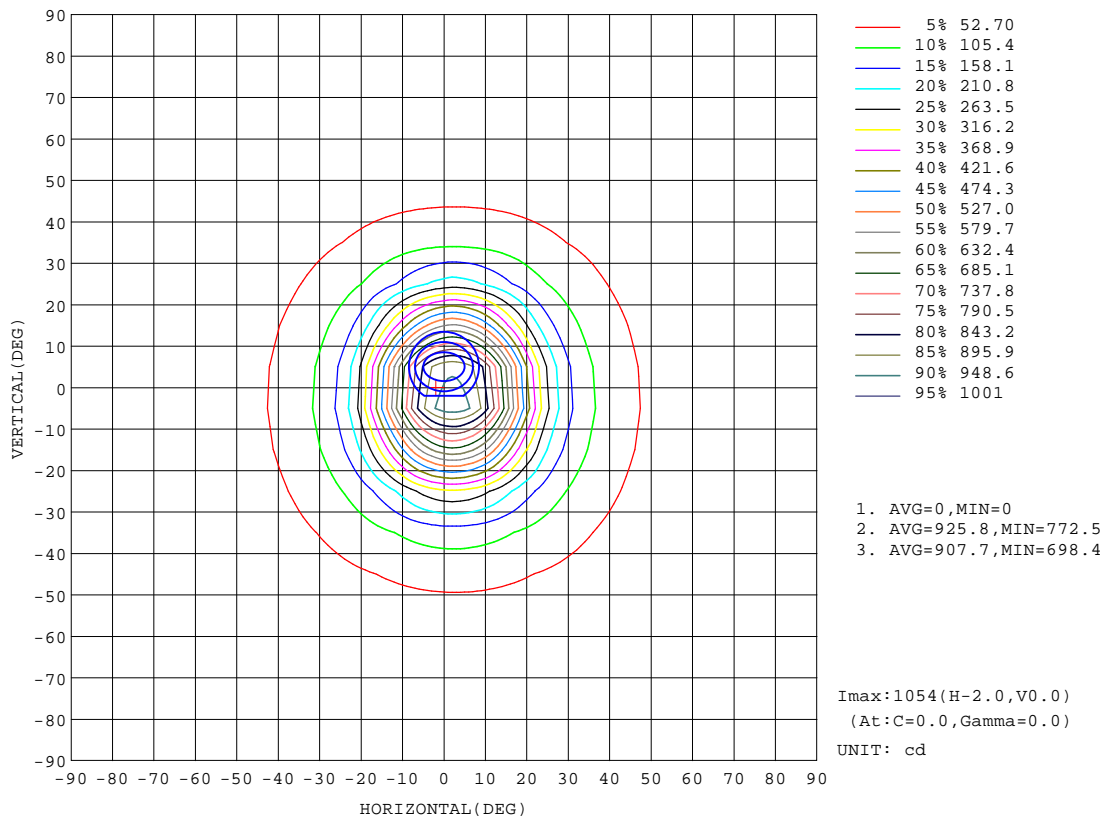


H_(b) Range:-90 - 90DEG
 H_(b) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:AED
 Test Date:2024-05-30

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM


Test:U:220.10V I:0.0882A P:8.8953W PF:0.4583 Freq:50.00Hz Lamp Flux:527.968x1 lm		
NAME: 6142	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:

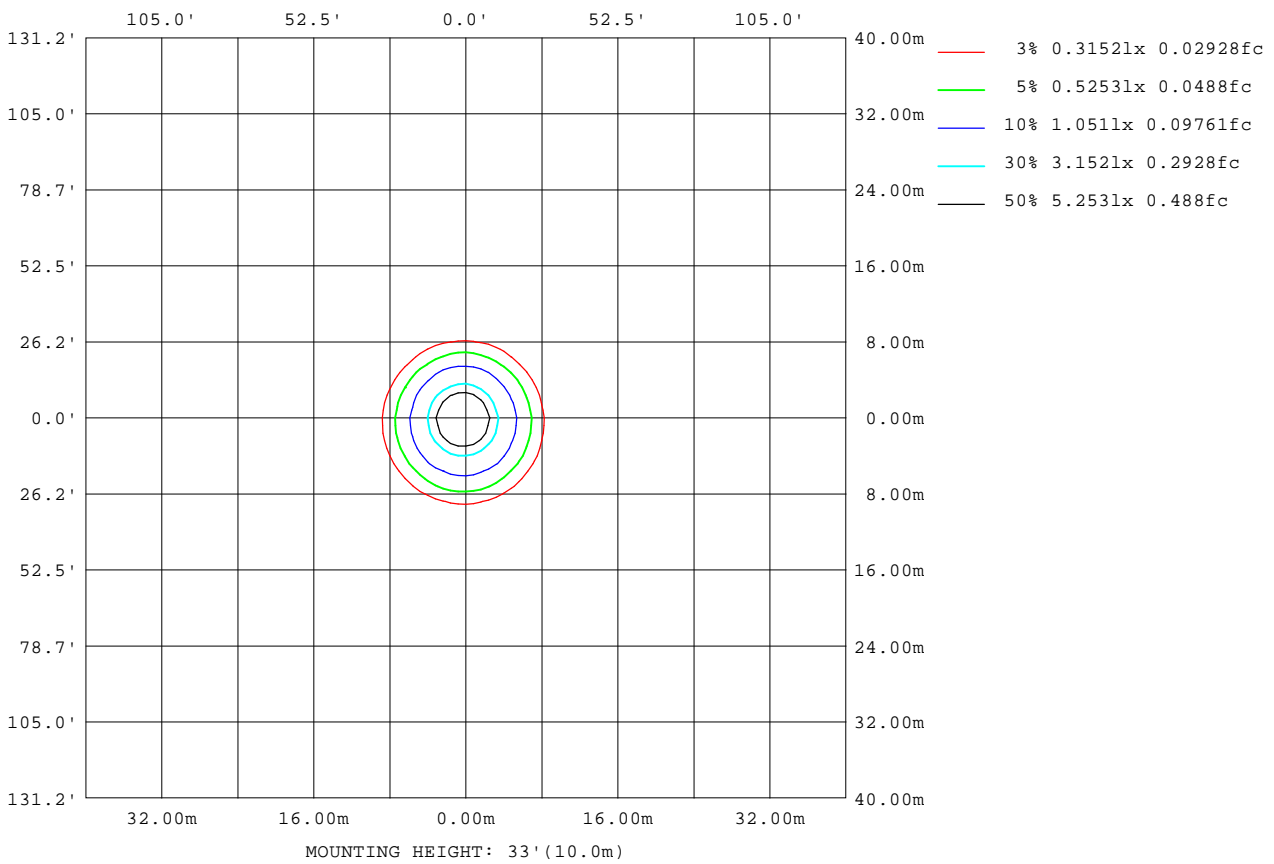

H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:AED
 Test Date:2024-05-30

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

Planar Illuminance Curve

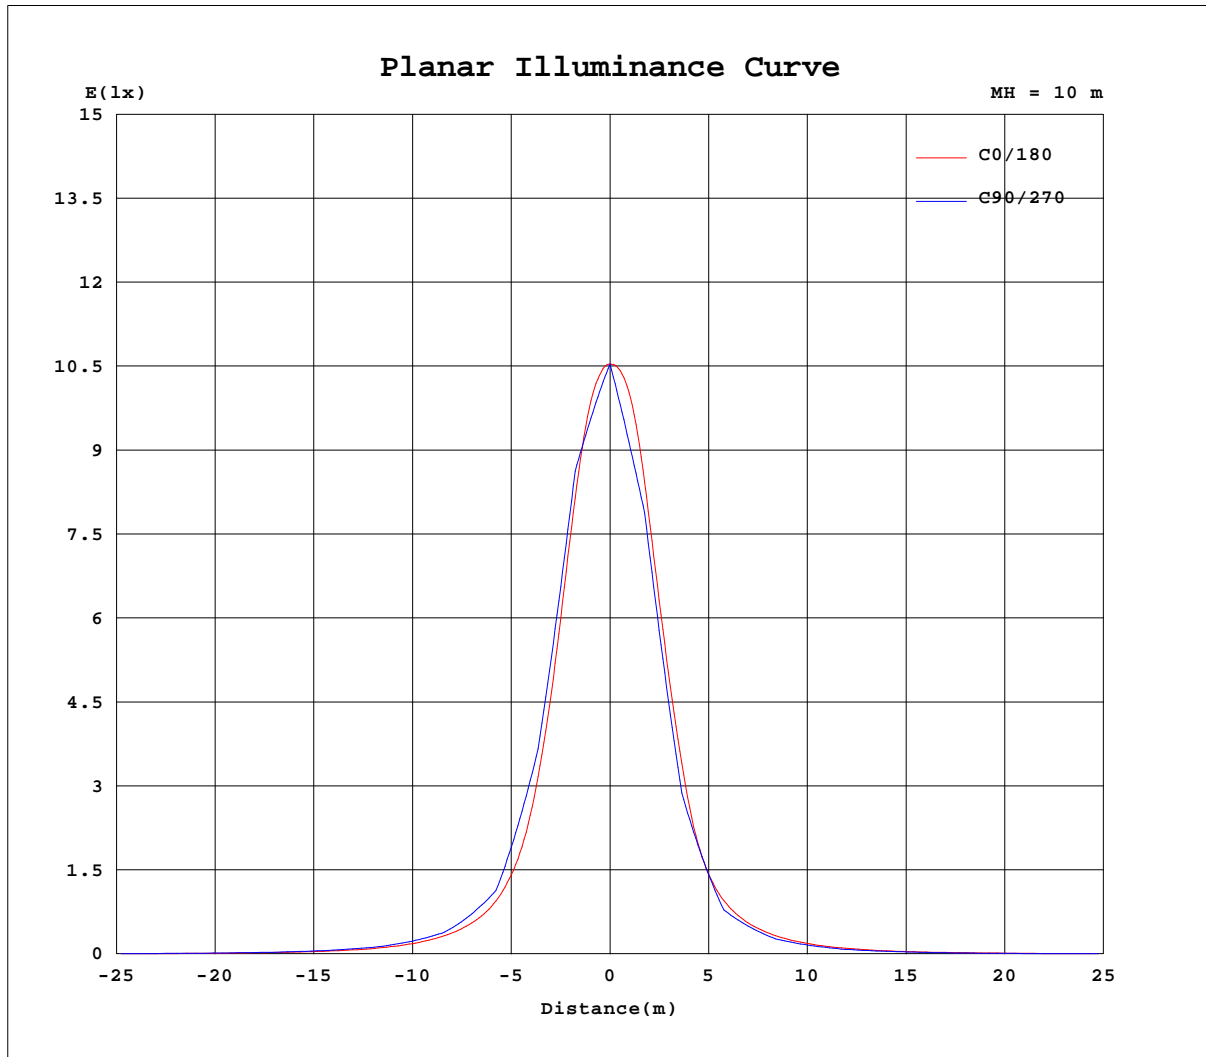


H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:AED
 Test Date:2024-05-30

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

AAI Figure

Test:U:220.10V I:0.0882A P:8.8953W PF:0.4583 Freq:50.00Hz Lamp Flux:527.968x1 lm		
NAME: 6142	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:

Flux out:209.0 lm

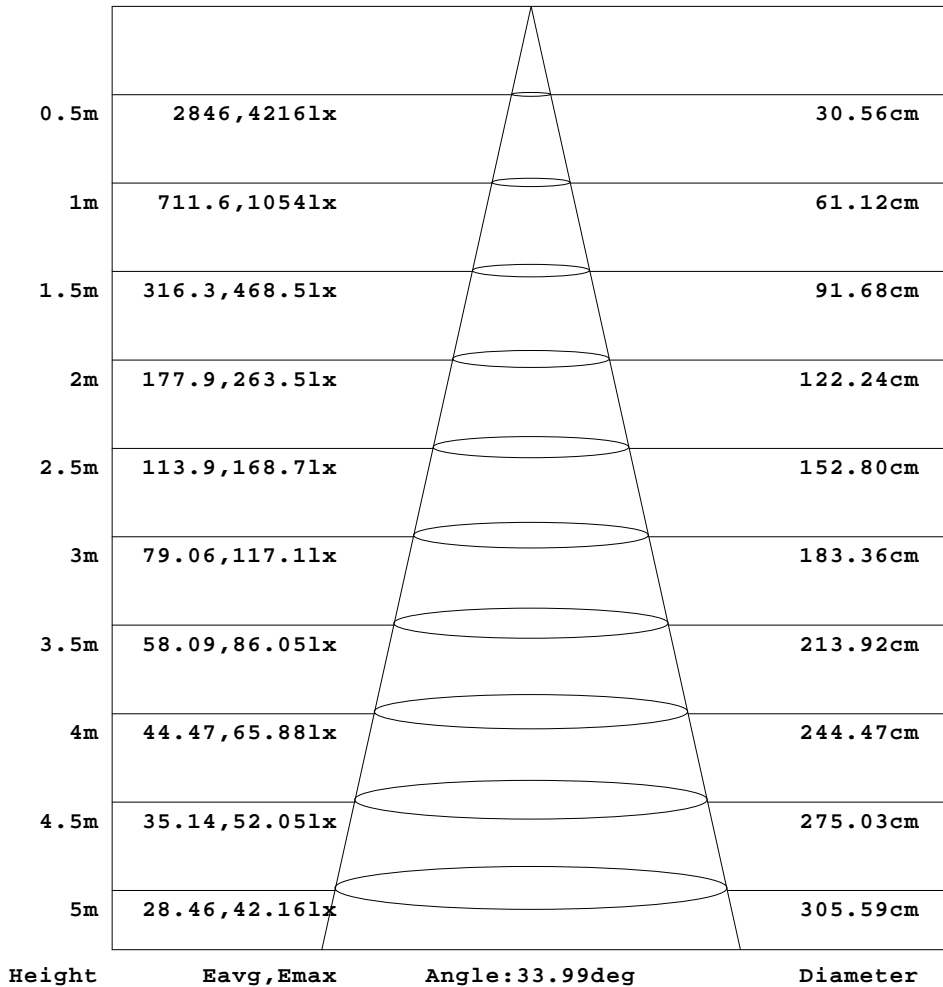

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:AED
 Test Date:2024-05-30

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.10V I:0.0882A P:8.8953W PF:0.4583 Freq:50.00Hz Lamp Flux:527.968x1 lm		
NAME: 6142	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:

Table--1

UNIT: cd

H(DEG) V(DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.26	1.31	1.34	1.35	1.42	1.58	1.78	2.03	2.37	2.69	3.04	3.37	3.67	3.91	4.14	4.32	4.46	4.54	4.55
-75	1.26	1.32	1.37	1.48	1.69	2.09	2.63	3.19	3.80	4.40	5.01	5.64	6.23	6.80	7.29	7.72	8.07	8.30	8.42
-70	1.36	1.42	1.54	1.92	2.58	3.45	4.35	5.33	6.20	7.08	7.99	8.87	9.72	10.5	11.1	11.7	12.1	12.3	12.3
-65	1.33	1.39	1.48	1.88	2.68	3.72	4.88	6.07	7.38	8.75	10.2	11.7	13.2	14.6	15.8	16.9	17.7	18.3	18.6
-60	1.41	1.49	1.99	3.05	4.41	5.84	7.28	8.92	10.7	12.8	14.9	17.0	19.0	20.7	22.2	23.4	24.3	24.8	25.0
-55	1.39	1.41	1.65	2.58	4.04	5.65	7.38	9.36	11.7	14.3	17.0	19.7	22.5	25.4	28.3	30.9	33.1	34.6	35.4
-50	1.41	1.62	2.67	4.38	6.23	8.19	10.6	13.5	16.8	20.1	23.4	26.9	30.7	34.7	38.6	41.9	44.4	45.8	46.1
-45	1.43	1.45	1.93	3.46	5.44	7.53	10.0	13.2	16.8	20.6	24.9	29.8	35.4	41.6	48.1	54.3	59.8	63.8	66.0
-40	1.49	1.87	3.51	5.70	7.96	10.8	14.5	18.6	22.9	27.9	34.3	41.6	50.0	58.9	67.7	75.7	81.9	85.7	86.4
-35	1.48	1.52	2.30	4.40	6.78	9.49	13.0	17.4	22.1	27.6	34.7	43.7	54.5	67.1	81.2	96.2	111	123	130
-30	1.54	2.16	4.37	6.91	9.83	13.7	18.5	23.6	29.9	38.3	49.3	62.8	78.9	97.6	119	140	160	173	174
-25	1.53	1.60	2.70	5.24	7.94	11.3	15.9	21.1	27.1	35.2	46.2	60.5	78.9	103	135	176	228	278	306
-20	1.62	2.47	5.00	7.81	11.3	16.0	21.5	27.9	36.8	49.1	65.4	86.8	116	157	216	294	379	432	438
-15	1.65	1.64	3.02	5.81	8.78	12.8	18.0	23.8	31.2	41.9	56.6	76.3	104	146	217	330	470	598	666
-10	1.62	2.65	5.43	8.43	12.4	17.7	23.6	31.2	42.1	57.5	78.4	108	156	242	393	588	775	884	896
-5	1.68	1.67	3.17	6.06	9.19	13.4	18.9	25.0	33.3	45.3	62.0	84.8	119	176	288	477	697	887	972
0	1.68	2.70	5.49	8.56	12.5	17.9	23.8	31.6	43.0	58.9	80.7	113	167	276	477	717	939	1042	1051
5	1.59	1.67	3.14	6.02	9.13	13.3	18.6	24.5	32.5	44.1	60.0	81.7	113	166	272	454	665	848	933
10	1.64	2.60	5.33	8.33	12.1	17.1	22.7	29.7	39.9	53.9	72.7	98.8	139	213	349	530	697	805	816
15	1.57	1.65	2.96	5.68	8.58	12.3	17.2	22.5	29.2	38.7	51.6	68.6	91.6	125	183	280	400	510	576
20	1.63	2.42	4.86	7.58	10.8	15.1	20.1	25.6	33.1	43.5	56.9	73.9	95.7	125	167	222	285	330	341
25	1.54	1.60	2.62	5.03	7.61	10.7	14.7	19.3	24.4	31.0	40.0	51.3	65.4	82.8	105	134	169	205	228
30	1.55	2.11	4.16	6.58	9.22	12.6	16.7	21.0	26.0	32.4	40.8	50.8	62.2	74.8	88.1	101	112	120	121
35	1.47	1.52	2.23	4.15	6.41	8.83	11.8	15.5	19.4	23.7	28.9	35.5	43.2	51.9	61.2	70.6	79.4	86.5	90.6
40	1.49	1.84	3.28	5.34	7.38	9.78	12.7	16.1	19.5	23.2	27.4	32.3	38.0	43.9	49.4	54.3	58.1	60.3	60.7
45	1.46	1.47	1.88	3.22	5.07	6.94	9.03	11.5	14.3	17.3	20.3	23.7	27.4	31.5	35.5	39.3	42.5	44.9	46.1
50	1.45	1.61	2.49	4.03	5.74	7.39	9.26	11.4	13.8	16.2	18.7	21.0	23.3	25.6	27.8	29.5	30.9	31.7	31.8
55	1.47	1.49	1.66	2.43	3.73	5.16	6.65	8.19	9.90	11.7	13.6	15.5	17.3	19.1	20.8	22.3	23.5	24.4	24.8
60	1.52	1.55	1.96	2.84	4.02	5.31	6.48	7.69	8.93	10.3	11.6	13.0	14.2	15.3	16.3	17.0	17.6	17.9	18.0
65	1.51	1.54	1.59	1.89	2.54	3.41	4.41	5.36	6.35	7.36	8.34	9.32	10.3	11.1	11.9	12.5	13.0	13.4	13.5
70	1.57	1.57	1.64	1.94	2.43	3.10	3.86	4.62	5.39	6.03	6.63	7.20	7.71	8.18	8.57	8.84	9.06	9.17	9.19
75	1.59	1.59	1.60	1.66	1.83	2.11	2.51	2.95	3.40	3.87	4.27	4.68	5.05	5.40	5.71	5.98	6.18	6.32	6.40
80	1.61	1.62	1.63	1.63	1.65	1.73	1.87	2.00	2.16	2.35	2.56	2.75	2.95	3.14	3.31	3.45	3.53	3.60	3.62
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-30

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.10V I:0.0882A P:8.8953W PF:0.4583 Freq:50.00Hz Lamp Flux:527.968x1 lm		
NAME: 6142	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:

Table--2

UNIT: cd

H(DEG) V(DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	4.50	4.40	4.27	4.06	3.83	3.55	3.25	2.95	2.63	2.33	2.01	1.72	1.50	1.35	1.29	1.27	1.23	1.17
-75	8.42	8.29	8.07	7.74	7.31	6.82	6.26	5.66	5.05	4.43	3.84	3.26	2.64	2.13	1.71	1.42	1.30	1.26
-70	12.1	11.8	11.3	10.7	10.0	9.18	8.30	7.39	6.48	5.59	4.74	3.80	2.94	2.22	1.63	1.35	1.29	1.25
-65	18.6	18.3	17.7	16.9	15.8	14.6	13.2	11.7	10.2	8.70	7.30	6.02	4.78	3.69	2.64	1.83	1.37	1.28
-60	24.6	23.9	22.8	21.4	19.6	17.7	15.7	13.6	11.5	9.57	7.79	6.23	4.85	3.47	2.32	1.51	1.29	1.28
-55	35.5	34.7	33.2	31.0	28.4	25.5	22.6	19.7	16.8	14.2	11.6	9.17	7.14	5.41	3.83	2.44	1.50	1.29
-50	45.2	43.2	40.2	36.6	32.6	28.6	24.8	21.2	17.9	14.6	11.5	8.80	6.60	4.78	3.06	1.77	1.30	1.33
-45	66.1	64.0	60.0	54.7	48.6	42.1	35.9	30.1	24.9	20.5	16.5	12.9	9.73	7.13	5.04	3.15	1.71	1.31
-40	83.9	78.7	71.5	63.1	54.2	45.6	37.6	30.6	24.8	20.0	15.8	11.9	8.60	6.07	3.96	2.12	1.31	1.32
-35	130	123	110	95.9	81.2	67.3	54.9	44.0	34.9	27.5	21.7	16.9	12.6	8.95	6.19	3.95	2.02	1.36
-30	165	147	126	105	85.7	68.9	54.5	42.6	32.9	25.4	19.8	14.9	10.6	7.30	4.82	2.55	1.42	1.38
-25	303	273	225	175	134	102	78.9	60.7	46.3	35.1	26.6	20.4	15.2	10.7	7.27	4.69	2.35	1.44
-20	397	322	242	179	130	97.4	73.4	55.3	41.4	30.8	23.3	17.5	12.5	8.44	5.52	2.95	1.49	1.49
-15	660	583	449	316	209	144	103	75.8	56.2	41.5	30.6	23.0	17.2	12.0	8.07	5.20	2.63	1.53
-10	810	634	435	274	178	122	87.6	64.1	46.9	34.3	25.4	19.0	13.5	9.06	5.92	3.23	1.60	1.53
-5	965	865	663	445	272	174	117	84.0	61.2	44.7	32.6	24.3	18.1	12.6	8.46	5.46	2.79	1.59
0	978	784	532	327	199	130	91.5	66.3	48.3	35.2	26.0	19.5	13.8	9.30	6.07	3.34	1.60	1.59
5	925	823	630	420	257	165	112	80.8	59.2	43.4	31.8	23.9	17.9	12.5	8.38	5.41	2.76	1.58
10	726	562	388	241	159	111	80.7	59.7	44.1	32.5	24.4	18.5	13.1	8.85	5.81	3.16	1.58	1.52
15	571	496	379	265	176	124	90.8	67.9	50.9	38.1	28.5	21.9	16.4	11.5	7.82	5.05	2.54	1.51
20	305	245	187	140	107	82.0	63.1	48.2	36.7	27.9	21.7	16.5	11.7	8.07	5.30	2.81	1.45	1.46
25	228	204	168	133	105	82.7	65.3	51.1	39.7	30.7	24.0	18.8	14.1	10.0	6.92	4.44	2.23	1.41
30	116	106	93.2	79.8	66.8	54.9	44.3	35.2	27.9	22.4	17.9	13.5	9.75	6.87	4.55	2.40	1.38	1.39
35	90.5	86.5	79.4	70.5	61.1	51.8	43.1	35.3	28.8	23.4	19.1	15.0	11.3	8.25	5.82	3.66	1.89	1.34
40	59.2	56.1	51.6	46.2	40.4	34.7	29.3	24.7	20.9	17.3	13.8	10.5	7.84	5.66	3.67	1.96	1.29	1.33
45	46.1	44.9	42.6	39.3	35.5	31.5	27.5	23.7	20.3	17.2	14.1	11.2	8.68	6.56	4.71	2.91	1.62	1.31
50	31.3	30.1	28.5	26.4	24.1	21.8	19.5	17.2	14.7	12.1	9.82	7.81	6.07	4.48	2.82	1.68	1.32	1.31
55	24.8	24.4	23.5	22.3	20.8	19.1	17.3	15.5	13.6	11.6	9.74	8.01	6.44	4.99	3.55	2.27	1.48	1.35
60	17.8	17.3	16.6	15.8	14.7	13.5	12.1	10.7	9.40	8.11	6.87	5.66	4.51	3.18	2.16	1.50	1.37	1.37
65	13.6	13.4	13.1	12.6	11.9	11.2	10.3	9.32	8.34	7.37	6.42	5.37	4.38	3.43	2.50	1.82	1.47	1.43
70	9.12	8.95	8.68	8.34	7.93	7.45	6.90	6.32	5.73	5.10	4.28	3.48	2.75	2.14	1.71	1.51	1.50	1.49
75	6.40	6.34	6.22	6.03	5.79	5.49	5.15	4.76	4.37	3.97	3.54	3.03	2.56	2.14	1.82	1.63	1.56	1.54
80	3.60	3.55	3.46	3.34	3.17	2.98	2.78	2.58	2.38	2.16	1.97	1.81	1.68	1.62	1.59	1.60	1.58	1.58
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-05-30

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks: