

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		3538.5 cd per klm. 0.0 degrees vertical 5.0 degrees horizontal
Beam Spread	At 10% of Imax	49.4V x 47.5H
	At 50% of Imax	30.6V x 29.4H
	At 90% of Imax	13.9V x 12.8H
Beam Flux	Total	994.5 lumens per klm.
	To 10% of Imax	873.0 lumens per klm.
	To 50% of Imax	549.8 lumens per klm.
	To 90% of Imax	125.5 lumens per klm.
	Upward LOR	0.0 %
	Downward LOR	99.5 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.27V I:0.0505A P:5.3017W PF:0.4769 Freq:50.00Hz Lamp Flux:188.181x1 lm		
NAME: 6396	TYPE:	WEIGHT:150g
SPEC.:5W	DIM.: $\phi 3 \times 13$ cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

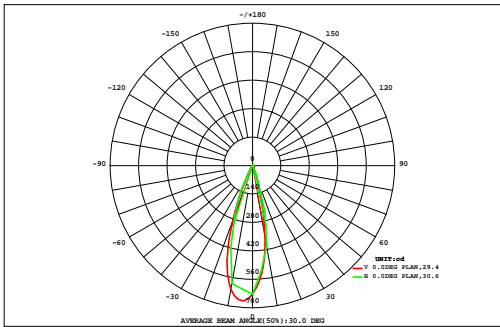

DATA OF LAMP		Eff:35.49lm/W	
MODEL		Imax(cd)	665.9
NOMINAL POWER(W)		AVAILABILITY(%)	88.8
RATED VOLTAGE(V)		Avai. FLUX(lm)	167.1
NOMINAL FLUX(lm)	188.181	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	188.2
TEST VOLTAGE(V)	0	q @50%(H,V)	29,31DEG

VERTICAL(DEG)	AREA FLUX DIAGRAM															UNIT:lm		F t	F a	
	90	80	70	60	50	40	30	20	10	0	10	20	30	40	50	60	70			80
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
80	0.00	0.01	0.01	0.02	0.02	0.03	0.03	0.03	0.04	0.04	0.03	0.03	0.03	0.02	0.02	0.01	0.01	0.00	0.39	0.00
70	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.01	0.01	0.01	0.00	0.33	0.00
60	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.04	0.04	0.04	0.03	0.02	0.02	0.01	0.01	0.01	0.00	0.36	0.00
50	0.00	0.01	0.01	0.01	0.02	0.03	0.04	0.07	0.10	0.11	0.09	0.06	0.03	0.02	0.01	0.01	0.01	0.00	0.63	0.00
40	0.00	0.01	0.01	0.02	0.02	0.03	0.09	0.23	0.45	0.55	0.39	0.18	0.06	0.03	0.02	0.01	0.01	0.00	2.11	0.00
30	0.00	0.01	0.01	0.02	0.03	0.07	0.25	0.93	2.69	3.72	2.20	0.62	0.15	0.04	0.02	0.01	0.01	0.00	10.8	7.21
20	0.00	0.01	0.01	0.02	0.04	0.13	0.55	3.04	9.44	12.6	7.86	1.89	0.29	0.06	0.02	0.01	0.01	0.00	36.0	33.7
10	0.00	0.01	0.01	0.02	0.04	0.17	0.83	5.40	16.0	20.1	13.9	3.40	0.42	0.08	0.02	0.01	0.01	0.00	60.4	58.4
0	0.00	0.01	0.01	0.02	0.04	0.15	0.71	4.46	13.3	17.3	11.8	2.95	0.38	0.07	0.02	0.01	0.01	0.00	51.3	49.2
-10	0.00	0.01	0.01	0.02	0.03	0.09	0.34	1.60	5.39	7.87	4.50	1.03	0.21	0.05	0.02	0.01	0.01	0.00	21.2	18.5
-20	0.00	0.01	0.01	0.02	0.02	0.04	0.11	0.25	0.55	0.73	0.47	0.21	0.09	0.03	0.02	0.01	0.01	0.00	2.58	0.06
-30	0.00	0.01	0.01	0.02	0.02	0.02	0.04	0.07	0.09	0.10	0.09	0.07	0.03	0.02	0.01	0.01	0.01	0.00	0.62	0.00
-40	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.04	0.04	0.04	0.03	0.03	0.02	0.01	0.01	0.01	0.00	0.37	0.00
-50	0.00	0.01	0.01	0.02	0.02	0.02	0.03	0.04	0.04	0.04	0.04	0.03	0.03	0.02	0.01	0.01	0.01	0.00	0.37	0.00
-60	0.00	0.01	0.01	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.01	0.01	0.01	0.00	0.34	0.00
-70	0.00	0.01	0.01	0.01	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.02	0.02	0.02	0.01	0.01	0.01	0.00	0.29	0.00
-80	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.13	0.00
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
F t	0.04	0.11	0.19	0.29	0.41	0.90	3.17	16.3	48.3	63.3	41.5	10.6	1.85	0.55	0.28	0.19	0.11	0.04	188	---
F a	0.00	0.00	0.00	0.00	0.00	0.00	0.02	13.3	46.3	61.0	39.6	6.99	0.00	0.00	0.00	0.00	0.00	0.00	---	167


one-half-peak spread: U:12.9,D:17.9 , L:15.6,R:13.9 NEMA Beam Type: Type 4

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.27V I:0.0505A P:5.3017W PF:0.4769 Freq:50.00Hz Lamp Flux:188.18lx1 lm		
NAME: 6396	TYPE:	WEIGHT:150g
SPEC.:5W	DIM.: $\phi 3 \times 13\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

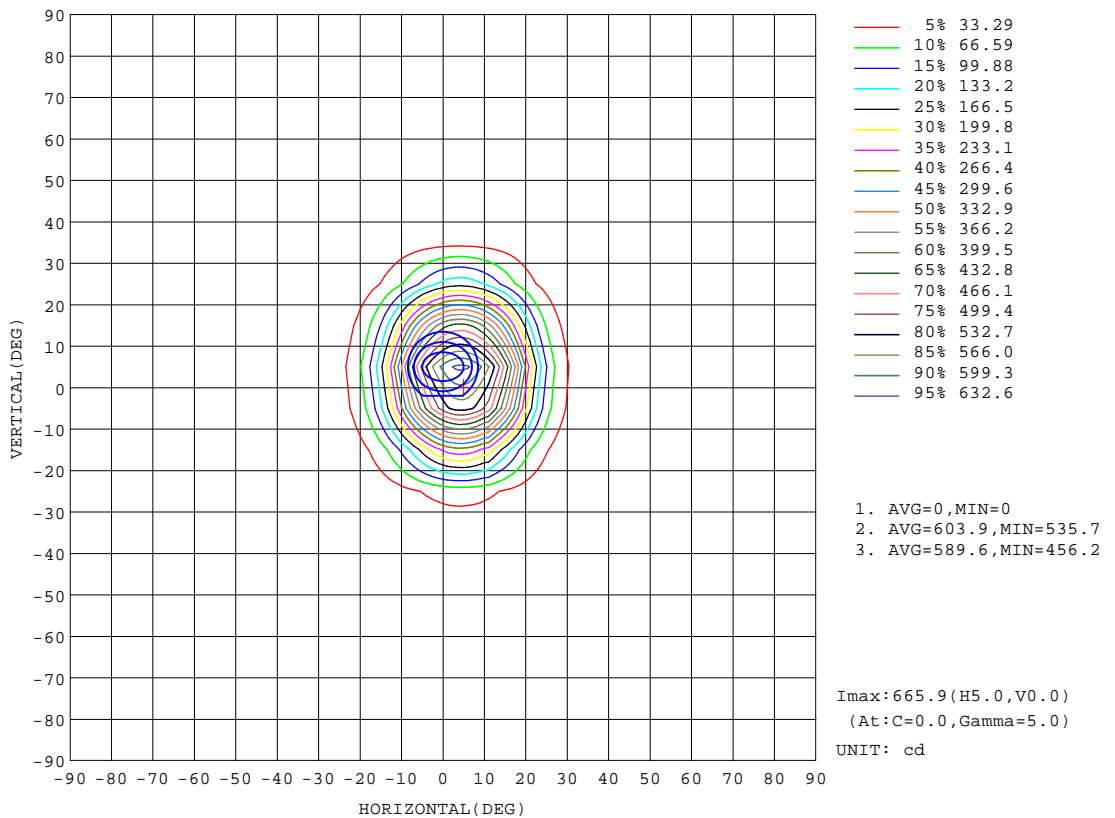


H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:NORDECOR
 Test Date:2024-10-31

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM


Test:U:220.27V I:0.0505A P:5.3017W PF:0.4769 Freq:50.00Hz Lamp Flux:188.18lx1 lm		
NAME: 6396	TYPE:	WEIGHT:150g
SPEC.:5W	DIM.: Φ 3*13cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

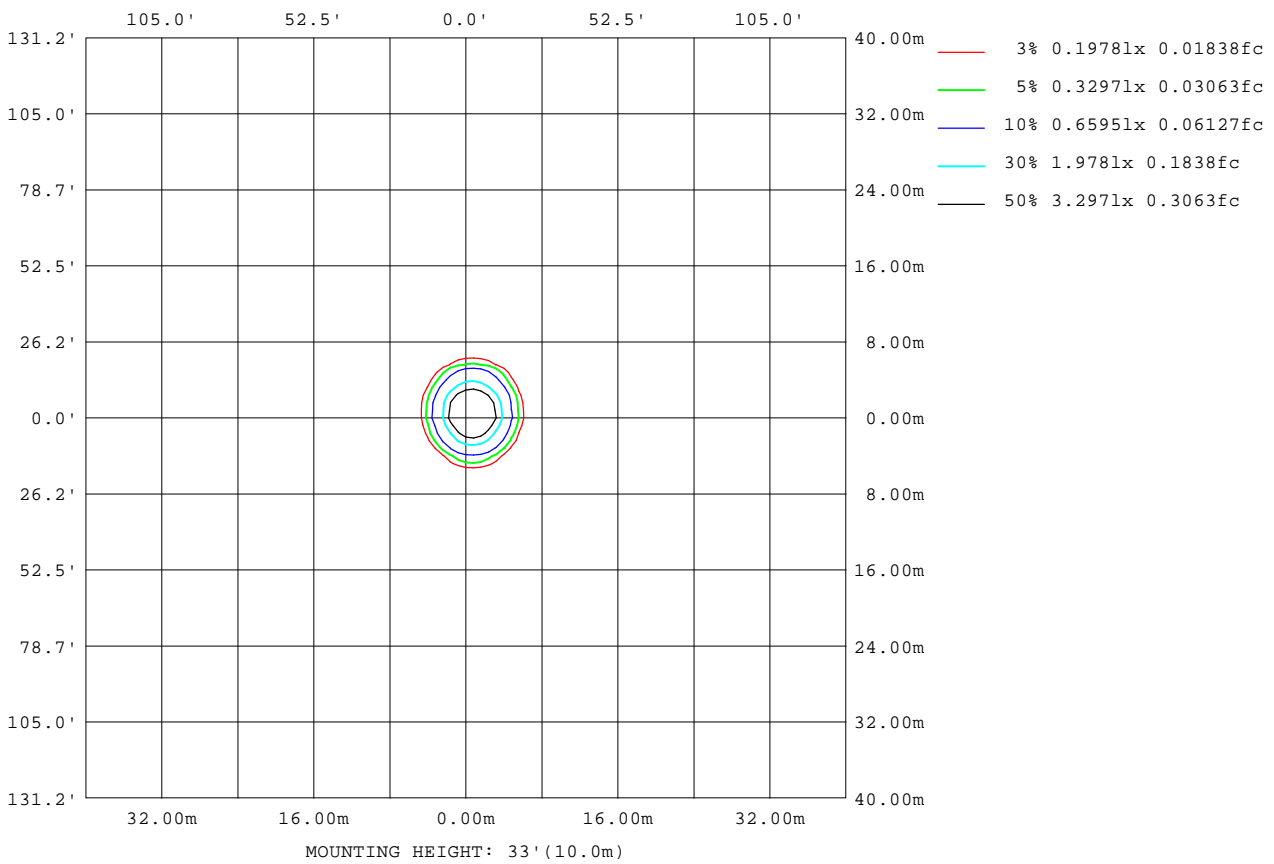

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

Planar Illuminance Curve

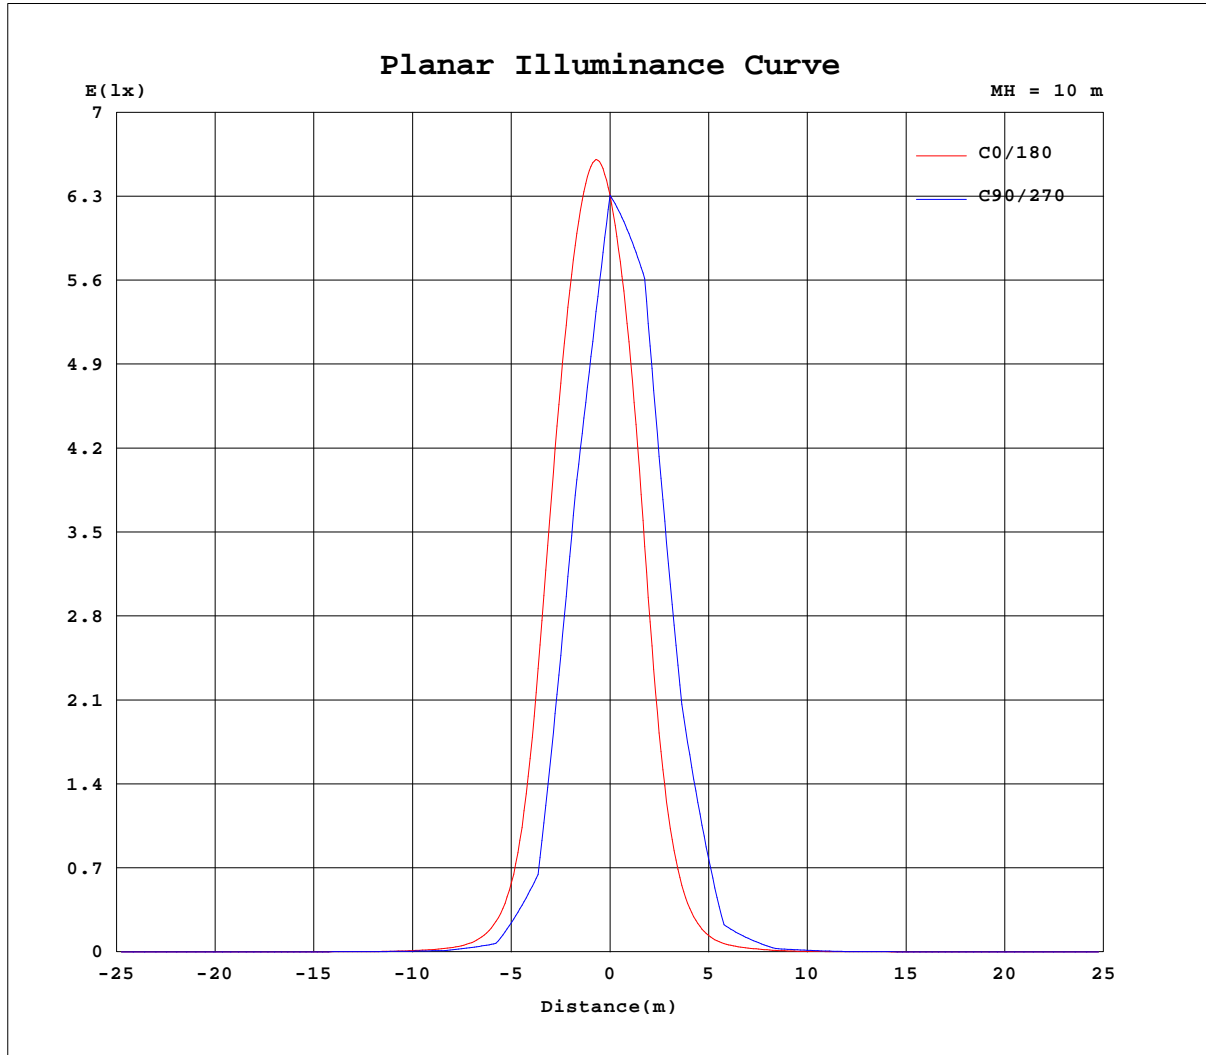


H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:NORDECOR
 Test Date:2024-10-31

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

AAI Figure

Test:U:220.27V I:0.0505A P:5.3017W PF:0.4769 Freq:50.00Hz Lamp Flux:188.18lx1 lm		
NAME: 6396	TYPE:	WEIGHT:150g
SPEC.:5W	DIM.: $\Phi 3 \times 13 \text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Flux out:97.87 lm

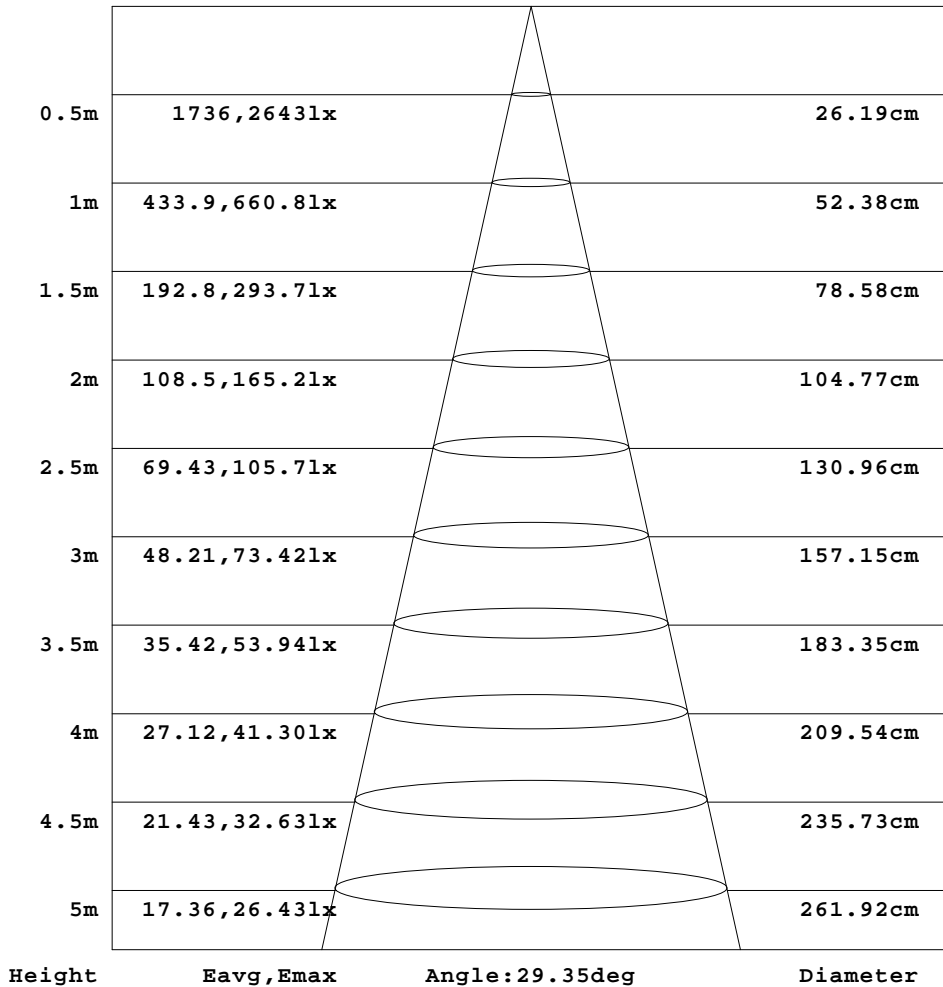

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(b) Range:-90 - 90DEG
 H(b) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:NORDECOR
 Test Date:2024-10-31

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.27V I:0.0505A P:5.3017W PF:0.4769 Freq:50.00Hz Lamp Flux:188.18lx1 lm		
NAME: 6396	TYPE:	WEIGHT:150g
SPEC.:5W	DIM.: ϕ 3*13cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--1

UNIT: cd

H(DEG) V(DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.72	0.75	0.76	0.75	0.75	0.76	0.75	0.76	0.77	0.76	0.77	0.76	0.78	0.77	0.79	0.79	0.79	0.79	0.80
-75	0.76	0.78	0.78	0.79	0.78	0.79	0.78	0.80	0.80	0.81	0.82	0.82	0.83	0.82	0.85	0.85	0.87	0.87	0.88
-70	0.79	0.81	0.80	0.83	0.81	0.83	0.82	0.84	0.84	0.85	0.86	0.88	0.88	0.88	0.91	0.92	0.94	0.95	0.96
-65	0.80	0.82	0.82	0.84	0.83	0.84	0.84	0.86	0.86	0.88	0.90	0.91	0.94	0.95	0.98	1.02	1.04	1.07	1.09
-60	0.82	0.83	0.84	0.84	0.84	0.86	0.86	0.88	0.88	0.91	0.93	0.95	1.00	1.02	1.05	1.12	1.14	1.18	1.21
-55	0.82	0.83	0.83	0.84	0.84	0.85	0.85	0.88	0.88	0.90	0.93	0.96	1.03	1.09	1.14	1.23	1.28	1.34	1.38
-50	0.83	0.82	0.83	0.83	0.83	0.84	0.84	0.87	0.88	0.90	0.92	0.98	1.07	1.15	1.24	1.33	1.43	1.51	1.54
-45	0.82	0.82	0.83	0.84	0.83	0.84	0.84	0.86	0.88	0.90	0.94	1.00	1.08	1.17	1.29	1.46	1.71	2.00	2.20
-40	0.82	0.82	0.83	0.84	0.83	0.83	0.84	0.85	0.87	0.90	0.96	1.02	1.09	1.19	1.35	1.59	2.00	2.49	2.87
-35	0.83	0.83	0.84	0.85	0.86	0.86	0.88	0.89	0.92	0.96	1.01	1.08	1.24	1.76	2.65	3.66	4.82	6.01	7.00
-30	0.84	0.84	0.85	0.86	0.88	0.90	0.91	0.92	0.98	1.03	1.07	1.15	1.39	2.34	3.96	5.74	7.64	9.54	11.1
-25	0.80	0.82	0.84	0.87	0.91	0.90	0.94	0.99	1.08	1.15	1.24	1.62	2.70	4.52	7.66	13.5	22.9	34.4	44.6
-20	0.75	0.81	0.83	0.88	0.94	0.90	0.96	1.06	1.19	1.27	1.41	2.09	4.01	6.70	11.4	21.3	38.2	59.4	78.1
-15	0.80	0.84	0.86	0.90	0.96	0.97	1.04	1.16	1.30	1.44	1.84	3.33	5.96	11.2	24.2	53.2	107	178	238
-10	0.84	0.86	0.88	0.92	0.98	1.04	1.11	1.26	1.42	1.61	2.27	4.57	7.90	15.6	37.1	85.1	175	297	399
-5	0.85	0.86	0.90	0.94	1.00	1.06	1.14	1.32	1.49	1.74	2.74	5.36	9.48	20.7	52.1	127	265	413	515
0	0.86	0.87	0.91	0.95	1.02	1.08	1.17	1.38	1.57	1.86	3.21	6.15	11.1	25.7	67.2	169	354	530	631
5	0.85	0.87	0.90	0.94	1.00	1.07	1.17	1.36	1.55	1.84	3.17	6.08	10.9	24.8	63.9	158	335	508	609
10	0.84	0.87	0.90	0.93	0.99	1.05	1.16	1.34	1.52	1.81	3.13	6.00	10.7	23.9	60.6	148	315	486	588
15	0.84	0.86	0.89	0.93	0.98	1.03	1.12	1.29	1.44	1.63	2.54	5.02	8.91	18.2	43.3	101	212	335	418
20	0.84	0.86	0.89	0.92	0.96	1.02	1.08	1.24	1.35	1.45	1.94	4.03	7.09	12.6	26.0	54.8	109	184	249
25	0.81	0.85	0.87	0.90	0.93	0.97	1.02	1.13	1.23	1.32	1.61	2.87	5.17	9.07	17.2	34.0	64.5	106	142
30	0.78	0.83	0.86	0.87	0.90	0.93	0.97	1.02	1.10	1.19	1.28	1.71	3.24	5.53	8.51	13.2	20.3	28.5	35.1
35	0.80	0.82	0.83	0.88	0.86	0.86	0.90	0.92	0.99	1.07	1.12	1.39	2.23	3.58	5.57	8.46	12.7	17.3	20.9
40	0.82	0.80	0.80	0.88	0.83	0.80	0.83	0.83	0.88	0.95	0.96	1.07	1.21	1.64	2.63	3.77	5.18	6.03	6.67
45	0.79	0.80	0.80	0.84	0.82	0.80	0.83	0.83	0.86	0.90	0.93	1.02	1.12	1.37	1.90	2.52	3.30	3.80	4.19
50	0.76	0.80	0.80	0.80	0.82	0.81	0.82	0.82	0.83	0.84	0.90	0.97	1.03	1.10	1.18	1.28	1.43	1.58	1.71
55	0.78	0.80	0.80	0.80	0.81	0.81	0.82	0.83	0.84	0.85	0.88	0.93	0.97	1.03	1.10	1.18	1.27	1.35	1.43
60	0.80	0.79	0.79	0.80	0.81	0.80	0.83	0.84	0.84	0.85	0.86	0.89	0.91	0.96	1.02	1.07	1.11	1.13	1.15
65	0.81	0.81	0.81	0.82	0.83	0.82	0.84	0.85	0.86	0.86	0.88	0.90	0.91	0.94	0.98	1.02	1.03	1.05	1.06
70	0.82	0.82	0.82	0.83	0.84	0.83	0.84	0.86	0.87	0.87	0.89	0.91	0.91	0.93	0.94	0.96	0.96	0.96	0.96
75	0.82	0.83	0.83	0.82	0.84	0.84	0.85	0.85	0.86	0.87	0.88	0.90	0.90	0.91	0.92	0.93	0.93	0.94	0.94
80	0.82	0.83	0.83	0.82	0.83	0.84	0.85	0.85	0.85	0.87	0.86	0.88	0.88	0.88	0.90	0.90	0.90	0.91	0.91
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.27V I:0.0505A P:5.3017W PF:0.4769 Freq:50.00Hz Lamp Flux:188.18lx1 lm		
NAME: 6396	TYPE:	WEIGHT:150g
SPEC.:5W	DIM.: Φ 3*13cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--2

UNIT: cd

H(DEG) V(DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.82	0.80	0.81	0.81	0.80	0.79	0.79	0.79	0.79	0.78	0.78	0.78	0.77	0.77	0.76	0.76	0.76	0.74
-75	0.89	0.88	0.89	0.88	0.88	0.86	0.86	0.84	0.84	0.83	0.82	0.81	0.80	0.80	0.79	0.79	0.78	0.76
-70	0.96	0.96	0.97	0.95	0.96	0.93	0.92	0.90	0.90	0.87	0.86	0.84	0.83	0.82	0.81	0.82	0.79	0.77
-65	1.09	1.09	1.08	1.06	1.04	1.00	0.98	0.94	0.92	0.89	0.86	0.85	0.84	0.82	0.81	0.81	0.79	0.78
-60	1.21	1.21	1.20	1.17	1.13	1.08	1.04	0.99	0.95	0.91	0.87	0.86	0.84	0.83	0.81	0.80	0.79	0.79
-55	1.39	1.38	1.34	1.29	1.22	1.14	1.08	1.00	0.95	0.89	0.85	0.84	0.82	0.80	0.79	0.79	0.78	0.78
-50	1.56	1.55	1.49	1.41	1.31	1.21	1.11	1.02	0.94	0.87	0.82	0.82	0.79	0.78	0.77	0.78	0.76	0.77
-45	2.28	2.21	1.97	1.70	1.45	1.26	1.13	1.02	0.94	0.86	0.82	0.79	0.78	0.77	0.77	0.77	0.76	0.77
-40	3.01	2.87	2.46	1.99	1.59	1.31	1.14	1.02	0.93	0.86	0.81	0.77	0.76	0.76	0.76	0.76	0.76	0.77
-35	7.32	6.87	5.77	4.56	3.35	2.33	1.55	1.12	0.96	0.88	0.83	0.80	0.79	0.78	0.78	0.78	0.79	0.78
-30	11.6	10.9	9.07	7.13	5.12	3.34	1.95	1.21	1.00	0.90	0.84	0.83	0.81	0.80	0.80	0.80	0.81	0.80
-25	47.8	41.5	30.0	19.0	10.8	6.16	3.54	1.99	1.24	1.02	0.94	0.90	0.86	0.84	0.81	0.80	0.82	0.80
-20	84.0	72.1	50.9	30.8	16.5	8.98	5.13	2.76	1.48	1.14	1.04	0.96	0.90	0.88	0.83	0.81	0.84	0.80
-15	256	224	152	79.9	36.1	15.9	7.47	3.90	2.03	1.31	1.14	1.05	0.96	0.92	0.88	0.87	0.87	0.85
-10	427	376	254	129	55.6	22.9	9.81	5.05	2.58	1.49	1.25	1.14	1.03	0.96	0.93	0.93	0.90	0.90
-5	547	496	370	207	83.4	31.0	12.2	5.86	3.03	1.64	1.31	1.17	1.05	0.97	0.95	0.94	0.92	0.92
0	666	617	487	285	111	39.1	14.6	6.67	3.48	1.79	1.36	1.21	1.08	0.99	0.96	0.95	0.94	0.93
5	640	587	456	261	101	36.2	13.8	6.43	3.37	1.76	1.36	1.20	1.07	0.99	0.96	0.94	0.93	0.92
10	614	558	425	237	91.1	33.3	13.0	6.20	3.25	1.73	1.35	1.19	1.07	0.99	0.96	0.94	0.92	0.91
15	441	393	288	157	63.6	24.8	10.5	5.25	2.74	1.55	1.26	1.13	1.01	0.96	0.93	0.91	0.89	0.88
20	267	228	152	77.9	36.0	16.4	7.95	4.31	2.23	1.38	1.17	1.07	0.96	0.92	0.89	0.88	0.87	0.85
25	152	130	88.1	47.2	23.1	11.4	5.89	3.23	1.77	1.22	1.07	0.99	0.91	0.88	0.87	0.86	0.84	0.83
30	36.7	32.4	24.5	16.4	10.2	6.34	3.83	2.16	1.32	1.06	0.98	0.91	0.87	0.85	0.85	0.83	0.82	0.80
35	21.7	19.4	15.1	10.5	6.79	4.31	2.67	1.64	1.15	0.97	0.90	0.85	0.82	0.81	0.81	0.80	0.80	0.78
40	6.81	6.43	5.64	4.58	3.38	2.28	1.50	1.13	0.97	0.89	0.82	0.78	0.76	0.77	0.76	0.78	0.77	0.75
45	4.28	4.07	3.61	3.02	2.34	1.72	1.27	1.05	0.93	0.86	0.80	0.77	0.76	0.76	0.76	0.76	0.76	0.74
50	1.76	1.72	1.59	1.45	1.30	1.15	1.04	0.96	0.88	0.82	0.78	0.75	0.75	0.75	0.75	0.75	0.74	0.74
55	1.46	1.43	1.36	1.27	1.18	1.08	1.00	0.94	0.87	0.82	0.80	0.78	0.76	0.76	0.76	0.75	0.75	0.73
60	1.16	1.15	1.12	1.10	1.06	1.01	0.95	0.91	0.86	0.83	0.82	0.81	0.78	0.77	0.77	0.76	0.75	0.71
65	1.07	1.06	1.04	1.02	1.00	0.97	0.93	0.91	0.88	0.85	0.84	0.83	0.80	0.80	0.80	0.79	0.78	0.76
70	0.98	0.98	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.88	0.86	0.85	0.83	0.82	0.82	0.82	0.81	0.80
75	0.95	0.94	0.94	0.93	0.92	0.92	0.91	0.90	0.88	0.87	0.86	0.86	0.85	0.84	0.84	0.83	0.83	0.82
80	0.91	0.91	0.91	0.91	0.90	0.90	0.91	0.90	0.87	0.87	0.86	0.86	0.86	0.85	0.85	0.84	0.84	0.84
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-31

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks: