

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		10354.5 cd per klm. 0.0 degrees vertical -2.0 degrees horizontal
Beam Spread	At 10% of Imax	34.2V x 26.3H
	At 50% of Imax	12.7V x 13.4H
	At 90% of Imax	4.7V x 5.3H
Beam Flux	Total	983.1 lumens per klm.
	To 10% of Imax	601.7 lumens per klm.
	To 50% of Imax	256.2 lumens per klm.
	To 90% of Imax	25.0 lumens per klm.
	Upward LOR	0.0 %
	Downward LOR	98.3 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-11

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.12V I:0.1609A P:15.555W PF:0.4393 Freq:50.00Hz Lamp Flux:572.459x1 lm		
NAME: 6419	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: $\phi 12 \times 8.7\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:12°

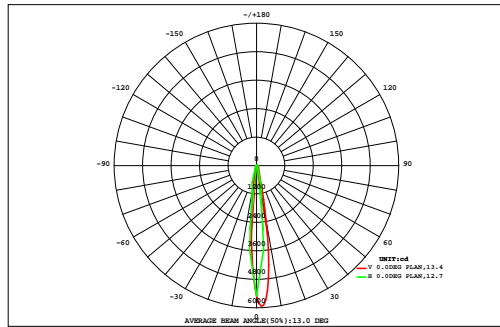

DATA OF LAMP		Eff:36.80lm/W	
MODEL		Imax(cd)	5928
NOMINAL POWER(W)		AVAILABILITY(%)	64.0
RATED VOLTAGE(V)		Avai. FLUX(lm)	366.3
NOMINAL FLUX(lm)	572.459	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	572.5
TEST VOLTAGE(V)	0	q @50%(H,V)	13,13DEG

VERTICAL(DEG)	AREA FLUX DIAGRAM																UNIT:lm		F t	F a	
	90	80	70	60	50	40	30	20	10	0	10	20	30	40	50	60	70	80			90
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80	0.01	0.02	0.03	0.04	0.05	0.06	0.06	0.07	0.07	0.07	0.07	0.06	0.05	0.04	0.03	0.02	0.01	0.00	0.76	0.00	0.00
70	0.00	0.01	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.08	0.07	0.06	0.05	0.04	0.03	0.02	0.01	0.00	0.72	0.00	0.00
60	0.00	0.01	0.02	0.03	0.04	0.07	0.11	0.15	0.18	0.20	0.16	0.10	0.06	0.04	0.03	0.02	0.01	0.00	1.23	0.00	0.00
50	0.00	0.01	0.02	0.03	0.06	0.14	0.31	0.47	0.60	0.67	0.54	0.30	0.13	0.05	0.02	0.02	0.01	0.00	3.38	0.00	0.00
40	0.00	0.01	0.02	0.04	0.13	0.39	0.83	1.31	1.65	1.84	1.38	0.73	0.35	0.11	0.03	0.02	0.01	0.00	8.86	0.00	0.00
30	0.00	0.01	0.03	0.08	0.27	0.78	1.73	3.29	4.60	4.65	2.95	1.60	0.74	0.25	0.06	0.02	0.01	0.00	21.1	0.00	0.00
20	0.00	0.02	0.04	0.12	0.46	1.23	3.25	7.48	15.1	15.1	6.49	2.88	1.20	0.41	0.10	0.03	0.01	0.00	53.9	17.0	0.00
10	0.00	0.02	0.04	0.15	0.58	1.75	4.73	13.7	62.2	64.6	12.4	3.93	1.47	0.50	0.12	0.03	0.02	0.00	166	133	0.00
0	0.00	0.02	0.04	0.15	0.60	1.80	5.17	19.7	109	81.3	12.2	4.00	1.40	0.47	0.11	0.03	0.02	0.01	236	207	0.00
-10	0.00	0.02	0.04	0.13	0.50	1.43	3.77	8.40	12.1	9.69	5.83	2.86	1.09	0.36	0.09	0.03	0.01	0.00	46.4	9.22	0.00
-20	0.00	0.02	0.03	0.08	0.30	0.84	1.87	3.59	3.86	3.25	2.78	1.50	0.71	0.22	0.05	0.02	0.01	0.00	19.1	0.00	0.00
-30	0.00	0.01	0.03	0.04	0.13	0.39	0.94	1.52	1.78	1.46	1.17	0.70	0.31	0.09	0.03	0.02	0.01	0.00	8.64	0.00	0.00
-40	0.00	0.01	0.02	0.03	0.06	0.15	0.34	0.54	0.63	0.52	0.42	0.27	0.12	0.04	0.02	0.02	0.01	0.00	3.19	0.00	0.00
-50	0.00	0.01	0.02	0.03	0.05	0.07	0.11	0.17	0.17	0.17	0.13	0.08	0.04	0.04	0.03	0.02	0.01	0.00	1.17	0.00	0.00
-60	0.00	0.01	0.02	0.03	0.04	0.05	0.07	0.07	0.08	0.08	0.07	0.05	0.05	0.04	0.03	0.02	0.01	0.00	0.72	0.00	0.00
-70	0.00	0.01	0.02	0.03	0.03	0.04	0.04	0.05	0.05	0.05	0.05	0.04	0.04	0.03	0.02	0.02	0.01	0.00	0.53	0.00	0.00
-80	0.00	0.00	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.01	0.01	0.01	0.00	0.00	0.22	0.00	0.00
-90	0.00	0.00	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.01	0.01	0.01	0.00	0.00	0.22	0.00	0.00
	-90	-80	-70	-60	-50	-40	-30	-20	HORIZONTAL(DEG)	20	30	40	50	60	70	80	90				
F t	0.07	0.23	0.45	1.04	3.34	9.25	23.4	60.6	212	184	46.7	19.2	7.83	2.74	0.81	0.36	0.19	0.06	572	---	---
F a	0.00	0.00	0.00	0.00	0.00	0.00	0.00	18.8	184	155	8.25	0.00	0.00	0.00	0.00	0.00	0.00	0.00	---	366	---


one-half-peak spread: U:6.4,D:6.4 , L:7.1,R:6.4 NEMA Beam Type: Type 2 x 3 (H x V)

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-11

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.12V I:0.1609A P:15.555W PF:0.4393 Freq:50.00Hz Lamp Flux:572.459x1 lm		
NAME: 6419	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: ϕ 12*8.7cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:12°

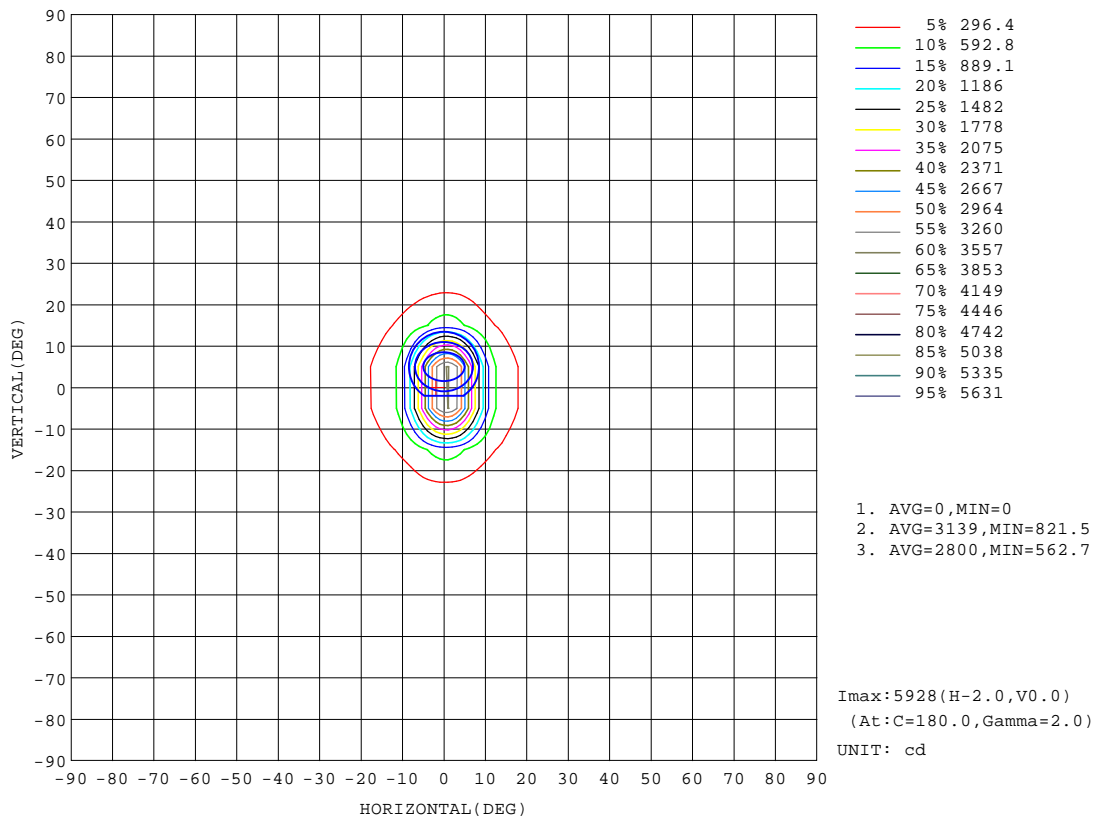


H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:AED
 Test Date:2024-04-11

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM


Test:U:220.12V I:0.1609A P:15.555W PF:0.4393 Freq:50.00Hz Lamp Flux:572.459x1 lm		
NAME: 6419	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: $\phi 12 \times 8.7\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:12°

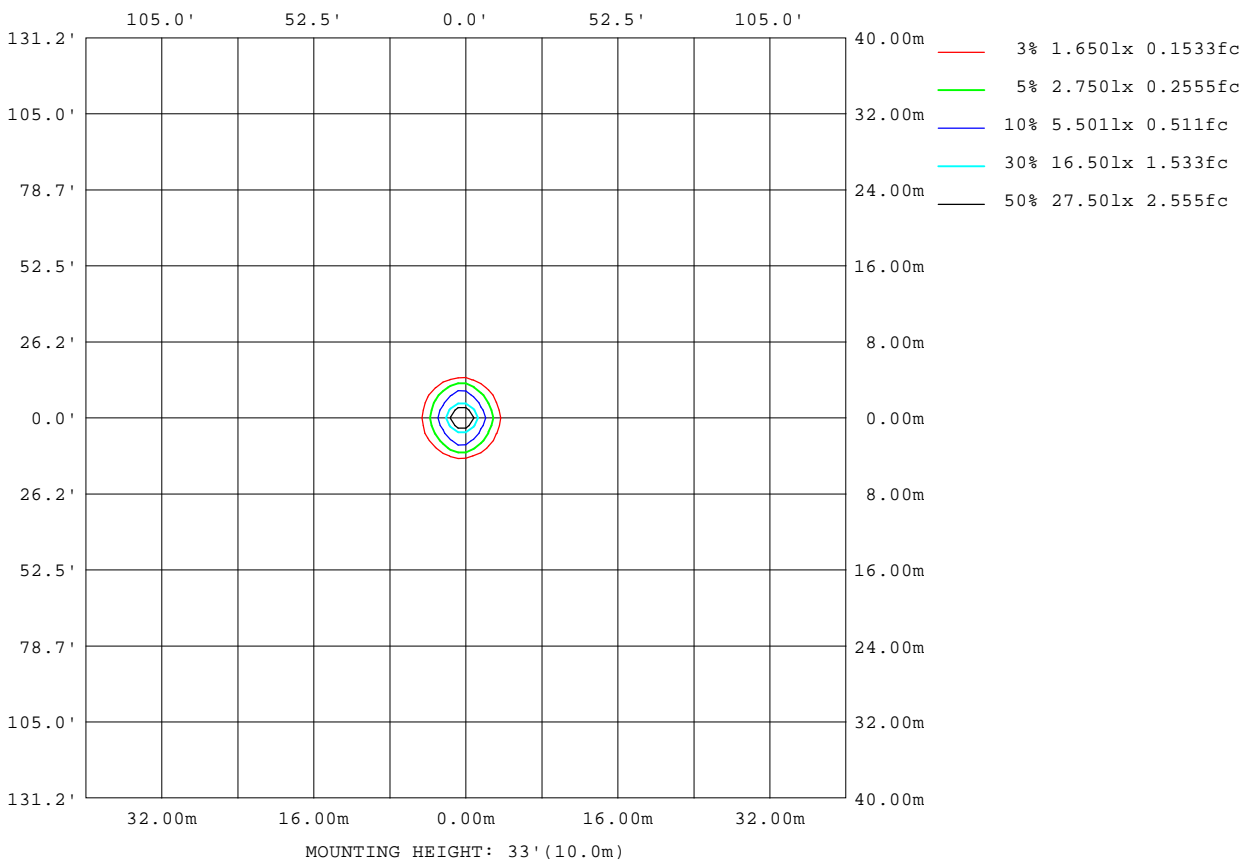

H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:AED
 Test Date:2024-04-11

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

Planar Illuminance Curve

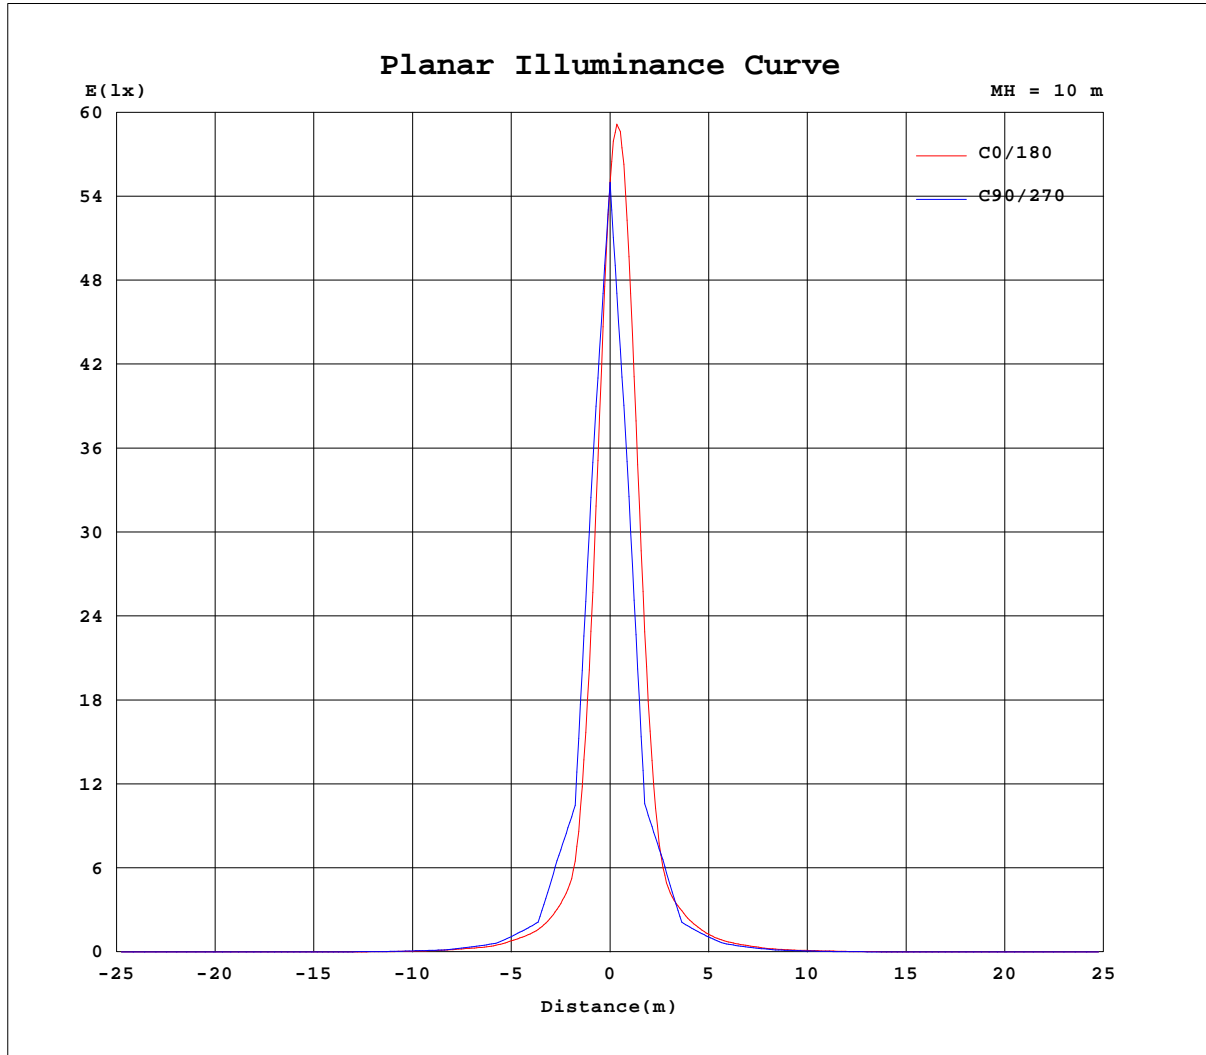


H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:AED
 Test Date:2024-04-11

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

AAI Figure

Test:U:220.12V I:0.1609A P:15.555W PF:0.4393 Freq:50.00Hz Lamp Flux:572.459x1 lm		
NAME: 6419	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: ϕ 12*8.7cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:12°

Flux out:154.4 lm

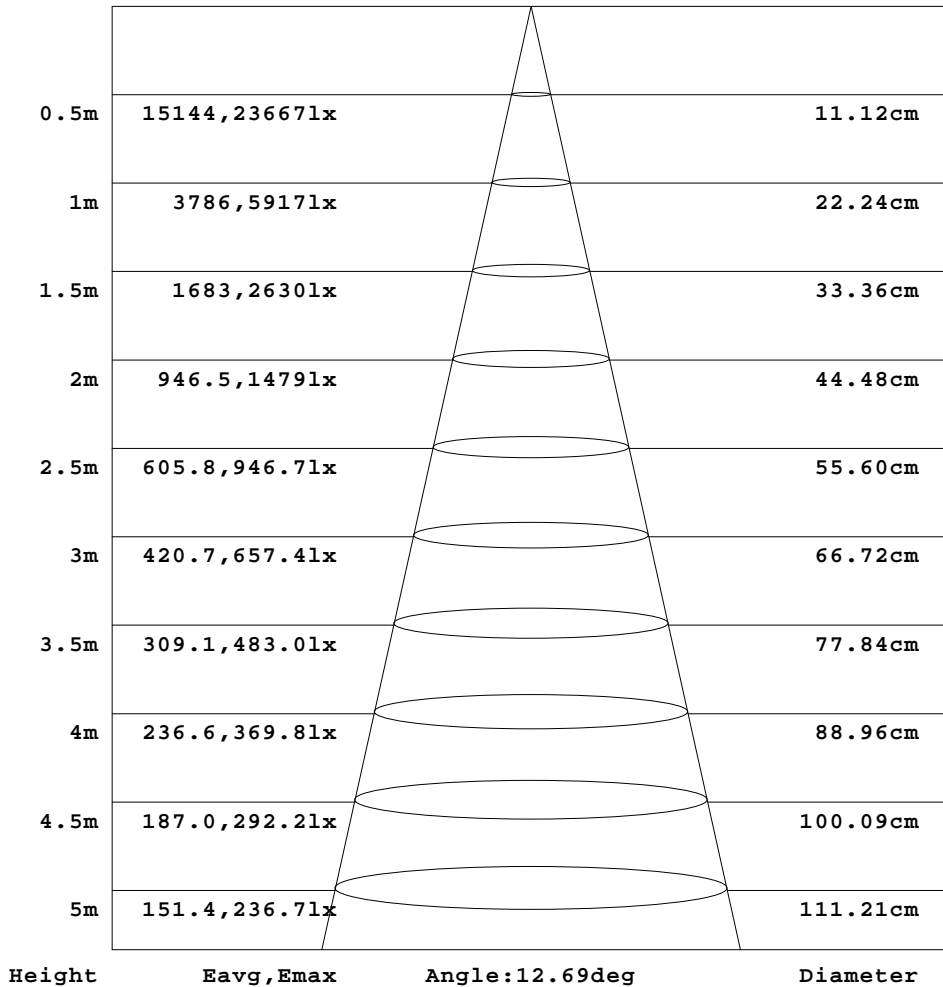

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-11

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.12V I:0.1609A P:15.555W PF:0.4393 Freq:50.00Hz Lamp Flux:572.459x1 lm		
NAME: 6419	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: ϕ 12*8.7cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:12°

Table--1

UNIT: cd

H(DEG) V(DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.13	1.21	1.23	1.23	1.24	1.25	1.26	1.29	1.31	1.33	1.35	1.37	1.39	1.41	1.43	1.46	1.49	1.52	1.51
-75	1.21	1.27	1.34	1.35	1.37	1.39	1.41	1.44	1.47	1.50	1.54	1.58	1.63	1.67	1.72	1.76	1.82	1.83	1.85
-70	1.35	1.43	1.47	1.52	1.53	1.56	1.59	1.63	1.67	1.72	1.77	1.84	1.93	1.99	2.07	2.13	2.16	2.19	2.16
-65	1.39	1.42	1.49	1.53	1.58	1.62	1.66	1.72	1.78	1.87	1.99	2.15	2.33	2.54	2.74	2.94	3.11	3.22	3.26
-60	1.45	1.51	1.55	1.63	1.68	1.73	1.79	1.87	1.98	2.16	2.38	2.65	2.99	3.33	3.68	3.97	4.21	4.33	4.31
-55	1.36	1.36	1.42	1.47	1.54	1.60	1.68	1.79	1.94	2.14	2.47	2.95	3.72	4.68	5.66	7.07	7.87	8.13	8.05
-50	1.24	1.29	1.34	1.40	1.46	1.55	1.68	1.86	2.11	2.49	3.08	4.05	5.61	7.11	9.32	11.3	12.0	12.0	11.3
-45	1.31	1.32	1.38	1.44	1.50	1.57	1.67	1.80	2.00	2.41	3.68	5.44	8.53	11.9	15.8	19.7	23.6	25.6	24.6
-40	1.36	1.43	1.49	1.55	1.62	1.70	1.81	1.96	2.24	3.64	6.08	10.4	15.6	22.0	26.6	33.0	38.9	38.8	34.7
-35	1.41	1.43	1.53	1.63	1.74	1.88	2.07	2.27	2.91	4.64	8.14	14.1	19.5	30.2	41.5	52.5	62.1	69.5	69.5
-30	1.47	1.57	1.69	1.83	2.03	2.27	2.56	3.04	5.44	9.28	17.9	23.3	35.1	52.8	70.2	83.4	96.1	102	97.0
-25	1.50	1.55	1.68	1.84	2.05	2.34	2.75	3.36	5.80	10.2	18.5	28.2	40.9	60.9	84.8	118	148	174	181
-20	1.56	1.69	1.86	2.08	2.41	2.86	3.54	6.03	10.8	20.0	31.7	44.7	71.9	93.0	141	189	232	261	259
-15	1.55	1.63	1.79	2.01	2.32	2.77	3.44	4.97	9.57	17.3	30.5	44.0	71.6	108	161	239	336	541	725
-10	1.60	1.76	1.97	2.28	2.73	3.44	4.63	9.04	15.8	28.7	45.8	70.5	117	176	271	399	638	1104	1097
-5	1.55	1.67	1.85	2.11	2.48	3.04	3.89	6.24	11.8	23.2	36.1	56.3	93.1	145	235	373	789	2209	3538
0	1.63	1.80	2.03	2.36	2.83	3.60	5.14	9.76	18.0	32.4	47.5	83.2	126	211	356	672	2396	5291	5501
5	1.55	1.66	1.85	2.11	2.47	3.03	3.90	6.28	11.7	23.7	33.9	56.8	92.6	138	234	382	804	2212	3545
10	1.58	1.74	1.96	2.27	2.73	3.42	4.85	8.81	15.9	29.0	40.1	75.0	104	167	281	419	671	1111	1110
15	1.53	1.61	1.78	2.00	2.31	2.76	3.50	5.30	9.45	17.6	28.4	43.0	69.5	102	166	246	355	543	731
20	1.53	1.67	1.86	2.08	2.40	2.92	3.89	6.14	10.6	20.9	29.3	42.6	68.1	104	142	191	239	256	258
25	1.45	1.53	1.66	1.83	2.03	2.33	2.78	3.73	6.07	10.4	18.8	27.6	41.3	60.7	86.5	114	145	164	177
30	1.44	1.56	1.67	1.80	1.99	2.23	2.60	3.65	6.06	9.97	18.2	26.4	36.4	46.1	63.0	76.0	77.5	88.0	95.6
35	1.34	1.43	1.51	1.60	1.71	1.84	2.04	2.36	3.25	5.23	8.95	15.5	21.3	29.5	37.9	48.3	52.4	56.2	63.9
40	1.35	1.41	1.47	1.53	1.58	1.67	1.81	1.97	2.43	4.33	7.42	10.6	15.9	22.3	25.5	26.8	30.6	34.0	35.4
45	1.28	1.34	1.38	1.42	1.48	1.52	1.62	1.76	1.94	2.50	3.95	5.70	8.18	12.1	15.6	17.0	19.0	21.4	23.1
50	1.28	1.32	1.35	1.38	1.42	1.49	1.59	1.75	1.92	2.15	2.52	3.57	4.92	6.38	7.85	9.21	10.2	10.9	12.3
55	1.32	1.34	1.38	1.41	1.46	1.50	1.57	1.68	1.82	1.98	2.17	2.53	3.27	4.03	4.91	5.58	6.57	6.88	7.21
60	1.37	1.41	1.45	1.50	1.54	1.60	1.67	1.77	1.89	2.02	2.17	2.34	2.53	2.71	2.90	3.08	3.18	3.20	3.12
65	1.42	1.43	1.47	1.51	1.55	1.59	1.64	1.71	1.79	1.88	1.98	2.08	2.20	2.32	2.44	2.55	2.63	2.68	2.67
70	1.46	1.50	1.53	1.58	1.61	1.65	1.70	1.75	1.80	1.86	1.91	1.96	2.01	2.05	2.10	2.13	2.14	2.16	2.15
75	1.49	1.50	1.54	1.56	1.60	1.61	1.65	1.68	1.72	1.75	1.78	1.82	1.85	1.88	1.91	1.93	1.95	1.95	1.95
80	1.53	1.56	1.57	1.59	1.61	1.61	1.64	1.67	1.67	1.69	1.71	1.72	1.73	1.73	1.75	1.75	1.75	1.76	1.75
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-11

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.12V I:0.1609A P:15.555W PF:0.4393 Freq:50.00Hz Lamp Flux:572.459x1 lm		
NAME: 6419	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: $\phi 12 \times 8.7\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:12°

Table--2

UNIT: cd

H(DEG) V(DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.47	1.43	1.39	1.36	1.33	1.32	1.29	1.27	1.26	1.23	1.21	1.20	1.18	1.18	1.18	1.17	1.12	1.06
-75	1.82	1.77	1.71	1.64	1.60	1.54	1.48	1.45	1.40	1.36	1.34	1.30	1.28	1.27	1.25	1.23	1.21	1.16
-70	2.11	2.04	1.95	1.87	1.78	1.68	1.62	1.56	1.51	1.46	1.41	1.39	1.37	1.32	1.31	1.29	1.24	1.22
-65	3.20	3.06	2.85	2.59	2.34	2.12	1.93	1.80	1.69	1.60	1.54	1.49	1.46	1.43	1.41	1.40	1.37	1.33
-60	4.14	3.84	3.43	3.02	2.62	2.32	2.08	1.90	1.77	1.67	1.60	1.56	1.52	1.51	1.48	1.47	1.42	1.41
-55	7.71	7.27	6.47	5.43	4.39	3.50	2.60	2.13	1.87	1.70	1.58	1.49	1.44	1.40	1.37	1.36	1.34	1.30
-50	10.9	9.85	8.24	6.55	5.07	3.58	2.45	2.01	1.76	1.57	1.45	1.36	1.31	1.27	1.24	1.23	1.19	1.20
-45	22.6	20.3	18.2	16.2	12.6	9.07	6.78	3.93	2.43	1.75	1.52	1.40	1.34	1.29	1.26	1.25	1.23	1.20
-40	31.9	28.3	26.4	21.9	15.5	11.9	7.30	3.91	2.08	1.61	1.45	1.35	1.30	1.29	1.26	1.25	1.23	1.23
-35	62.1	56.5	50.6	40.3	31.0	22.7	15.6	10.1	5.30	2.93	1.98	1.64	1.51	1.44	1.38	1.35	1.32	1.27
-30	84.9	79.7	63.6	46.5	36.7	24.7	16.9	10.8	5.42	2.87	2.02	1.75	1.61	1.52	1.46	1.41	1.34	1.35
-25	170	146	117	88.3	64.2	44.5	31.8	20.3	11.6	6.17	3.34	2.28	1.89	1.71	1.59	1.51	1.45	1.38
-20	224	181	136	98.5	66.7	47.5	33.6	18.4	11.1	5.58	3.21	2.25	1.92	1.73	1.61	1.53	1.45	1.40
-15	586	357	242	163	114	75.0	46.8	32.7	18.4	10.2	5.21	3.06	2.27	1.95	1.78	1.66	1.61	1.54
-10	636	389	246	162	114	62.3	44.6	27.3	15.8	8.17	4.34	2.68	2.20	1.93	1.77	1.71	1.77	1.58
-5	2700	1055	402	238	152	99.9	56.1	41.9	22.9	13.3	6.80	3.61	2.52	2.12	1.90	1.82	1.96	1.96
0	2599	682	338	195	129	75.4	50.9	31.3	18.7	9.69	4.97	2.88	2.31	2.01	1.88	2.06	2.32	2.14
5	2702	1055	405	237	149	98.3	61.4	40.8	24.2	14.2	7.12	3.53	2.51	2.13	1.90	1.82	1.93	1.93
10	633	393	248	157	107	71.0	45.6	27.3	18.5	9.01	4.30	2.64	2.20	1.94	1.77	1.68	1.63	1.55
15	586	353	240	160	112	72.6	52.5	32.2	20.9	11.7	5.75	2.88	2.24	1.95	1.76	1.64	1.57	1.49
20	219	170	126	103	67.3	46.7	34.5	20.7	12.9	6.54	2.95	2.20	1.90	1.72	1.59	1.51	1.42	1.37
25	170	142	109	84.9	64.0	43.7	33.2	20.9	13.2	7.13	3.46	2.16	1.86	1.68	1.56	1.47	1.41	1.35
30	89.9	74.7	60.3	43.7	33.3	27.5	17.1	10.4	5.95	2.79	1.93	1.71	1.58	1.49	1.42	1.38	1.32	1.27
35	65.6	60.9	50.0	40.1	28.0	22.4	16.2	9.86	5.79	3.26	1.87	1.59	1.48	1.40	1.34	1.30	1.28	1.23
40	37.4	33.8	28.7	21.8	14.8	11.5	6.31	4.12	2.21	1.61	1.41	1.32	1.26	1.23	1.21	1.20	1.18	1.16
45	24.5	23.8	20.7	17.4	11.9	8.61	6.36	3.80	2.51	1.71	1.47	1.33	1.26	1.21	1.19	1.17	1.16	1.13
50	11.9	10.2	9.24	6.59	4.67	3.57	2.56	1.95	1.64	1.47	1.34	1.25	1.21	1.16	1.13	1.13	1.10	1.09
55	7.70	6.99	6.21	5.52	4.00	3.22	2.59	2.07	1.77	1.59	1.47	1.36	1.29	1.25	1.22	1.20	1.18	1.16
60	2.99	2.82	2.64	2.46	2.28	2.11	1.94	1.79	1.66	1.55	1.46	1.40	1.35	1.30	1.26	1.24	1.22	1.18
65	2.61	2.51	2.41	2.29	2.17	2.05	1.93	1.81	1.71	1.62	1.55	1.49	1.43	1.39	1.36	1.33	1.31	1.28
70	2.13	2.10	2.04	1.97	1.91	1.84	1.77	1.71	1.65	1.60	1.55	1.51	1.47	1.44	1.41	1.39	1.35	1.34
75	1.95	1.93	1.91	1.87	1.82	1.79	1.74	1.69	1.65	1.61	1.57	1.55	1.52	1.49	1.47	1.44	1.42	1.40
80	1.75	1.73	1.72	1.70	1.68	1.66	1.64	1.62	1.60	1.58	1.57	1.54	1.53	1.50	1.50	1.48	1.45	1.45
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-11

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks: