

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		2140.7 cd per klm. 0.0 degrees vertical -2.0 degrees horizontal
Beam Spread	At 10% of Imax	63.6V x 62.4H
	At 50% of Imax	32.7V x 33.3H
	At 90% of Imax	10.3V x 13.2H
Beam Flux	Total	999.3 lumens per klm.
	To 10% of Imax	724.3 lumens per klm.
	To 50% of Imax	382.4 lumens per klm.
	To 90% of Imax	49.4 lumens per klm.
	Upward LOR	0.0 %
	Downward LOR	99.9 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-15

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.18V I:0.1593A P:15.457W PF:0.4406 Freq:50.00Hz Lamp Flux:254.306x1 lm		
NAME: 6623	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: $\phi 12 \times 8.7\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

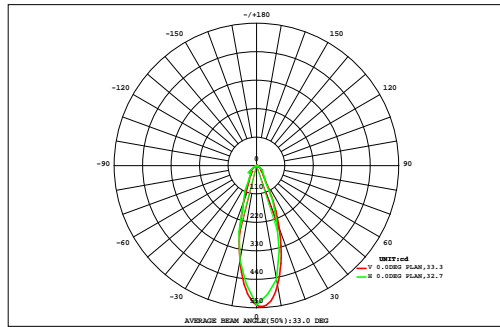

DATA OF LAMP		Eff:16.45lm/W	
MODEL		Imax(cd)	544.4
NOMINAL POWER(W)		AVAILABILITY(%)	73.1
RATED VOLTAGE(V)		Avai. FLUX(lm)	186.0
NOMINAL FLUX(lm)	254.306	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	254.3
TEST VOLTAGE(V)	0	q @50%(H,V)	33,33DEG

VERTICAL(DEG)	AREA FLUX DIAGRAM															UNIT:lm		F t	F a	
	90	80	70	60	50	40	30	20	10	0	10	20	30	40	50	60	70			80
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
80	0.00	0.01	0.02	0.02	0.03	0.04	0.05	0.05	0.06	0.06	0.05	0.05	0.04	0.03	0.02	0.02	0.01	0.00	0.56	0.00
70	0.00	0.01	0.02	0.02	0.04	0.05	0.07	0.10	0.12	0.11	0.10	0.08	0.06	0.04	0.02	0.01	0.01	0.00	0.86	0.00
60	0.00	0.01	0.02	0.03	0.06	0.13	0.31	0.47	0.57	0.63	0.58	0.40	0.20	0.07	0.03	0.02	0.01	0.00	3.53	0.00
50	0.00	0.01	0.02	0.05	0.15	0.47	0.86	1.03	1.19	1.37	1.37	1.06	0.60	0.18	0.05	0.02	0.01	0.00	8.44	0.83
40	0.00	0.01	0.03	0.09	0.40	0.88	1.06	1.08	1.18	1.24	1.31	1.23	1.04	0.43	0.08	0.03	0.01	0.00	10.1	0.55
30	0.00	0.01	0.04	0.16	0.58	0.79	1.18	2.09	2.87	2.75	1.79	1.09	1.00	0.72	0.14	0.04	0.01	0.00	15.3	8.90
20	0.00	0.01	0.05	0.24	0.56	0.93	1.91	4.54	7.12	6.82	3.98	1.63	0.88	0.85	0.23	0.05	0.01	0.00	29.8	25.2
10	0.00	0.01	0.06	0.28	0.55	1.14	3.22	8.66	13.4	12.7	6.95	2.35	0.96	0.81	0.29	0.05	0.01	0.00	51.5	47.7
0	0.00	0.01	0.06	0.27	0.54	1.12	3.81	10.1	15.3	14.3	7.83	2.51	0.96	0.72	0.28	0.05	0.01	0.00	57.9	54.0
-10	0.00	0.01	0.05	0.23	0.50	0.95	2.76	7.02	10.4	9.45	5.00	1.85	0.82	0.66	0.22	0.04	0.01	0.00	40.0	35.9
-20	0.00	0.01	0.04	0.15	0.43	0.69	1.31	2.80	4.09	3.65	2.01	1.13	0.74	0.56	0.14	0.04	0.01	0.00	17.8	12.7
-30	0.00	0.01	0.03	0.09	0.29	0.50	0.72	0.94	1.05	1.08	0.95	0.82	0.71	0.38	0.08	0.03	0.01	0.00	7.70	0.26
-40	0.00	0.01	0.02	0.05	0.15	0.34	0.54	0.73	0.91	0.91	0.75	0.66	0.52	0.15	0.05	0.02	0.01	0.00	5.83	0.00
-50	0.00	0.01	0.02	0.03	0.06	0.16	0.33	0.47	0.62	0.69	0.57	0.41	0.13	0.06	0.03	0.02	0.01	0.00	3.64	0.00
-60	0.00	0.01	0.02	0.02	0.03	0.04	0.05	0.08	0.21	0.20	0.08	0.05	0.04	0.03	0.02	0.01	0.01	0.00	0.91	0.00
-70	0.00	0.01	0.01	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.01	0.01	0.00	0.38	0.00
-80	0.00	0.00	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0.02	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.18	0.00
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
F t	0.05	0.18	0.51	1.78	4.41	8.27	18.2	40.2	59.1	56.1	33.4	15.3	8.74	5.71	1.74	0.46	0.16	0.05	254	---
F a	0.00	0.00	0.00	0.00	0.00	0.76	11.6	34.8	53.6	50.4	27.0	7.65	0.26	0.00	0.00	0.00	0.00	0.00	---	186


one-half-peak spread: U:18.0,D:14.9 , L:17.5,R:16.1 NEMA Beam Type: Type 4

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-15

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.18V I:0.1593A P:15.457W PF:0.4406 Freq:50.00Hz Lamp Flux:254.306x1 lm		
NAME: 6623	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: ϕ 12*8.7cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

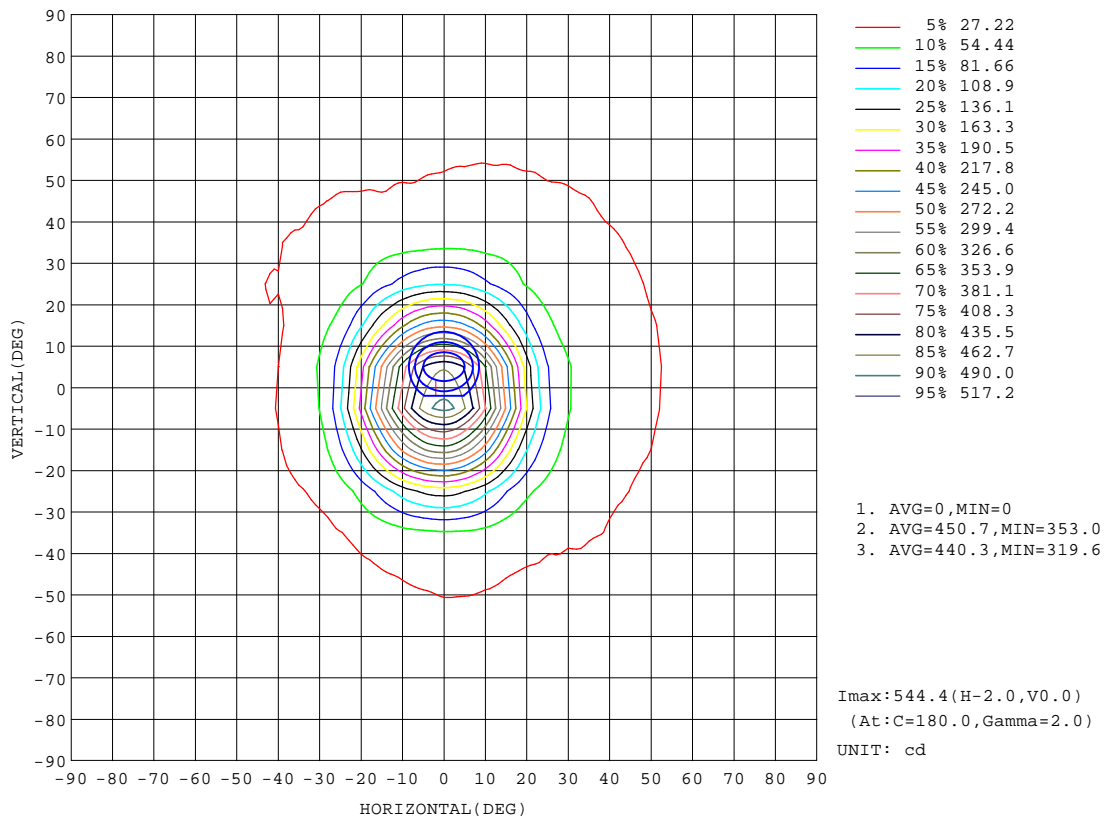


H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:AED
 Test Date:2024-04-15

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM


Test:U:220.18V I:0.1593A P:15.457W PF:0.4406 Freq:50.00Hz Lamp Flux:254.306x1 lm		
NAME: 6623	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: $\phi 12 \times 8.7\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

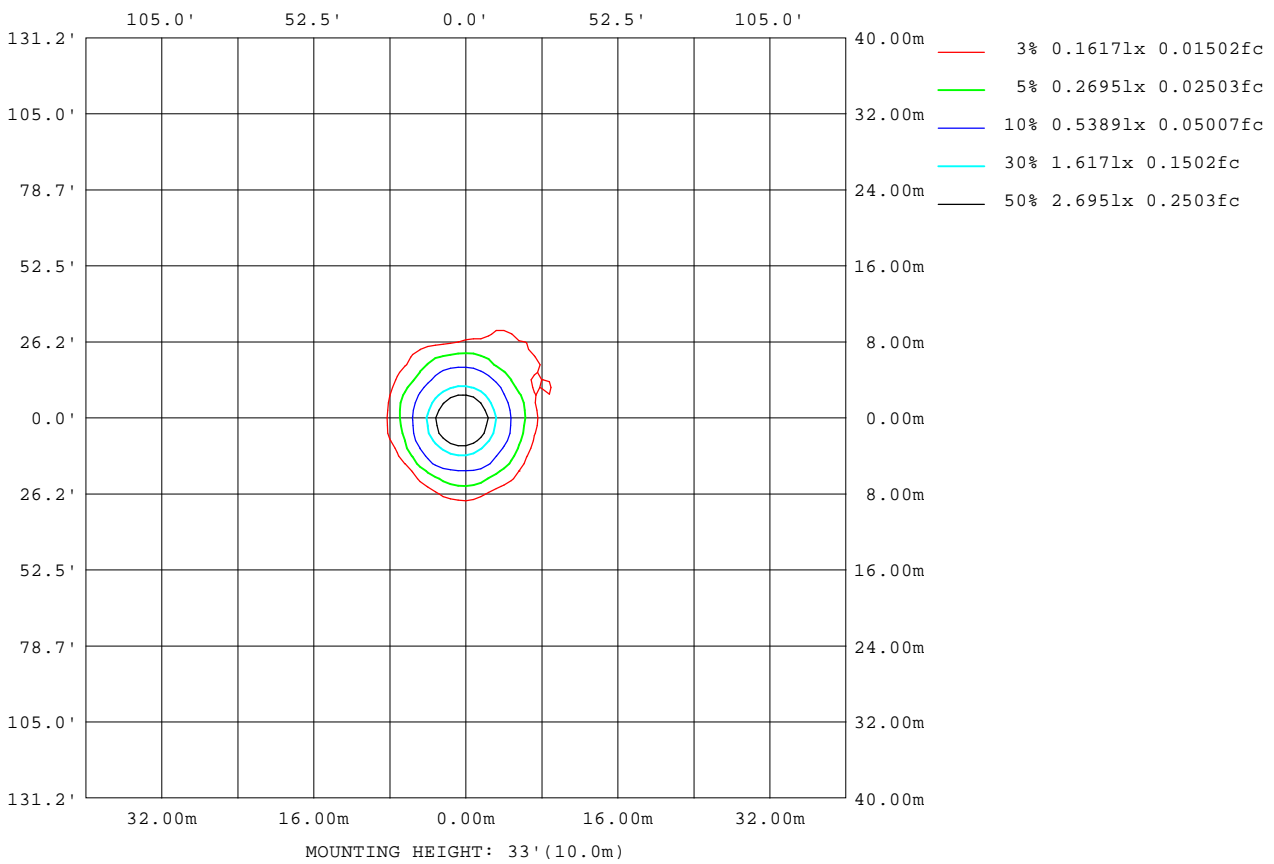

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-15

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

Planar Illuminance Curve

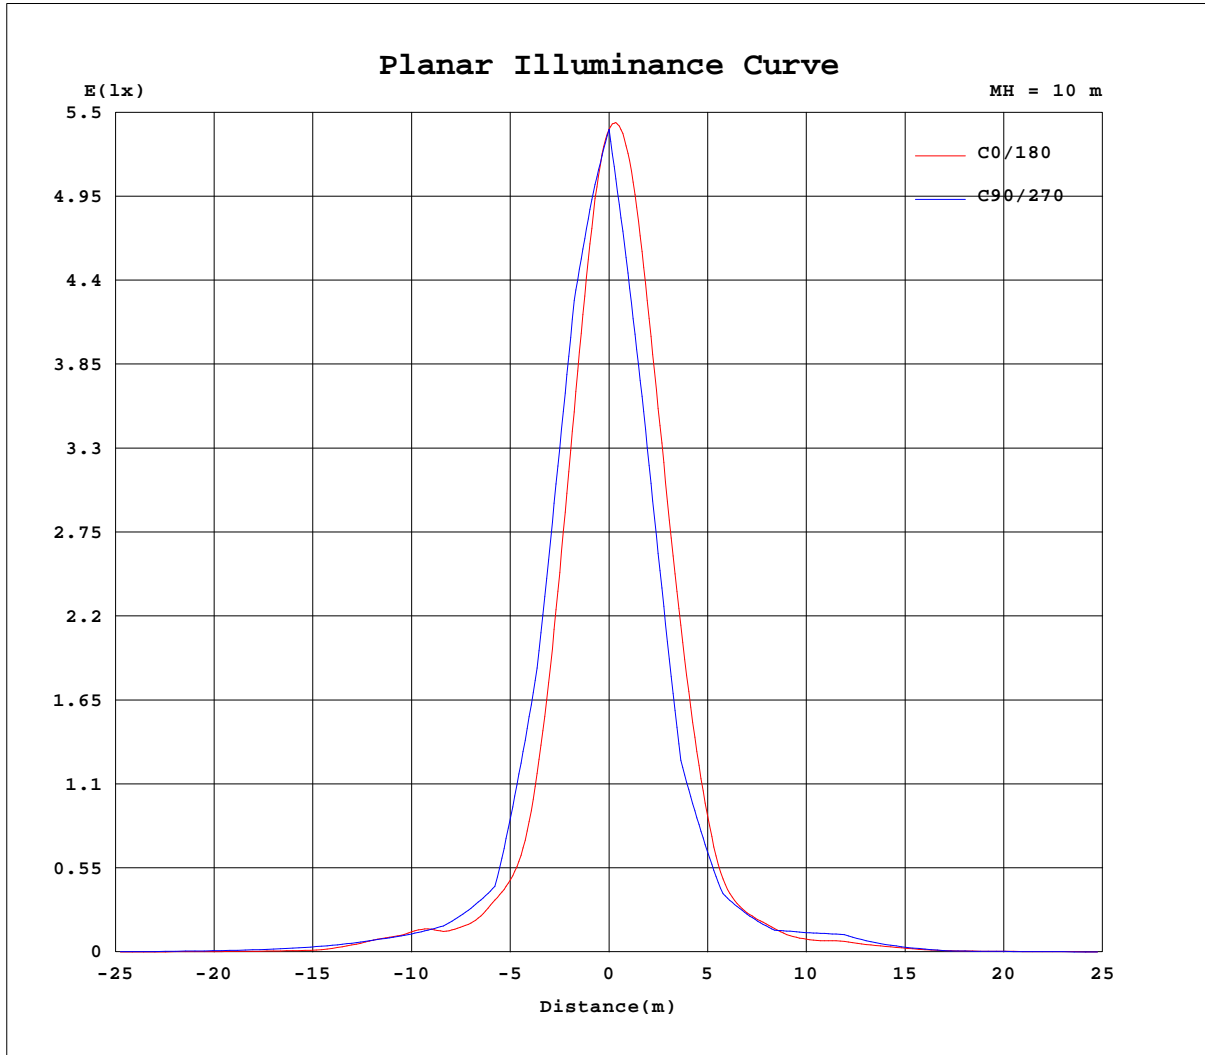


H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-15

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.18V I:0.1593A P:15.457W PF:0.4406 Freq:50.00Hz Lamp Flux:254.306x1 lm		
NAME: 6623	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: $\phi 12 \times 8.7\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Flux out:97.69 lm

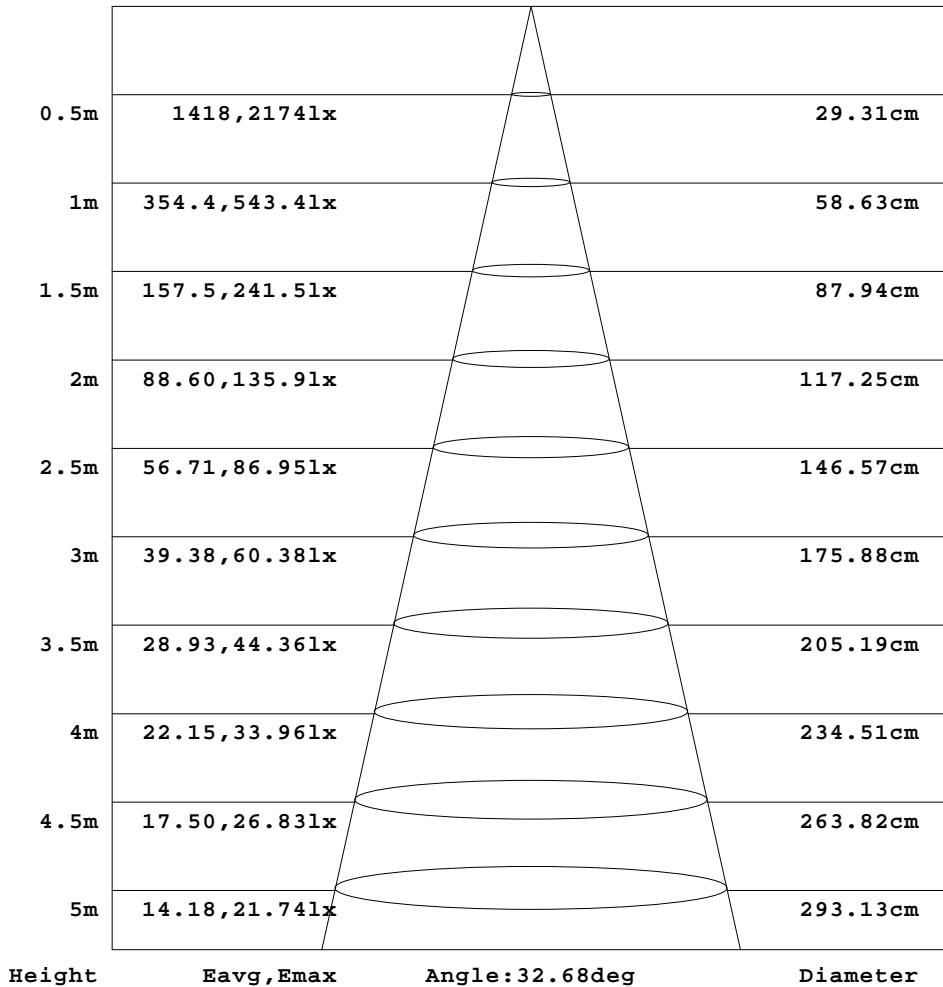

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(β) Range:-90 - 90DEG
 H(β) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:AED
 Test Date:2024-04-15

V(B) Range:-80 - 80DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.780m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.18V I:0.1593A P:15.457W PF:0.4406 Freq:50.00Hz Lamp Flux:254.306x1 lm		
NAME: 6623	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: ϕ 12*8.7cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--1

UNIT: cd

H(DEG) V(DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.93	0.96	1.02	1.04	1.04	1.06	1.07	1.09	1.11	1.12	1.15	1.17	1.19	1.22	1.22	1.23	1.25	1.25	1.24
-75	0.91	0.94	1.00	1.04	1.06	1.08	1.11	1.14	1.18	1.22	1.27	1.33	1.37	1.41	1.48	1.55	1.61	1.62	1.61
-70	0.94	0.96	1.02	1.05	1.06	1.11	1.17	1.20	1.28	1.39	1.44	1.52	1.52	1.69	1.78	1.92	1.99	2.00	1.98
-65	0.94	0.96	1.04	1.07	1.13	1.18	1.27	1.38	1.50	1.66	1.87	2.14	2.48	2.81	3.17	3.58	4.85	7.09	8.40
-60	0.96	1.02	1.07	1.14	1.19	1.31	1.44	1.61	1.84	2.11	2.50	3.03	3.63	4.25	4.88	5.96	9.23	13.5	14.2
-55	0.96	0.98	1.07	1.12	1.21	1.35	1.58	1.87	2.25	2.87	3.74	5.75	8.34	10.6	12.1	14.3	16.0	19.5	22.2
-50	0.96	1.02	1.10	1.17	1.32	1.59	1.93	2.40	3.09	4.25	6.45	10.6	15.2	18.2	19.9	24.1	25.5	27.6	29.8
-45	0.98	1.00	1.10	1.18	1.36	1.68	2.15	2.81	3.69	5.45	10.0	13.1	15.4	19.9	22.1	25.7	29.2	31.9	33.7
-40	0.99	1.07	1.15	1.31	1.62	2.13	2.85	3.85	5.23	10.2	16.9	16.8	19.7	22.9	26.0	30.2	35.9	37.4	38.2
-35	1.01	1.03	1.14	1.27	1.61	2.20	3.12	4.30	6.74	12.4	17.5	20.3	20.8	26.8	32.7	38.7	45.4	49.6	52.1
-30	1.02	1.11	1.20	1.44	2.00	2.95	4.30	5.78	13.7	18.3	21.5	23.3	25.2	34.5	44.8	52.0	59.0	64.2	66.4
-25	1.04	1.08	1.20	1.39	1.90	2.84	4.31	5.94	13.2	20.3	20.9	26.0	32.1	43.4	63.4	92.3	121	140	147
-20	1.05	1.16	1.31	1.65	2.43	3.84	5.66	10.7	21.8	21.9	25.7	32.2	45.7	65.5	104	156	202	226	224
-15	1.06	1.12	1.25	1.50	2.16	3.47	5.35	9.11	19.7	22.2	25.4	34.5	45.8	77.2	135	208	277	325	340
-10	1.06	1.18	1.32	1.75	2.76	4.53	6.62	16.7	24.1	21.8	33.2	42.5	64.1	129	223	318	397	444	447
-5	1.05	1.13	1.27	1.55	2.29	3.82	5.90	12.4	22.3	22.6	28.5	41.0	55.3	108	199	302	400	473	499
0	1.07	1.20	1.35	1.81	2.82	4.71	6.88	18.3	26.6	24.1	34.3	46.8	73.9	153	258	370	470	534	539
5	1.04	1.13	1.26	1.54	2.27	3.79	5.87	13.2	22.7	25.1	27.2	41.5	57.1	98.3	181	275	367	436	460
10	1.05	1.18	1.32	1.72	2.68	4.49	6.59	17.7	25.4	24.0	31.4	47.0	61.5	104	178	257	327	368	371
15	1.04	1.13	1.24	1.47	2.09	3.36	5.24	10.7	21.3	27.0	25.5	36.5	48.4	64.6	106	160	213	252	265
20	1.06	1.16	1.29	1.61	2.31	3.68	5.49	13.5	22.3	28.2	25.5	36.0	44.7	54.0	75.9	105	134	152	152
25	1.03	1.11	1.19	1.36	1.81	2.68	4.18	6.79	16.4	24.9	27.8	30.9	37.3	42.5	53.2	73.0	89.9	103	106
30	1.00	1.11	1.19	1.40	1.87	2.75	4.18	6.96	16.5	26.6	32.5	29.4	34.3	38.0	45.2	55.2	58.2	59.4	58.8
35	0.98	1.07	1.12	1.25	1.53	2.06	3.01	4.36	8.87	16.1	25.9	30.8	35.0	37.4	37.9	40.7	42.2	43.6	45.2
40	1.00	1.08	1.14	1.26	1.52	2.01	2.80	4.07	5.75	14.7	24.9	35.4	36.3	37.5	32.0	27.9	27.2	29.3	31.9
45	0.98	1.03	1.09	1.16	1.31	1.60	2.10	2.89	3.94	6.91	12.9	19.2	26.2	30.9	30.6	29.7	31.9	33.5	36.1
50	0.98	1.05	1.10	1.16	1.28	1.52	1.93	2.47	3.30	4.34	5.46	9.70	18.5	24.4	29.7	33.3	36.2	40.0	43.0
55	0.94	1.02	1.08	1.12	1.19	1.32	1.56	1.89	2.36	2.98	3.72	4.83	9.34	13.2	16.0	17.7	21.5	22.6	23.7
60	0.96	1.04	1.10	1.12	1.17	1.27	1.43	1.64	1.90	2.21	2.57	3.05	3.66	4.26	4.80	5.79	6.43	6.38	6.23
65	0.91	1.02	1.07	1.10	1.13	1.19	1.27	1.38	1.52	1.70	1.92	2.17	2.50	2.86	3.19	3.61	4.19	4.21	4.24
70	1.03	1.05	1.08	1.10	1.11	1.15	1.19	1.24	1.31	1.37	1.47	1.55	1.63	1.73	1.85	1.96	2.09	2.17	2.17
75	0.98	1.02	1.06	1.08	1.10	1.12	1.14	1.17	1.20	1.23	1.28	1.32	1.36	1.41	1.47	1.53	1.60	1.65	1.69
80	1.01	1.06	1.07	1.08	1.08	1.09	1.11	1.12	1.13	1.14	1.12	1.14	1.15	1.15	1.15	1.17	1.18	1.18	1.20
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-15

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.18V I:0.1593A P:15.457W PF:0.4406 Freq:50.00Hz Lamp Flux:254.306x1 lm		
NAME: 6623	TYPE:	WEIGHT:690g
SPEC.:15W	DIM.: $\phi 12 \times 8.7\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--2

UNIT: cd

H(DEG) V(DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.24	1.23	1.20	1.19	1.18	1.16	1.15	1.14	1.12	1.11	1.08	1.07	1.06	1.05	1.04	0.97	0.91	0.95
-75	1.61	1.57	1.53	1.50	1.46	1.41	1.36	1.31	1.26	1.20	1.15	1.11	1.10	1.07	1.05	1.02	0.95	0.93
-70	1.96	1.90	1.84	1.79	1.71	1.63	1.53	1.44	1.34	1.26	1.19	1.12	1.10	1.08	1.04	1.00	0.95	0.95
-65	7.80	6.22	4.40	3.57	3.20	2.85	2.50	2.18	1.92	1.64	1.41	1.26	1.18	1.11	1.07	1.03	0.98	0.95
-60	12.6	8.94	6.04	5.01	4.40	3.78	3.20	2.72	2.25	1.82	1.51	1.31	1.19	1.11	1.06	1.03	0.94	0.97
-55	21.8	20.2	17.6	14.9	14.0	10.8	6.79	4.62	3.76	2.89	2.11	1.64	1.37	1.19	1.11	1.04	0.98	0.95
-50	30.3	30.0	26.9	23.9	23.2	15.0	7.81	5.80	4.60	3.30	2.29	1.72	1.39	1.20	1.08	1.02	0.94	0.94
-45	33.5	31.6	28.2	25.6	23.9	23.4	20.0	14.2	8.41	4.85	3.45	2.37	1.72	1.34	1.16	1.05	0.98	0.94
-40	35.9	31.3	27.2	26.3	26.0	31.5	26.0	18.5	8.20	5.21	3.70	2.41	1.71	1.31	1.13	1.04	0.96	0.95
-35	50.9	46.5	39.2	34.8	31.2	29.5	29.1	25.6	18.5	9.92	5.23	3.49	2.26	1.59	1.25	1.09	1.01	0.95
-30	63.5	55.2	47.1	41.3	34.4	28.3	30.6	27.5	21.9	9.70	5.13	3.44	2.18	1.52	1.20	1.08	0.96	0.96
-25	137	114	83.3	59.1	46.3	34.7	28.9	30.4	26.9	18.9	8.47	4.72	2.97	1.88	1.37	1.14	1.06	0.97
-20	195	149	96.9	65.0	49.0	34.8	29.8	31.4	28.4	18.3	7.23	4.53	2.69	1.74	1.31	1.13	1.02	1.00
-15	314	256	179	110	69.1	46.9	32.1	31.2	30.7	27.1	12.9	5.64	3.62	2.16	1.50	1.21	1.12	1.01
-10	392	304	201	117	69.8	45.1	31.4	33.2	30.7	25.1	9.49	5.11	3.11	1.93	1.41	1.19	1.08	1.02
-5	464	381	270	162	88.8	56.9	37.4	30.7	36.0	31.5	16.9	6.14	4.00	2.32	1.57	1.23	1.14	1.03
0	479	371	249	141	75.0	52.6	34.5	30.1	37.4	29.7	10.5	5.41	3.29	1.98	1.39	1.17	1.07	1.03
5	432	354	250	151	83.2	56.9	38.6	29.6	41.3	33.6	17.6	6.12	3.98	2.33	1.57	1.23	1.12	1.02
10	332	255	167	96.2	63.2	47.4	32.6	35.3	44.2	28.2	7.92	5.07	3.08	1.94	1.39	1.16	1.08	1.02
15	249	205	147	94.9	60.7	44.7	34.0	35.0	43.0	31.3	12.1	5.49	3.59	2.19	1.49	1.19	1.10	1.00
20	135	107	82.4	60.4	42.4	32.6	32.8	44.7	39.6	21.7	6.04	4.34	2.72	1.75	1.28	1.10	1.03	0.97
25	101	85.5	68.1	52.0	41.0	37.4	37.6	42.2	37.7	20.3	6.48	4.43	2.95	1.93	1.36	1.13	1.04	0.96
30	55.7	49.7	40.1	33.7	34.4	43.3	43.7	39.9	24.4	6.51	4.63	3.30	2.17	1.52	1.20	1.04	0.97	0.88
35	45.2	43.5	43.7	42.3	39.9	43.8	43.1	34.9	23.1	8.86	4.45	3.28	2.28	1.61	1.22	1.06	1.00	0.92
40	34.0	37.3	45.8	47.9	47.3	43.4	35.7	21.9	7.37	4.55	3.32	2.39	1.73	1.31	1.08	0.99	0.92	0.94
45	38.3	40.4	44.0	43.2	37.6	35.2	28.6	16.7	8.78	4.17	3.08	2.31	1.72	1.34	1.09	1.00	0.98	0.91
50	45.0	44.5	41.6	36.1	26.6	20.2	11.7	5.28	3.93	2.87	2.20	1.69	1.35	1.12	1.03	0.96	0.91	0.93
55	24.9	25.9	25.1	21.1	16.5	13.2	9.27	4.63	3.28	2.53	1.98	1.64	1.34	1.17	1.05	1.00	0.98	0.94
60	5.89	5.45	5.13	4.79	4.34	3.75	3.00	2.45	2.04	1.73	1.50	1.32	1.18	1.08	1.04	1.02	0.94	0.94
65	4.14	3.88	3.66	3.42	3.15	2.81	2.39	2.02	1.75	1.54	1.38	1.26	1.16	1.10	1.06	1.02	0.99	0.96
70	2.14	2.12	2.01	1.87	1.72	1.56	1.44	1.35	1.28	1.22	1.16	1.12	1.08	1.06	1.03	1.02	0.96	0.95
75	1.69	1.67	1.62	1.55	1.46	1.39	1.31	1.25	1.20	1.16	1.12	1.10	1.08	1.06	1.04	1.02	0.99	0.98
80	1.20	1.19	1.19	1.17	1.15	1.13	1.12	1.10	1.08	1.07	1.06	1.05	1.06	1.04	1.03	1.01	0.99	0.96
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_(h) Range:-90 - 90DEG
H_(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2024-04-15

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks: