

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		2327.9 cd per klm. 0.0 degrees vertical 0.0 degrees horizontal
Beam Spread	At 10% of Imax	68.6V x 65.4H
	At 50% of Imax	33.8V x 31.6H
	At 90% of Imax	7.9V x 13.3H
Beam Flux	Total	997.6 lumens per klm.
	To 10% of Imax	837.1 lumens per klm.
	To 50% of Imax	414.3 lumens per klm.
	To 90% of Imax	54.0 lumens per klm.
	Upward LOR	0.0 %
	Downward LOR	99.8 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2023-06-30

V(B) Range:-45 - 45DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.31V I:0.0929A P:9.5886W PF:0.4684 Freq:50.00Hz Lamp Flux:563.371x1 lm		
NAME: 6449	TYPE:Indoor Lighting	WEIGHT:0.2kg
SPEC.:10W	DIM.: φ10*7*5.6cm	SERIAL No.:06
MFR.: NORDECOR	SUR.:3cm	Shielding Angle:24°

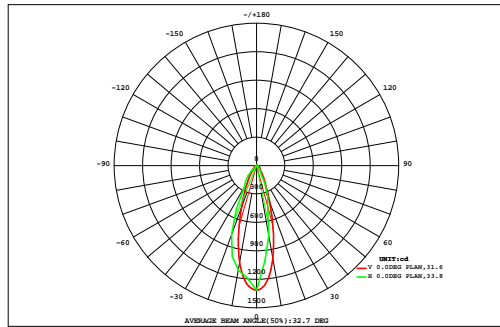

DATA OF LAMP		Eff:58.75lm/W	
MODEL		Imax(cd)	1311
NOMINAL POWER(W)	10W	AVAILABILITY(%)	84.8
RATED VOLTAGE(V)	220	Avai. FLUX(lm)	477.6
NOMINAL FLUX(lm)	563.371	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	563.4
TEST VOLTAGE(V)	220.2	q @50%(H,V)	32,34DEG

AREA FLUX DIAGRAM																		UNIT:lm		F t	F a		
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
40	0.00	0.00	0.02	0.09	0.25	0.46	0.77	1.18	1.57	1.68	1.50	1.10	0.68	0.38	0.19	0.05	0.00	0.00	0.00	0.00	0.00	9.93	0.79
30	0.00	0.01	0.05	0.20	0.51	1.07	2.17	3.84	5.59	6.04	4.87	3.05	1.59	0.73	0.32	0.10	0.01	0.00	0.00	0.00	0.00	30.2	18.7
	0.00	0.01	0.07	0.26	0.67	1.53	3.49	7.16	12.3	13.9	10.1	5.22	2.39	0.99	0.40	0.13	0.01	0.00	0.00	0.00	0.00	58.7	50.5
	0.00	0.01	0.09	0.33	0.81	2.07	5.33	13.3	26.2	29.6	19.4	8.26	3.36	1.26	0.47	0.15	0.02	0.00	0.00	0.00	0.00	111	104
	0.00	0.02	0.11	0.34	0.84	2.17	5.81	16.1	31.9	35.1	22.8	9.24	3.47	1.26	0.47	0.14	0.02	0.00	0.00	0.00	0.00	130	123
	0.00	0.02	0.12	0.34	0.80	2.04	5.51	15.7	30.1	32.5	20.8	8.41	3.16	1.17	0.44	0.12	0.02	0.00	0.00	0.00	0.00	121	114
	0.00	0.01	0.11	0.29	0.64	1.45	3.32	7.56	12.8	13.8	9.01	4.53	2.09	0.89	0.37	0.10	0.02	0.00	0.00	0.00	0.00	57.0	48.1
	0.00	0.01	0.08	0.23	0.48	0.97	1.96	3.85	6.05	6.46	4.57	2.56	1.31	0.64	0.29	0.08	0.01	0.00	0.00	0.00	0.00	29.6	18.2
-30	0.00	0.01	0.06	0.17	0.34	0.58	0.94	1.30	1.39	1.43	1.36	1.07	0.72	0.43	0.21	0.05	0.01	0.00	0.00	0.00	0.00	10.1	0.00
-40	0.00	0.00	0.03	0.12	0.23	0.38	0.56	0.74	0.85	0.88	0.79	0.63	0.45	0.29	0.14	0.04	0.00	0.00	0.00	0.00	0.00	6.14	0.00
-50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
-60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
-70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
-80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
	-90	-80	-70	-60	-50	-40	-30	-20	HORIZONTAL(DEG)	20	30	40	50	60	70	80	90						
F t	0.01	0.11	0.74	2.38	5.57	12.7	29.9	70.8	129	141	95.2	44.1	19.2	8.04	3.30	0.96	0.13	0.01	563	---			
F a	0.00	0.00	0.00	0.00	0.00	1.15	18.7	64.0	124	137	89.9	35.6	6.72	0.00	0.00	0.00	0.00	0.00	---	478			


one-half-peak spread: U:11.7,D:22.3 , L:15.4,R:16.4 NEMA Beam Type: Type 4

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2023-06-30

V(B) Range:-45 - 45DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.31V I:0.0929A P:9.5886W PF:0.4684 Freq:50.00Hz Lamp Flux:563.37lx1 lm		
NAME: 6449	TYPE:Indoor Lighting	WEIGHT:0.2kg
SPEC.:10W	DIM.: φ10*7*5.6cm	SERIAL No.:06
MFR.: NORDECOR	SUR.:3cm	Shielding Angle:24°

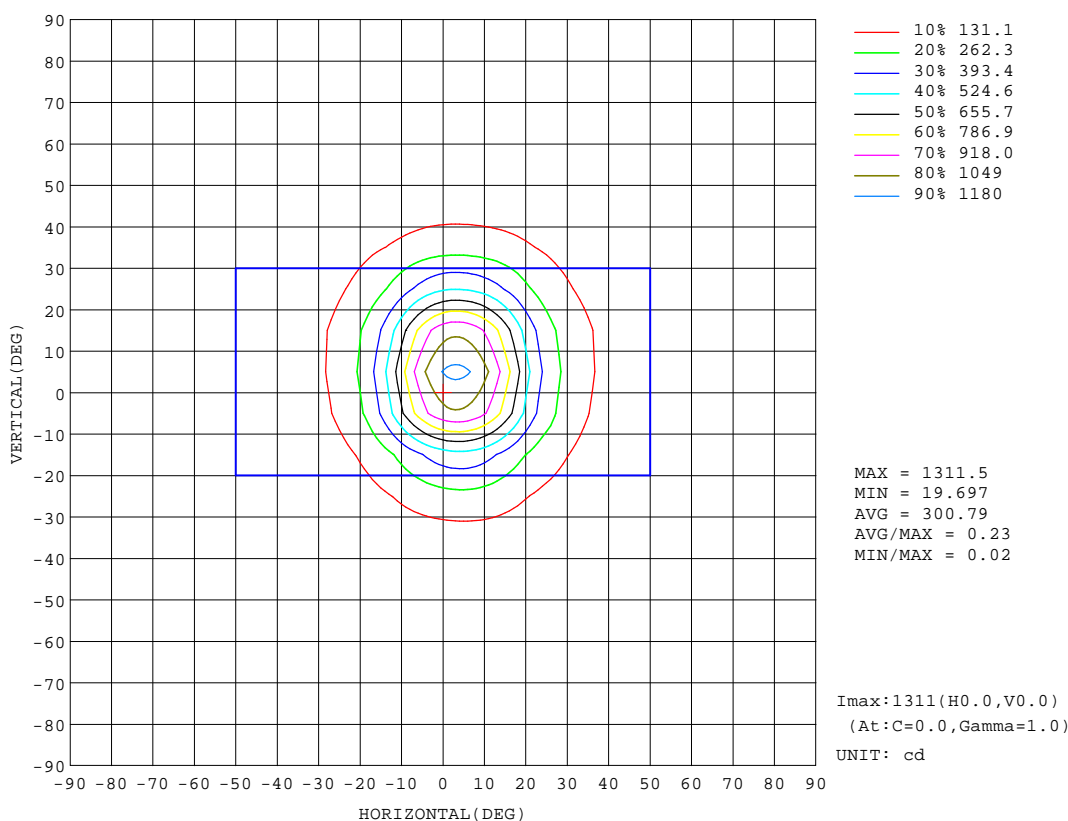


H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2023-06-30

V(B) Range:-45 - 45DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


Test:U:220.31V I:0.0929A P:9.5886W PF:0.4684 Freq:50.00Hz Lamp Flux:563.37lx1 lm		
NAME: 6449	TYPE:Indoor Lighting	WEIGHT:0.2kg
SPEC.:10W	DIM.: φ10*7*5.6cm	SERIAL No.:06
MFR.: NORDECOR	SUR.:3cm	Shielding Angle:24°

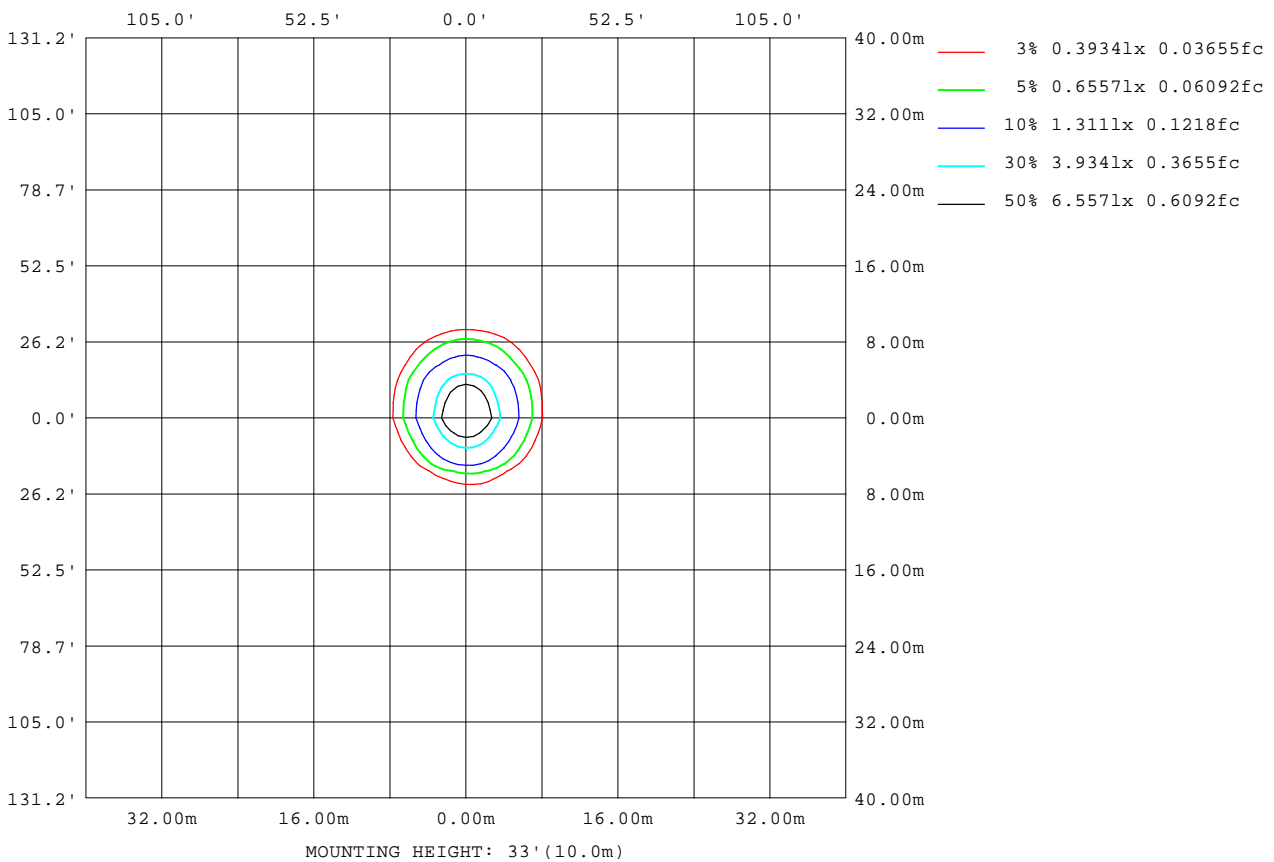

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2023-06-30

V(B) Range:-45 - 45DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

Planar Illuminance Curve

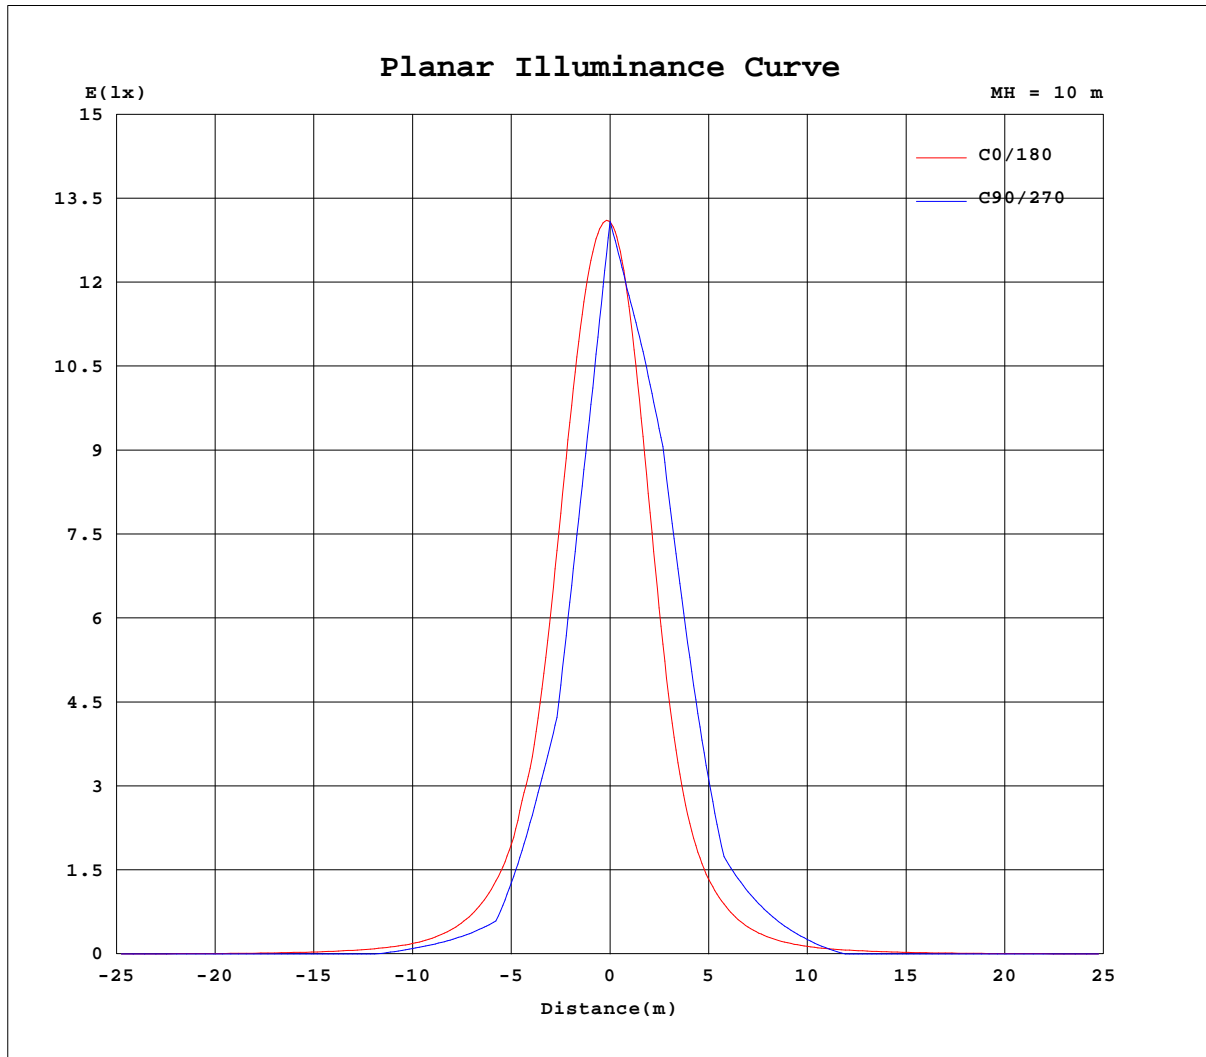


H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2023-06-30

V(B) Range:-45 - 45DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.31V I:0.0929A P:9.5886W PF:0.4684 Freq:50.00Hz Lamp Flux:563.371x1 lm		
NAME: 6449	TYPE:Indoor Lighting	WEIGHT:0.2kg
SPEC.:10W	DIM.: φ10*7*5.6cm	SERIAL No.:06
MFR.: NORDECOR	SUR.:3cm	Shielding Angle:24°

Flux out:217.3 lm

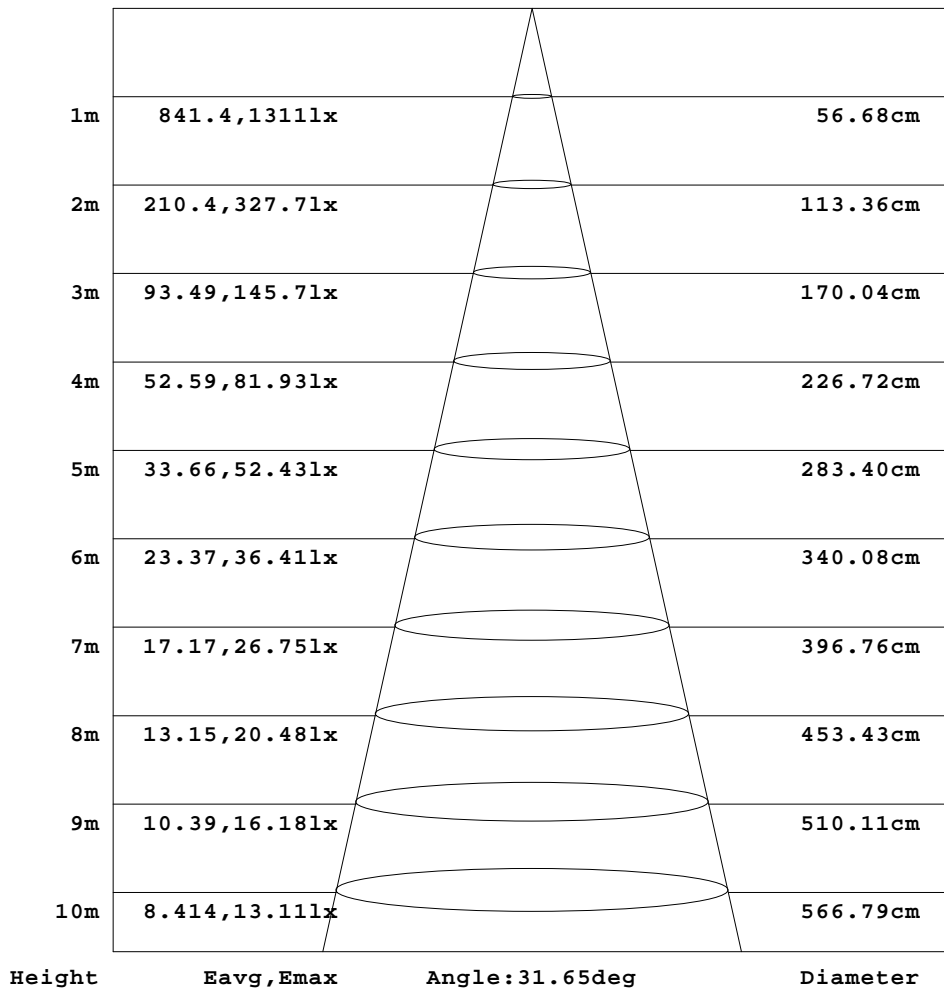

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(β) Range:-90 - 90DEG
H(β) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2023-06-30

V(B) Range:-45 - 45DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.31V I:0.0929A P:9.5886W PF:0.4684 Freq:50.00Hz Lamp Flux:563.371x1 lm		
NAME: 6449	TYPE:Indoor Lighting	WEIGHT:0.2kg
SPEC.:10W	DIM.: φ10*7*5.6cm	SERIAL No.:06
MFR.: NORDECOR	SUR.:3cm	Shielding Angle:24°

Table--1

UNIT: cd

H(DEG) V(DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-75	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-65	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-55	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-45	0.00	0.00	0.13	0.19	0.35	1.15	3.59	5.99	7.83	9.72	11.7	14.0	16.4	18.9	21.3	23.6	25.6	27.4	28.6
-40	0.07	0.19	0.30	0.48	1.39	3.91	6.47	8.81	11.1	13.7	16.7	20.3	24.5	29.4	34.8	40.0	44.4	47.8	49.9
-35	0.11	0.20	0.37	0.49	0.98	3.22	6.28	8.89	11.6	14.6	18.0	22.2	27.4	33.9	41.7	50.2	58.1	64.5	69.0
-30	0.21	0.43	0.56	0.90	2.93	6.58	9.19	12.1	15.5	19.3	24.1	30.0	37.8	47.5	58.8	70.3	79.9	87.1	91.8
-25	0.23	0.35	0.56	0.77	1.82	5.17	8.64	11.8	15.6	20.1	25.8	33.9	45.0	60.5	82.3	112	149	185	213
-20	0.33	0.57	0.76	1.41	4.33	8.31	11.8	15.9	20.8	27.2	36.5	50.2	69.5	98.1	139	196	263	321	350
-15	0.38	0.48	0.71	1.01	2.87	7.01	10.7	14.8	19.9	26.2	35.1	49.1	69.2	98.8	143	208	298	390	461
-10	0.43	0.70	0.94	1.86	5.28	9.45	13.8	19.0	25.5	34.7	49.3	72.1	107	162	254	399	568	702	757
-5	0.39	0.59	0.85	1.23	3.20	7.31	11.6	16.7	23.0	31.3	44.4	65.7	99.5	153	243	403	636	866	1009
0	0.50	0.82	1.11	2.26	5.79	10.0	15.3	21.6	29.6	41.9	62.5	95.8	151	239	404	677	994	1231	1311
5	0.41	0.62	0.89	1.29	3.15	6.87	11.3	17.2	24.2	33.6	48.5	73.2	113	176	281	465	739	1015	1186
10	0.45	0.76	1.04	2.00	4.90	8.63	14.0	20.8	29.2	41.2	61.3	93.5	145	224	358	569	832	1040	1117
15	0.43	0.56	0.83	1.19	2.73	5.70	9.73	16.3	23.7	33.1	47.6	71.6	110	168	256	395	607	838	991
20	0.40	0.69	0.94	1.68	3.92	7.07	11.8	18.6	26.6	37.2	54.0	80.5	121	181	271	404	575	715	769
25	0.33	0.50	0.74	1.02	2.24	4.33	7.54	12.6	19.7	27.7	38.3	54.8	80.0	117	168	239	336	438	506
30	0.35	0.61	0.82	1.30	2.86	5.33	8.58	15.0	21.9	29.8	40.6	56.7	79.8	110	145	184	224	256	269
35	0.23	0.37	0.57	0.76	1.55	3.00	5.45	9.37	15.3	21.6	29.0	39.1	53.6	73.0	97.1	125	154	182	201
40	0.20	0.37	0.55	0.78	1.84	3.54	6.29	10.8	16.2	21.7	28.5	37.5	49.5	64.4	81.6	100	119	134	139
45	0.12	0.17	0.32	0.44	0.66	1.71	3.46	6.55	10.6	15.1	19.6	24.5	30.3	37.1	44.9	53.3	62.0	69.6	73.9
50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
55	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
65	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
75	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2023-06-30

V(B) Range:-45 - 45DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.31V I:0.0929A P:9.5886W PF:0.4684 Freq:50.00Hz Lamp Flux:563.371x1 lm		
NAME: 6449	TYPE:Indoor Lighting	WEIGHT:0.2kg
SPEC.:10W	DIM.: φ10*7*5.6cm	SERIAL No.:06
MFR.: NORDECOR	SUR.:3cm	Shielding Angle:24°

Table--2

UNIT: cd

H(DEG) V(DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-75	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-65	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-55	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-45	29.1	29.1	28.2	26.6	24.5	22.1	19.6	17.0	14.4	12.0	9.27	6.23	3.28	1.62	0.68	0.06	0.00	0.00
-40	50.5	48.8	44.7	39.3	33.8	28.6	23.9	19.9	16.3	12.8	9.14	5.25	2.67	1.34	0.35	0.02	0.00	0.00
-35	71.7	71.2	66.6	58.6	49.7	41.2	33.8	27.5	22.3	17.8	13.6	8.79	4.84	2.32	1.24	0.20	0.02	0.00
-30	93.1	89.1	79.5	67.1	55.3	44.5	35.8	28.7	22.9	17.7	12.5	7.10	3.71	1.87	0.71	0.07	0.00	0.00
-25	222	208	175	137	104	78.7	58.5	43.5	32.6	24.7	18.3	11.9	6.53	3.38	1.78	0.45	0.16	0.07
-20	340	290	225	165	122	87.3	62.0	44.2	32.4	23.9	16.7	9.54	5.31	2.72	1.09	0.37	0.20	0.10
-15	481	439	354	261	188	135	93.8	64.9	45.2	32.6	23.5	15.6	8.35	4.81	2.32	0.82	0.44	0.21
-10	724	606	444	296	199	134	89.6	59.9	41.2	29.2	20.1	11.9	6.76	3.49	1.36	0.61	0.39	0.25
-5	1027	931	733	498	321	205	134	87.7	57.4	38.9	27.2	18.1	10.2	5.90	2.72	0.96	0.61	0.36
0	1245	1037	738	460	287	184	118	75.9	49.3	33.7	22.9	14.2	8.04	4.18	1.51	0.77	0.56	0.43
5	1204	1087	851	573	364	230	151	97.8	63.0	41.8	28.9	19.6	11.6	6.77	2.85	0.99	0.67	0.43
10	1057	877	628	403	260	174	115	74.3	48.5	33.2	22.9	15.1	8.90	4.08	1.32	0.72	0.53	0.37
15	1011	908	709	486	315	210	144	95.1	61.8	41.2	28.6	19.8	12.7	7.42	2.71	0.91	0.62	0.40
20	729	610	449	303	205	143	97.4	64.8	43.5	30.3	21.4	14.7	8.52	3.44	0.98	0.53	0.37	0.23
25	515	470	385	285	202	144	103	70.5	48.2	33.8	24.2	17.3	11.4	5.56	1.64	0.50	0.31	0.13
30	259	236	201	162	125	92.8	66.7	47.4	34.2	24.9	18.3	13.0	6.91	2.25	0.47	0.19	0.07	0.00
35	203	192	171	144	115	89.0	66.6	48.6	35.4	26.2	19.5	14.1	8.78	3.45	0.80	0.20	0.10	0.00
40	135	125	110	91.8	73.4	57.1	43.5	32.9	25.0	19.0	14.1	8.68	3.77	1.05	0.16	0.06	0.02	0.00
45	74.3	72.1	68.2	61.8	53.4	44.3	36.2	29.3	23.4	18.5	14.4	10.1	4.75	1.07	0.18	0.00	0.00	0.00
50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
55	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
65	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
75	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG
H(h) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:AED
Test Date:2023-06-30

V(B) Range:-45 - 45DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks: