

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		1837.2 cd per klm. -10.0 degrees vertical 1.0 degrees horizontal
Beam Spread	At 10% of Imax	77.5V x 75.7H
	At 50% of Imax	37.8V x 35.1H
	At 90% of Imax	15.6V x 13.2H
Beam Flux	Total	999.6 lumens per klm.
	To 10% of Imax	844.3 lumens per klm.
	To 50% of Imax	403.7 lumens per klm.
	To 90% of Imax	78.8 lumens per klm.
	Upward LOR	0.0 %
	Downward LOR	100.0 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H( $\beta$ ) Range:-90 - 90DEG  
H( $\beta$ ) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:AED  
Test Date:2024-04-23

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.12V I:0.0275A P:3.0245W PF:0.4992 Freq:50.00Hz Lamp Flux:159.48x1 lm		
NAME: 6626	TYPE:	WEIGHT:
SPEC.:3W	DIM.: $\phi 4.2*6*25cm$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

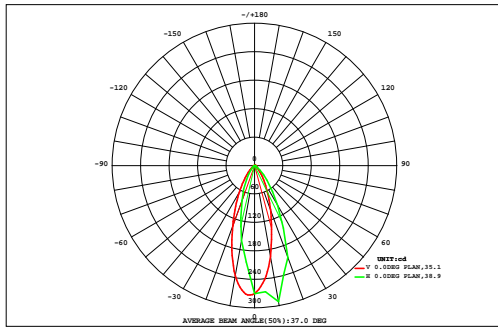

DATA OF LAMP		Eff:52.73lm/W	
MODEL		Imax(cd)	293.0
NOMINAL POWER(W)		AVAILABILITY(%)	84.8
RATED VOLTAGE(V)		Avai. FLUX(lm)	135.2
NOMINAL FLUX(lm)	159.48	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	159.5
TEST VOLTAGE(V)	0	q @50%(H,V)	35,38DEG

VERTICAL( DEG)	AREA FLUX DIAGRAM																UNIT:lm		F t	F a
	90	80	70	60	50	40	30	20	10	0	10	20	30	40	50	60	70	80	90	
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
80	0.00	0.01	0.02	0.02	0.03	0.03	0.04	0.04	0.04	0.05	0.04	0.04	0.04	0.03	0.03	0.02	0.01	0.00	0.49	0.00
70	0.00	0.01	0.01	0.02	0.03	0.03	0.04	0.05	0.06	0.06	0.05	0.05	0.04	0.03	0.02	0.02	0.01	0.00	0.53	0.00
60	0.00	0.01	0.01	0.02	0.03	0.05	0.06	0.09	0.10	0.11	0.10	0.08	0.07	0.05	0.03	0.02	0.01	0.00	0.84	0.00
50	0.00	0.01	0.02	0.03	0.05	0.08	0.12	0.18	0.23	0.25	0.22	0.17	0.12	0.07	0.04	0.02	0.01	0.00	1.63	0.00
40	0.00	0.01	0.02	0.04	0.07	0.13	0.27	0.45	0.62	0.68	0.60	0.41	0.23	0.11	0.05	0.03	0.01	0.00	3.73	0.48
30	0.00	0.01	0.02	0.05	0.10	0.26	0.57	1.02	1.46	1.63	1.41	0.93	0.48	0.19	0.07	0.03	0.01	0.00	8.24	6.07
20	0.00	0.01	0.02	0.06	0.15	0.44	1.02	1.96	3.00	3.44	2.84	1.74	0.82	0.30	0.09	0.04	0.01	0.00	16.0	14.5
10	0.00	0.01	0.03	0.07	0.21	0.61	1.49	3.13	5.35	6.31	4.86	2.64	1.14	0.40	0.11	0.04	0.01	0.00	26.4	25.1
0	0.00	0.01	0.03	0.08	0.23	0.69	1.77	4.01	7.40	8.69	6.37	3.16	1.29	0.44	0.12	0.04	0.01	0.00	34.4	33.1
-10	0.00	0.01	0.03	0.07	0.22	0.66	1.66	3.79	6.77	7.77	5.65	2.80	1.16	0.40	0.11	0.04	0.01	0.00	31.2	29.9
-20	0.00	0.01	0.03	0.06	0.17	0.49	1.19	2.44	4.07	4.59	3.37	1.85	0.84	0.30	0.09	0.04	0.01	0.00	19.6	18.1
-30	0.00	0.01	0.02	0.05	0.12	0.31	0.69	1.25	1.77	1.88	1.53	0.97	0.48	0.19	0.07	0.03	0.01	0.00	9.39	7.44
-40	0.00	0.01	0.02	0.04	0.07	0.15	0.30	0.51	0.68	0.73	0.62	0.42	0.23	0.11	0.06	0.03	0.01	0.00	4.01	0.53
-50	0.00	0.01	0.02	0.03	0.05	0.08	0.12	0.18	0.22	0.23	0.20	0.14	0.10	0.07	0.05	0.02	0.01	0.00	1.54	0.00
-60	0.00	0.01	0.01	0.02	0.04	0.05	0.07	0.09	0.10	0.09	0.08	0.07	0.06	0.05	0.03	0.02	0.01	0.00	0.82	0.00
-70	0.00	0.01	0.01	0.02	0.03	0.04	0.05	0.06	0.06	0.06	0.06	0.05	0.05	0.04	0.02	0.02	0.01	0.00	0.59	0.00
-80	0.00	0.00	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.01	0.01	0.01	0.00	0.00	0.20	0.00
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
F t	0.04	0.15	0.33	0.70	1.61	4.11	9.49	19.3	32.0	36.6	28.0	15.5	7.16	2.80	1.03	0.45	0.19	0.05	159	---
F a	0.00	0.00	0.00	0.00	0.00	1.12	7.18	17.3	30.1	34.8	26.2	13.6	4.69	0.31	0.00	0.00	0.00	0.00	---	135


one-half-peak spread: U:15.1,D:23.1 , L:17.4,R:18.0 NEMA Beam Type: Type 5

H(h) Range:-90 - 90DEG  
 H(h) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:AED  
 Test Date:2024-04-23

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

ISOCANDELA DIAGRAM

Test:U:220.12V I:0.0275A P:3.0245W PF:0.4992 Freq:50.00Hz Lamp Flux:159.48x1 lm		
NAME: 6626	TYPE:	WEIGHT:
SPEC.:3W	DIM.: $\phi 4.2 \times 6 \times 25\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

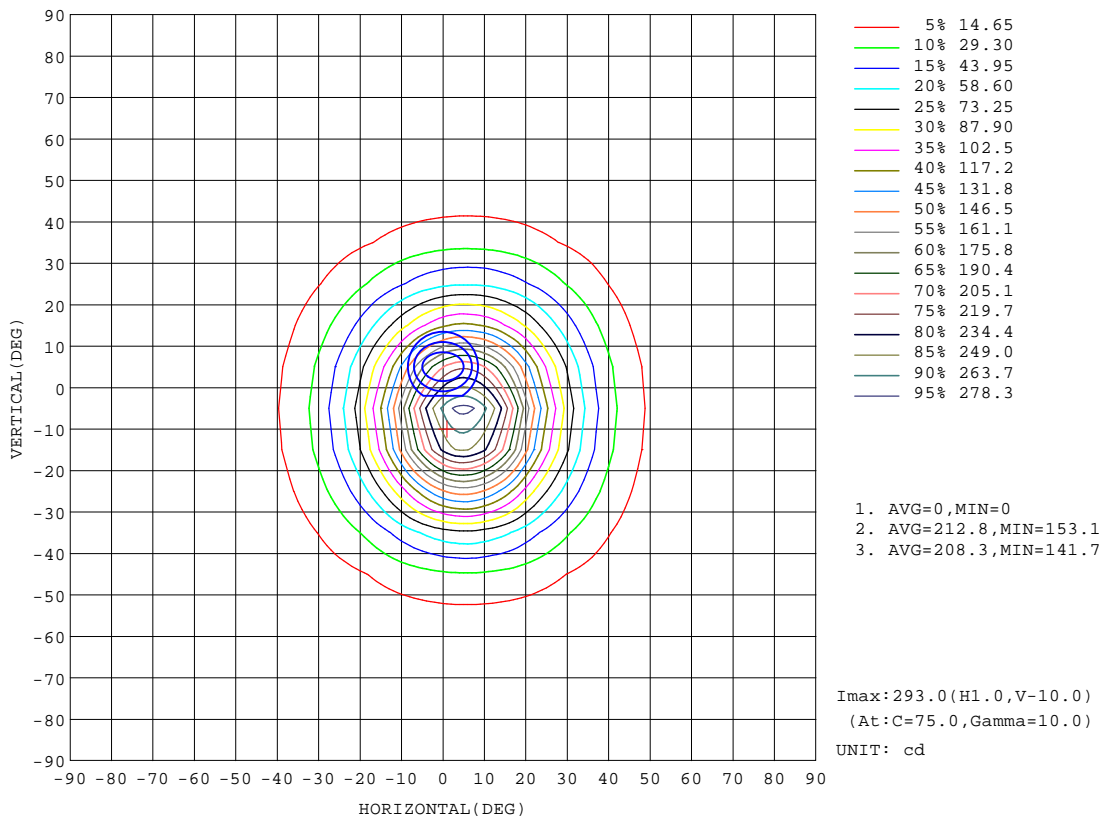


H( $\beta$ ) Range:-90 - 90DEG  
 H( $\beta$ ) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:AED  
 Test Date:2024-04-23

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

ISOLUX DIAGRAM


Test:U:220.12V I:0.0275A P:3.0245W PF:0.4992 Freq:50.00Hz Lamp Flux:159.48x1 lm		
NAME: 6626	TYPE:	WEIGHT:
SPEC.:3W	DIM.: $\Phi$ 4.2*6*25cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

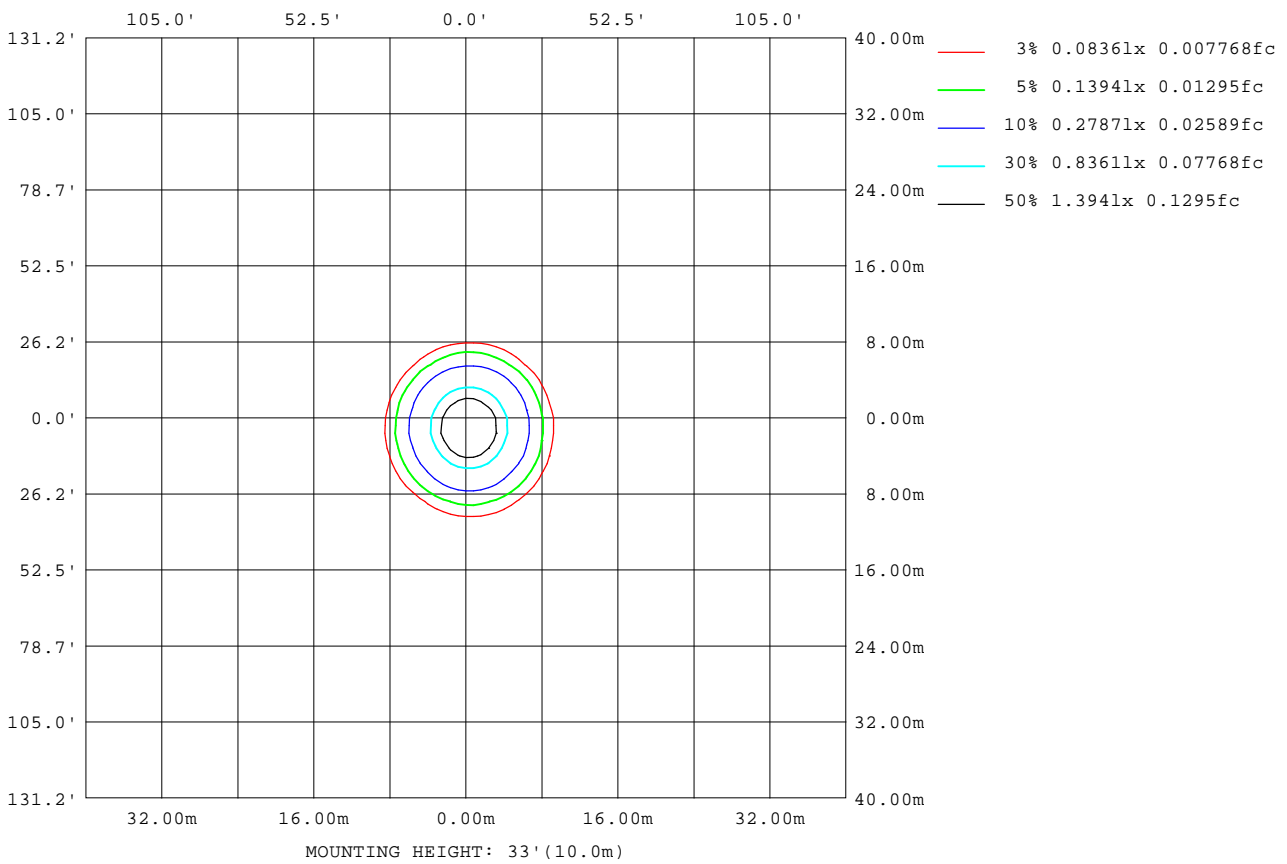

H( $\beta$ ) Range:-90 - 90DEG  
 H( $\beta$ ) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:AED  
 Test Date:2024-04-23

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

Planar Illuminance Curve

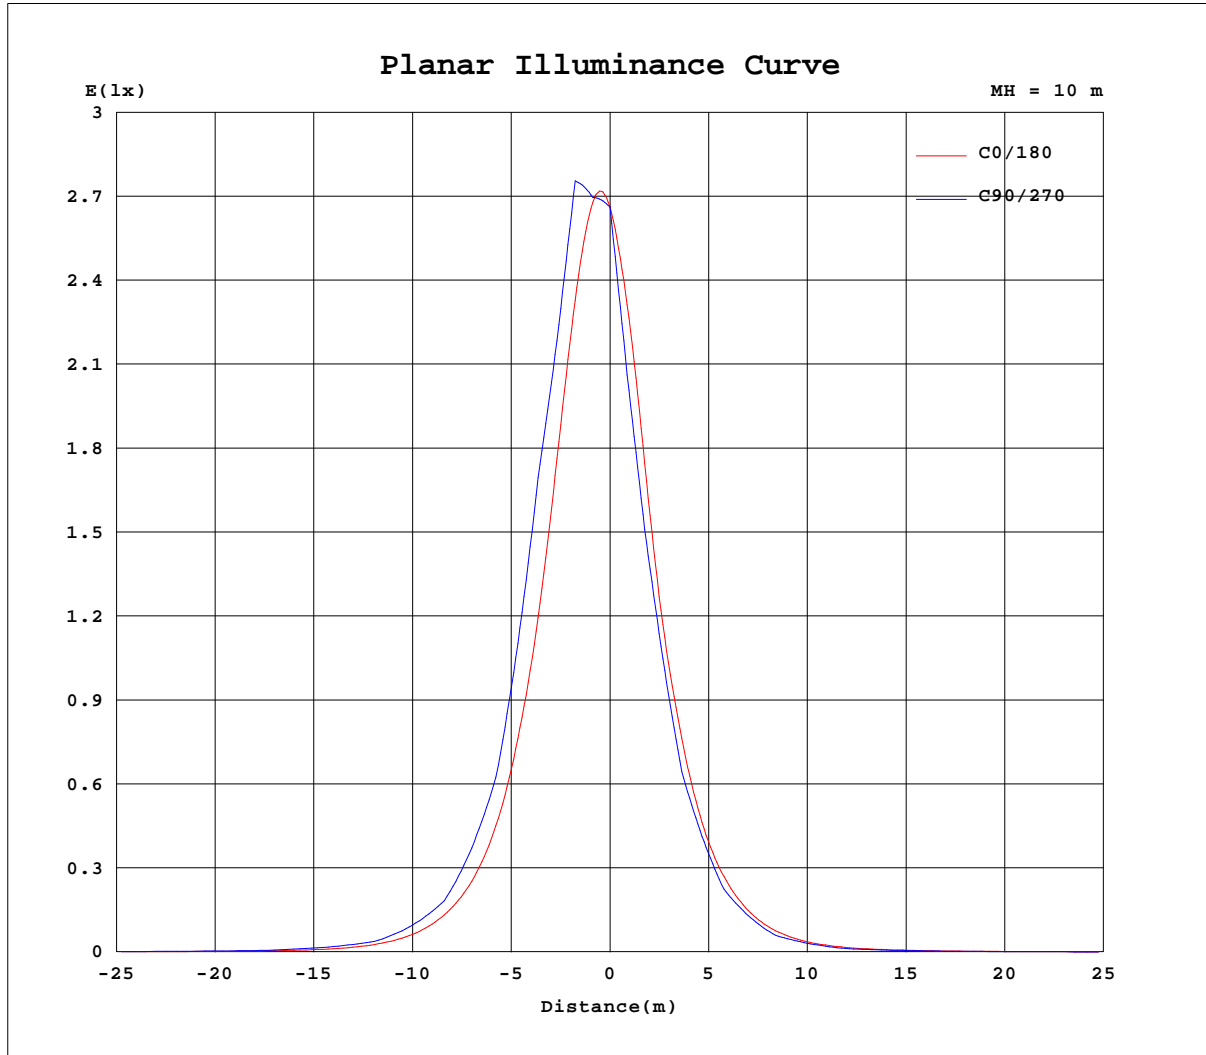


H( $\beta$ ) Range:-90 - 90DEG  
 H( $\beta$ ) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:AED  
 Test Date:2024-04-23

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

AAI Figure

Test:U:220.12V I:0.0275A P:3.0245W PF:0.4992 Freq:50.00Hz Lamp Flux:159.48x1 lm		
NAME: 6626	TYPE:	WEIGHT:
SPEC.:3W	DIM.: $\phi 4.2 \times 6 \times 25\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Flux out:59.59 lm

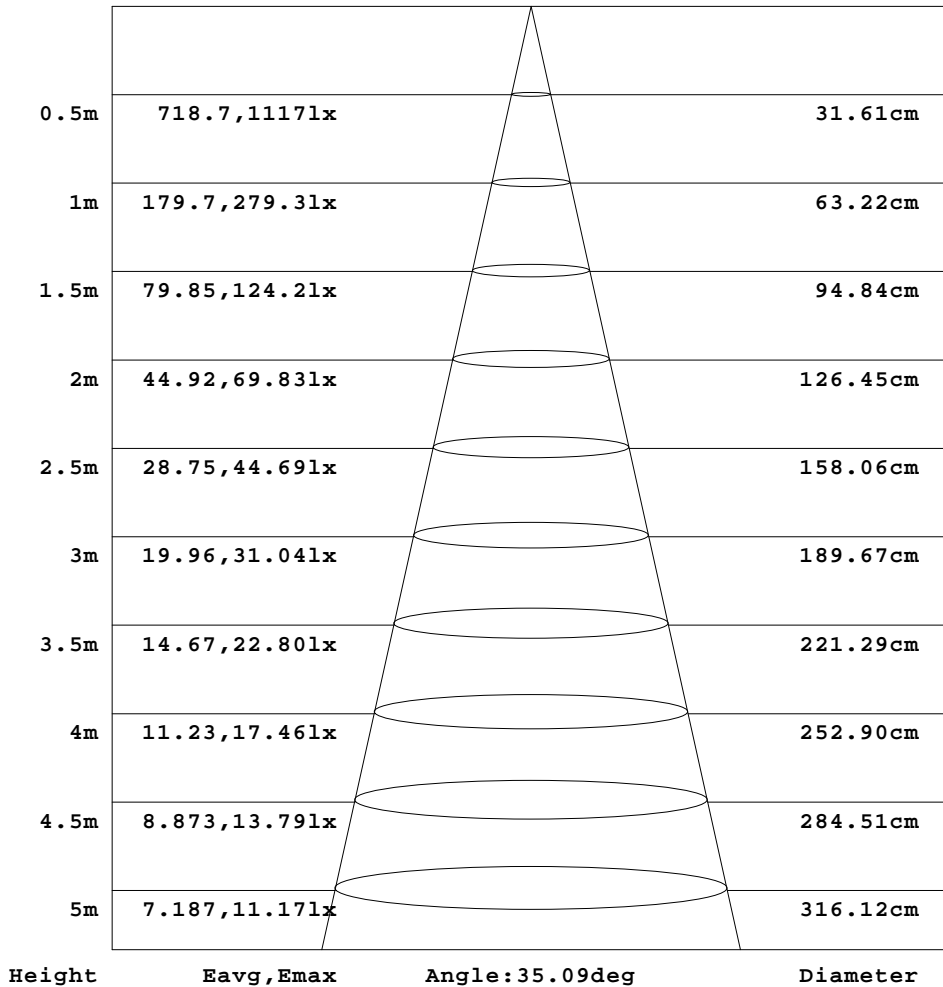

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H( $\beta$ ) Range:-90 - 90DEG  
 H( $\beta$ ) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:AED  
 Test Date:2024-04-23

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.12V I:0.0275A P:3.0245W PF:0.4992 Freq:50.00Hz Lamp Flux:159.48x1 lm		
NAME: 6626	TYPE:	WEIGHT:
SPEC.:3W	DIM.: $\phi$ 4.2*6*25cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--1

UNIT: cd

H( DEG) V( DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.86	0.87	0.88	0.88	0.91	0.96	0.98	1.03	1.09	1.15	1.19	1.24	1.29	1.35	1.41	1.47	1.51	1.55	1.58
-75	0.87	0.87	0.89	0.90	0.94	0.98	1.04	1.11	1.17	1.25	1.32	1.40	1.58	1.71	1.84	1.99	2.10	2.19	2.23
-70	0.88	0.88	0.90	0.96	1.01	1.09	1.18	1.25	1.34	1.44	1.54	1.77	2.02	2.22	2.45	2.68	2.80	2.88	2.91
-65	0.89	0.88	0.90	0.95	1.02	1.10	1.22	1.32	1.44	1.68	1.86	2.06	2.34	2.60	2.92	3.30	3.65	3.87	4.00
-60	0.88	0.90	0.93	1.01	1.13	1.25	1.37	1.52	1.85	2.14	2.42	2.68	2.97	3.36	3.83	4.39	4.78	5.05	5.13
-55	0.89	0.89	0.92	1.00	1.11	1.23	1.39	1.66	1.92	2.32	2.70	3.15	3.71	4.50	5.58	6.74	7.89	8.85	9.59
-50	0.90	0.91	0.99	1.10	1.24	1.41	1.62	2.10	2.49	2.95	3.50	4.26	5.35	6.88	8.70	10.5	12.2	13.6	14.5
-45	0.90	0.91	0.96	1.07	1.22	1.38	1.68	2.14	2.60	3.18	4.00	5.38	7.46	10.2	13.4	17.2	21.1	24.4	27.0
-40	0.92	0.94	1.05	1.21	1.39	1.63	2.21	2.71	3.38	4.27	5.95	8.84	12.7	17.2	22.6	28.6	34.1	38.6	41.2
-35	0.92	0.92	0.99	1.14	1.33	1.53	2.08	2.67	3.40	4.50	6.55	10.0	15.1	21.5	29.4	38.8	49.8	59.6	66.8
-30	0.92	0.96	1.10	1.28	1.48	2.04	2.65	3.44	4.60	6.86	10.9	16.9	24.8	35.0	47.0	62.3	77.8	90.0	97.1
-25	0.93	0.93	1.02	1.18	1.40	1.69	2.42	3.19	4.31	6.33	10.1	16.1	24.6	36.2	51.5	71.7	96.5	124	145
-20	0.93	0.98	1.14	1.35	1.57	2.28	3.05	4.12	6.10	9.75	15.9	24.8	37.5	54.7	79.0	110	148	186	207
-15	0.94	0.93	1.04	1.22	1.44	1.85	2.66	3.58	5.10	8.03	13.1	21.2	32.8	49.4	73.1	106	151	200	237
-10	0.92	0.98	1.14	1.36	1.63	2.42	3.32	4.60	7.17	11.7	19.2	30.7	46.7	70.7	104	153	215	264	291
-5	0.95	0.95	1.06	1.24	1.47	1.92	2.75	3.73	5.41	8.63	14.2	22.9	35.8	54.1	80.9	117	169	226	267
0	0.98	1.03	1.19	1.41	1.66	2.41	3.30	4.56	7.06	11.5	18.7	29.6	45.1	67.6	98.9	139	194	242	270
5	0.93	0.96	1.06	1.23	1.45	1.80	2.63	3.56	5.03	7.90	12.9	20.7	31.9	47.5	69.2	97.6	134	174	204
10	0.94	0.98	1.13	1.32	1.55	2.23	3.01	4.06	5.99	9.67	15.6	24.4	36.2	51.9	72.0	96.9	122	146	160
15	0.90	0.95	1.02	1.17	1.37	1.61	2.34	3.09	4.17	6.15	9.79	15.5	23.6	34.1	47.7	64.2	82.7	101	114
20	0.93	0.96	1.07	1.25	1.43	1.84	2.51	3.28	4.38	6.54	10.3	15.8	23.0	31.9	42.5	53.6	64.8	73.3	78.2
25	0.90	0.93	0.98	1.11	1.27	1.44	1.88	2.50	3.21	4.28	6.29	9.56	14.1	19.9	26.9	34.7	42.7	49.9	54.9
30	0.91	0.92	1.02	1.15	1.31	1.48	2.02	2.51	3.18	4.13	5.86	8.55	11.9	16.1	20.6	25.4	29.7	32.9	34.9
35	0.93	0.93	0.96	1.05	1.19	1.31	1.51	1.91	2.42	2.99	3.87	5.26	7.20	9.73	12.7	15.8	18.9	21.5	23.5
40	0.94	0.93	1.01	1.11	1.21	1.35	1.50	1.94	2.31	2.79	3.40	4.17	5.35	6.88	8.43	9.96	11.5	12.7	13.4
45	0.95	0.95	0.96	1.04	1.13	1.21	1.34	1.49	1.80	2.08	2.55	3.01	3.62	4.51	5.51	6.49	7.44	8.34	8.90
50	0.97	0.96	1.01	1.07	1.15	1.22	1.34	1.45	1.61	1.96	2.23	2.53	2.89	3.34	3.75	4.17	4.60	4.71	4.79
55	0.95	0.96	0.97	1.00	1.06	1.11	1.19	1.28	1.39	1.50	1.74	1.91	2.11	2.36	2.69	3.03	3.34	3.56	3.62
60	0.96	0.96	0.96	1.00	1.05	1.08	1.16	1.24	1.31	1.37	1.45	1.53	1.62	1.77	2.07	2.25	2.44	2.46	2.50
65	0.96	0.97	0.97	0.98	1.01	1.02	1.07	1.12	1.17	1.21	1.27	1.32	1.39	1.45	1.57	1.74	1.87	1.94	1.96
70	0.96	0.98	0.98	0.98	0.99	1.00	1.05	1.07	1.10	1.12	1.17	1.20	1.24	1.27	1.31	1.37	1.41	1.43	1.45
75	0.98	1.00	1.00	1.00	1.00	1.00	1.02	1.03	1.05	1.06	1.08	1.10	1.12	1.13	1.15	1.18	1.22	1.24	1.26
80	1.03	1.02	1.03	1.02	1.01	1.01	1.02	1.02	1.02	1.03	1.03	1.03	1.03	1.03	1.03	1.04	1.06	1.06	1.08
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H( $\beta$ ) Range:-90 - 90DEG  
H( $\beta$ ) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:AED  
Test Date:2024-04-23

V( $\beta$ ) Range:-80 - 80DEG  
V( $\beta$ ) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.12V I:0.0275A P:3.0245W PF:0.4992 Freq:50.00Hz Lamp Flux:159.48x1 lm		
NAME: 6626	TYPE:	WEIGHT:
SPEC.:3W	DIM.: $\phi 4.2 \times 6 \times 25 \text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--2

UNIT: cd

H( DEG) V( DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.59	1.58	1.54	1.51	1.50	1.47	1.44	1.42	1.39	1.34	1.29	1.22	1.17	1.10	1.06	0.99	0.88	0.88
-75	2.25	2.25	2.20	2.09	2.02	1.97	1.91	1.84	1.75	1.65	1.49	1.37	1.30	1.21	1.13	1.05	0.97	0.86
-70	2.91	2.87	2.71	2.59	2.48	2.38	2.29	2.16	2.04	1.71	1.55	1.43	1.32	1.22	1.12	1.03	0.86	0.87
-65	4.01	3.96	3.80	3.54	3.27	3.04	2.89	2.77	2.63	2.40	2.08	1.81	1.51	1.36	1.23	1.11	1.00	0.86
-60	5.04	4.89	4.57	4.16	3.77	3.50	3.35	3.22	2.99	2.64	2.29	1.79	1.49	1.33	1.20	1.06	0.86	0.88
-55	9.86	9.72	9.14	8.20	7.06	6.01	5.16	4.40	3.80	3.33	2.89	2.43	1.92	1.51	1.33	1.17	1.04	0.88
-50	14.6	14.0	12.6	10.9	9.02	7.46	6.03	4.85	4.03	3.50	2.94	2.43	1.87	1.46	1.28	1.11	0.89	0.86
-45	28.1	27.4	25.3	22.2	18.4	14.5	11.1	8.32	6.13	4.51	3.65	3.02	2.45	1.84	1.44	1.24	1.08	0.89
-40	41.3	38.6	34.5	29.1	23.0	17.3	12.7	9.07	6.18	4.38	3.57	2.93	2.30	1.61	1.35	1.18	0.89	0.90
-35	70.0	67.4	61.0	51.1	40.5	30.7	22.2	15.3	10.3	6.63	4.52	3.51	2.82	2.18	1.55	1.31	1.12	0.89
-30	97.1	89.0	76.2	60.1	45.9	33.6	23.0	15.2	9.69	5.98	4.11	3.26	2.56	1.88	1.44	1.21	0.90	0.91
-25	153	145	125	98.1	73.5	53.4	37.1	24.6	15.5	9.45	5.73	3.93	3.10	2.39	1.67	1.37	1.15	0.90
-20	203	179	142	105	75.9	52.7	35.4	22.3	13.4	7.95	4.82	3.54	2.75	2.08	1.49	1.25	0.92	0.91
-15	251	236	200	150	107	75.0	50.2	32.6	20.0	11.8	6.81	4.29	3.26	2.51	1.79	1.43	1.19	0.94
-10	286	254	199	141	97.9	65.4	42.4	26.7	15.9	9.07	5.28	3.64	2.82	2.16	1.57	1.30	0.97	0.94
-5	283	267	225	169	120	82.8	54.8	35.5	22.0	12.8	7.22	4.42	3.27	2.53	1.83	1.45	1.21	0.96
0	268	236	185	135	95.1	64.3	42.3	26.9	16.1	9.17	5.26	3.64	2.78	2.14	1.55	1.28	0.94	0.97
5	217	205	175	137	101	71.8	48.7	32.0	20.0	11.7	6.69	4.18	3.13	2.43	1.76	1.42	1.20	0.94
10	157	143	120	94.8	70.6	49.8	33.8	21.6	13.1	7.64	4.60	3.34	2.60	2.00	1.50	1.26	0.94	0.94
15	120	115	102	86.1	67.2	50.1	35.3	23.7	14.9	9.01	5.43	3.69	2.84	2.22	1.62	1.36	1.15	0.91
20	78.7	74.3	65.6	54.7	42.6	31.8	22.1	14.5	9.06	5.63	3.83	2.95	2.31	1.71	1.39	1.18	0.90	0.88
25	56.9	56.1	51.5	45.0	36.7	28.4	20.8	14.4	9.48	6.16	4.18	3.13	2.47	1.94	1.49	1.29	1.11	0.89
30	34.9	33.2	29.9	25.6	20.7	15.6	11.4	8.05	5.57	4.03	3.10	2.48	2.00	1.53	1.32	1.15	0.90	0.89
35	24.3	23.9	22.2	19.7	16.5	13.2	10.1	7.50	5.52	4.15	3.23	2.58	2.09	1.65	1.39	1.22	1.08	0.88
40	13.5	12.9	11.7	10.1	8.46	6.92	5.52	4.41	3.70	3.06	2.52	2.06	1.60	1.39	1.26	1.10	0.90	0.88
45	9.17	9.01	8.48	7.65	6.67	5.76	4.89	4.10	3.46	2.95	2.49	2.03	1.73	1.46	1.31	1.18	1.06	0.91
50	4.77	4.57	4.35	4.02	3.76	3.53	3.28	2.97	2.61	2.26	1.94	1.62	1.45	1.32	1.21	1.11	0.93	0.91
55	3.65	3.58	3.45	3.29	3.09	2.93	2.77	2.51	2.27	2.04	1.83	1.59	1.45	1.34	1.23	1.14	1.06	0.94
60	2.49	2.43	2.41	2.31	2.22	2.15	2.00	1.77	1.66	1.56	1.46	1.38	1.31	1.23	1.14	1.08	0.94	0.94
65	1.99	1.96	1.93	1.90	1.84	1.80	1.74	1.61	1.53	1.46	1.40	1.34	1.28	1.21	1.16	1.10	1.06	0.97
70	1.45	1.46	1.45	1.43	1.41	1.39	1.37	1.35	1.32	1.29	1.25	1.21	1.18	1.13	1.11	1.07	0.99	0.99
75	1.27	1.27	1.27	1.27	1.25	1.25	1.24	1.23	1.22	1.21	1.19	1.16	1.15	1.12	1.10	1.08	1.06	1.00
80	1.09	1.10	1.10	1.10	1.10	1.10	1.10	1.10	1.11	1.10	1.10	1.09	1.08	1.08	1.08	1.07	1.01	0.97
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG  
H(h) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:AED  
Test Date:2024-04-23

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks: