

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		5135.0 cd per klm. 0.0 degrees vertical -2.0 degrees horizontal
Beam Spread	At 10% of Imax At 50% of Imax At 90% of Imax	41.0V x 41.3H 19.3V x 18.9H 5.5V x 7.6H
Beam Flux	Total To 10% of Imax To 50% of Imax To 90% of Imax	997.0 lumens per klm. 659.0 lumens per klm. 285.5 lumens per klm. 29.1 lumens per klm.
	Upward LOR Downward LOR	0.0 % 99.7 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H( $\beta$ ) Range:-90 - 90DEG  
H( $\beta$ ) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:AED  
Test Date:2024-04-16

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.26V I:0.1543A P:15.024W PF:0.4421 Freq:50.00Hz Lamp Flux:741.357x1 lm		
NAME: 6629	TYPE:	WEIGHT:620g
SPEC.:15W	DIM.: $\phi 6 \times 14$ cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

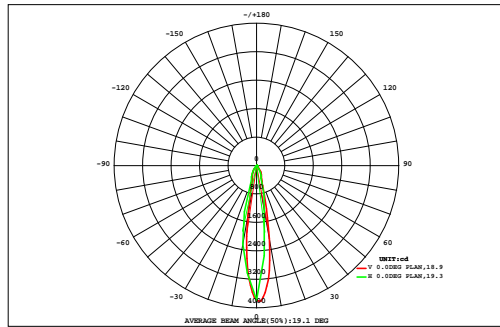

DATA OF LAMP		Eff:49.34lm/W	
MODEL		Imax(cd)	3807
NOMINAL POWER(W)		AVAILABILITY(%)	66.3
RATED VOLTAGE(V)		Avai. FLUX(lm)	491.2
NOMINAL FLUX(lm)	741.357	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	741.4
TEST VOLTAGE(V)	0	q @50%(H,V)	19,19DEG

VERTICAL( DEG)	AREA FLUX DIAGRAM																UNIT:lm		F t	F a	
	90	80	70	60	50	40	30	20	10	0	10	20	30	40	50	60	70	80	90		
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80	0.01	0.02	0.03	0.04	0.06	0.07	0.09	0.10	0.10	0.10	0.09	0.08	0.06	0.05	0.03	0.02	0.00	1.04	0.00		
70	0.00	0.01	0.03	0.04	0.06	0.07	0.09	0.10	0.11	0.11	0.10	0.09	0.07	0.05	0.04	0.03	0.01	0.00	1.02	0.00	
60	0.00	0.01	0.03	0.04	0.06	0.09	0.12	0.15	0.17	0.17	0.15	0.12	0.08	0.06	0.04	0.02	0.01	0.00	1.33	0.00	
50	0.00	0.01	0.03	0.04	0.07	0.12	0.22	0.65	1.08	1.09	0.70	0.25	0.12	0.07	0.04	0.02	0.01	0.00	4.55	0.00	
40	0.00	0.02	0.03	0.06	0.11	0.25	1.35	3.36	4.61	4.49	3.24	1.61	0.37	0.11	0.05	0.03	0.02	0.00	19.7	0.00	
30	0.00	0.02	0.05	0.09	0.18	1.00	4.76	7.90	9.82	9.69	7.74	4.85	1.30	0.18	0.08	0.04	0.02	0.00	47.7	4.05	
20	0.01	0.02	0.06	0.12	0.28	2.83	7.45	12.1	27.5	29.5	12.8	7.48	2.78	0.30	0.10	0.05	0.02	0.01	103	70.6	
10	0.01	0.02	0.06	0.14	0.43	4.16	8.66	19.9	72.8	74.0	20.6	8.53	3.58	0.41	0.12	0.05	0.02	0.01	214	188	
0	0.01	0.02	0.06	0.14	0.45	3.92	8.76	22.7	76.0	72.2	19.6	8.15	3.47	0.37	0.12	0.05	0.02	0.01	216	188	
-10	0.01	0.02	0.05	0.12	0.33	2.58	7.17	11.6	17.4	15.0	9.72	6.79	2.23	0.24	0.10	0.04	0.02	0.01	73.3	40.7	
-20	0.00	0.02	0.04	0.09	0.19	0.76	4.01	7.28	7.54	6.94	6.71	3.77	0.68	0.17	0.07	0.04	0.02	0.00	38.3	0.00	
-30	0.00	0.02	0.03	0.06	0.12	0.20	0.77	2.97	4.12	3.94	2.50	0.69	0.17	0.11	0.05	0.03	0.01	0.00	15.8	0.00	
-40	0.00	0.01	0.03	0.04	0.08	0.14	0.18	0.20	0.29	0.31	0.22	0.17	0.14	0.08	0.04	0.02	0.01	0.00	1.98	0.00	
-50	0.00	0.01	0.03	0.04	0.07	0.11	0.16	0.21	0.23	0.21	0.20	0.15	0.10	0.06	0.04	0.03	0.01	0.00	1.67	0.00	
-60	0.00	0.01	0.03	0.04	0.05	0.07	0.09	0.11	0.12	0.12	0.11	0.09	0.07	0.05	0.04	0.02	0.01	0.00	1.03	0.00	
-70	0.00	0.01	0.02	0.03	0.04	0.05	0.05	0.06	0.06	0.06	0.06	0.05	0.05	0.04	0.03	0.02	0.01	0.00	0.65	0.00	
-80	0.00	0.00	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.01	0.01	0.01	0.00	0.00	0.22	0.00	
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	90	80	70	60	50	40	30	20	10	0	10	20	30	40	50	60	70	80	90		
F t	0.07	0.28	0.60	1.15	2.59	16.4	44.0	89.3	222	218	84.6	42.9	15.3	2.35	1.02	0.53	0.26	0.07	741	---	
F a	0.00	0.00	0.00	0.00	0.00	0.00	3.70	53.7	193	191	48.4	1.21	0.00	0.00	0.00	0.00	0.00	0.00	---	491	


one-half-peak spread: U:7.2,D:12.2 , L:8.7,R:10.4 NEMA Beam Type: Type 3

H(h) Range:-90 - 90DEG  
H(h) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:AED  
Test Date:2024-04-16

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.26V I:0.1543A P:15.024W PF:0.4421 Freq:50.00Hz Lamp Flux:741.357x1 lm		
NAME: 6629	TYPE:	WEIGHT:620g
SPEC.:15W	DIM.: $\phi 6 \times 14\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

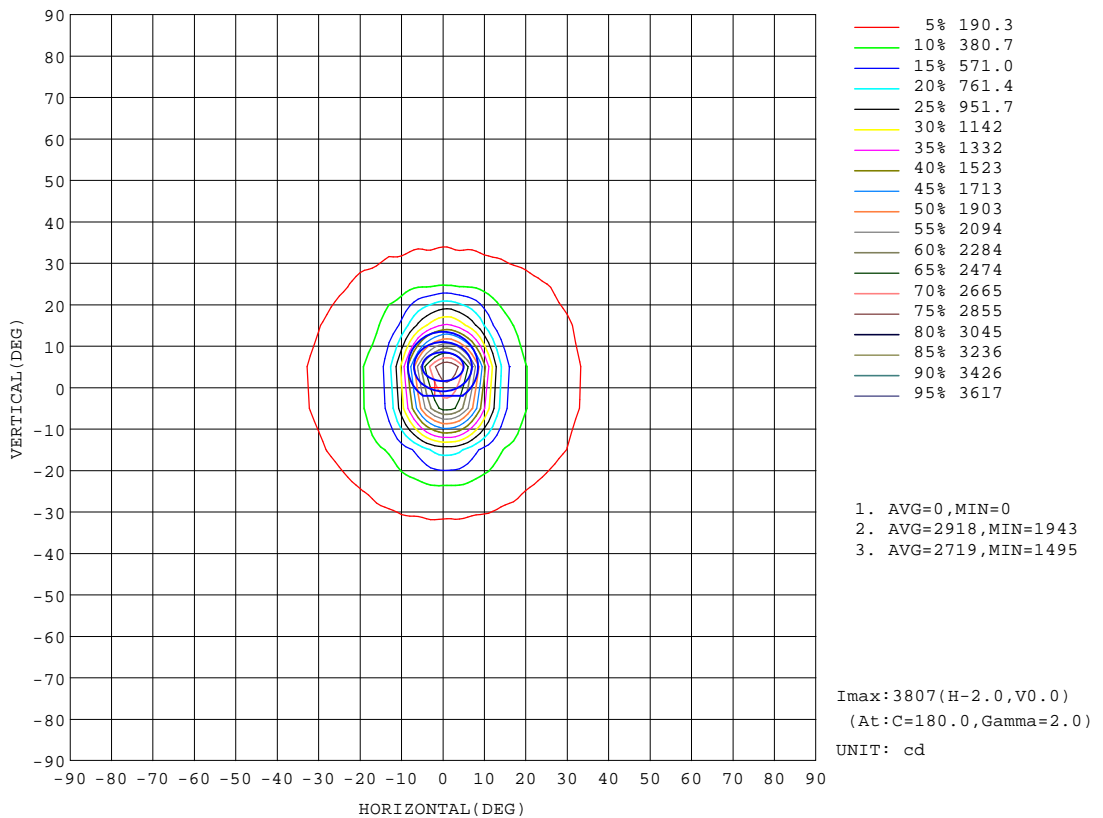


H( $\beta$ ) Range:-90 - 90DEG  
 H( $\beta$ ) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:AED  
 Test Date:2024-04-16

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

ISOLUX DIAGRAM


Test:U:220.26V I:0.1543A P:15.024W PF:0.4421 Freq:50.00Hz Lamp Flux:741.357x1 lm		
NAME: 6629	TYPE:	WEIGHT:620g
SPEC.:15W	DIM.: $\Phi 6 \times 14\text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

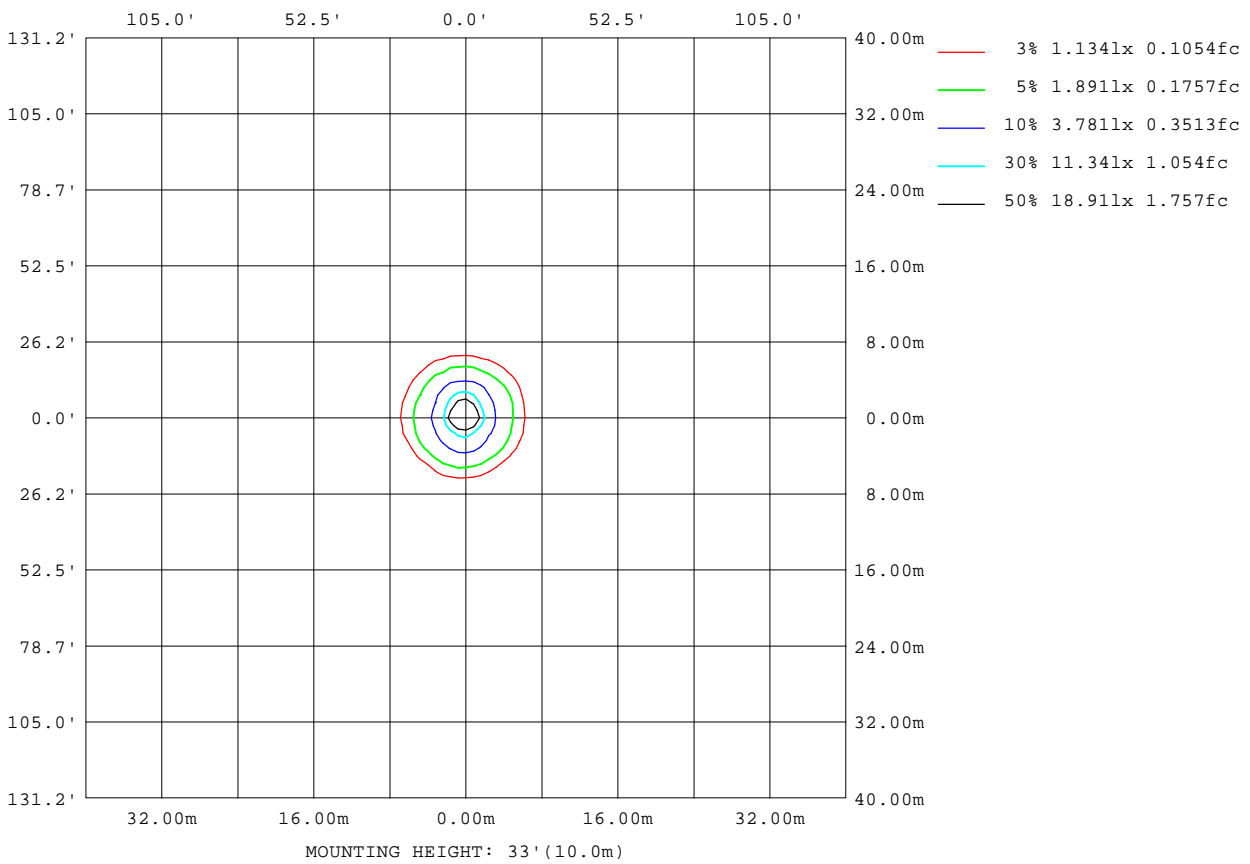

H( $\beta$ ) Range:-90 - 90DEG  
 H( $\beta$ ) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:AED  
 Test Date:2024-04-16

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

Planar Illuminance Curve

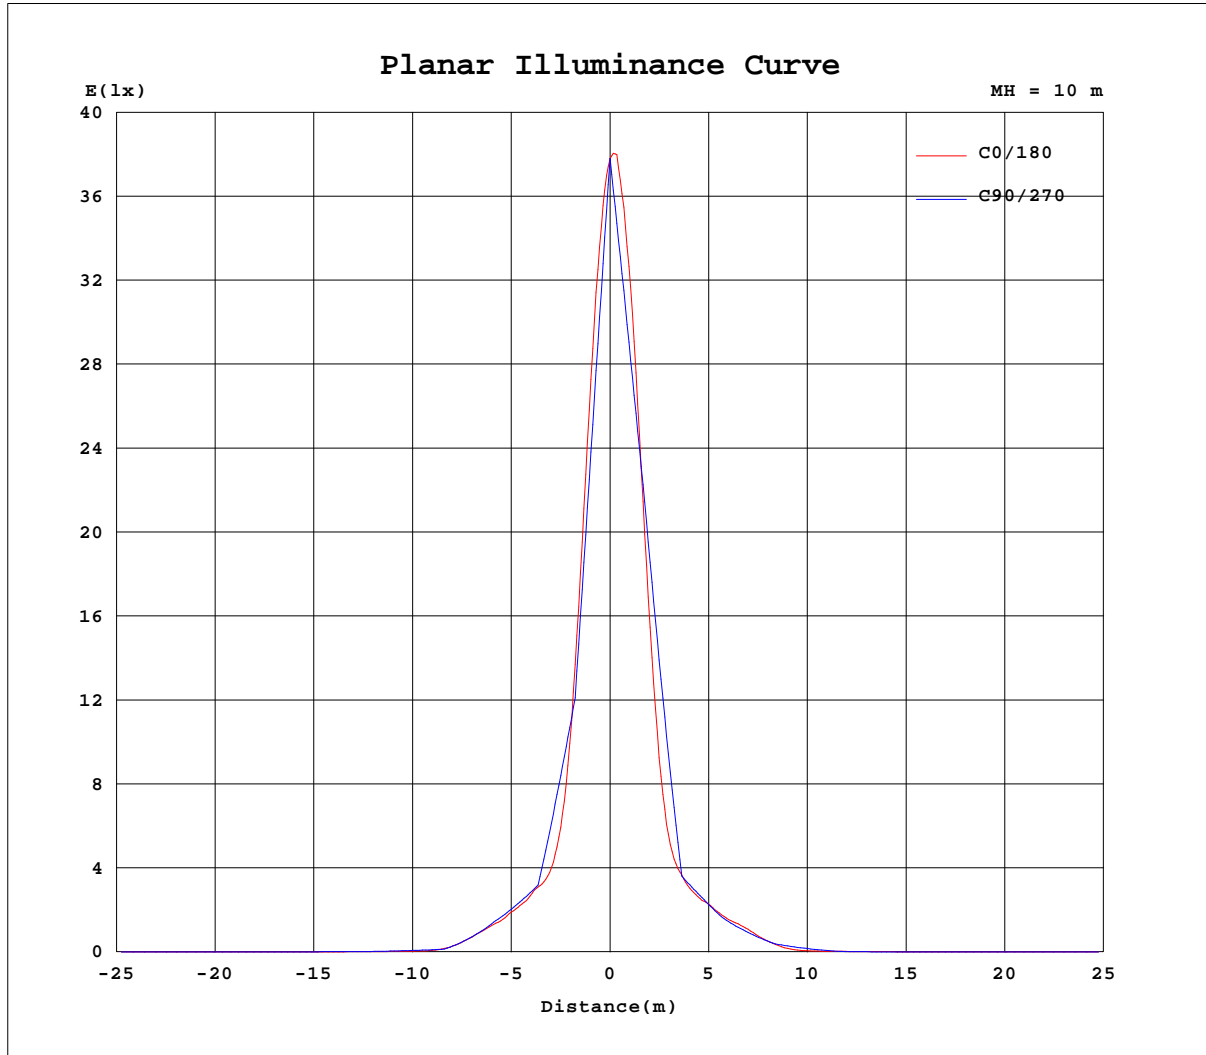


H( $\beta$ ) Range:-90 - 90DEG  
 H( $\beta$ ) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:AED  
 Test Date:2024-04-16

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

AAI Figure

Test:U:220.26V I:0.1543A P:15.024W PF:0.4421 Freq:50.00Hz Lamp Flux:741.357x1 lm		
NAME: 6629	TYPE:	WEIGHT:620g
SPEC.:15W	DIM.: #6*14cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Flux out:217.3 lm

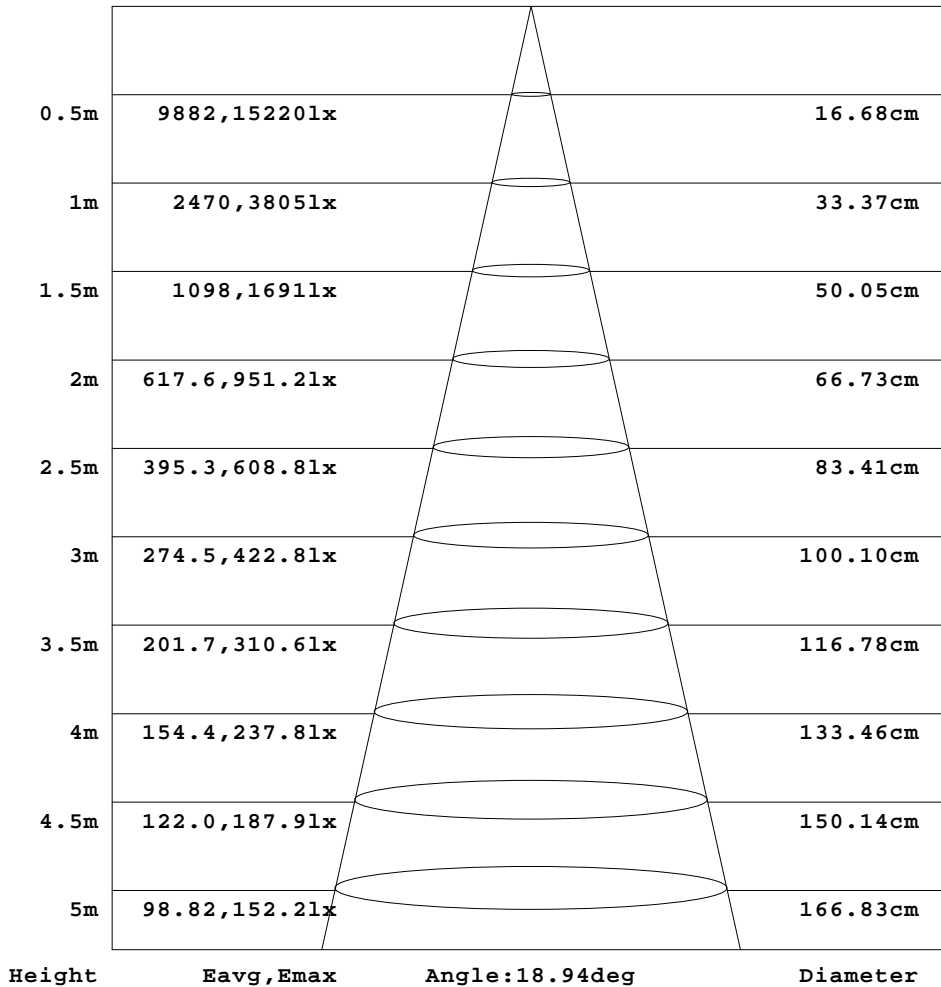

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(β) Range:-90 - 90DEG  
 H(β) Interval: 1.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:AED  
 Test Date:2024-04-16

V(B) Range:-80 - 80DEG  
 V(B) Interval: 5.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
 Humidity:65.0%  
 Test Distance:5.780m [K=1.0000]  
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.26V I:0.1543A P:15.024W PF:0.4421 Freq:50.00Hz Lamp Flux:741.357x1 lm		
NAME: 6629	TYPE:	WEIGHT:620g
SPEC.:15W	DIM.: $\phi 6 \times 14 \text{cm}$	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--1

UNIT: cd

H( DEG) V( DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.12	1.21	1.20	1.20	1.22	1.23	1.27	1.32	1.34	1.40	1.45	1.50	1.56	1.60	1.62	1.64	1.71	1.74	1.73
-75	1.18	1.29	1.32	1.36	1.41	1.46	1.54	1.62	1.69	1.75	1.83	1.91	1.98	2.07	2.13	2.20	2.26	2.31	2.35
-70	1.34	1.40	1.46	1.52	1.62	1.76	1.89	1.99	2.06	2.16	2.26	2.36	2.48	2.58	2.68	2.78	2.86	2.93	2.95
-65	1.37	1.45	1.51	1.61	1.77	1.89	2.02	2.15	2.27	2.42	2.56	2.84	3.08	3.36	3.63	3.86	4.12	4.32	4.36
-60	1.49	1.55	1.63	1.82	2.00	2.13	2.26	2.42	2.58	2.72	3.20	3.52	4.00	4.37	4.78	5.14	5.50	5.76	5.73
-55	1.38	1.44	1.54	1.72	1.90	2.04	2.20	2.38	2.64	2.98	3.41	4.07	4.80	5.72	6.63	7.42	8.27	8.78	8.95
-50	1.35	1.41	1.57	1.75	1.92	2.08	2.28	2.54	2.93	3.51	4.21	5.09	6.38	7.88	9.15	10.3	11.4	12.0	12.0
-45	1.36	1.42	1.55	1.77	1.93	2.08	2.27	2.52	2.94	3.59	4.53	5.74	7.27	9.29	11.7	14.1	16.5	20.0	21.6
-40	1.43	1.48	1.72	1.92	2.07	2.24	2.46	2.78	3.40	4.38	5.68	7.47	9.68	12.7	16.2	19.7	24.4	30.4	31.4
-35	1.49	1.53	1.76	2.03	2.24	2.48	2.79	3.21	3.97	5.10	6.83	9.09	12.7	27.9	58.5	93.7	118	128	132
-30	1.56	1.69	2.04	2.31	2.59	2.96	3.43	4.09	5.33	7.09	9.42	13.1	24.5	65.1	127	186	222	237	232
-25	1.60	1.67	2.02	2.37	2.71	3.17	3.76	4.55	6.03	8.02	11.0	19.8	57.5	122	183	242	285	301	310
-20	1.65	1.86	2.30	2.69	3.18	3.83	4.66	6.13	8.13	11.2	16.3	50.2	144	231	278	325	362	392	385
-15	1.65	1.78	2.22	2.66	3.20	3.87	4.75	6.12	8.33	11.5	20.7	69.0	159	240	300	372	488	675	833
-10	1.73	1.98	2.51	3.05	3.72	4.56	5.67	7.94	10.7	15.7	52.0	151	244	317	385	468	737	1144	1268
-5	1.69	1.85	2.36	2.88	3.55	4.35	5.38	7.23	9.83	13.8	34.6	129	229	298	360	508	1059	1975	2543
0	1.77	2.05	2.61	3.22	3.96	4.89	6.07	8.56	11.6	17.5	79.9	197	261	331	442	834	2085	3400	3781
5	1.71	1.87	2.37	2.93	3.60	4.42	5.46	7.26	9.81	13.7	38.0	142	228	297	367	528	1194	2348	3024
10	1.74	2.02	2.56	3.14	3.85	4.71	5.80	7.94	10.7	15.5	68.5	177	250	301	372	585	1222	2000	2244
15	1.65	1.80	2.26	2.76	3.35	4.07	4.97	6.32	8.35	11.3	24.3	96.3	184	252	317	395	618	1064	1343
20	1.67	1.89	2.37	2.81	3.38	4.09	4.95	6.29	8.07	10.9	23.8	89.9	180	232	285	358	384	406	437
25	1.55	1.68	2.08	2.45	2.88	3.41	4.07	4.86	6.11	7.83	11.0	34.2	95.0	165	225	260	282	325	349
30	1.55	1.71	2.11	2.40	2.77	3.21	3.76	4.34	5.31	6.68	9.02	15.9	62.0	136	186	221	237	238	245
35	1.45	1.53	1.83	2.10	2.37	2.65	3.03	3.41	3.99	4.84	6.20	8.51	24.5	57.6	95.7	123	145	164	171
40	1.43	1.51	1.81	1.98	2.18	2.37	2.61	2.88	3.25	3.92	4.97	6.42	8.46	12.4	30.1	55.5	75.5	81.9	86.2
45	1.36	1.39	1.58	1.80	1.97	2.13	2.30	2.50	2.78	3.20	3.83	4.71	6.07	7.73	13.9	27.0	39.9	46.1	48.1
50	1.33	1.37	1.57	1.73	1.89	2.01	2.16	2.37	2.59	2.94	3.35	3.93	4.94	5.85	6.56	7.12	7.52	7.78	7.84
55	1.36	1.37	1.47	1.69	1.85	1.97	2.11	2.27	2.47	2.70	3.01	3.39	3.95	4.56	5.08	5.49	5.77	5.98	6.08
60	1.40	1.43	1.53	1.77	1.92	2.04	2.17	2.33	2.50	2.71	2.95	3.22	3.47	3.72	3.95	4.11	4.21	4.29	4.27
65	1.47	1.48	1.53	1.67	1.85	1.98	2.11	2.25	2.38	2.54	2.70	2.89	3.08	3.26	3.41	3.56	3.64	3.71	3.72
70	1.52	1.55	1.60	1.73	1.91	2.02	2.15	2.26	2.37	2.49	2.60	2.70	2.82	2.94	3.02	3.08	3.10	3.14	3.14
75	1.56	1.58	1.61	1.65	1.76	1.86	1.96	2.07	2.18	2.29	2.38	2.46	2.55	2.64	2.69	2.76	2.78	2.80	2.83
80	1.60	1.61	1.63	1.67	1.68	1.76	1.85	1.97	2.07	2.14	2.22	2.27	2.33	2.39	2.41	2.45	2.46	2.49	2.50
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(h) Range:-90 - 90DEG  
H(h) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:AED  
Test Date:2024-04-16

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.26V I:0.1543A P:15.024W PF:0.4421 Freq:50.00Hz Lamp Flux:741.357x1 lm		
NAME: 6629	TYPE:	WEIGHT:620g
SPEC.:15W	DIM.: #6*14cm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table--2

UNIT: cd

H( DEG) V( DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.71	1.68	1.65	1.62	1.58	1.54	1.49	1.44	1.39	1.33	1.27	1.22	1.19	1.16	1.17	1.17	1.13	1.07
-75	2.33	2.28	2.22	2.15	2.08	2.01	1.92	1.84	1.75	1.69	1.61	1.54	1.47	1.38	1.29	1.24	1.21	1.15
-70	2.91	2.83	2.74	2.64	2.53	2.40	2.28	2.17	2.06	1.96	1.90	1.80	1.68	1.51	1.36	1.29	1.25	1.18
-65	4.30	4.17	3.97	3.73	3.46	3.19	2.90	2.64	2.42	2.26	2.12	2.01	1.91	1.79	1.62	1.45	1.36	1.32
-60	5.63	5.35	5.03	4.62	4.19	3.73	3.30	2.94	2.64	2.41	2.25	2.15	2.04	1.92	1.73	1.50	1.43	1.37
-55	8.69	8.16	7.50	6.78	5.99	5.06	4.23	3.59	3.06	2.65	2.38	2.18	2.04	1.93	1.79	1.57	1.37	1.35
-50	11.4	10.4	9.40	8.34	7.06	5.65	4.62	3.79	3.12	2.64	2.31	2.09	1.94	1.83	1.71	1.44	1.28	1.28
-45	20.8	17.5	14.5	12.1	9.99	8.03	6.36	5.01	3.91	3.04	2.50	2.18	2.00	1.86	1.76	1.59	1.30	1.27
-40	27.8	21.5	17.9	14.1	11.3	8.94	6.98	5.30	3.95	2.94	2.38	2.11	1.93	1.81	1.71	1.49	1.25	1.23
-35	129	117	94.9	66.3	38.1	15.4	10.3	7.62	5.67	4.11	3.05	2.52	2.23	2.04	1.91	1.76	1.41	1.32
-30	217	196	153	96.6	44.5	16.2	11.5	8.33	5.98	4.29	3.20	2.66	2.38	2.17	2.02	1.79	1.43	1.40
-25	308	282	238	188	139	86.2	33.9	12.2	8.55	6.10	4.36	3.35	2.82	2.47	2.23	2.03	1.63	1.45
-20	362	342	301	248	195	110	27.8	12.5	8.91	6.35	4.50	3.56	2.99	2.57	2.29	2.02	1.55	1.48
-15	754	521	370	315	257	188	98.1	28.2	11.9	8.24	5.91	4.28	3.48	2.92	2.54	2.28	1.85	1.61
-10	950	572	406	320	261	196	95.3	20.5	11.6	8.08	5.73	4.28	3.49	2.93	2.56	2.29	1.81	1.69
-5	2247	1349	606	387	307	231	154	55.8	14.4	9.71	7.02	4.89	3.94	3.26	2.80	2.58	2.21	1.93
0	2908	1436	556	373	286	212	130	38.6	12.7	8.90	6.46	4.64	3.78	3.17	2.79	2.71	2.21	2.04
5	2658	1577	655	385	312	237	160	62.8	14.2	9.72	7.12	4.97	4.04	3.33	2.87	2.64	2.27	1.98
10	1661	824	452	353	280	201	109	30.3	11.4	8.13	5.94	4.46	3.66	3.07	2.67	2.42	1.91	1.80
15	1173	755	429	326	277	212	121	38.7	11.6	8.19	6.13	4.48	3.68	3.07	2.66	2.36	1.91	1.65
20	405	341	307	267	227	156	60.8	13.1	8.72	6.41	4.74	3.80	3.16	2.69	2.39	2.08	1.54	1.47
25	320	294	265	233	191	130	55.6	15.5	8.20	5.96	4.53	3.56	3.00	2.60	2.31	2.07	1.62	1.43
30	240	218	192	163	107	48.3	11.8	7.80	5.70	4.30	3.34	2.83	2.50	2.26	2.07	1.82	1.39	1.36
35	160	146	128	105	75.8	40.3	13.4	6.96	5.15	3.89	3.08	2.62	2.32	2.12	1.96	1.80	1.39	1.27
40	81.4	65.3	43.3	21.1	10.1	7.69	5.91	4.57	3.50	2.75	2.38	2.15	1.97	1.85	1.74	1.51	1.21	1.20
45	45.5	39.4	28.7	17.6	9.37	6.55	5.19	4.11	3.32	2.71	2.34	2.10	1.94	1.80	1.70	1.53	1.17	1.12
50	7.53	6.99	6.39	5.80	5.10	4.27	3.51	2.97	2.59	2.29	2.08	1.90	1.77	1.67	1.55	1.28	1.06	1.10
55	5.95	5.65	5.27	4.88	4.44	3.93	3.40	2.96	2.66	2.40	2.19	2.01	1.89	1.76	1.65	1.40	1.15	1.13
60	4.12	3.99	3.82	3.63	3.41	3.14	2.89	2.68	2.49	2.30	2.15	2.02	1.88	1.76	1.59	1.28	1.20	1.20
65	3.67	3.58	3.46	3.34	3.20	3.02	2.84	2.67	2.51	2.38	2.23	2.10	1.98	1.84	1.65	1.41	1.30	1.28
70	3.11	3.06	3.01	2.94	2.86	2.75	2.64	2.54	2.43	2.32	2.21	2.10	1.98	1.78	1.53	1.41	1.38	1.34
75	2.83	2.80	2.76	2.73	2.67	2.60	2.52	2.44	2.34	2.26	2.14	2.01	1.88	1.76	1.59	1.49	1.46	1.44
80	2.52	2.50	2.49	2.47	2.42	2.38	2.32	2.26	2.21	2.12	1.97	1.81	1.67	1.60	1.56	1.53	1.53	1.53
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H(β) Range:-90 - 90DEG  
H(β) Interval: 1.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:AED  
Test Date:2024-04-16

V(B) Range:-80 - 80DEG  
V(B) Interval: 5.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.411  
Humidity:65.0%  
Test Distance:5.780m [K=1.0000]  
Remarks: