

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		2376.1 cd per klm. 0.0 degrees vertical 0.0 degrees horizontal
Beam Spread	At 10% of Imax	63.5V x 62.0H
	At 50% of Imax	35.8V x 34.6H
	At 90% of Imax	15.3V x 14.0H
Beam Flux	Total	998.7 lumens per klm.
	To 10% of Imax	872.4 lumens per klm.
	To 50% of Imax	489.4 lumens per klm.
	To 90% of Imax	95.3 lumens per klm.
Upward LOR		0.0 %
Downward LOR		99.9 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-08-24

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.11V I:0.0246A P:2.6403W PF:0.4883 Freq:50.00Hz Lamp Flux:145.293x1 lm		
NAME: 6734	TYPE:	WEIGHT:
SPEC.:10W	DIM.: 15*5.2*4.6CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

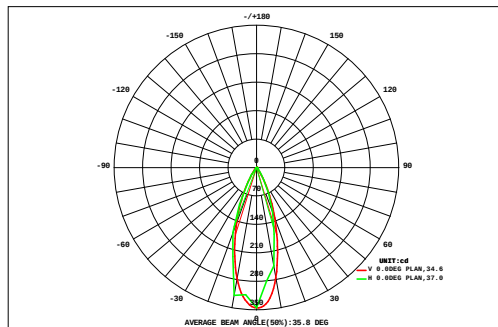

DATA OF LAMP		Eff:55.03lm/W	
MODEL		Imax(cd)	345.2
NOMINAL POWER(W)		AVAILABILITY(%)	88.8
RATED VOLTAGE(V)		Avai. FLUX(lm)	129.0
NOMINAL FLUX(lm)	145.293	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	145.3
TEST VOLTAGE(V)	0	q @50%(H,V)	35,36DEG

VERTICAL (DEG)	AREA FLUX DIAGRAM																UNIT:lm				F t	F a
	90	80	70	60	50	40	30	20	10	0	10	20	30	40	50	60	70	80	90			
	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
	0.00	0.01	0.01	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.01	0.01	0.00	0.38			
	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.04	0.04	0.04	0.04	0.03	0.03	0.02	0.01	0.01	0.00	0.39			
	0.00	0.01	0.01	0.02	0.03	0.03	0.04	0.05	0.05	0.05	0.05	0.04	0.04	0.03	0.02	0.01	0.01	0.00	0.49			
	0.00	0.01	0.01	0.02	0.03	0.04	0.05	0.06	0.08	0.10	0.09	0.06	0.04	0.03	0.02	0.02	0.01	0.00	0.67			
	0.00	0.01	0.01	0.02	0.03	0.04	0.08	0.18	0.44	0.65	0.50	0.22	0.09	0.04	0.03	0.02	0.01	0.00	2.38			
	0.00	0.01	0.02	0.03	0.04	0.07	0.26	1.01	2.30	2.92	2.15	1.02	0.27	0.07	0.03	0.02	0.01	0.00	10.2			
	0.00	0.01	0.02	0.03	0.05	0.15	0.80	3.07	5.94	7.08	5.21	2.36	0.62	0.12	0.03	0.02	0.01	0.00	25.5			
	0.00	0.01	0.02	0.03	0.06	0.26	1.53	4.76	8.86	10.1	7.13	3.23	0.88	0.16	0.04	0.02	0.01	0.00	37.1			
	0.00	0.01	0.02	0.03	0.06	0.30	1.59	4.62	8.22	9.01	6.36	2.94	0.84	0.16	0.04	0.02	0.01	0.00	34.3			
	0.00	0.01	0.02	0.03	0.06	0.23	1.09	2.90	4.89	5.31	3.75	1.75	0.53	0.12	0.04	0.02	0.01	0.00	20.8			
	0.00	0.01	0.02	0.03	0.05	0.13	0.46	1.16	1.89	2.03	1.45	0.71	0.26	0.07	0.03	0.02	0.01	0.00	8.33			
	0.00	0.01	0.02	0.03	0.04	0.06	0.16	0.30	0.46	0.49	0.38	0.22	0.10	0.04	0.03	0.02	0.01	0.00	2.38			
	0.00	0.01	0.01	0.02	0.04	0.05	0.06	0.10	0.12	0.13	0.11	0.08	0.04	0.04	0.03	0.02	0.01	0.00	0.87			
	0.00	0.01	0.01	0.02	0.03	0.04	0.06	0.06	0.05	0.05	0.05	0.05	0.05	0.04	0.03	0.02	0.01	0.00	0.57			
	0.00	0.01	0.01	0.02	0.03	0.03	0.04	0.05	0.05	0.06	0.06	0.05	0.04	0.03	0.02	0.01	0.01	0.00	0.52			
	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.03	0.04	0.04	0.03	0.03	0.02	0.02	0.01	0.01	0.00	0.35			
	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.11			
HORIZONTAL (DEG)																						
-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90				
F t	0.03	0.11	0.24	0.40	0.60	1.53	6.31	18.4	33.5	38.1	27.4	12.8	3.90	1.03	0.45	0.27	0.13	0.03	145			
F a	0.00	0.00	0.00	0.00	0.00	0.10	4.47	16.8	32.0	36.8	25.8	11.2	1.91	0.00	0.00	0.00	0.00	0.00	129			

one-half-peak spread: U:14.9,D:21.1 , L:17.0,R:17.8


NEMA Beam Type: Type 4

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-08-24

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.11V I:0.0246A P:2.6403W PF:0.4883 Freq:50.00Hz Lamp Flux:145.293x1 lm		
NAME: 6734	TYPE:	WEIGHT:
SPEC.:10W	DIM.: 15*5.2*4.6CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

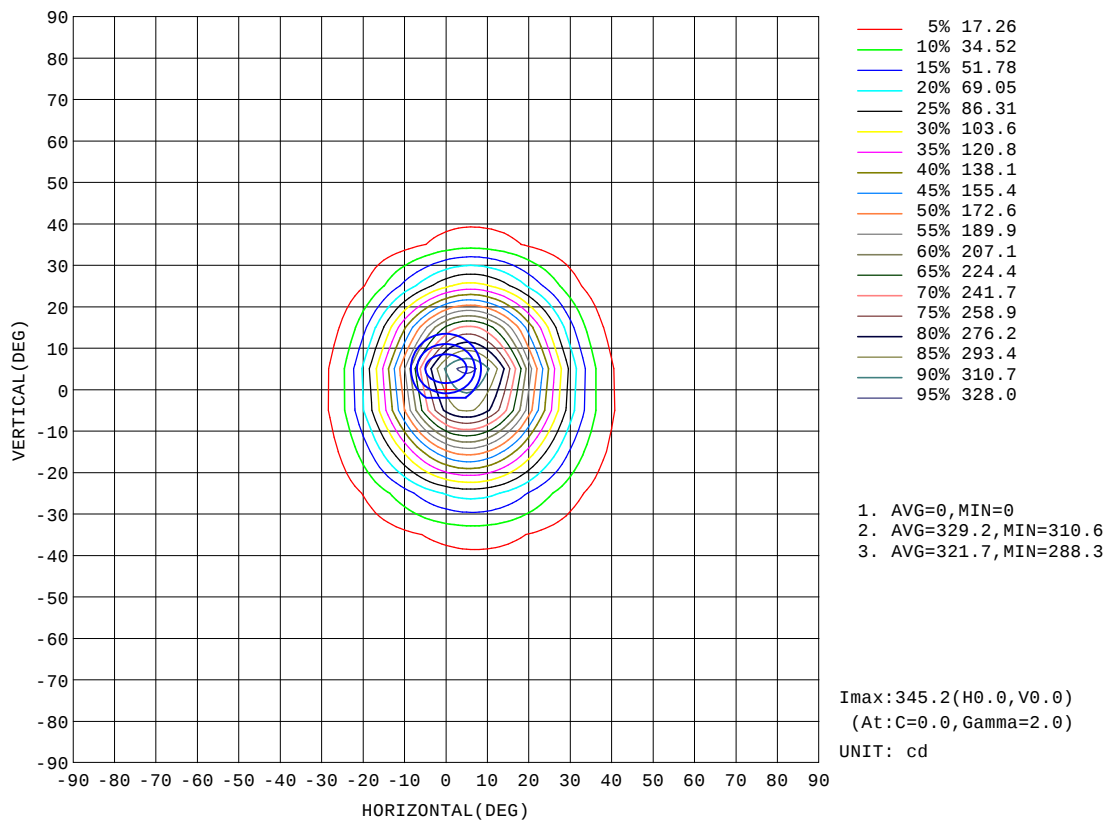


H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-08-24

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


Test:U:220.11V I:0.0246A P:2.6403W PF:0.4883 Freq:50.00Hz Lamp Flux:145.293x1 lm		
NAME: 6734	TYPE:	WEIGHT:
SPEC.:10W	DIM.: 15*5.2*4.6CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

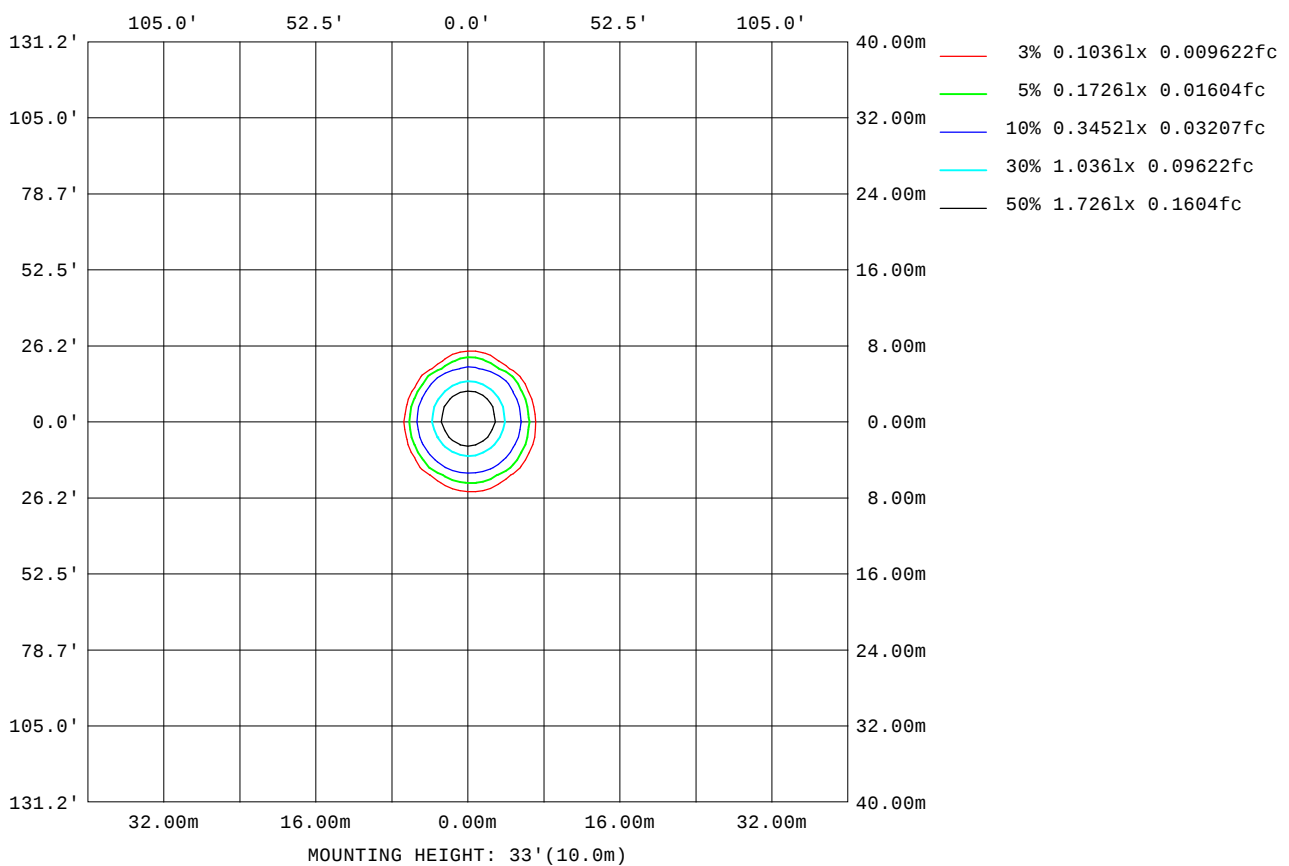

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: NORDECOR
Test Date: 2024-08-24

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

Planar Illuminance Curve

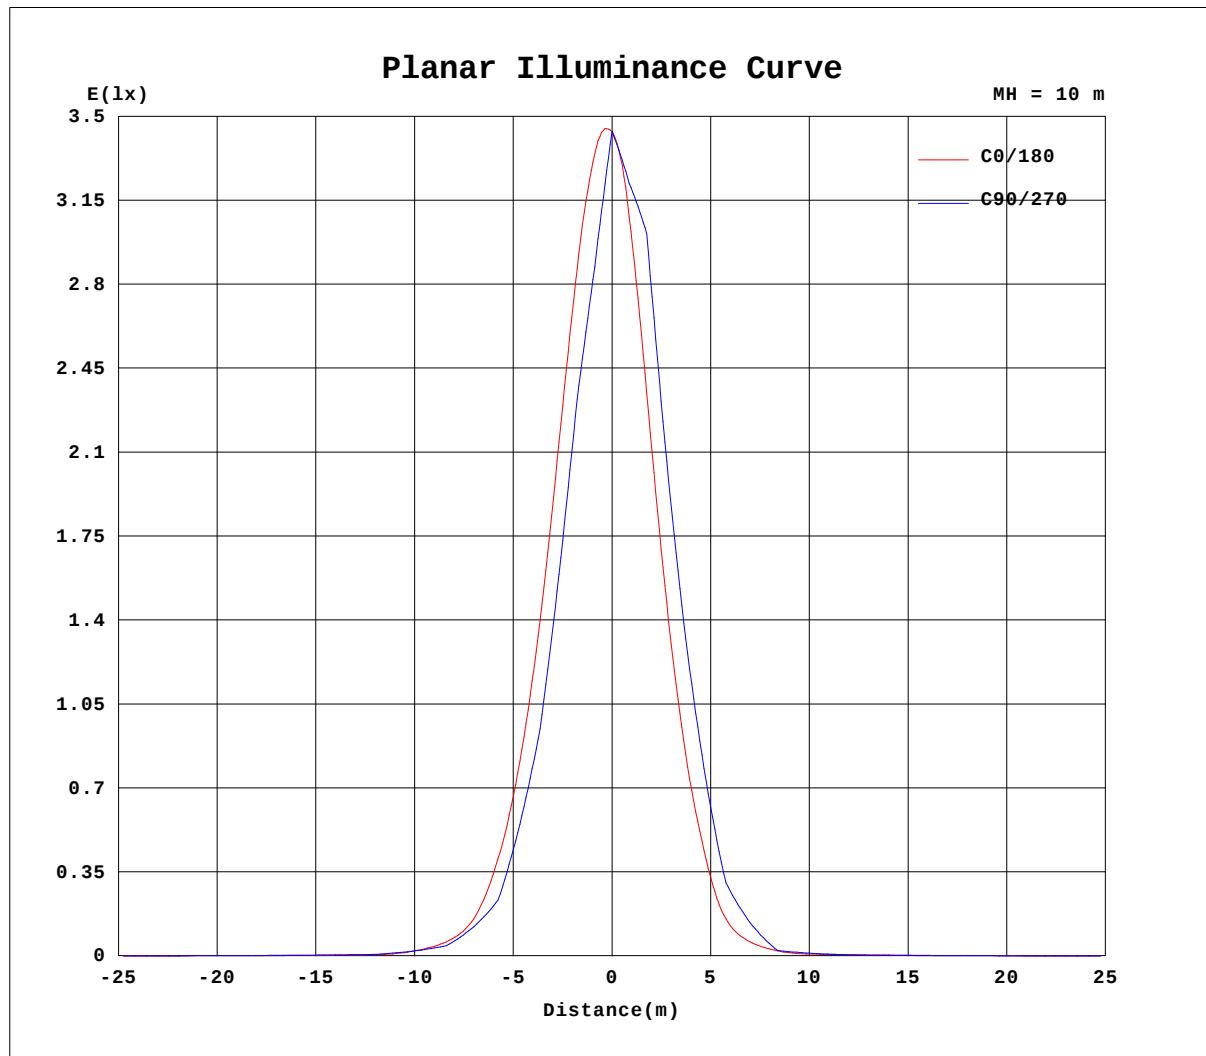


H_b Range: -90 - 90DEG
H_b Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: NORDECOR
Test Date: 2024-08-24

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.11V I:0.0246A P:2.6403W PF:0.4883 Freq:50.00Hz Lamp Flux:145.293x1 lm		
NAME: 6734	TYPE:	WEIGHT:
SPEC.:10W	DIM.: 15*5.2*4.6CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

Flux out:70.41 lm

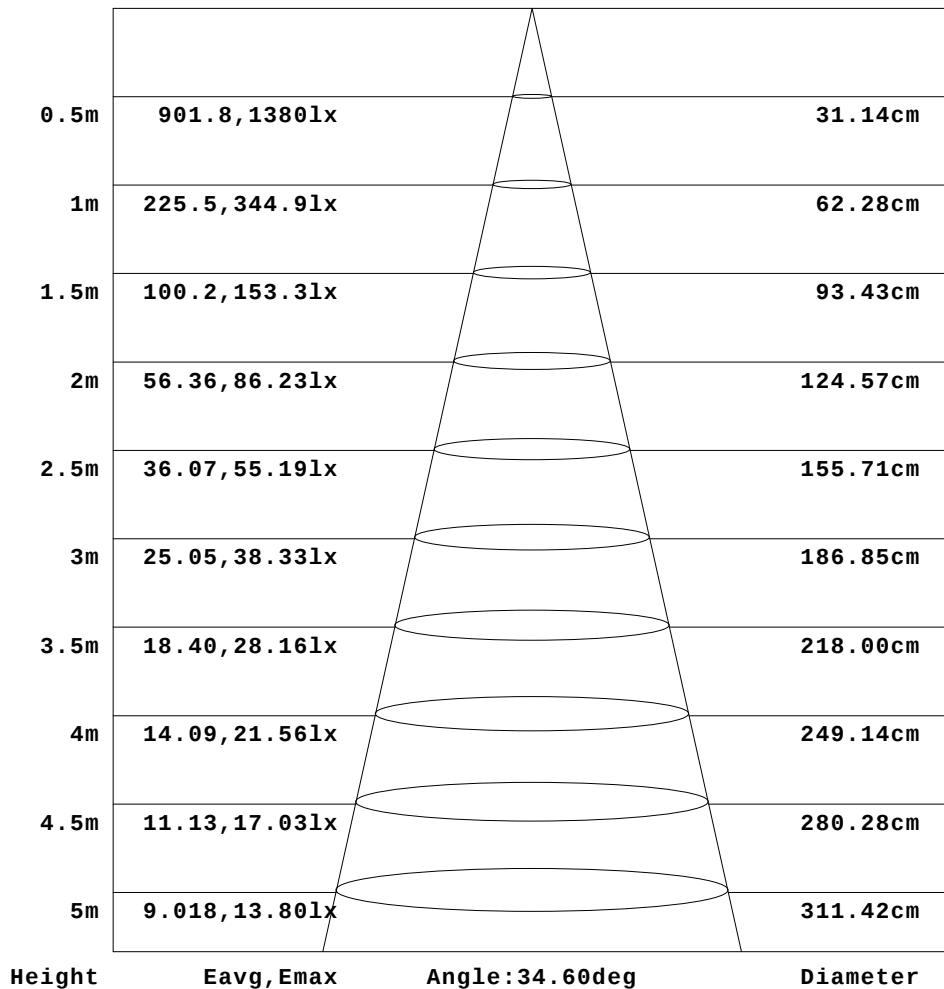

Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: NORDECOR
Test Date: 2024-08-24

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.11V I:0.0246A P:2.6403W PF:0.4883 Freq:50.00Hz Lamp Flux:145.293x1 lm		
NAME: 6734	TYPE:	WEIGHT:
SPEC.:10W	DIM.: 15*5.2*4.6CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

Table--1

UNIT: cd

H(°) \ V(°)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.66	0.67	0.68	0.67	0.68	0.68	0.69	0.69	0.72	0.75	0.79	0.79	0.78	0.77	0.76	0.76	0.78	0.78	0.79
-75	0.68	0.68	0.69	0.70	0.70	0.70	0.72	0.78	0.82	0.87	0.91	0.96	0.98	0.99	1.00	1.01	1.03	1.06	1.10
-70	0.69	0.72	0.72	0.73	0.73	0.76	0.86	0.95	1.03	1.08	1.13	1.18	1.21	1.23	1.26	1.30	1.35	1.42	1.50
-65	0.69	0.70	0.72	0.73	0.74	0.78	0.85	0.97	1.07	1.15	1.24	1.32	1.40	1.48	1.55	1.61	1.68	1.74	1.80
-60	0.71	0.73	0.75	0.75	0.82	0.95	1.07	1.19	1.28	1.39	1.52	1.63	1.75	1.86	1.96	2.06	2.13	2.18	2.21
-55	0.70	0.71	0.73	0.75	0.78	0.88	1.02	1.15	1.28	1.39	1.52	1.66	1.79	1.93	2.05	2.17	2.27	2.36	2.41
-50	0.72	0.73	0.75	0.82	0.95	1.10	1.24	1.37	1.51	1.65	1.79	1.95	2.10	2.24	2.37	2.49	2.59	2.65	2.67
-45	0.76	0.72	0.74	0.76	0.85	1.01	1.17	1.31	1.45	1.59	1.74	1.90	2.05	2.20	2.47	3.52	4.55	5.32	5.90
-40	0.73	0.75	0.77	0.88	1.07	1.23	1.38	1.53	1.68	1.84	2.00	2.15	2.30	2.70	4.67	6.61	8.05	9.14	9.93
-35	0.78	0.73	0.75	0.79	0.93	1.12	1.30	1.45	1.61	1.77	1.92	2.08	2.56	4.34	6.44	9.82	13.8	17.9	21.3
-30	0.74	0.76	0.80	0.97	1.18	1.37	1.53	1.69	1.86	2.01	2.16	2.97	6.38	10.2	15.0	21.0	27.7	33.4	36.5
-25	0.74	0.75	0.78	0.83	1.02	1.24	1.44	1.61	1.80	1.98	2.13	2.82	5.32	10.0	18.0	30.7	44.6	59.5	70.8
-20	0.76	0.80	0.86	1.06	1.30	1.51	1.70	1.90	2.09	2.25	3.48	7.66	13.7	25.8	46.5	68.2	91.3	108	116
-15	0.74	0.76	0.80	0.87	1.09	1.34	1.55	1.76	1.98	2.19	2.45	4.87	9.97	20.2	42.2	72.5	107	142	169
-10	0.76	0.80	0.88	1.11	1.38	1.59	1.82	2.06	2.28	2.64	6.26	12.3	26.7	58.5	98.5	145	193	231	245
-5	0.76	0.76	0.80	0.89	1.12	1.39	1.61	1.86	2.09	2.32	2.74	6.57	13.4	31.0	67.9	115	173	234	280
0	0.76	0.81	0.89	1.13	1.40	1.64	1.89	2.13	2.36	2.85	6.88	14.5	35.4	77.2	132	201	275	330	345
5	0.75	0.75	0.80	0.88	1.10	1.38	1.60	1.83	2.07	2.30	2.66	6.05	13.1	31.6	71.9	124	189	259	314
10	0.74	0.79	0.86	1.08	1.35	1.55	1.78	2.01	2.23	2.46	5.22	11.7	27.8	66.6	116	177	243	297	319
15	0.71	0.75	0.78	0.84	1.05	1.30	1.51	1.71	1.91	2.11	2.30	3.88	8.80	19.8	46.1	86.6	136	186	227
20	0.75	0.78	0.83	1.01	1.26	1.46	1.64	1.81	1.99	2.13	2.54	5.86	11.7	25.6	56.7	94.7	129	157	170
25	0.71	0.74	0.77	0.81	0.96	1.19	1.38	1.54	1.69	1.84	1.97	2.22	3.95	7.85	16.4	34.1	56.8	79.5	99.4
30	0.73	0.76	0.79	0.91	1.12	1.30	1.44	1.57	1.69	1.80	1.90	2.04	3.97	7.24	11.5	18.8	30.4	42.2	48.5
35	0.72	0.73	0.76	0.78	0.86	1.04	1.22	1.35	1.47	1.58	1.68	1.77	1.88	2.88	4.54	6.80	10.8	17.1	23.4
40	0.73	0.75	0.77	0.81	0.95	1.14	1.27	1.38	1.47	1.55	1.64	1.72	1.79	1.84	2.06	2.80	3.71	4.67	5.37
45	0.69	0.73	0.75	0.76	0.79	0.88	1.04	1.17	1.29	1.37	1.46	1.53	1.61	1.68	1.74	1.88	2.28	2.75	3.24
50	0.73	0.75	0.75	0.77	0.82	0.93	1.08	1.20	1.28	1.36	1.43	1.50	1.57	1.63	1.70	1.75	1.79	1.81	1.83
55	0.71	0.73	0.74	0.74	0.76	0.79	0.86	0.96	1.05	1.14	1.22	1.30	1.38	1.46	1.52	1.57	1.61	1.65	1.67
60	0.72	0.73	0.73	0.75	0.76	0.78	0.84	0.91	1.00	1.09	1.17	1.27	1.34	1.41	1.44	1.48	1.50	1.53	1.54
65	0.70	0.73	0.73	0.74	0.75	0.76	0.77	0.81	0.85	0.90	0.95	1.00	1.06	1.11	1.16	1.19	1.23	1.27	1.31
70	0.73	0.73	0.74	0.75	0.76	0.76	0.78	0.79	0.80	0.81	0.82	0.85	0.88	0.91	0.94	0.98	1.04	1.10	1.16
75	0.70	0.73	0.74	0.75	0.75	0.76	0.76	0.77	0.78	0.79	0.80	0.81	0.82	0.84	0.85	0.87	0.90	0.92	0.96
80	0.73	0.75	0.75	0.75	0.76	0.75	0.77	0.78	0.78	0.78	0.79	0.80	0.80	0.80	0.81	0.81	0.81	0.81	0.81
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: NORDECOR
Test Date: 2024-08-24

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.11V I:0.0246A P:2.6403W PF:0.4883 Freq:50.00Hz Lamp Flux:145.293x1 lm		
NAME: 6734	TYPE:	WEIGHT:
SPEC.:10W	DIM.: 15*5.2*4.6CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

Table--2

UNIT: cd

H(DEG) V(DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.79	0.78	0.77	0.77	0.76	0.77	0.78	0.77	0.78	0.75	0.74	0.72	0.70	0.69	0.68	0.67	0.66	0.66
-75	1.14	1.18	1.19	1.19	1.17	1.15	1.12	1.08	1.04	1.00	0.94	0.89	0.83	0.78	0.73	0.70	0.68	0.67
-70	1.57	1.61	1.60	1.57	1.53	1.47	1.39	1.30	1.22	1.13	1.04	0.94	0.85	0.77	0.71	0.69	0.67	0.68
-65	1.85	1.89	1.90	1.88	1.83	1.76	1.68	1.59	1.50	1.40	1.30	1.19	1.07	0.95	0.84	0.75	0.69	0.68
-60	2.21	2.19	2.15	2.08	2.00	1.90	1.80	1.69	1.58	1.47	1.34	1.20	1.04	0.91	0.78	0.70	0.68	0.66
-55	2.44	2.44	2.41	2.36	2.27	2.17	2.05	1.94	1.81	1.67	1.55	1.41	1.27	1.12	0.96	0.81	0.71	0.69
-50	2.68	2.63	2.57	2.47	2.35	2.21	2.07	1.92	1.77	1.62	1.48	1.35	1.20	1.02	0.85	0.72	0.69	0.66
-45	6.30	6.42	6.07	5.45	4.56	3.45	2.36	2.13	1.99	1.83	1.68	1.53	1.39	1.23	1.05	0.88	0.72	0.68
-40	10.2	9.52	8.33	6.66	4.56	2.51	2.20	2.06	1.90	1.74	1.59	1.43	1.25	1.08	0.92	0.72	0.67	0.85
-35	23.2	23.0	20.5	16.7	12.6	8.94	5.79	3.73	2.15	1.96	1.81	1.65	1.49	1.33	1.15	0.96	0.76	0.70
-30	35.8	31.5	25.0	18.6	13.3	9.07	5.26	2.24	2.02	1.87	1.71	1.55	1.40	1.23	1.01	0.80	0.72	0.73
-25	76.2	73.9	64.4	50.7	36.5	24.0	14.5	8.44	4.10	2.12	1.94	1.78	1.62	1.45	1.28	1.05	0.83	0.73
-20	112	97.3	76.4	54.4	34.6	19.9	11.6	5.97	2.22	2.01	1.86	1.69	1.50	1.33	1.09	0.85	0.74	0.78
-15	181	172	148	115	80.6	50.3	27.9	14.8	7.44	2.77	2.08	1.92	1.74	1.55	1.37	1.12	0.88	0.75
-10	232	198	153	107	65.9	36.0	17.9	8.92	3.32	2.15	1.98	1.79	1.60	1.40	1.16	0.90	0.77	0.75
-5	295	279	237	182	125	77.3	41.5	19.3	9.46	3.66	2.17	1.99	1.80	1.61	1.41	1.16	0.90	0.78
0	326	277	210	144	88.7	47.1	20.6	10.00	4.01	2.19	2.01	1.81	1.62	1.42	1.17	0.90	0.78	0.76
5	332	313	264	199	135	82.4	41.9	18.5	9.09	3.53	2.14	1.97	1.79	1.59	1.40	1.16	0.90	0.78
10	301	252	188	127	76.0	36.7	16.5	8.18	3.05	2.09	1.93	1.76	1.57	1.39	1.15	0.89	0.77	0.72
15	245	232	195	147	100.0	57.7	27.8	13.2	6.36	2.52	1.99	1.84	1.68	1.51	1.33	1.11	0.86	0.75
20	163	139	107	73.2	39.3	18.8	9.93	4.54	2.00	1.89	1.75	1.60	1.44	1.28	1.06	0.82	0.73	0.72
25	109	105	88.1	66.3	44.7	25.0	12.6	6.46	3.20	1.89	1.79	1.66	1.53	1.38	1.23	1.03	0.81	0.72
30	46.1	37.1	25.3	16.2	10.7	6.35	3.00	1.85	1.79	1.68	1.57	1.45	1.33	1.18	0.99	0.79	0.71	0.72
35	26.9	25.8	21.2	14.9	9.65	6.33	4.07	2.36	1.76	1.68	1.59	1.48	1.38	1.26	1.12	0.94	0.76	0.70
40	5.60	5.32	4.49	3.09	1.99	1.79	1.73	1.66	1.57	1.49	1.39	1.30	1.20	1.06	0.89	0.73	0.69	0.70
45	3.60	3.72	3.57	3.14	2.41	1.83	1.70	1.64	1.58	1.49	1.41	1.32	1.24	1.14	1.00	0.85	0.72	0.69
50	1.83	1.81	1.78	1.74	1.68	1.62	1.55	1.49	1.42	1.33	1.26	1.17	1.08	0.95	0.81	0.71	0.69	0.65
55	1.69	1.68	1.67	1.65	1.61	1.57	1.52	1.46	1.40	1.33	1.27	1.20	1.12	1.02	0.90	0.78	0.71	0.69
60	1.54	1.53	1.51	1.48	1.46	1.41	1.37	1.31	1.25	1.21	1.14	1.06	0.96	0.86	0.76	0.71	0.69	0.70
65	1.35	1.37	1.38	1.36	1.35	1.32	1.29	1.26	1.21	1.17	1.12	1.06	0.99	0.90	0.81	0.74	0.72	0.71
70	1.20	1.23	1.21	1.21	1.19	1.18	1.15	1.12	1.09	1.04	0.98	0.91	0.84	0.77	0.73	0.74	0.72	0.75
75	0.99	1.01	1.02	1.02	1.03	1.03	1.04	1.03	1.01	0.98	0.94	0.90	0.85	0.80	0.76	0.74	0.74	0.73
80	0.82	0.82	0.83	0.84	0.88	0.91	0.91	0.90	0.87	0.84	0.82	0.78	0.76	0.75	0.75	0.75	0.75	0.70
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_b Range: -90 - 90DEG
H_b Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-08-24

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks: