

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity (Luminaire orientation as tested.)		2434.6 cd per klm. 0.0 degrees vertical 1.0 degrees horizontal
Beam Spread	At 10% of Imax	63.6V x 61.4H
	At 50% of Imax	34.5V x 34.0H
	At 90% of Imax	7.9V x 13.6H
Beam Flux	Total	998.6 lumens per klm.
	To 10% of Imax	877.2 lumens per klm.
	To 50% of Imax	475.0 lumens per klm.
	To 90% of Imax	59.2 lumens per klm.
Upward LOR		0.0 %
Downward LOR		99.9 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-10

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.35V I:0.0223A P:2.3521W PF:0.4795 Freq:50.00Hz Lamp Flux:119.323x1 lm		
NAME: 6783	TYPE:	WEIGHT:94g
SPEC.:2W	DIM.: 4.6*4.6*5.2CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

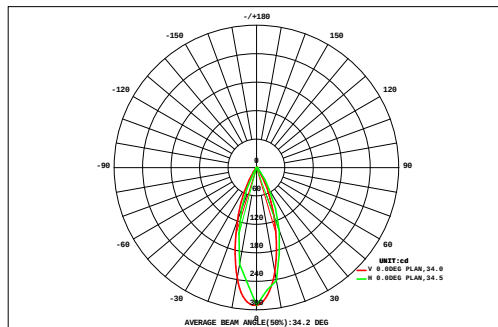

DATA OF LAMP		Eff:50.73lm/W	
MODEL		Imax(cd)	290.5
NOMINAL POWER(W)		AVAILABILITY(%)	88.4
RATED VOLTAGE(V)		Avai. FLUX(lm)	105.5
NOMINAL FLUX(lm)	119.323	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	119.3
TEST VOLTAGE(V)	0	q @50%(H,V)	34,34DEG

AREA FLUX DIAGRAM																	UNIT:lm	F t	F a
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80	0.00	0.01	0.01	0.01	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.02	0.02	0.02	0.01	0.01	0.01	0.00	0.30
70	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.01	0.01	0.01	0.00	0.32
60	0.00	0.01	0.01	0.02	0.02	0.03	0.03	0.04	0.04	0.04	0.04	0.03	0.03	0.02	0.02	0.01	0.01	0.00	0.39
50	0.00	0.01	0.01	0.02	0.02	0.03	0.04	0.04	0.05	0.05	0.04	0.04	0.03	0.03	0.02	0.01	0.01	0.00	0.44
40	0.00	0.01	0.01	0.02	0.03	0.03	0.05	0.10	0.17	0.20	0.14	0.08	0.04	0.03	0.02	0.01	0.01	0.00	0.96
30	0.00	0.01	0.01	0.02	0.03	0.05	0.17	0.56	1.13	1.32	0.95	0.38	0.09	0.03	0.02	0.01	0.01	0.00	4.80
20	0.00	0.01	0.01	0.03	0.04	0.12	0.56	1.96	3.70	4.23	2.94	1.17	0.26	0.05	0.02	0.02	0.01	0.00	15.1
10	0.00	0.01	0.02	0.03	0.04	0.25	1.24	3.69	6.58	7.36	5.01	2.13	0.48	0.08	0.03	0.02	0.01	0.00	27.0
0	0.00	0.01	0.02	0.03	0.05	0.32	1.55	4.36	7.55	8.27	5.62	2.39	0.57	0.09	0.03	0.02	0.01	0.00	30.9
-10	0.00	0.01	0.02	0.03	0.05	0.27	1.26	3.36	5.41	5.81	4.01	1.76	0.42	0.07	0.03	0.02	0.01	0.00	22.5
-20	0.00	0.01	0.02	0.03	0.04	0.16	0.63	1.64	2.66	2.78	1.92	0.82	0.22	0.05	0.02	0.02	0.01	0.00	11.0
-30	0.00	0.01	0.01	0.02	0.03	0.07	0.21	0.48	0.77	0.80	0.56	0.25	0.09	0.03	0.02	0.01	0.01	0.00	3.38
-40	0.00	0.01	0.01	0.02	0.03	0.04	0.06	0.12	0.15	0.16	0.12	0.08	0.03	0.03	0.02	0.01	0.01	0.00	0.89
-50	0.00	0.01	0.01	0.02	0.03	0.04	0.04	0.03	0.03	0.04	0.03	0.03	0.04	0.03	0.02	0.01	0.01	0.00	0.41
-60	0.00	0.01	0.01	0.02	0.02	0.03	0.04	0.04	0.05	0.05	0.04	0.04	0.03	0.02	0.02	0.01	0.00	0.00	0.44
-70	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.04	0.04	0.03	0.03	0.03	0.02	0.01	0.01	0.00	0.00	0.34
-80	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.14
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-90 -80 -70 -60 -50 -40 -30 -20 HORIZONTAL(DEG) 20 30 40 50 60 70 80 90																			
F t	0.03	0.10	0.21	0.33	0.51	1.51	5.97	16.5	28.4	31.2	21.5	9.30	2.42	0.63	0.33	0.21	0.10	0.03	119
F a	0.00	0.00	0.00	0.00	0.00	0.09	4.19	15.2	27.2	29.9	20.4	7.86	0.74	0.00	0.00	0.00	0.00	0.00	106

one-half-peak spread: U:19.8,D:15.0 , L:17.6,R:16.6


NEMA Beam Type: Type 4

H_b Range: -90 - 90DEG
H_b Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-10

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.35V I:0.0223A P:2.3521W PF:0.4795 Freq:50.00Hz Lamp Flux:119.323x1 lm		
NAME: 6783	TYPE:	WEIGHT:94g
SPEC.:2W	DIM.: 4.6*4.6*5.2CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

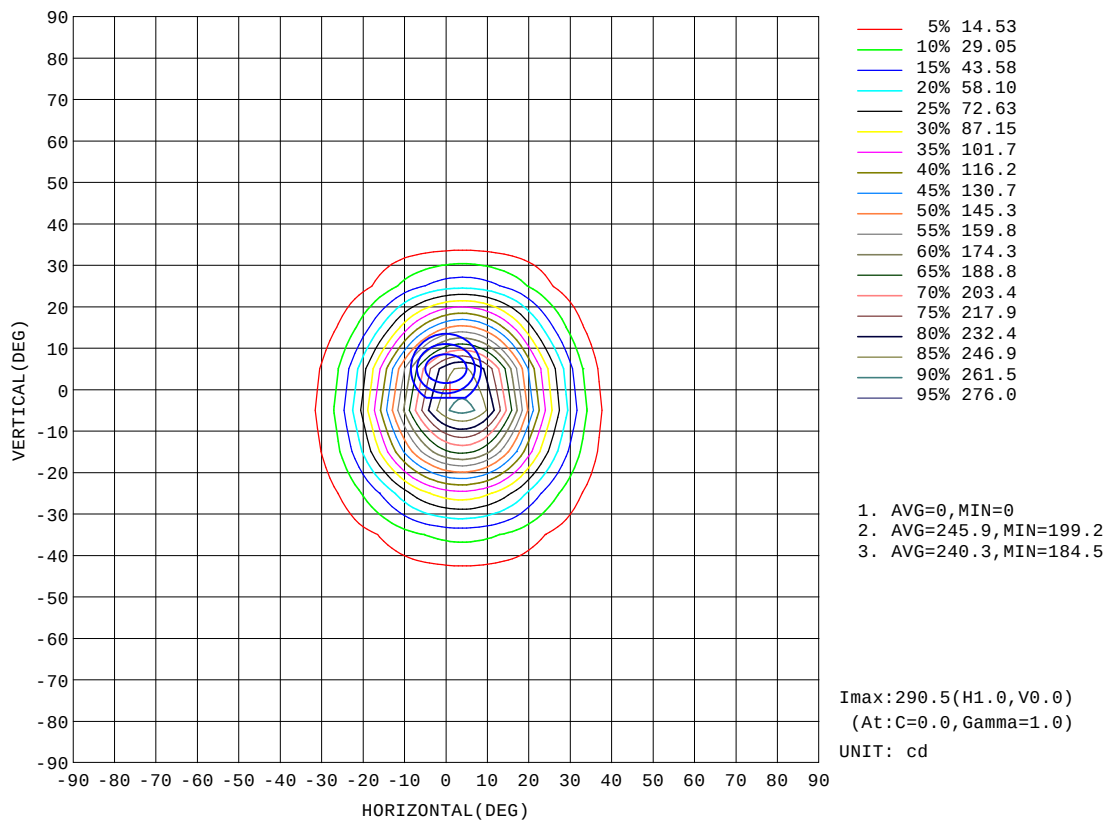


H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-10

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


Test:U:220.35V I:0.0223A P:2.3521W PF:0.4795 Freq:50.00Hz Lamp Flux:119.323x1 lm		
NAME: 6783	TYPE:	WEIGHT:94g
SPEC.:2W	DIM.: 4.6*4.6*5.2CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

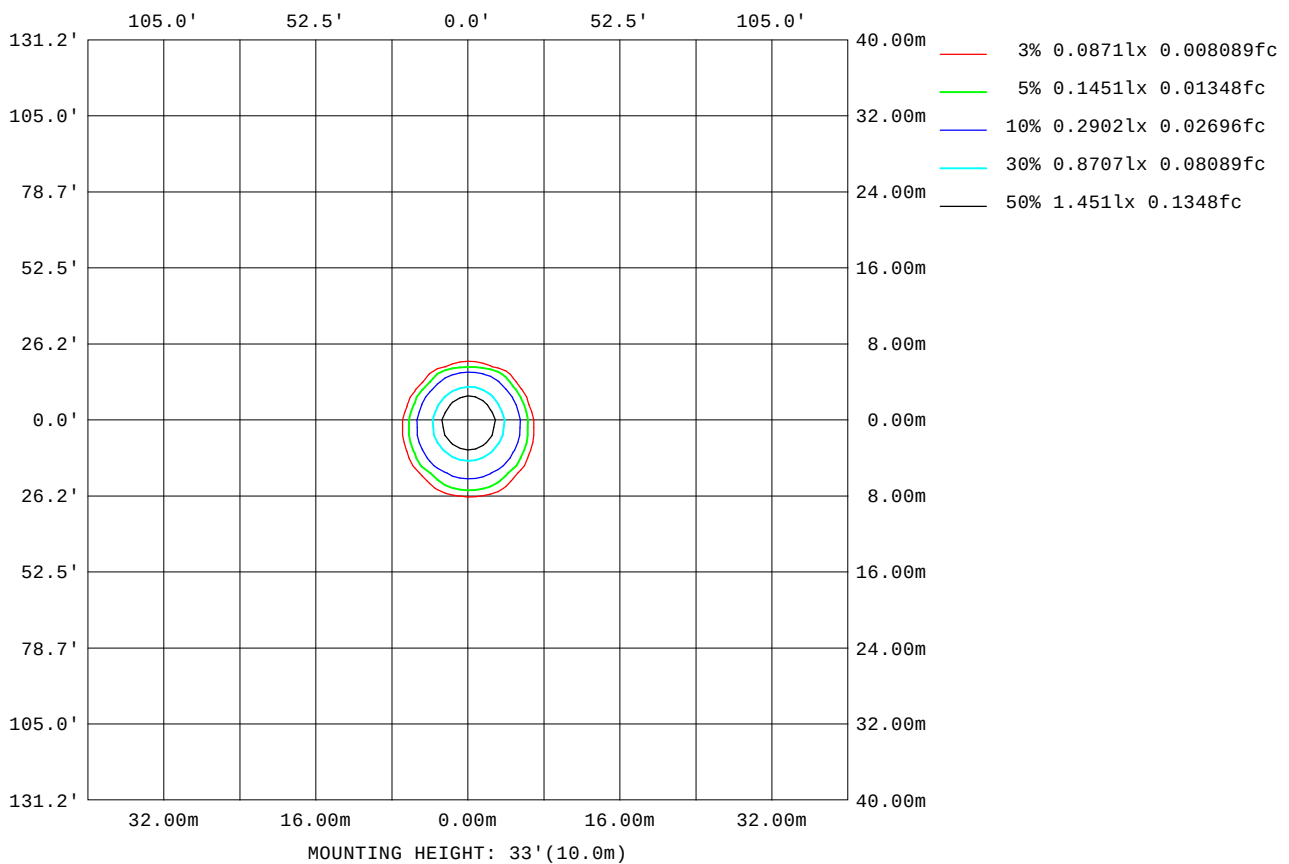

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: NORDECOR
Test Date: 2024-10-10

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

Planar Illuminance Curve

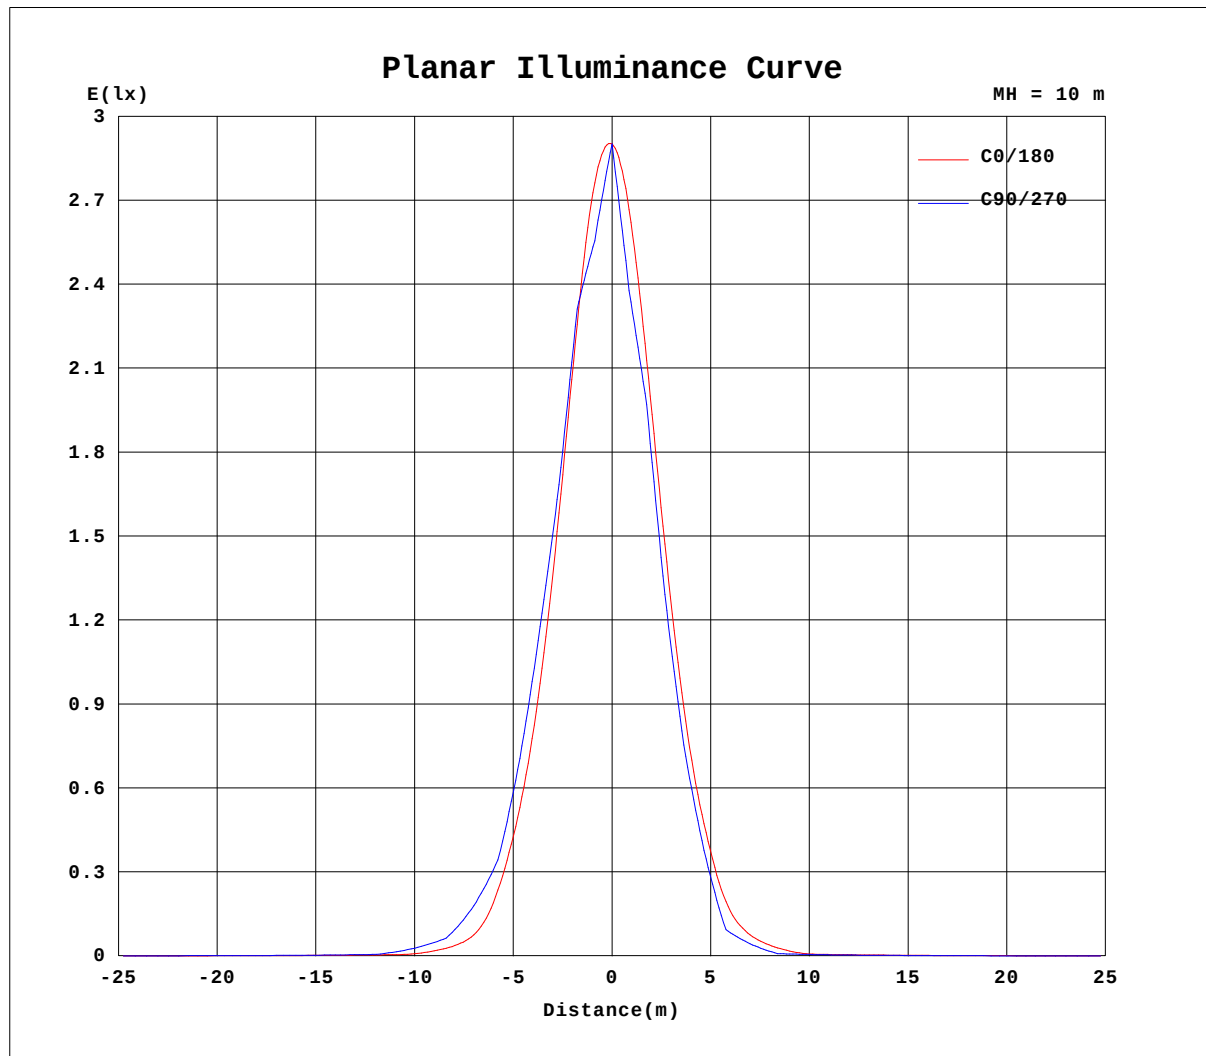


H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: NORDECOR
Test Date: 2024-10-10

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.35V I:0.0223A P:2.3521W PF:0.4795 Freq:50.00Hz Lamp Flux:119.323x1 lm		
NAME: 6783	TYPE:	WEIGHT:94g
SPEC.:2W	DIM.: 4.6*4.6*5.2CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

Flux out:57.67 lm

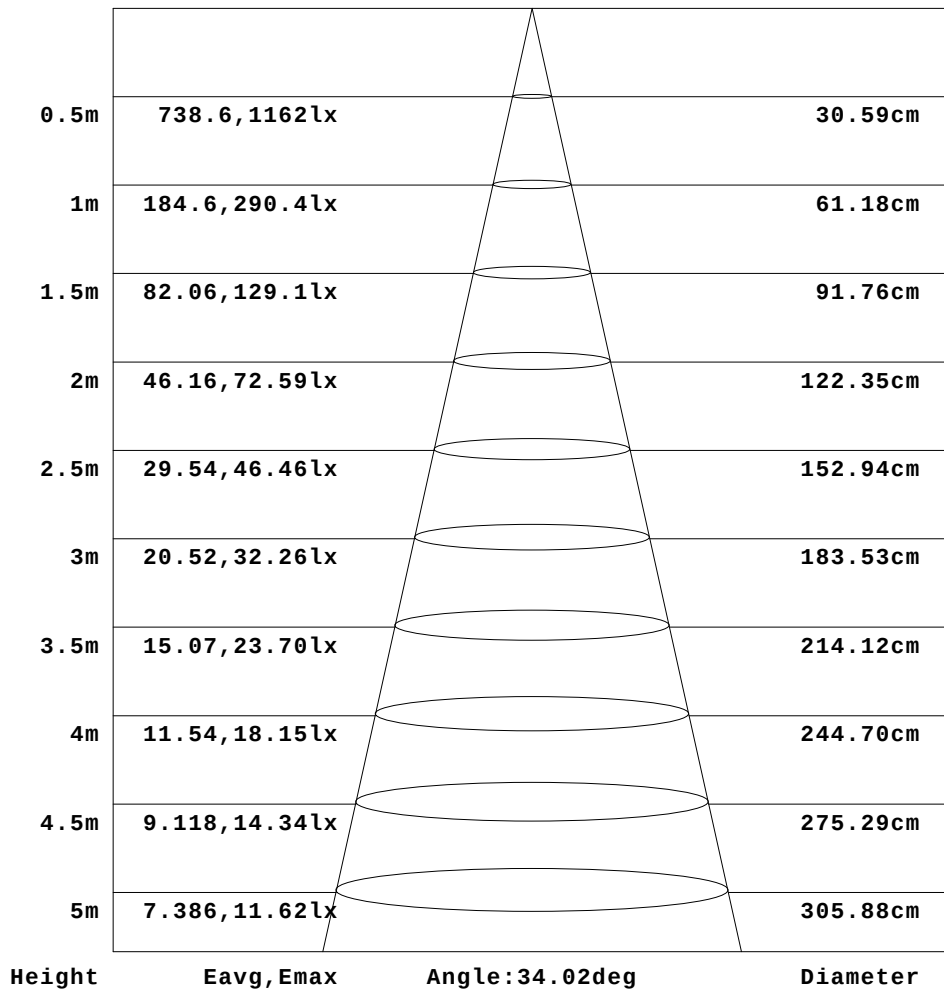

Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: NORDECOR
Test Date: 2024-10-10

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.35V I:0.0223A P:2.3521W PF:0.4795 Freq:50.00Hz Lamp Flux:119.323x1 lm		
NAME: 6783	TYPE:	WEIGHT:94g
SPEC.:2W	DIM.: 4.6*4.6*5.2CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

Table--1

UNIT: cd

H(°) \ V(°)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	0.59	0.60	0.61	0.61	0.62	0.66	0.68	0.74	0.76	0.79	0.83	0.85	0.89	0.91	0.94	0.95	0.97	0.99	0.98
-75	0.59	0.60	0.61	0.62	0.65	0.68	0.73	0.78	0.82	0.86	0.91	0.96	1.00	1.04	1.07	1.11	1.14	1.16	1.18
-70	0.60	0.62	0.63	0.66	0.71	0.76	0.82	0.88	0.93	0.99	1.05	1.11	1.16	1.22	1.27	1.28	1.34	1.36	1.36
-65	0.61	0.61	0.62	0.65	0.72	0.77	0.83	0.91	0.97	1.04	1.12	1.19	1.26	1.33	1.39	1.45	1.50	1.53	1.56
-60	0.62	0.63	0.65	0.72	0.79	0.86	0.93	1.02	1.10	1.19	1.26	1.35	1.45	1.53	1.61	1.66	1.71	1.75	1.76
-55	0.60	0.62	0.63	0.70	0.78	0.85	0.93	1.02	1.11	1.21	1.30	1.40	1.49	1.58	1.67	1.74	1.81	1.87	1.98
-50	0.62	0.63	0.69	0.74	0.85	0.94	1.04	1.14	1.24	1.34	1.44	1.56	1.66	1.75	1.84	1.90	1.98	2.13	2.28
-45	0.60	0.62	0.65	0.75	0.84	0.92	1.02	1.14	1.24	1.35	1.46	1.56	1.65	2.04	3.63	4.92	6.07	7.14	8.02
-40	0.62	0.64	0.73	0.83	0.92	1.03	1.14	1.26	1.37	1.48	1.59	1.68	1.84	4.24	7.02	9.32	11.5	13.3	14.4
-35	0.60	0.63	0.69	0.80	0.90	1.00	1.13	1.25	1.38	1.49	1.60	1.79	3.71	6.40	10.8	16.4	23.4	29.3	32.7
-30	0.63	0.66	0.77	0.88	1.00	1.13	1.28	1.40	1.52	1.63	1.72	3.93	8.42	13.7	20.9	31.7	43.1	49.8	53.0
-25	0.60	0.64	0.72	0.85	0.97	1.10	1.25	1.39	1.54	1.66	1.85	4.00	8.81	16.7	30.4	47.3	67.5	84.5	94.9
-20	0.65	0.69	0.82	0.94	1.08	1.24	1.40	1.56	1.70	1.83	4.10	9.22	17.5	34.6	59.4	87.1	114	133	142
-15	0.62	0.64	0.75	0.88	1.01	1.17	1.33	1.50	1.67	1.82	2.79	7.54	14.9	31.6	60.0	94.6	132	165	187
-10	0.64	0.70	0.82	0.96	1.11	1.29	1.46	1.65	1.81	2.13	6.72	13.5	29.0	60.4	101	148	192	227	242
-5	0.63	0.65	0.76	0.89	1.03	1.19	1.36	1.54	1.72	1.89	3.50	9.01	18.2	41.1	77.2	124	177	226	259
0	0.66	0.71	0.84	0.98	1.13	1.31	1.49	1.66	1.83	2.14	6.56	13.8	30.0	63.5	107	163	223	270	290
5	0.64	0.65	0.75	0.88	1.02	1.17	1.34	1.50	1.67	1.82	2.74	7.52	15.5	34.0	67.5	110	159	208	240
10	0.64	0.69	0.82	0.95	1.09	1.24	1.39	1.55	1.70	1.82	4.10	9.52	18.9	42.3	76.4	115	156	190	206
15	0.66	0.64	0.73	0.85	0.98	1.10	1.25	1.39	1.53	1.65	1.84	4.09	8.90	17.8	36.5	62.6	94.2	123	143
20	0.63	0.68	0.80	0.91	1.03	1.15	1.28	1.39	1.51	1.61	1.70	3.87	7.69	13.3	26.4	47.8	68.9	83.6	90.9
25	0.66	0.63	0.70	0.81	0.92	1.02	1.14	1.24	1.35	1.44	1.53	1.80	3.42	6.02	10.9	20.5	33.1	43.6	50.8
30	0.63	0.65	0.74	0.84	0.93	1.03	1.12	1.22	1.31	1.38	1.45	1.50	1.89	3.79	5.87	8.19	10.8	13.3	14.6
35	0.64	0.63	0.67	0.76	0.85	0.93	1.01	1.10	1.18	1.25	1.32	1.39	1.44	1.95	3.05	4.12	5.38	6.77	7.97
40	0.62	0.63	0.71	0.79	0.85	0.93	1.01	1.08	1.15	1.21	1.28	1.33	1.39	1.44	1.47	1.51	1.63	1.83	1.98
45	0.62	0.62	0.64	0.72	0.79	0.85	0.92	0.99	1.05	1.11	1.17	1.21	1.28	1.34	1.38	1.41	1.46	1.55	1.66
50	0.62	0.62	0.66	0.72	0.79	0.84	0.90	0.97	1.02	1.08	1.13	1.18	1.24	1.28	1.32	1.36	1.38	1.40	1.40
55	0.61	0.62	0.63	0.67	0.73	0.78	0.84	0.88	0.93	0.98	1.03	1.07	1.12	1.16	1.19	1.22	1.25	1.28	1.29
60	0.63	0.63	0.63	0.68	0.72	0.77	0.82	0.86	0.90	0.94	0.98	1.02	1.05	1.08	1.12	1.13	1.16	1.18	1.18
65	0.62	0.63	0.64	0.65	0.67	0.71	0.75	0.79	0.82	0.86	0.88	0.91	0.94	0.96	0.98	1.01	1.02	1.03	1.04
70	0.63	0.64	0.64	0.65	0.66	0.70	0.73	0.76	0.78	0.80	0.82	0.85	0.85	0.86	0.88	0.90	0.90	0.90	0.91
75	0.64	0.64	0.65	0.64	0.62	0.66	0.65	0.68	0.68	0.71	0.72	0.72	0.74	0.75	0.76	0.79	0.76	0.77	0.78
80	0.64	0.63	0.64	0.59	0.61	0.66	0.64	0.62	0.61	0.58	0.62	0.62	0.62	0.66	0.68	0.64	0.62	0.62	0.67
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: NORDECOR
Test Date: 2024-10-10

V(B) Range: -80 - 80DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.780m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.35V I:0.0223A P:2.3521W PF:0.4795 Freq:50.00Hz Lamp Flux:119.323x1 lm		
NAME: 6783	TYPE:	WEIGHT:94g
SPEC.:2W	DIM.: 4.6*4.6*5.2CM	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:38°

Table--2

UNIT: cd

H(°) \ V(°)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-80	1.00	1.00	0.98	0.98	0.96	0.88	0.82	0.74	0.68	0.65	0.64	0.64	0.64	0.63	0.62	0.62	0.59	0.57
-75	1.19	1.18	1.18	1.16	1.13	1.10	1.04	0.96	0.87	0.79	0.73	0.68	0.65	0.63	0.63	0.62	0.61	0.59
-70	1.37	1.37	1.34	1.30	1.27	1.23	1.17	1.06	0.97	0.87	0.76	0.68	0.64	0.62	0.62	0.61	0.59	0.62
-65	1.57	1.55	1.54	1.50	1.45	1.40	1.34	1.26	1.17	1.07	0.94	0.83	0.73	0.66	0.62	0.62	0.61	0.59
-60	1.75	1.72	1.70	1.63	1.57	1.50	1.40	1.33	1.24	1.12	0.98	0.86	0.73	0.64	0.63	0.61	0.60	0.58
-55	2.03	1.96	1.85	1.78	1.71	1.63	1.55	1.45	1.36	1.26	1.14	1.02	0.88	0.75	0.65	0.62	0.61	0.60
-50	2.25	2.06	1.91	1.84	1.76	1.66	1.57	1.45	1.36	1.26	1.15	1.01	0.86	0.72	0.62	0.61	0.60	0.57
-45	8.34	7.83	6.82	5.54	4.31	3.11	1.91	1.56	1.46	1.37	1.26	1.15	1.01	0.86	0.71	0.62	0.61	0.60
-40	14.0	12.5	10.2	7.74	5.43	2.96	1.65	1.54	1.44	1.35	1.24	1.13	0.98	0.81	0.67	0.61	0.60	0.60
-35	33.6	31.4	26.9	20.0	13.3	8.28	4.80	2.71	1.56	1.46	1.36	1.25	1.09	0.94	0.80	0.66	0.62	0.61
-30	51.3	45.5	35.7	23.9	14.7	9.03	5.15	2.06	1.52	1.42	1.29	1.17	1.04	0.90	0.74	0.64	0.62	0.62
-25	97.1	89.7	75.1	55.6	36.4	21.1	10.9	5.58	2.37	1.56	1.46	1.34	1.19	1.03	0.87	0.70	0.64	0.62
-20	136	118	92.0	63.5	39.1	19.4	9.59	4.67	1.74	1.56	1.43	1.33	1.18	0.98	0.78	0.66	0.64	0.62
-15	192	177	146	107	70.6	40.9	18.9	8.62	3.80	1.68	1.54	1.42	1.31	1.15	0.92	0.71	0.67	0.64
-10	235	202	154	105	64.6	33.5	13.6	6.23	2.38	1.65	1.50	1.40	1.22	1.10	0.79	0.69	0.66	0.64
-5	266	245	198	142	92.8	54.1	24.2	9.89	4.49	1.75	1.58	1.46	1.34	1.19	0.95	0.73	0.68	0.64
0	279	236	176	118	71.3	36.3	13.8	6.26	2.43	1.64	1.51	1.39	1.26	1.06	0.83	0.70	0.61	0.63
5	248	226	181	129	83.6	47.1	20.0	8.41	3.75	1.70	1.56	1.45	1.32	1.17	0.95	0.76	0.68	0.64
10	197	166	124	83.8	50.2	21.8	9.21	4.38	1.78	1.57	1.46	1.35	1.21	1.03	0.83	0.69	0.65	0.60
15	148	135	109	77.8	48.3	25.0	10.8	5.08	2.28	1.54	1.45	1.35	1.24	1.11	0.91	0.73	0.66	0.64
20	87.9	75.8	57.4	35.2	16.9	8.33	4.39	1.93	1.49	1.41	1.33	1.24	1.12	0.95	0.76	0.65	0.63	0.61
25	52.8	48.4	39.6	28.0	16.0	7.86	4.16	2.33	1.48	1.39	1.32	1.22	1.14	1.01	0.83	0.68	0.63	0.62
30	13.8	11.3	8.50	6.08	4.01	2.24	1.47	1.42	1.35	1.28	1.20	1.13	1.02	0.87	0.71	0.62	0.62	0.62
35	8.24	7.38	5.91	4.50	3.34	2.33	1.58	1.38	1.32	1.25	1.19	1.12	1.03	0.91	0.75	0.64	0.62	0.60
40	1.95	1.79	1.58	1.47	1.45	1.39	1.34	1.28	1.22	1.16	1.09	1.02	0.90	0.76	0.64	0.61	0.60	0.58
45	1.69	1.65	1.54	1.43	1.39	1.36	1.31	1.25	1.20	1.14	1.08	1.02	0.92	0.80	0.69	0.61	0.61	0.59
50	1.41	1.38	1.37	1.34	1.29	1.25	1.21	1.17	1.11	1.06	1.00	0.92	0.80	0.69	0.61	0.61	0.60	0.58
55	1.29	1.30	1.28	1.26	1.23	1.20	1.17	1.12	1.08	1.03	0.97	0.90	0.81	0.71	0.64	0.62	0.61	0.60
60	1.19	1.18	1.16	1.15	1.13	1.10	1.07	1.04	0.99	0.94	0.84	0.77	0.70	0.64	0.61	0.62	0.60	0.60
65	1.04	1.05	1.05	1.03	1.00	0.98	0.96	0.93	0.90	0.85	0.81	0.75	0.70	0.66	0.64	0.63	0.63	0.61
70	0.90	0.92	0.90	0.87	0.85	0.84	0.82	0.78	0.75	0.71	0.68	0.67	0.65	0.66	0.65	0.65	0.63	0.64
75	0.78	0.79	0.79	0.78	0.76	0.76	0.74	0.74	0.72	0.70	0.68	0.66	0.66	0.66	0.63	0.62	0.63	0.62
80	0.66	0.66	0.66	0.67	0.66	0.67	0.66	0.67	0.66	0.66	0.66	0.65	0.66	0.66	0.61	0.62	0.63	0.62
85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

H_b Range:-90 - 90DEG
H_b Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:NORDECOR
Test Date:2024-10-10

V(B) Range:-80 - 80DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.780m [K=1.0000]
Remarks: