


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm		
NAME: POWERUS	TYPE:	WEIGHT:
SPEC.:	DIM.: 65*60*163mm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

DATA OF LAMP		PHOTOMETRIC DATA Eff: 2852.10 lm/W			
MODEL	6734	I _{max} (cd)	3861	S/MH(C0/180)	0.51
NOMINAL POWER(W)	20	LOR(%)	100.0	S/MH(C90/270)	0.37
RATED VOLTAGE(V)	85-265V	TOTAL FLUX(lm)	823.89	h UP, DN(C0-180)	0.0,50.9
NOMINAL FLUX(lm)	823.892	CIE CLASS	DIRECT	h UP, DN(C180-360)	0.0,49.1
LAMPS INSIDE	1	h up(%)	0.0	CIBSE SHR NOM	0.00
TEST VOLTAGE(V)	220	h down(%)	100.0	CIBSE SHR MAX	1.00

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

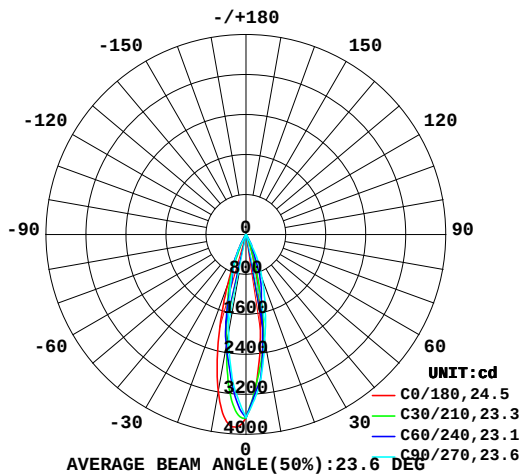

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

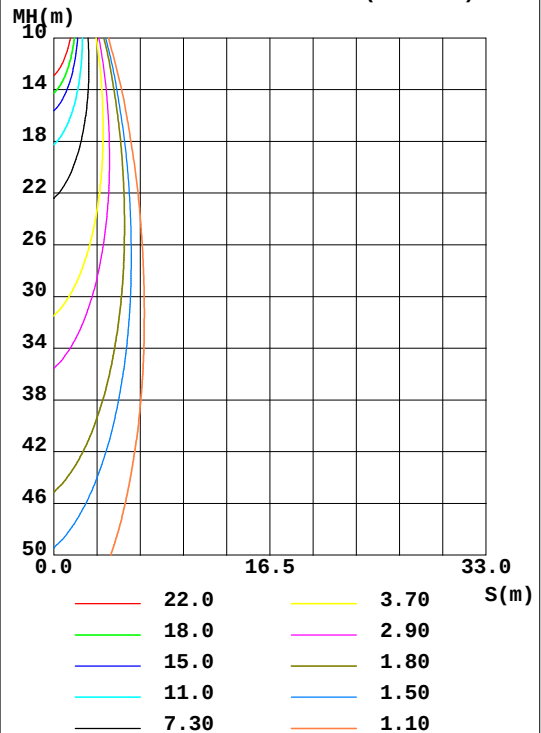

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 2026-07-02

V(B) Range: -75 - 75DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.000m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

g	C0	C45	C90	C135	C180	C225	C270	C315	g	F zone	F total	%lum, lamp
10	1645	1950	2155	2375	3206	2282	2020	1880	0- 10	264.1	264.1	32.1, 32.1
20	281.5	575.2	954.9	735.2	1100	637.2	813.3	491.9	10- 20	355.7	619.7	75.2, 75.2
30	32.74	76.16	68.95	192.9	135.6	161.9	48.66	64.58	20- 30	151.3	771.1	93.6, 93.6
40	15.46	14.03	31.95	21.81	30.52	21.50	25.07	13.60	30- 40	25.96	797.0	96.7, 96.7
50	10.97	8.428	9.081	11.92	17.30	12.57	11.71	8.316	40- 50	11.63	808.7	98.2, 98.2
60	7.227	4.107	0.3329	5.258	12.36	8.358	8.594	5.851	50- 60	7.597	816.3	99.1, 99.1
70	4.336	0.3259	0.3272	0.3198	7.912	5.832	5.772	4.093	60- 70	4.617	820.9	99.6, 99.6
80	2.773	0.2609	0	0.2577	4.613	3.011	0	2.013	70- 80	2.541	823.4	99.9, 99.9
90	1.863	0	0	0	1.991	0	0	0	80- 90	0.4825	823.9	100, 100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 803.64 lm

%lum = 97.5%

%lamp = 97.5%

Conical surface Flux(120deg): 816.25 lm

%lum = 99.1%


%lamp = 99.1%

H_(b) Range:-90 - 90DEG
 H_(b) Interval: 1.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:
 Test Date:2026-07-02

V(B) Range:-75 - 75DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
 Humidity:65.0%
 Test Distance:5.000m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.: 65*60*163mm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

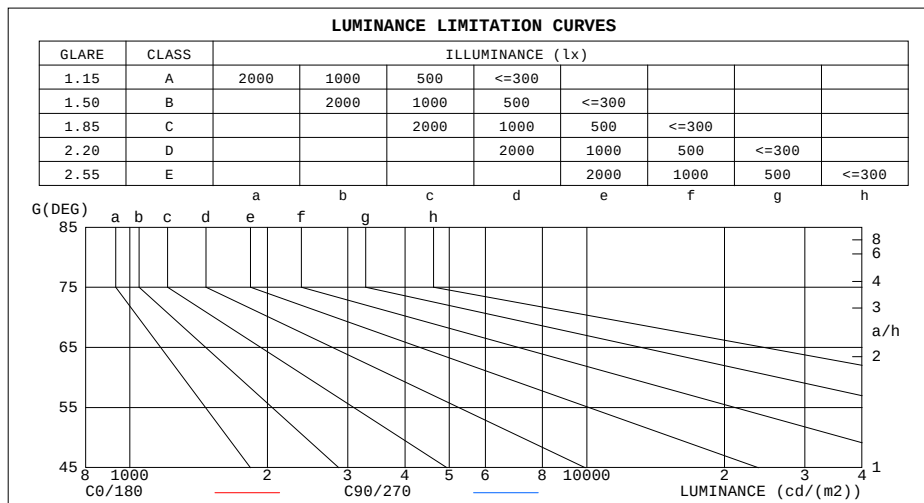

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	255	0
80	160	0
75	129	12
70	127	10
65	135	7
60	145	7
55	158	83
50	171	141
45	182	192


H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 2026-07-02

V(B) Range: -75 - 75DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.000m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.: 65*60*163mm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

r CC	80%			70%			50%			30%			10%			0
r W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r fc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.13	1.10	1.09	1.10	1.09	1.07	1.06	1.05	1.04	1.03	1.02	1.01	.99	.99	.98	.96
2.0	1.07	1.04	1.01	1.05	1.02	.00	1.02	.00	.98	.99	.97	.96	.96	.95	.94	.92
3.0	1.02	.98	.95	1.01	.97	.94	.98	.95	.93	.96	.93	.91	.94	.92	.90	.89
4.0	.98	.93	.90	.97	.93	.90	.95	.91	.89	.93	.90	.88	.91	.89	.87	.86
5.0	.94	.89	.86	.93	.89	.86	.91	.88	.85	.90	.87	.84	.88	.86	.84	.83
6.0	.90	.86	.83	.90	.86	.83	.88	.85	.82	.87	.84	.81	.86	.83	.81	.80
7.0	.87	.83	.80	.87	.82	.80	.85	.82	.79	.84	.81	.79	.83	.81	.78	.77
8.0	.84	.80	.77	.84	.80	.77	.83	.79	.77	.82	.79	.76	.81	.78	.76	.75
9.0	.82	.77	.74	.81	.77	.74	.80	.77	.74	.80	.76	.74	.79	.76	.74	.73
10.0	.79	.75	.72	.79	.75	.72	.78	.74	.72	.78	.74	.72	.77	.74	.72	.71

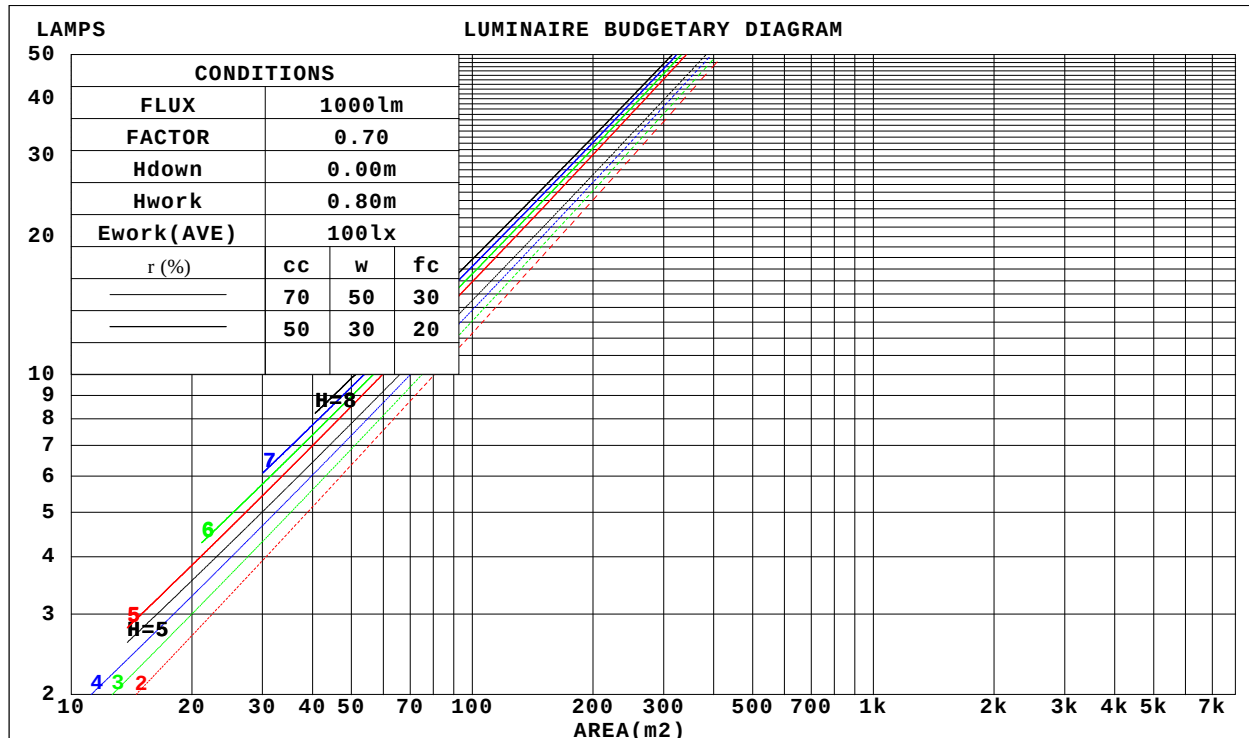

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 2026-07-02

V(B) Range: -75 - 75DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.000m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm					
NAME:			TYPE:		WEIGHT:
SPEC.:			DIM.: 65*60*163mm		SERIAL No.:01
MFR.: NORDECOR			SUR.:		Shielding Angle:24°

r _{CC}	80%			70%			50%			30%			10%			0
r _W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r _{fC}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Wall Exitance Coefficients(WEC)												
0.0																
1.0	.144	.082	.026	.138	.079	.025	.125	.072	.023	.114	.066	.021	.103	.060	.019	
2.0	.134	.074	.023	.129	.071	.022	.119	.066	.020	.109	.061	.019	.100	.057	.018	
3.0	.125	.067	.020	.121	.065	.019	.112	.061	.018	.104	.057	.017	.097	.054	.017	
4.0	.117	.061	.018	.114	.059	.018	.106	.056	.017	.099	.053	.016	.093	.051	.015	
5.0	.111	.056	.016	.107	.055	.016	.101	.053	.015	.095	.050	.015	.090	.048	.014	
6.0	.105	.052	.015	.102	.051	.015	.096	.049	.014	.091	.047	.014	.087	.046	.014	
7.0	.099	.049	.014	.097	.048	.014	.092	.047	.013	.088	.045	.013	.084	.043	.013	
8.0	.095	.046	.013	.092	.045	.013	.088	.044	.013	.084	.043	.012	.081	.041	.012	
9.0	.090	.044	.012	.088	.043	.012	.085	.042	.012	.081	.041	.012	.078	.040	.011	
10.0	.087	.041	.012	.085	.041	.011	.082	.040	.011	.079	.039	.011	.076	.038	.011	

r _{cc}	80%			70%			50%			30%			10%			0
r _w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
r _{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Ceiling Cavity Exitance Coefficients(CCEC)												
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.169	.158	.147	.144	.135	.127	.099	.093	.088	.057	.054	.051	.018	.017	.017	
2.0	.151	.133	.117	.130	.114	.101	.089	.079	.071	.051	.046	.041	.016	.015	.013	
3.0	.137	.113	.095	.117	.098	.082	.080	.068	.058	.046	.040	.034	.015	.013	.011	
4.0	.124	.098	.078	.107	.085	.068	.073	.059	.048	.042	.035	.028	.014	.011	.009	
5.0	.114	.086	.065	.098	.074	.057	.067	.052	.040	.039	.030	.024	.013	.010	.008	
6.0	.105	.076	.055	.091	.066	.048	.062	.046	.034	.036	.027	.020	.012	.009	.007	
7.0	.098	.068	.047	.084	.059	.041	.058	.041	.029	.034	.024	.017	.011	.008	.006	
8.0	.091	.061	.040	.079	.053	.035	.054	.037	.025	.032	.022	.015	.010	.007	.005	
9.0	.086	.056	.035	.074	.048	.031	.051	.034	.022	.030	.020	.013	.010	.007	.004	
10.0	.081	.051	.031	.070	.044	.027	.048	.031	.019	.028	.018	.011	.009	.006	.004	

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 2026-07-02

V(B) Range: -75 - 75DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.000m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm											
NAME:					TYPE:			WEIGHT:			
SPEC.:					DIM.: 65*60*163mm			SERIAL No.:01			
MFR.: NORDECOR					SUR.:			Shielding Angle:24°			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	2H	-2.9	-2.2	-2.7	-2.1	-1.9	-3.3	-2.6	-3.1	-2.5	-2.3
	3H	-1.7	-1.1	-1.5	-0.9	-0.7	-3.5	-2.8	-3.2	-2.6	-2.5
	4H	-1.2	-0.5	-0.9	-0.3	-0.1	-3.5	-2.9	-3.3	-2.7	-2.5
	6H	-0.6	-0.0	-0.3	0.2	0.4	-3.6	-3.0	-3.3	-2.8	-2.6
	8H	-0.3	0.2	-0.0	0.5	0.7	-3.7	-3.1	-3.4	-2.9	-2.6
	12H	0.1	0.6	0.4	0.9	1.1	-3.7	-3.2	-3.4	-2.9	-2.7
4H	2H	-2.9	-2.3	-2.6	-2.1	-1.9	-3.3	-2.7	-3.1	-2.5	-2.3
	3H	-1.7	-1.1	-1.4	-0.9	-0.6	-3.5	-2.9	-3.2	-2.7	-2.4
	4H	-1.1	-0.6	-0.8	-0.3	-0.0	-3.6	-3.1	-3.2	-2.8	-2.5
	6H	-0.5	-0.1	-0.2	0.2	0.6	-3.6	-3.2	-3.3	-2.9	-2.5
	8H	-0.2	0.2	0.1	0.5	0.9	-3.7	-3.3	-3.3	-2.9	-2.6
	12H	0.2	0.5	0.6	0.9	1.3	-3.8	-3.4	-3.4	-3.0	-2.6
8H	4H	-1.3	-0.8	-0.9	-0.5	-0.1	-3.7	-3.2	-3.3	-2.9	-2.5
	6H	-0.7	-0.4	-0.3	0.0	0.5	-3.8	-3.4	-3.3	-3.0	-2.6
	8H	-0.4	-0.1	0.1	0.3	0.8	-3.8	-3.5	-3.4	-3.1	-2.7
	12H	0.0	0.3	0.5	0.7	1.2	-3.9	-3.6	-3.4	-3.2	-2.7
12H	4H	-1.3	-0.9	-0.9	-0.6	-0.2	-3.7	-3.3	-3.3	-3.0	-2.6
	6H	-0.7	-0.4	-0.3	-0.0	0.4	-3.8	-3.5	-3.4	-3.1	-2.7
	8H	-0.4	-0.2	0.0	0.3	0.7	-3.9	-3.6	-3.4	-3.2	-2.7
Variations with the observer position at spacings:											
S = 1.0H		+ 0.4 / - 0.6					+ 3.6 / - 5.7				
1.5H		+ 0.4 / - 0.6					+ 4.7 / - 2.8				
2.0H		+ 1.1 / - 1.1					+ 3.6 / -11.7				

CIE Pub.117, 823.9 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.7)
Area: 0.1 m2

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:2026-07-02

V(B) Range:-75 - 75DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.000m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.: 65*60*163mm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	90	84	80	89	83	80	88	83	80	76
0.80	97	91	88	96	91	88	95	90	87	84
1.00	101	95	92	100	95	92	98	95	91	87
1.25	104	99	96	103	99	96	101	98	95	91
1.50	107	102	99	106	102	99	103	100	98	93
2.00	109	105	102	108	104	101	105	102	100	95
2.50	111	107	104	109	106	103	106	104	102	96
3.00	112	109	106	110	108	105	107	105	103	97
4.00	114	112	110	112	110	108	109	107	105	98
5.00	115	113	112	113	111	110	109	108	107	99
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

H_b) Range:-90 - 90DEG
H_b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:2026-07-02

V(B) Range:-75 - 75DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.000m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.: 65*60*163mm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

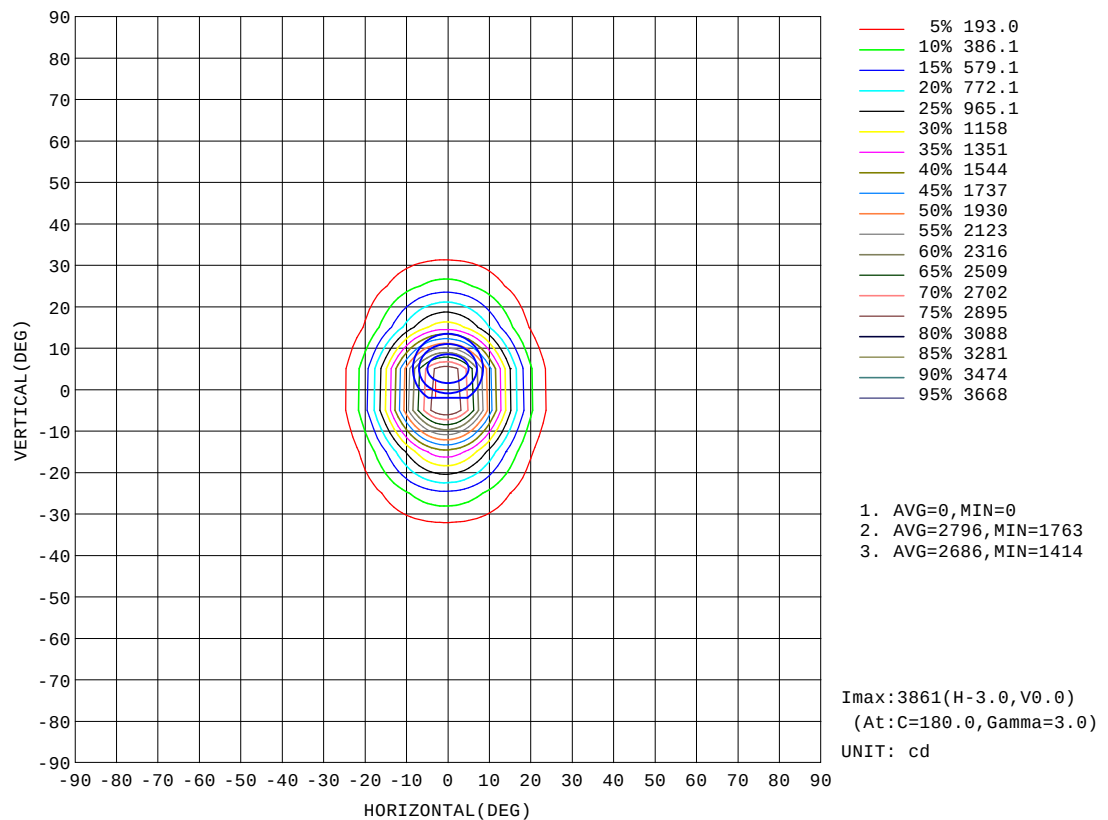


H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:2026-07-02

V(B) Range:-75 - 75DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.000m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.: 65*60*163mm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

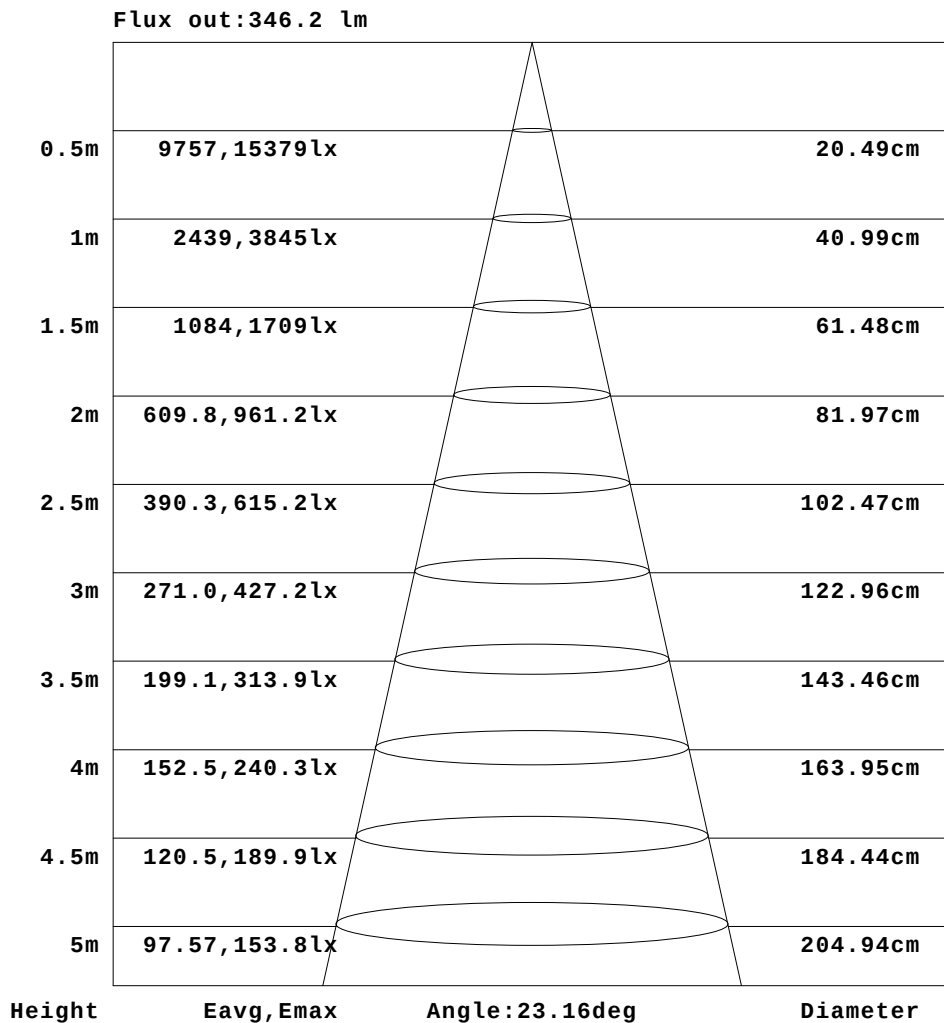


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:2026-07-02

V(B) Range:-75 - 75DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.000m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.: 65*60*163mm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

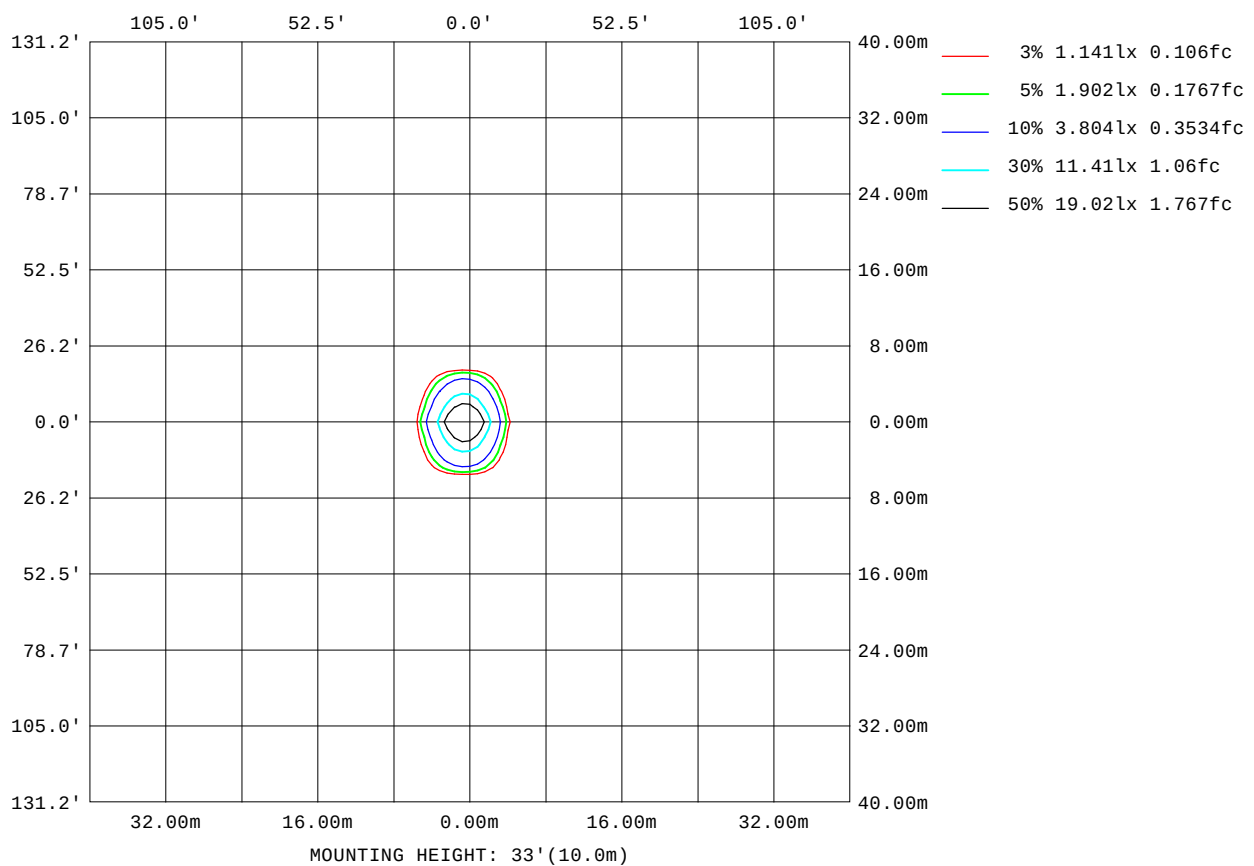

H_(b) Range: -90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 2026-07-02

V(B) Range: -75 - 75DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.000m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.: 65*60*163mm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°


AvgL	cd/m2
L_0~180(65)av	186
L_0~180(75)av	183
L_0~180(85)av	320
L_90~270(65)av	90
L_90~270(75)av	91
L_90~270(85)av	0
L_45(65)av	93
L_45(75)av	82
L_45(85)av	0

Standard: GB/T 29293-2012

H_(b) Range:-90 - 90DEG
H_(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:2026-07-02

V(B) Range:-75 - 75DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.000m [K=1.0000]
Remarks:

Planar Illuminance Curve

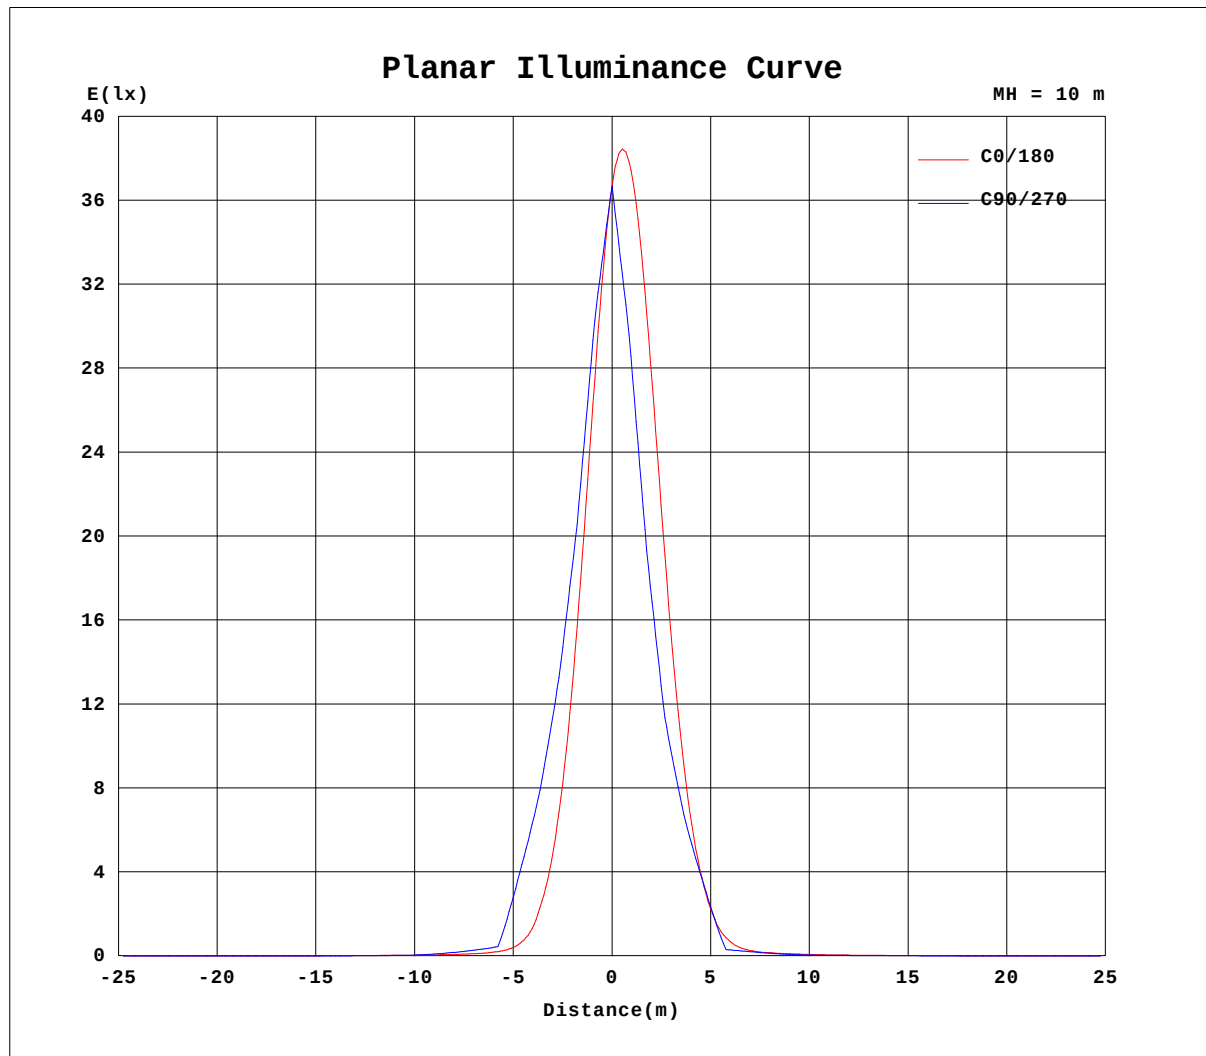

H_b Range: -90 - 90DEG
H_b Interval: 1.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators:
Test Date: 2026-07-02

V(B) Range: -75 - 75DEG
V(B) Interval: 5.0DEG
Test System: EVERFINE G0-2000A_V1 SYSTEM V2.00.411
Humidity: 65.0%
Test Distance: 5.000m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.24V I:0.0084A P:0.2889W PF:0.1564 Freq:50.00Hz Lamp Flux:823.892x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.: 65*60*163mm	SERIAL No.:01
MFR.: NORDECOR	SUR.:	Shielding Angle:24°

Table- -2

UNIT: cd

[illegible]

H(b) Range:-90 - 90DEG
H(b) Interval: 1.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:
Test Date:2026-07-02

V(B) Range:-75 - 75DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.411
Humidity:65.0%
Test Distance:5.000m [K=1.0000]
Remarks:

