

Report No.:

Test Time: 2026-04-14 16:46

Luminaire Property

Luminaire Manufacturer: NORDECOR
Luminaire Description: 80081
Luminous Width (mm): 51
Current: 0.058 A
Power Factor: 0.447


Luminous Length (mm): 51
Voltage: 220.4 V
Power: 5.72 W

Photometric Results


CIE Class: Direct
Measurement Flux: 525.9 lm
Downward Ratio: 100%
Horizontal Diffuse Angle(10%,50%,80%,100%): H29.7,H17.4,H10.4,H0
Vertical Diffuse Angle(10%,50%,80%,100%): V30,V17.7,V10.5,V1
Luminaire Efficacy Rating (LER): 91.99
Max. Intensity: 2919.87 cd
S/MH(C0/C180): 0.30

Total Rated Lamp Lumens: 525.9 lm
Efficiency: 100%
Upward Ratio: 0%
Central Intensity: 2919.86 cd
Pos of Max. Intensity: H0 V0
S/MH(C90/C270): 0.30

Picture Of Luminaire



Luminous Intensity Distribution Curve

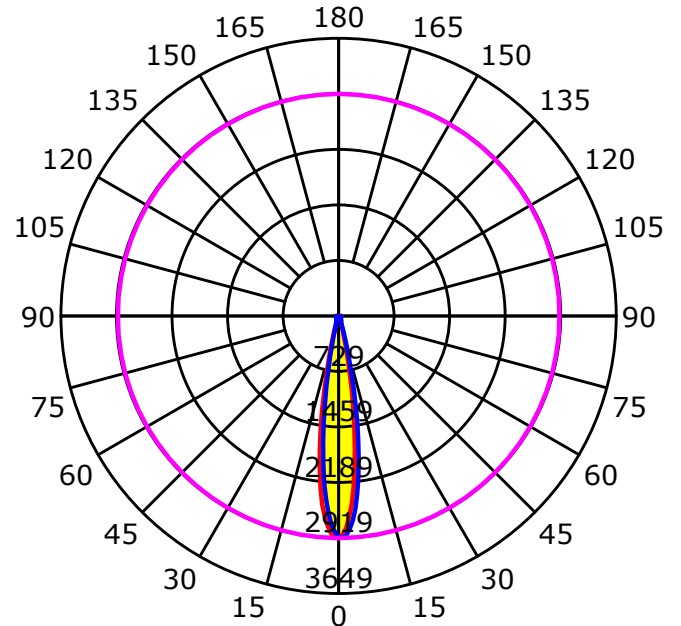

Unit: cd

Average Diffuse Angle(50%): 17.5°

— C0-C180 — C90-C270 — G0

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0



Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

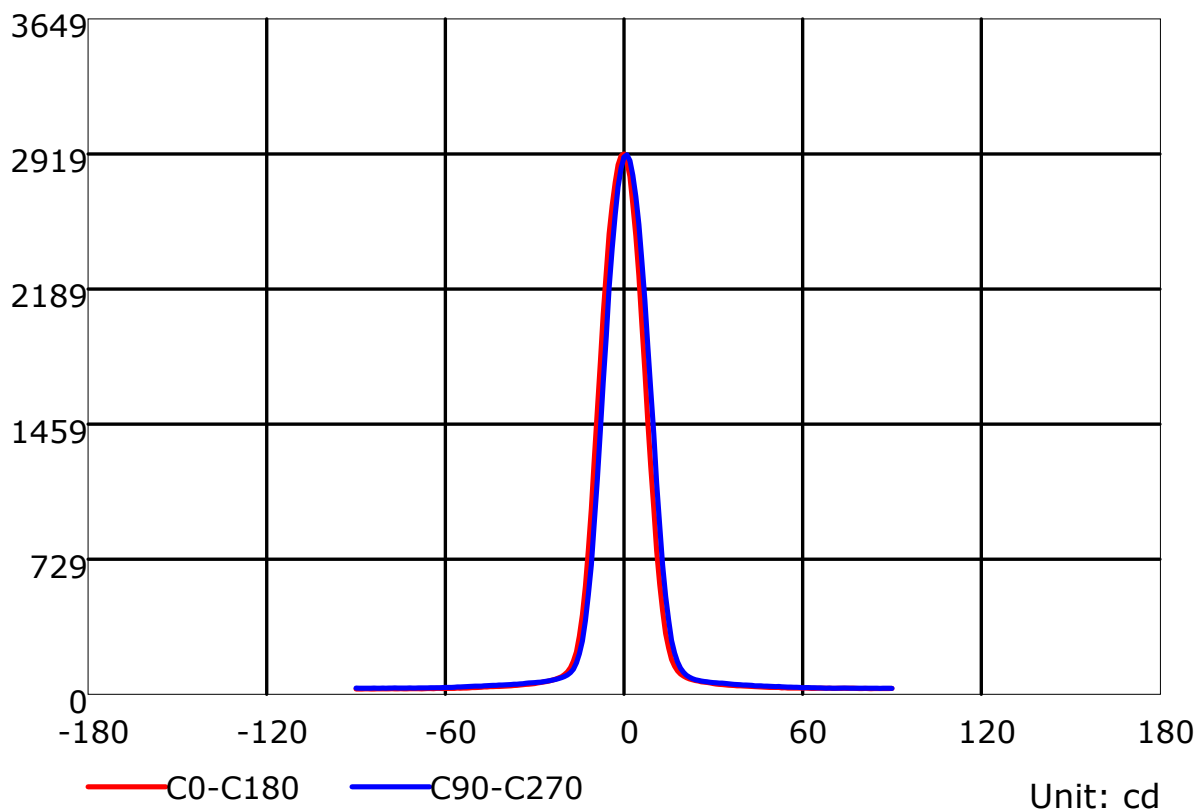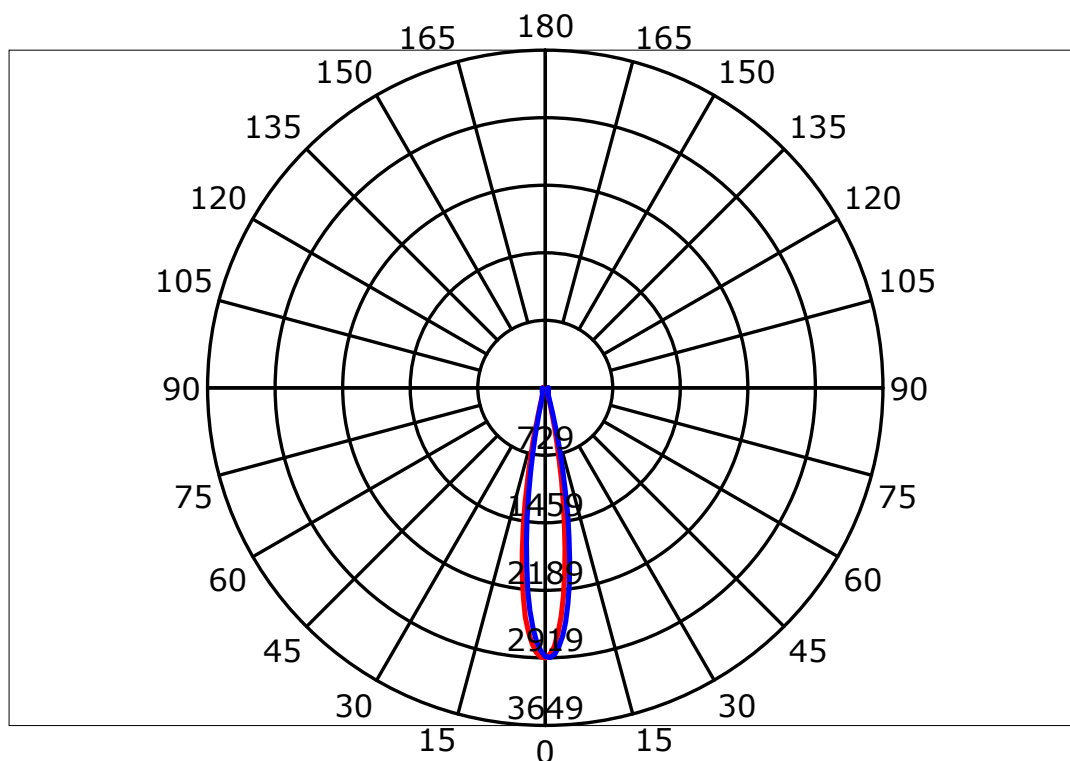

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

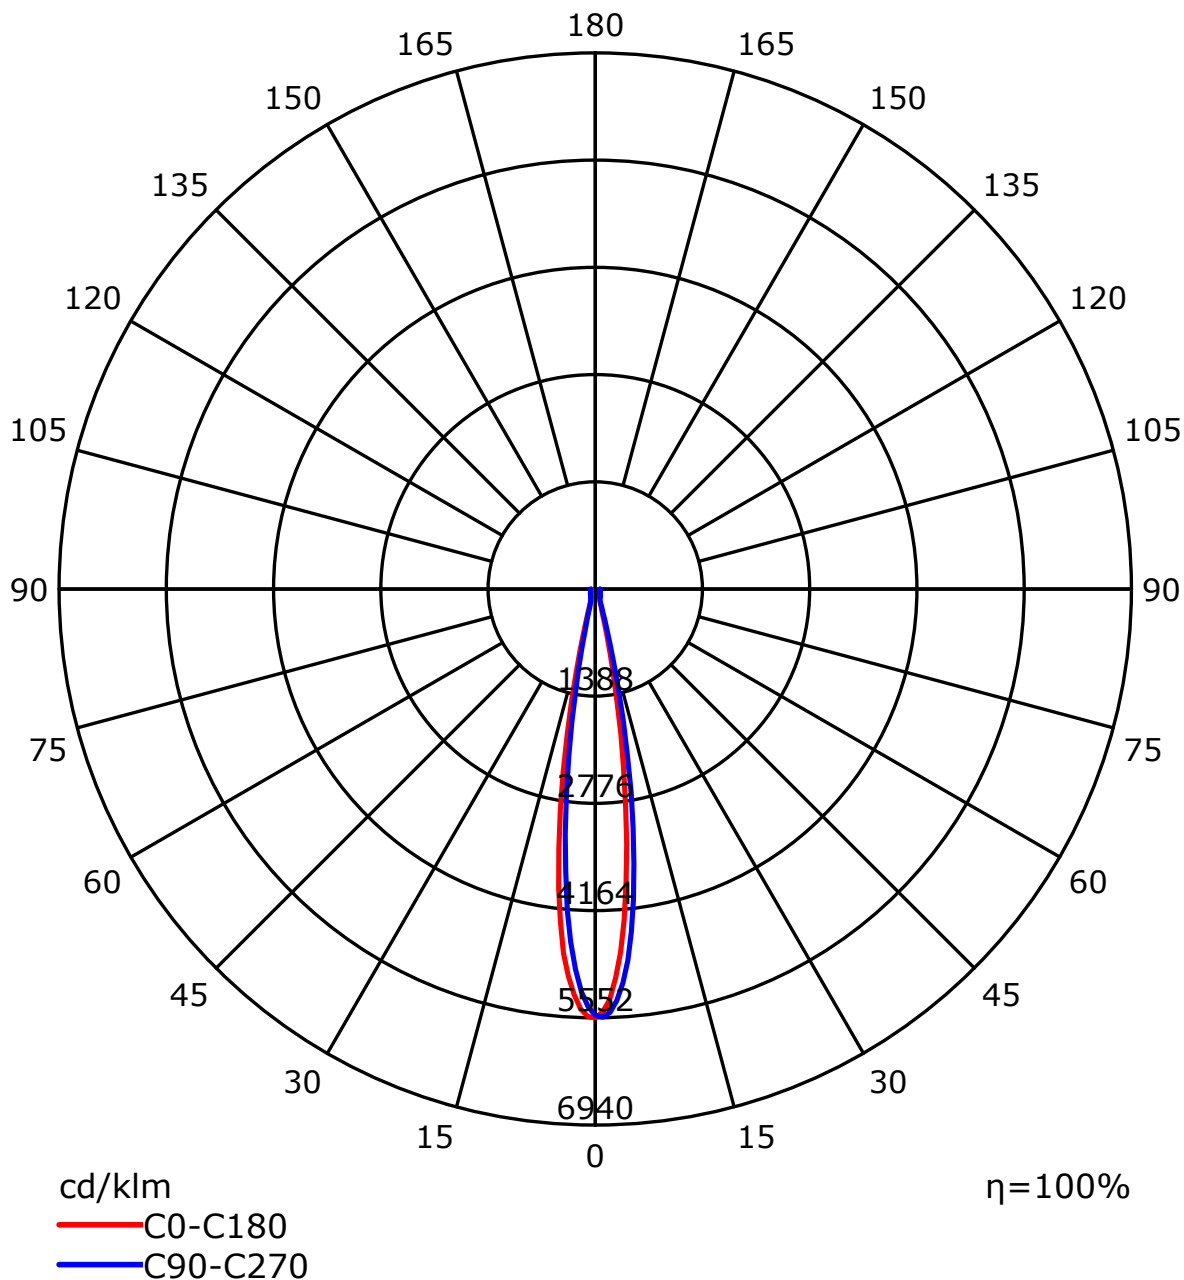

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	110	105	101	98	107	103	99	96	99	96	93	95	93	90	91	89	88	86
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	76	73	72
4	93	84	77	72	91	82	76	72	80	75	71	78	74	70	76	72	69	67
5	89	79	73	68	87	78	72	67	76	71	67	75	70	66	73	69	66	64
6	85	75	69	64	83	75	69	64	73	68	64	72	67	63	70	66	63	61
7	82	72	66	62	81	72	66	61	70	65	61	69	64	61	68	64	60	59
8	79	70	64	59	78	69	63	59	68	63	59	67	62	59	66	62	59	57
9	77	67	61	58	76	67	61	57	66	61	57	65	60	57	64	60	57	56
10	74	65	60	56	73	65	59	56	64	59	56	63	59	56	62	58	55	54

Spacing Criteria (0-180): 0.30
Spacing Criteria (90-270): 0.30
Spacing Criteria (Diagonal): 0.29

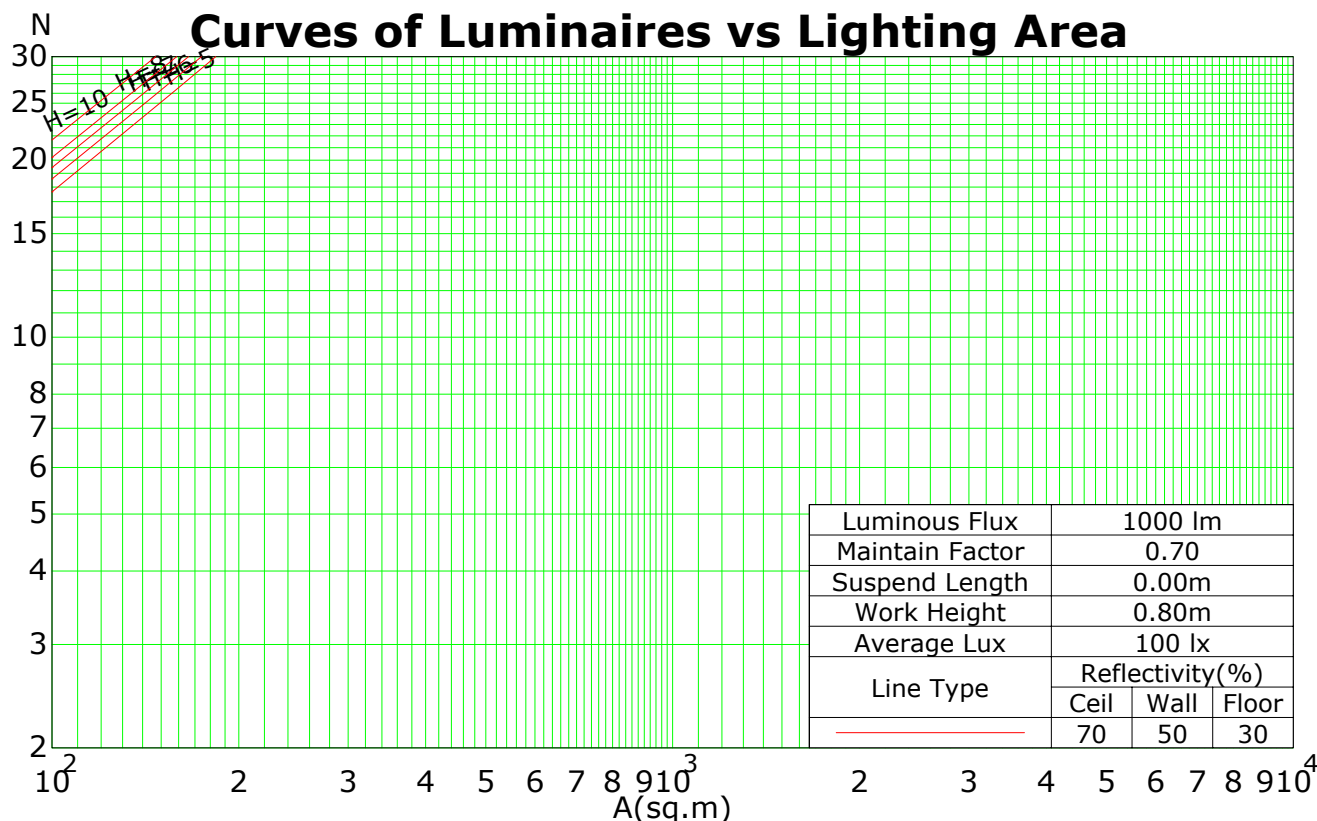

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Isocandela (rectangle)

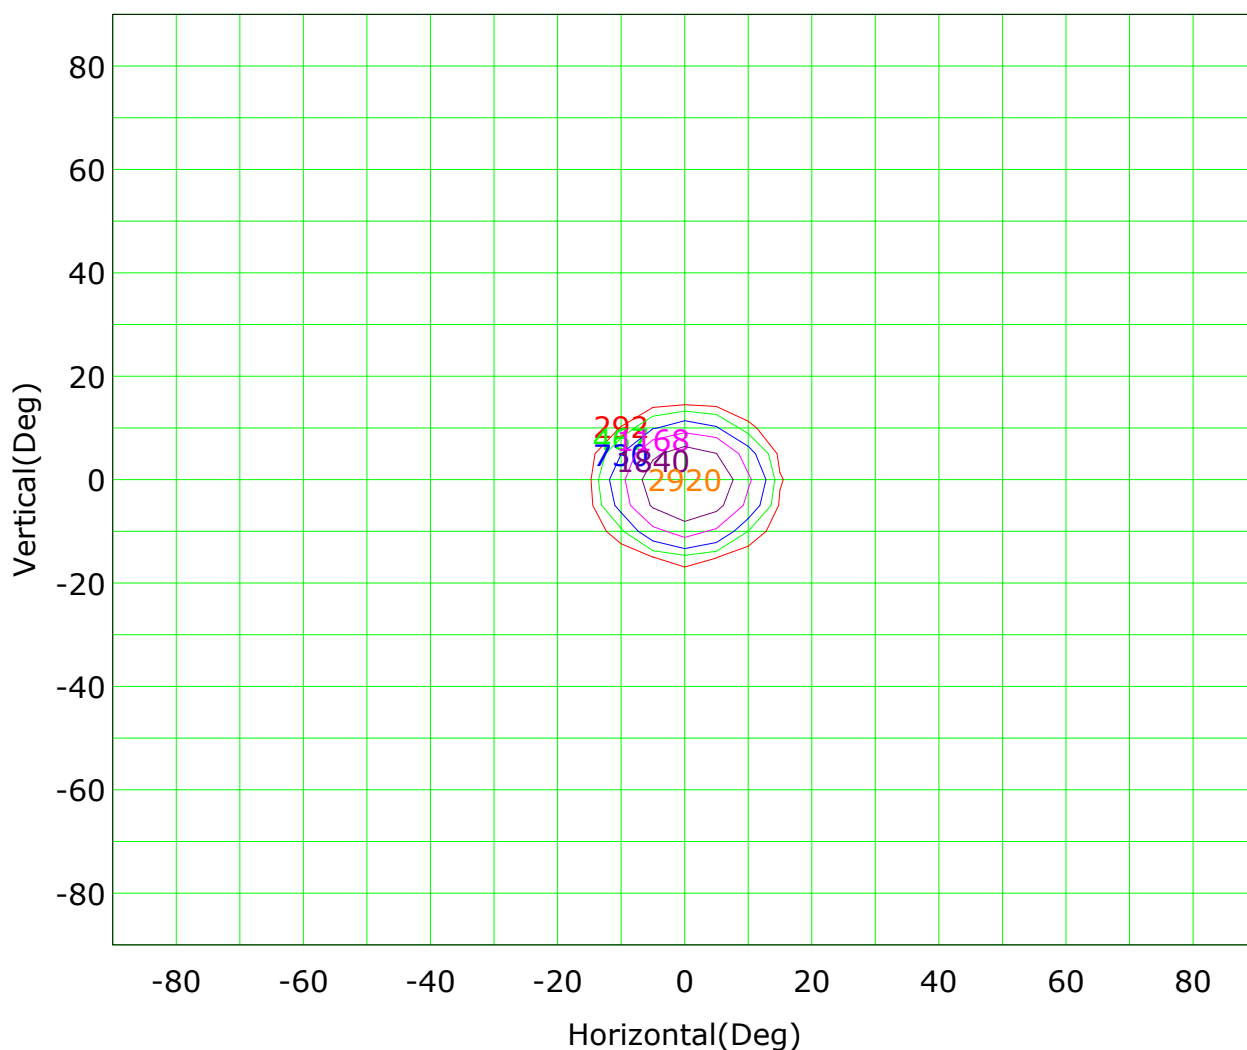


Imax (100%): 2920 cd

(10%): 292 cd	(16%): 467 cd
(25%): 730 cd	(40%): 1168 cd
(63%): 1840 cd	(100%): 2920 cd

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Isocandela (sphere)

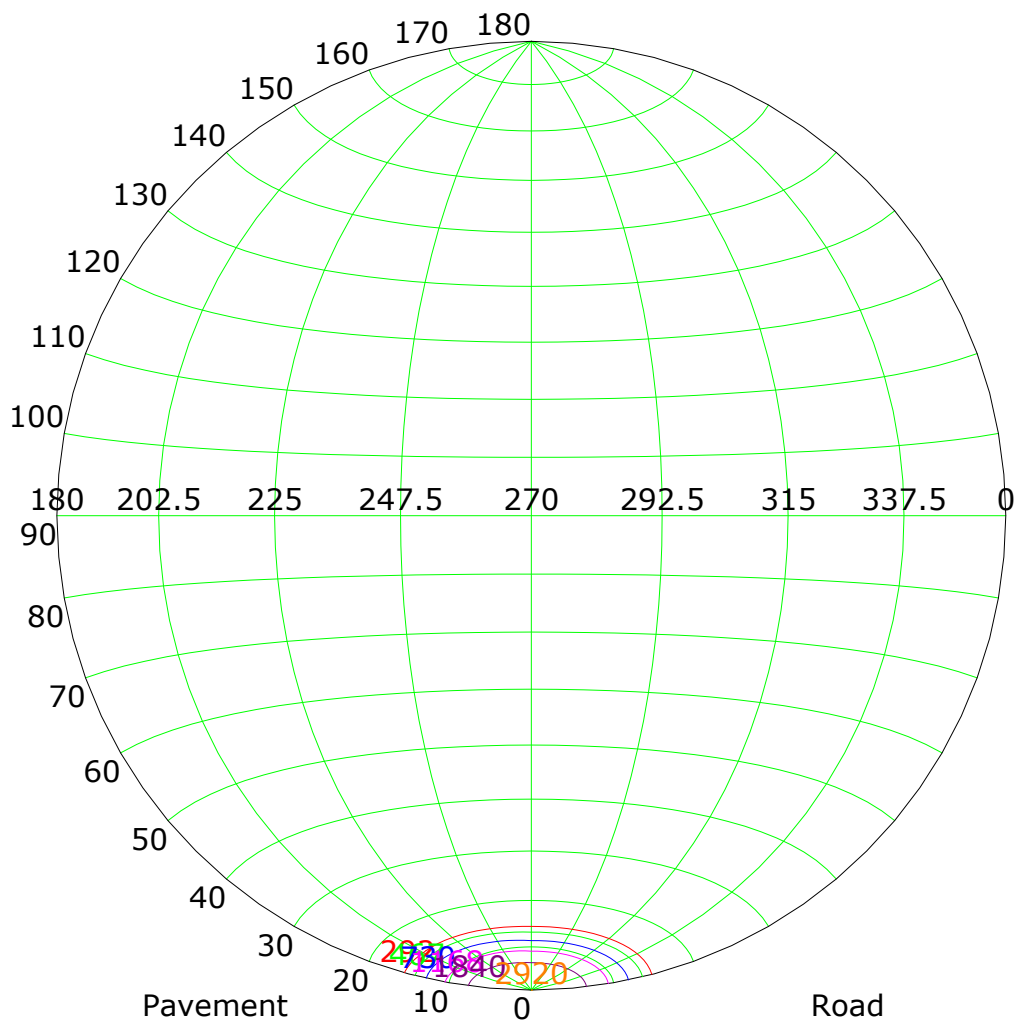


Imax (100%): 2920 cd

(10%): 292 cd	(16%): 467 cd
(25%): 730 cd	(40%): 1168 cd
(63%): 1840 cd	(100%): 2920 cd

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

IsoLux Plot

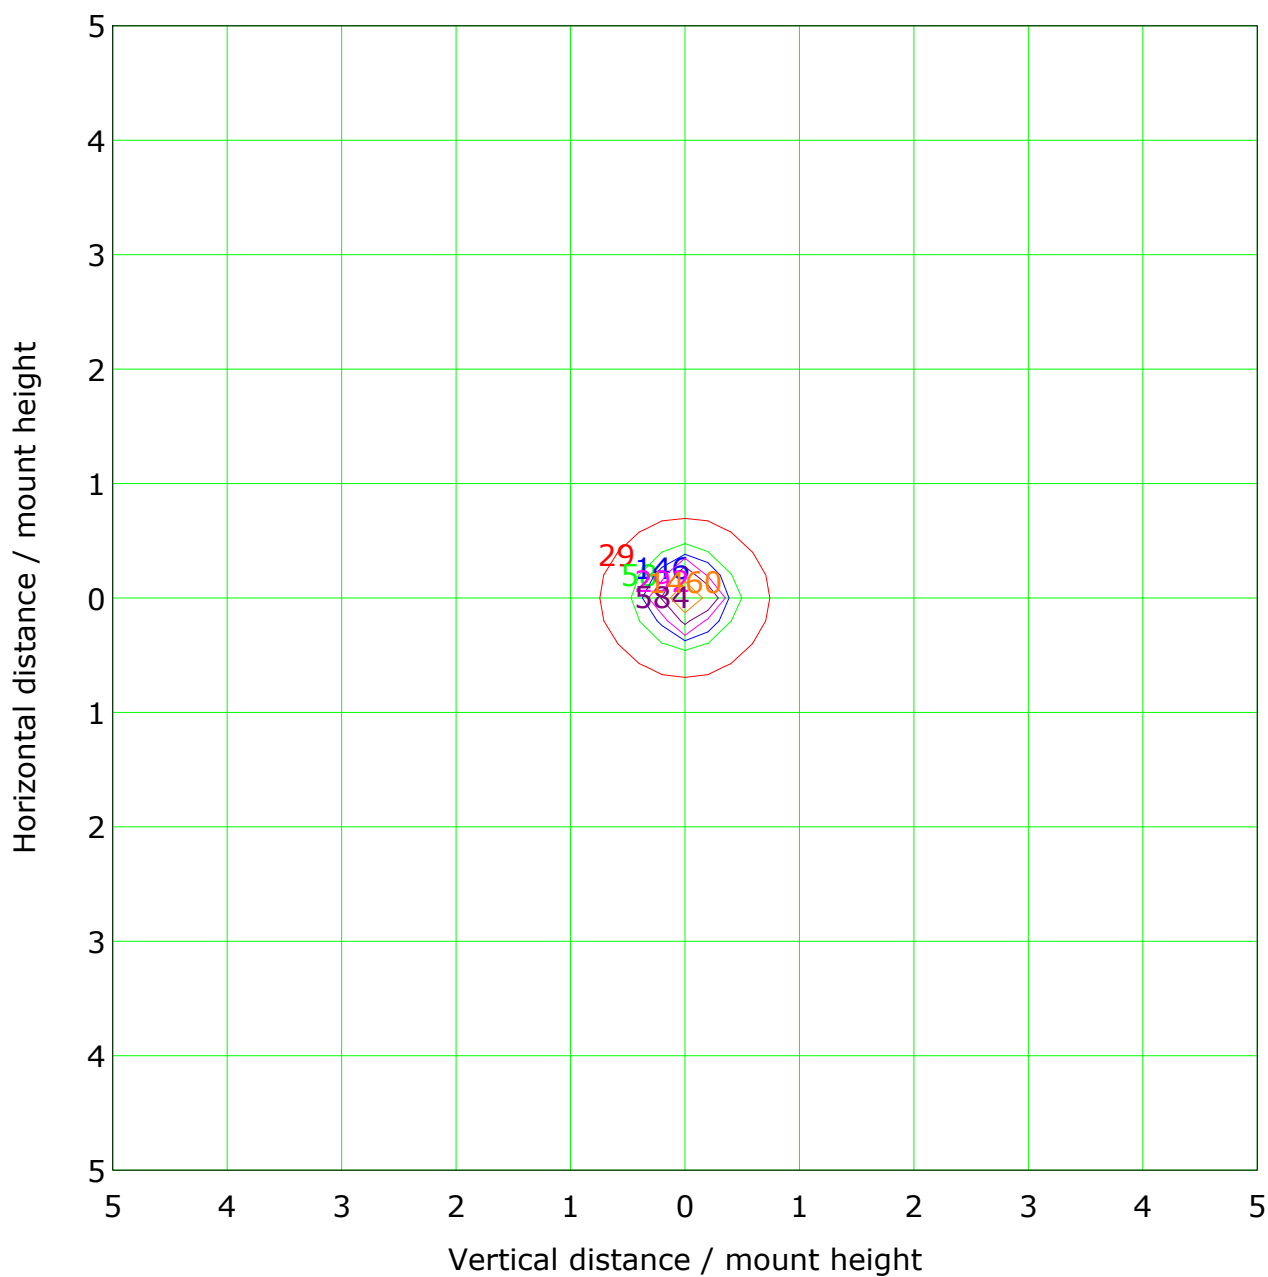

Mounting Height: 1.0m Max Lux(100%): 2919.9 lx


(1%): 29.2 lx	(2%): 58.4 lx
(5%): 146.0 lx	(10%): 292.0 lx
(20%): 584.0 lx	(50%): 1459.9 lx
(100%): 2919.9 lx	

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Roadway CU Curve

Efficiency(%)

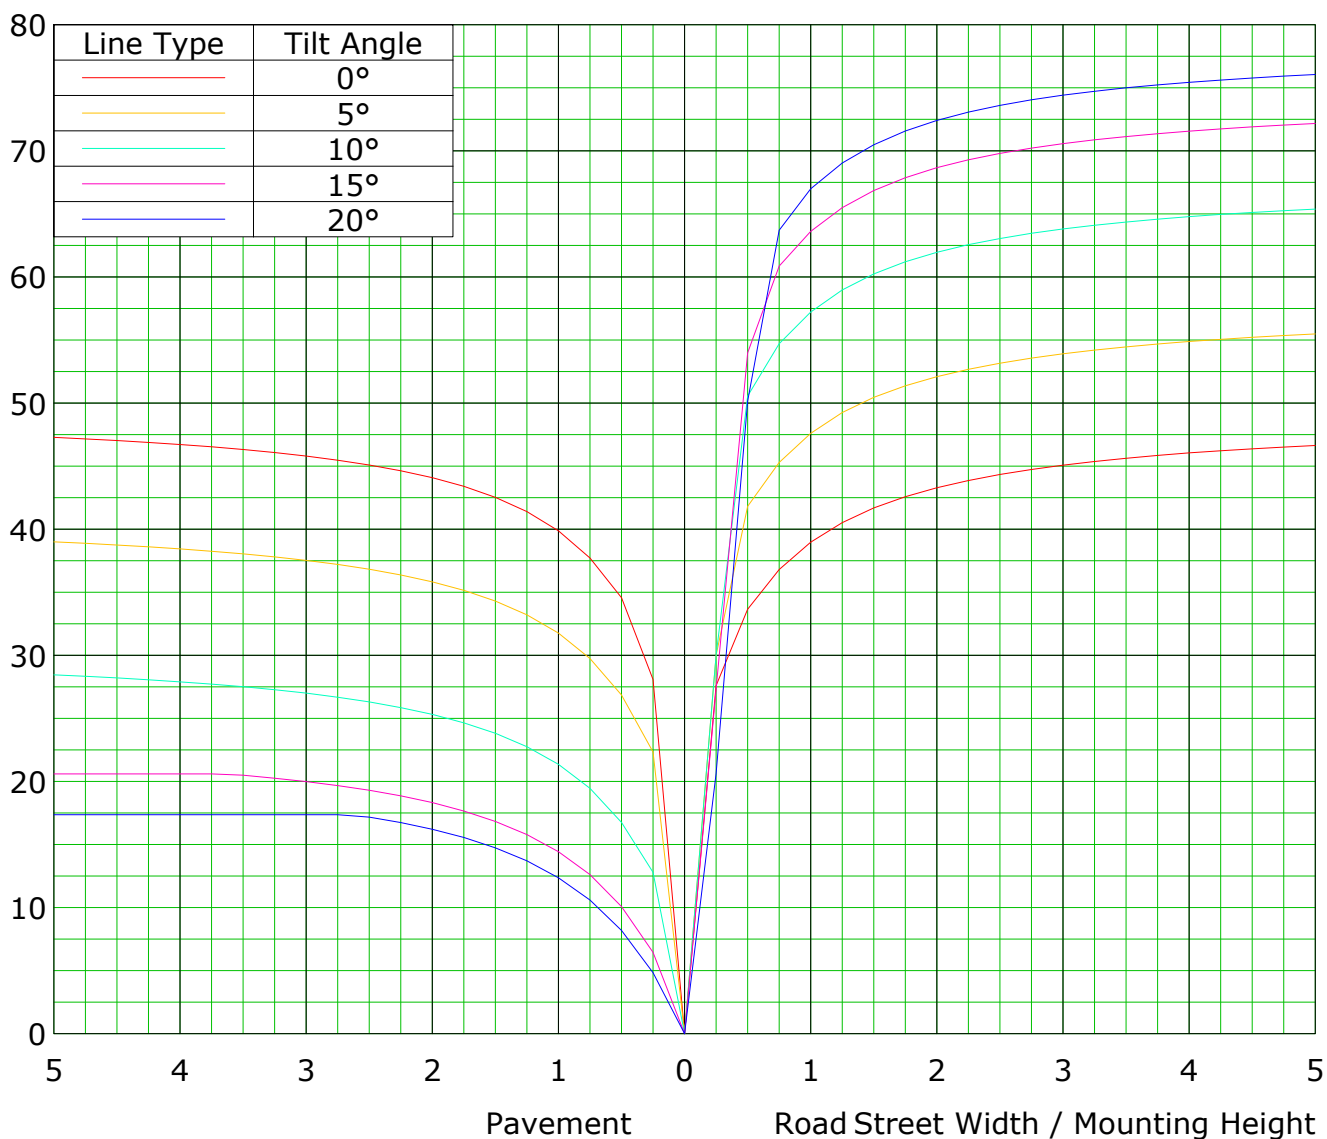

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L



Distance: 8.443 m

Humidity:

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

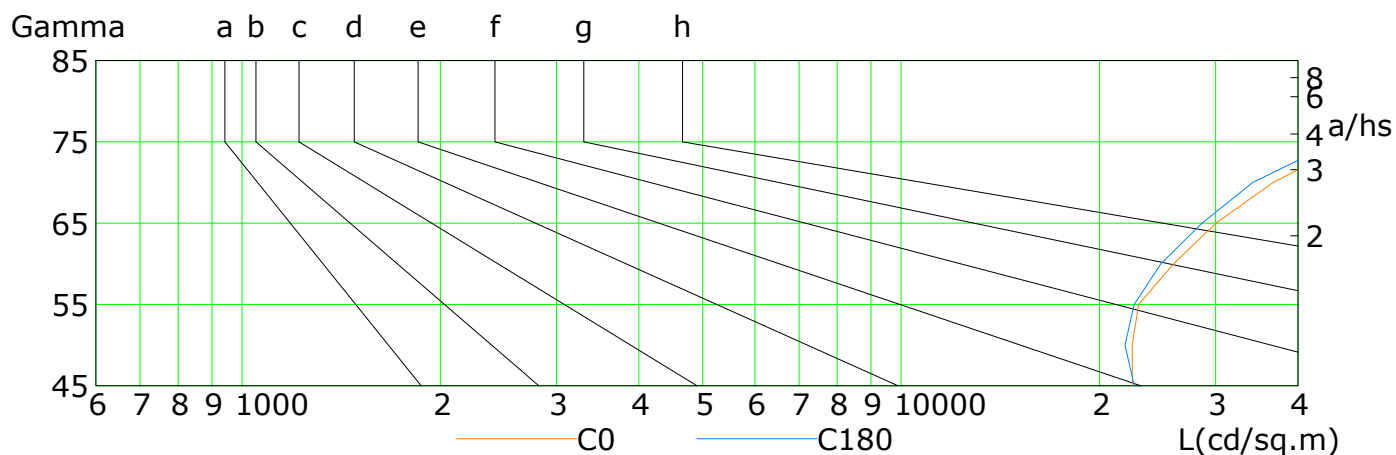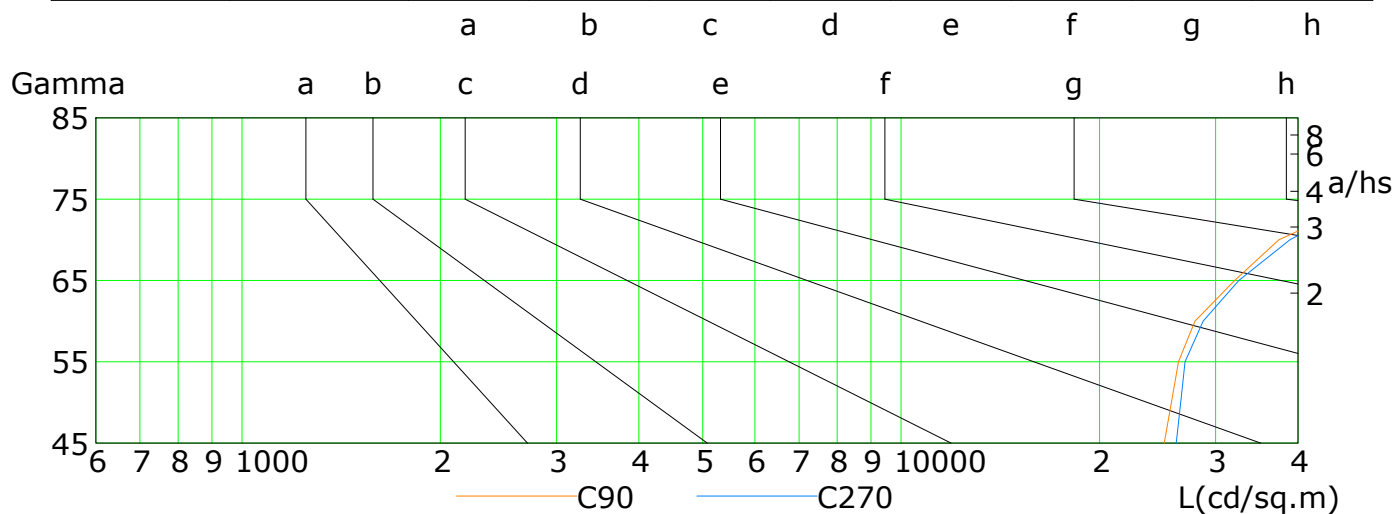

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	22439	22412	22918	25890	30030	36668	48263	70784	138690
C90	25071	25701	26343	27905	32059	37410	50788	73684	146807
C180	22581	21861	22569	24783	28602	34162	45544	65846	127706
C270	26142	26563	26959	28712	32532	38883	50788	74260	147954

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 8.443 m


Humidity:

Inspector:

Illuminance at a Distance

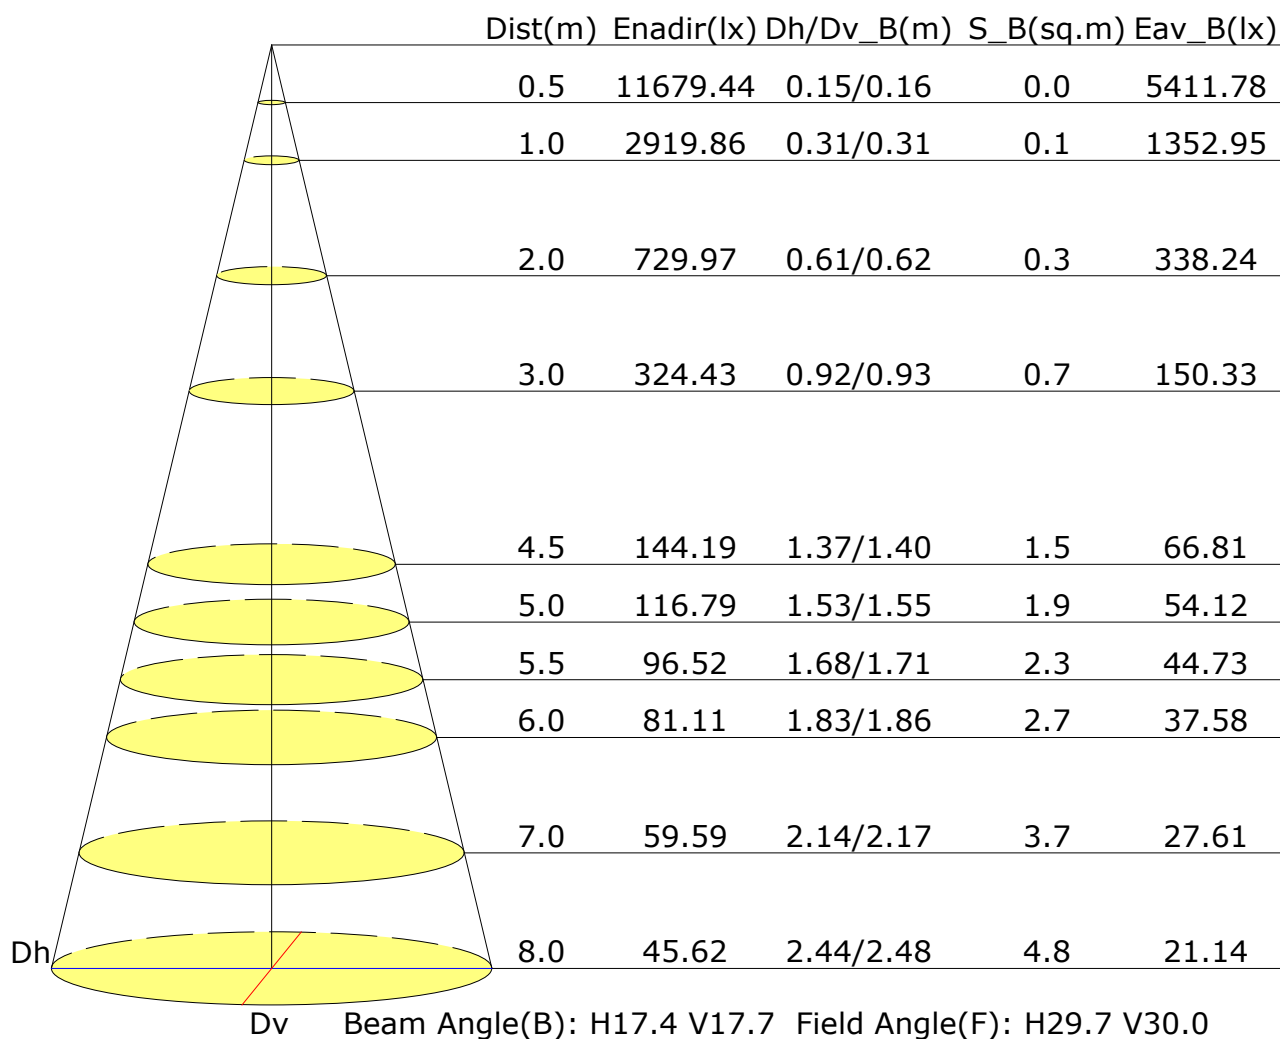


Vertical IsoLux Plot

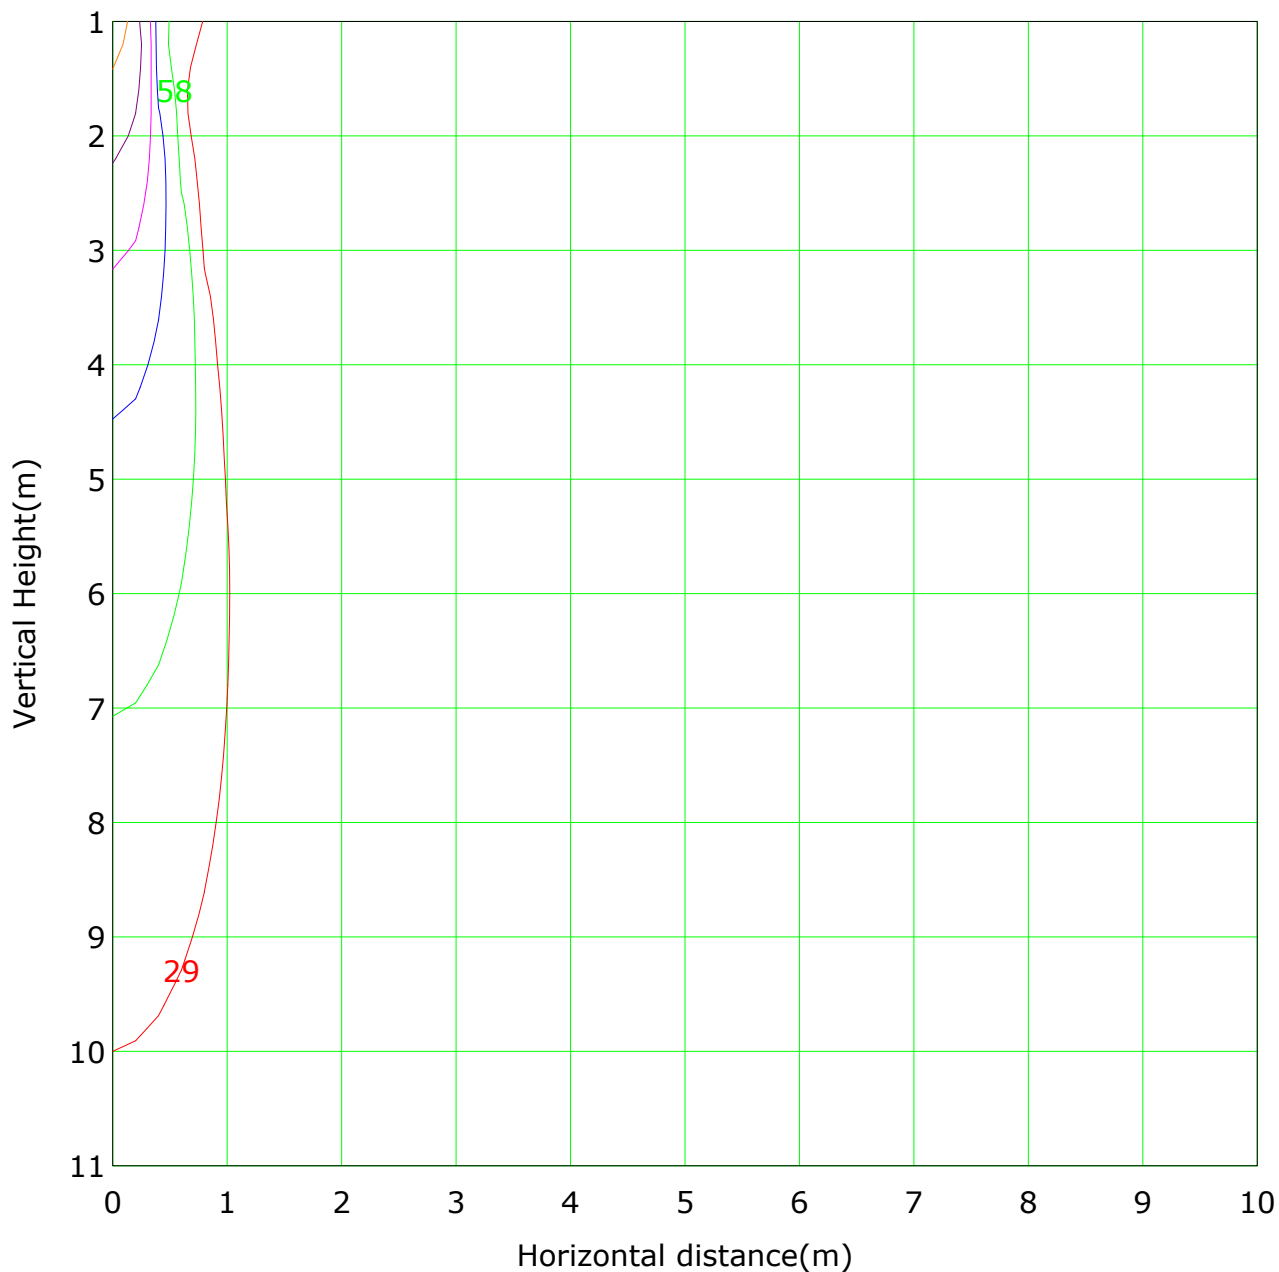

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 2919.9 lx
— (1%): 29.2 lx — (2%): 58.4 lx
— (5%): 146.0 lx — (10%): 292.0 lx
— (20%): 584.0 lx — (50%): 1459.9 lx
— (100%): 2919.9 lx

Humidity:

The Average Illuminance Effective Figure

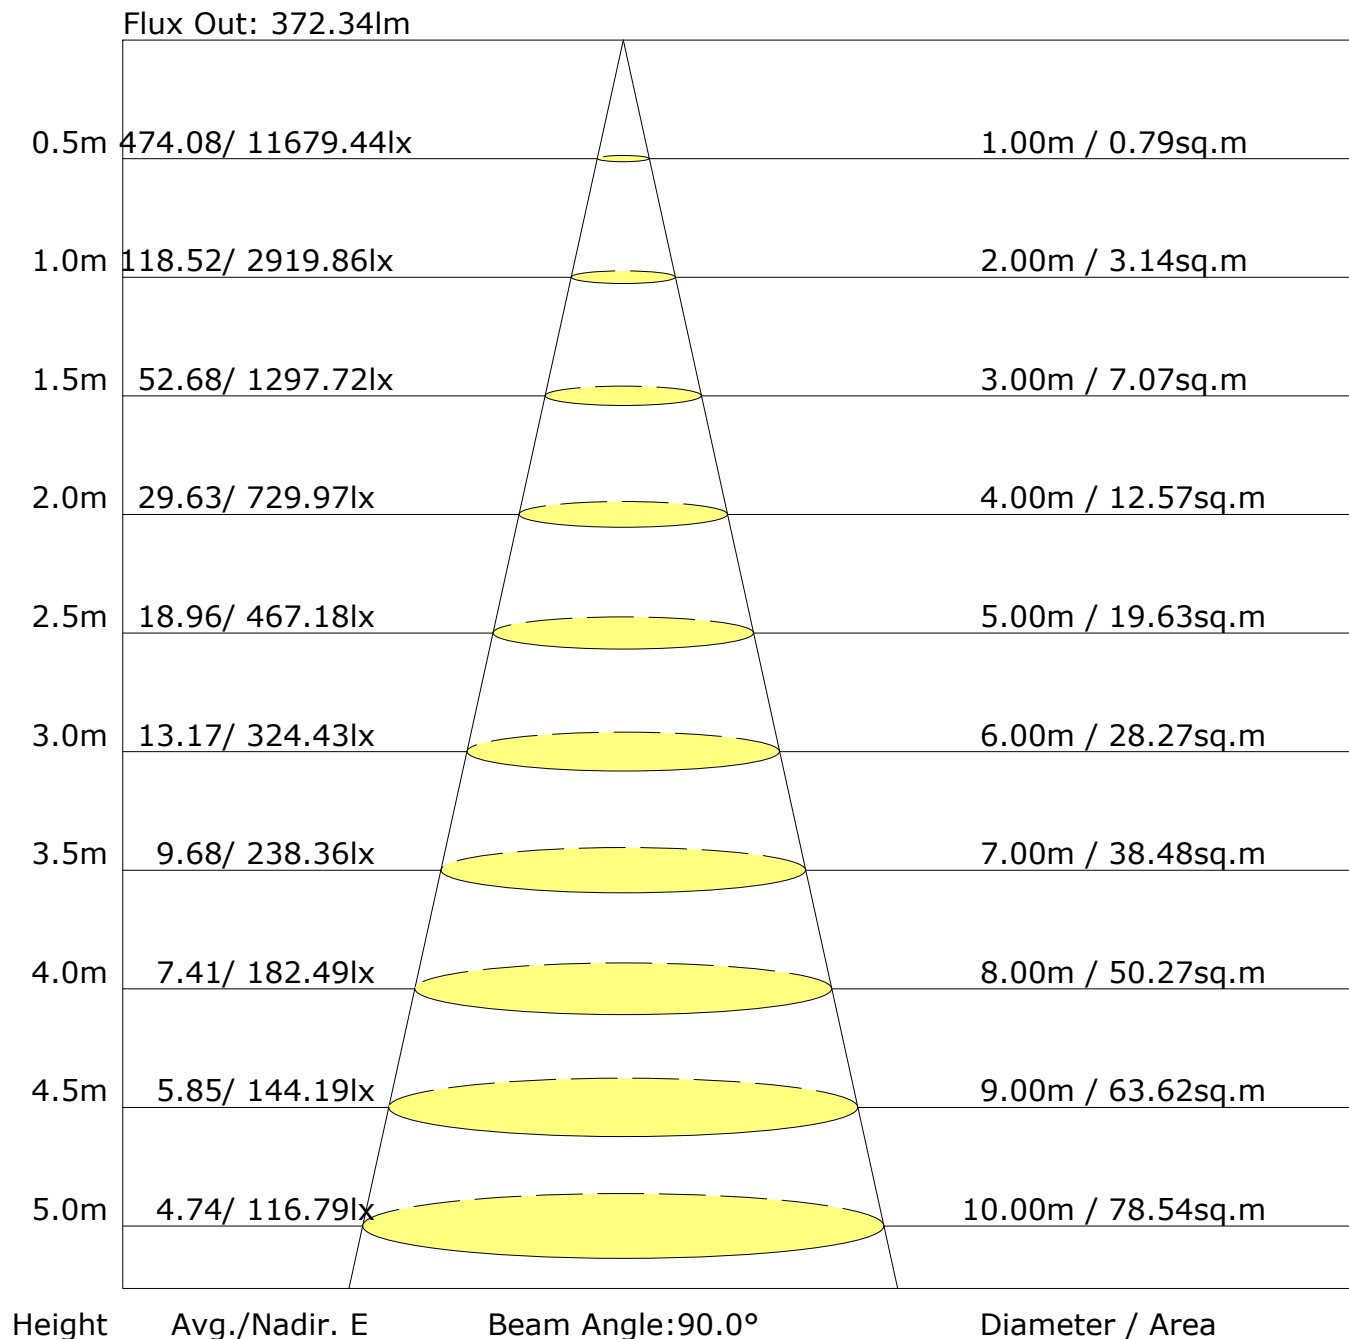

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	20.9	21.8	21.1	22.0	22.3	21.3	22.3	21.6	22.5	22.7
3H	23.8	24.8	24.1	25.0	25.3	24.2	25.1	24.5	25.3	25.6
4H	25.6	26.5	26.0	26.8	27.1	25.9	26.8	26.2	27.1	27.3
6H	27.6	28.5	28.0	28.8	29.1	27.9	28.7	28.2	29.0	29.3
8H	28.7	29.5	29.1	29.8	30.2	29.0	29.8	29.4	30.1	30.4
12H	30.0	30.8	30.3	31.1	31.4	30.3	31.1	30.7	31.4	31.7
X=4H Y=2H	22.0	22.9	22.3	23.1	23.4	22.3	23.2	22.6	23.5	23.7
3H	25.2	26.0	25.6	26.3	26.6	25.4	26.2	25.8	26.5	26.9
4H	27.1	27.9	27.5	28.2	28.6	27.3	28.1	27.7	28.4	28.8
6H	29.3	30.0	29.7	30.3	30.7	29.5	30.2	29.9	30.5	30.9
8H	30.5	31.1	30.9	31.5	31.9	30.7	31.3	31.1	31.7	32.1
12H	31.8	32.4	32.3	32.8	33.3	32.1	32.7	32.6	33.1	33.5
X=8H Y=4H	28.0	28.6	28.4	29.0	29.4	28.1	28.8	28.6	29.1	29.6
6H	30.4	30.9	30.9	31.4	31.8	30.6	31.1	31.0	31.5	32.0
8H	31.8	32.2	32.2	32.7	33.2	32.0	32.4	32.4	32.9	33.4
12H	33.3	33.8	33.8	34.2	34.7	33.6	34.0	34.1	34.5	35.0
X=12H Y=4H	28.2	28.8	28.7	29.2	29.6	28.4	28.9	28.8	29.3	29.8
6H	30.8	31.2	31.2	31.7	32.2	30.9	31.4	31.4	31.8	32.3
8H	32.2	32.7	32.7	33.1	33.6	32.4	32.8	32.9	33.3	33.8
Variations with the observer position at spacings:										
S=1.0H	+0.4/-0.4					+0.4/-0.4				
S=1.5H	+0.6/-0.7					+0.6/-0.7				
S=2.0H	+0.9/-1.1					+0.8/-1.1				

Calculate in accordance with CIE Pub.117. The table is revised with 526lm ($8\log(F/F_0) = -2.2$).

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM


	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	258	49.1
	FL (0°-30°)	155	29.4
	FM (30°-60°)	51	9.7
	FH (60°-80°)	35	6.6
	FVH (80°-90°)	18	3.4
	BACK LIGHT	268	50.9
	BL (0°-30°)	167	31.7
	BM (30°-60°)	51	9.6
	BH (60°-80°)	34	6.4
	BVH (80°-90°)	17	3.2
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U1 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U1 G1

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

LCS Graph

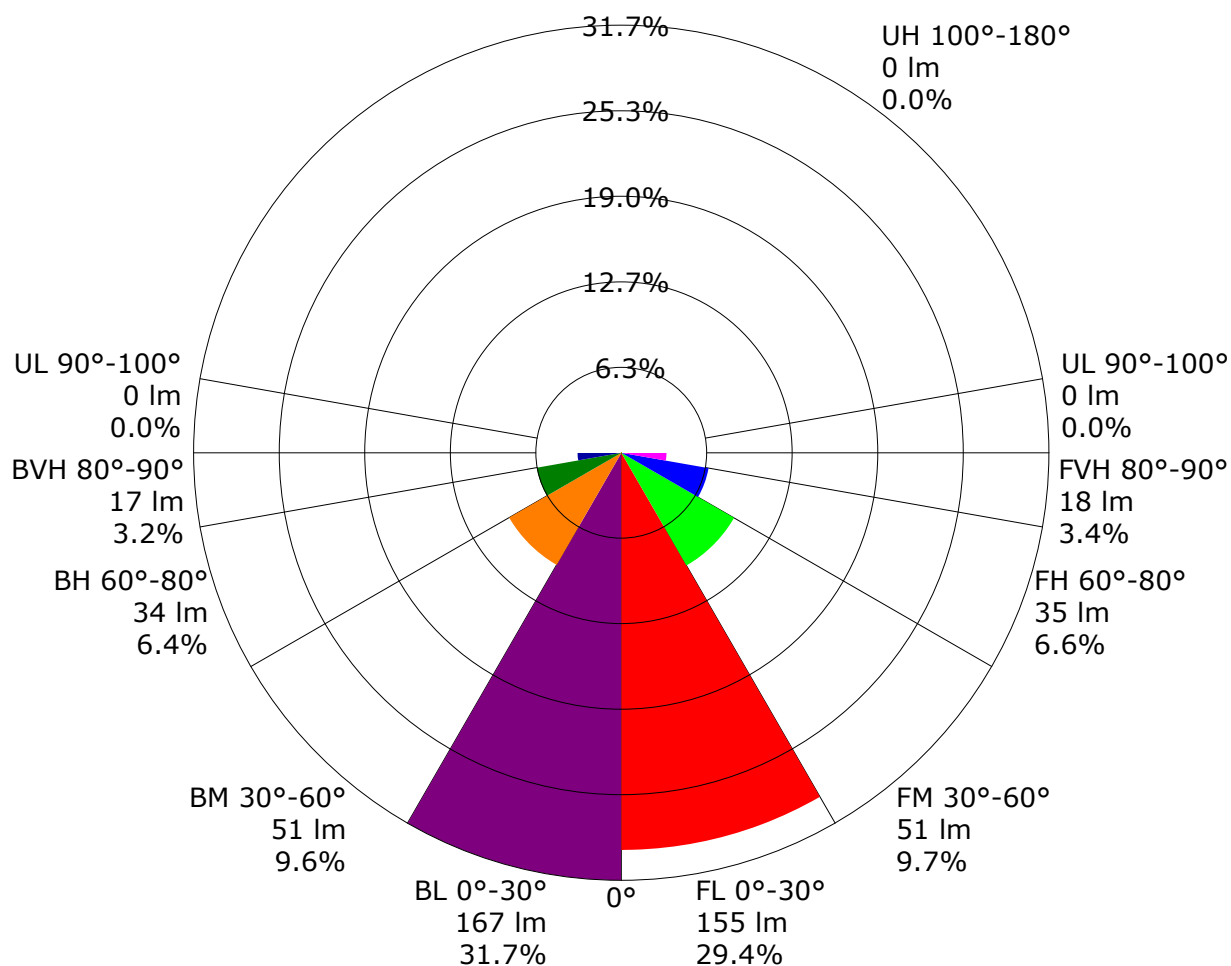

Back Light

Forward Light

Scale= MAX LCS%

Trapped Light:NA,NA

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 0.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.78	0.84	0.88	0.92	0.96	1.00	1.02	1.06	1.08	
	0.30		0.72	0.78	0.82	0.86	0.91	0.95	0.98	1.02	1.05	
	0.20		0.68	0.73	0.78	0.81	0.87	0.91	0.94	0.98	1.01	
0.50	0.50	0.20	0.77	0.82	0.86	0.89	0.93	0.96	0.98	1.02	1.04	
	0.30		0.72	0.77	0.81	0.84	0.89	0.92	0.95	0.98	1.01	
	0.20		0.68	0.73	0.77	0.80	0.85	0.88	0.91	0.95	0.98	
0.30	0.50	0.20	0.76	0.80	0.84	0.86	0.90	0.93	0.95	0.98	1.00	
	0.30		0.71	0.76	0.79	0.82	0.86	0.90	0.92	0.95	0.97	
	0.20		0.67	0.72	0.76	0.79	0.83	0.86	0.89	0.93	0.95	
0.00	0.00	0.00	0.66	0.70	0.73	0.76	0.80	0.83	0.85	0.88	0.90	
Rating:6W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 0.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.74	0.64	0.56	0.51	0.42	0.36	0.32	0.26	0.22	
	0.30		0.62	0.55	0.49	0.45	0.38	0.33	0.29	0.24	0.21	
	0.20		0.53	0.48	0.44	0.40	0.35	0.31	0.27	0.23	0.20	
0.50	0.50	0.20	0.71	0.61	0.54	0.48	0.40	0.38	0.30	0.24	0.21	
	0.30		0.60	0.53	0.47	0.43	0.36	0.32	0.28	0.23	0.20	
	0.20		0.52	0.47	0.43	0.39	0.34	0.30	0.27	0.22	0.19	
0.30	0.50	0.20	0.69	0.58	0.51	0.46	0.38	0.33	0.29	0.23	0.20	
	0.30		0.59	0.51	0.46	0.41	0.35	0.30	0.27	0.22	0.19	
	0.20		0.51	0.46	0.42	0.38	0.33	0.29	0.26	0.21	0.18	
0.00	0.00	0.00	0.39	0.34	0.31	0.28	0.24	0.21	0.19	0.16	0.14	
Rating:6W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 0.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.14	0.16	0.18	0.19	0.20	0.21	0.21	0.22	0.23	
	0.30		0.09	0.11	0.13	0.14	0.16	0.17	0.18	0.19	0.20	
	0.20		0.06	0.07	0.09	0.10	0.12	0.14	0.15	0.16	0.18	
0.50	0.50	0.20	0.14	0.16	0.17	0.18	0.19	0.20	0.20	0.21	0.22	
	0.30		0.09	0.11	0.12	0.14	0.15	0.16	0.17	0.18	0.19	
	0.20		0.06	0.07	0.09	0.10	0.12	0.13	0.14	0.16	0.17	
0.30	0.50	0.20	0.14	0.15	0.16	0.17	0.18	0.19	0.20	0.20	0.21	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19	
	0.20		0.06	0.07	0.09	0.10	0.12	0.13	0.14	0.16	0.17	
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Rating:6W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	2899.5	2.8	2.8	0.53	0.53
1.0-2.0	2854.7	8.2	11.0	1.56	2.09
2.0-3.0	2762.8	13.2	24.2	2.51	4.60
3.0-4.0	2628.8	17.6	41.8	3.35	7.95
4.0-5.0	2463.1	21.2	63.0	4.03	11.98
5.0-6.0	2256.5	23.7	86.7	4.51	16.48
6.0-7.0	2023.5	25.1	111.8	4.78	21.26
7.0-8.0	1776.4	25.4	137.2	4.83	26.10
8.0-9.0	1518.6	24.6	161.9	4.68	30.78
9.0-10.0	1270.8	23.0	184.9	4.37	35.15
10.0-11.0	1028.1	20.5	205.4	3.91	39.06
11.0-12.0	805.2	17.6	223.0	3.35	42.41
12.0-13.0	620.0	14.7	237.7	2.80	45.20
13.0-14.0	464.4	11.9	249.6	2.26	47.46
14.0-15.0	344.9	9.5	259.1	1.80	49.26
15.0-16.0	257.8	7.6	266.6	1.44	50.70
16.0-17.0	196.6	6.1	272.8	1.16	51.87
17.0-18.0	157.3	5.2	277.9	0.99	52.85
18.0-19.0	130.6	4.5	282.5	0.86	53.72
19.0-20.0	112.6	4.1	286.6	0.78	54.50
20.0-21.0	100.1	3.8	290.5	0.73	55.23
21.0-22.0	91.1	3.7	294.1	0.70	55.93
22.0-23.0	84.7	3.6	297.7	0.68	56.60
23.0-24.0	79.6	3.5	301.2	0.66	57.27
24.0-25.0	75.3	3.4	304.6	0.65	57.92
25.0-26.0	72.1	3.4	308.0	0.65	58.56
26.0-27.0	69.2	3.4	311.4	0.64	59.21
27.0-28.0	66.8	3.4	314.7	0.64	59.85
28.0-29.0	64.6	3.4	318.1	0.64	60.49
29.0-30.0	62.3	3.4	321.5	0.64	61.13
30.0-31.0	60.3	3.4	324.8	0.64	61.77
31.0-32.0	58.8	3.4	328.2	0.64	62.41
32.0-33.0	57.5	3.4	331.6	0.64	63.06
33.0-34.0	56.0	3.4	335.0	0.64	63.70
34.0-35.0	54.4	3.4	338.4	0.64	64.34
35.0-36.0	52.9	3.4	341.7	0.64	64.98

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	51.6	3.4	345.1	0.64	65.62
37.0-38.0	50.4	3.4	348.5	0.64	66.26
38.0-39.0	49.5	3.4	351.9	0.64	66.91
39.0-40.0	48.6	3.4	355.2	0.64	67.55
40.0-41.0	47.7	3.4	358.6	0.65	68.20
41.0-42.0	47.0	3.4	362.1	0.65	68.85
42.0-43.0	46.3	3.4	365.5	0.65	69.50
43.0-44.0	45.4	3.4	368.9	0.65	70.15
44.0-45.0	44.5	3.4	372.3	0.65	70.80
45.0-46.0	43.9	3.4	375.8	0.65	71.45
46.0-47.0	43.0	3.4	379.2	0.65	72.10
47.0-48.0	42.1	3.4	382.6	0.65	72.75
48.0-49.0	41.3	3.4	386.0	0.64	73.40
49.0-50.0	40.7	3.4	389.4	0.64	74.04
50.0-51.0	40.2	3.4	392.8	0.65	74.69
51.0-52.0	39.8	3.4	396.2	0.65	75.34
52.0-53.0	38.8	3.4	399.6	0.64	75.98
53.0-54.0	38.1	3.4	402.9	0.64	76.62
54.0-55.0	37.4	3.3	406.3	0.63	77.25
55.0-56.0	36.8	3.3	409.6	0.63	77.89
56.0-57.0	36.4	3.3	412.9	0.63	78.52
57.0-58.0	35.9	3.3	416.2	0.63	79.15
58.0-59.0	35.6	3.3	419.6	0.63	79.78
59.0-60.0	35.2	3.3	422.9	0.63	80.42
60.0-61.0	34.8	3.3	426.2	0.63	81.05
61.0-62.0	34.6	3.3	429.6	0.63	81.68
62.0-63.0	34.4	3.3	432.9	0.64	82.32
63.0-64.0	34.0	3.3	436.2	0.63	82.95
64.0-65.0	33.8	3.4	439.6	0.64	83.59
65.0-66.0	33.8	3.4	443.0	0.64	84.23
66.0-67.0	33.5	3.4	446.3	0.64	84.87
67.0-68.0	33.1	3.4	449.7	0.64	85.51
68.0-69.0	33.0	3.4	453.0	0.64	86.15
69.0-70.0	32.9	3.4	456.4	0.64	86.79
70.0-71.0	32.7	3.4	459.8	0.64	87.43
71.0-72.0	32.8	3.4	463.2	0.65	88.08

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G0.0	2919.9	2903.0	2919.9	2903.0	2919.9					
G1.0	2879.4	2915.9	2910.6	2844.4	2879.4					
G2.0	2798.8	2883.8	2861.8	2743.1	2798.8					
G3.0	2649.9	2805.1	2766.6	2592.9	2649.9					
G4.0	2477.4	2689.6	2640.8	2408.3	2477.4					
G5.0	2262.3	2539.2	2488.9	2198.0	2262.3					
G6.0	2008.1	2346.6	2277.0	1932.1	2008.1					
G7.0	1753.0	2133.7	2053.0	1684.5	1753.0					
G8.0	1483.9	1891.1	1790.2	1421.8	1483.9					
G9.0	1232.0	1645.8	1527.9	1156.3	1232.0					
G10.0	1006.9	1408.2	1265.3	923.7	1006.9					
G11.0	776.5	1140.7	1003.0	700.4	776.5					
G12.0	595.8	911.8	776.9	536.9	595.8					
G13.0	454.2	699.8	585.2	399.6	454.2					
G14.0	329.2	530.6	428.4	288.1	329.2					
G15.0	250.0	399.7	313.8	219.2	250.0					
G16.0	189.2	290.8	229.5	170.6	189.2					
G17.0	152.5	223.6	179.6	136.6	152.5					
G18.0	127.3	175.9	145.0	118.0	127.3					
G19.0	110.2	141.6	121.6	105.5	110.2					
G20.0	99.0	119.3	106.6	96.6	99.0					
G21.0	90.3	103.4	95.9	90.0	90.3					
G22.0	83.6	93.0	88.3	84.8	83.6					
G23.0	78.7	85.6	82.9	81.0	78.7					
G24.0	74.5	79.3	77.4	77.2	74.5					
G25.0	71.8	75.7	72.8	73.9	71.8					
G26.0	68.3	72.4	70.0	71.5	68.3					
G27.0	66.4	69.3	67.3	68.5	66.4					
G28.0	64.1	67.6	64.8	66.4	64.1					
G29.0	61.4	65.0	62.1	65.1	61.4					
G30.0	58.4	63.9	58.7	63.4	58.4					
G31.0	56.2	62.8	56.7	62.6	56.2					
G32.0	54.1	61.3	55.3	61.7	54.1					
G33.0	52.8	60.9	53.8	59.7	52.8					
G34.0	51.6	59.3	52.1	57.6	51.6					
G35.0	50.0	57.3	50.3	56.9	50.0					
G36.0	48.7	55.9	48.9	55.3	48.7					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G37.0	48.0	53.8	47.7	54.6	48.0					
G38.0	46.5	52.9	46.5	53.2	46.5					
G39.0	46.5	52.0	45.3	52.7	46.5					
G40.0	45.5	50.4	44.8	51.8	45.5					
G41.0	44.7	50.3	44.0	50.4	44.7					
G42.0	43.9	49.5	43.0	50.4	43.9					
G43.0	43.1	48.7	43.0	48.7	43.1					
G44.0	41.9	46.6	42.0	48.7	41.9					
G45.0	41.3	46.1	41.5	48.1	41.3					
G46.0	40.5	46.3	40.2	46.9	40.5					
G47.0	39.6	44.8	40.0	46.0	39.6					
G48.0	38.5	44.3	38.7	44.8	38.5					
G49.0	37.9	43.9	37.7	44.5	37.9					
G50.0	37.5	43.0	36.5	44.4	37.5					
G51.0	37.5	42.3	36.5	43.9	37.5					
G52.0	37.2	42.6	35.2	43.1	37.2					
G53.0	35.1	41.3	34.3	41.9	35.1					
G54.0	35.8	40.5	34.2	41.4	35.8					
G55.0	34.2	39.3	33.7	40.2	34.2					
G56.0	34.1	39.2	33.8	40.0	34.1					
G57.0	34.3	38.7	32.8	38.8	34.3					
G58.0	34.6	38.1	32.5	37.9	34.6					
G59.0	34.3	37.3	32.8	37.5	34.3					
G60.0	33.7	36.3	32.2	37.3	33.7					
G61.0	33.9	36.7	31.6	36.7	33.9					
G62.0	33.3	36.5	32.1	36.3	33.3					
G63.0	32.2	35.9	32.6	36.0	32.2					
G64.0	32.6	35.8	30.9	36.0	32.6					
G65.0	33.0	35.2	31.4	35.8	33.0					
G66.0	33.3	35.0	31.3	35.2	33.3					
G67.0	33.4	34.5	30.4	34.7	33.4					
G68.0	33.0	33.7	30.3	34.8	33.0					
G69.0	33.0	33.8	30.5	34.7	33.0					
G70.0	32.6	33.3	30.4	34.6	32.6					
G71.0	32.8	33.1	30.4	34.5	32.8					
G72.0	33.1	33.3	30.4	34.8	33.1					
G73.0	32.8	33.9	30.1	34.3	32.8					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Unit: cd

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector: