

Report No.:

Test Time: 2026-05-18 11:07

Luminaire Property

Luminaire Manufacturer: NORDECOR
Luminaire Description: 80083
Luminous Width (mm): 52
Current: 0.058 A
Power Factor: 0.466


Luminous Length (mm): 52
Voltage: 220.4 V
Power: 5.96 W

Photometric Results


CIE Class: Direct
Measurement Flux: 599.6 lm
Downward Ratio: 100%
Horizontal Diffuse Angle(10%,50%,80%,100%): H33.9,H16.9,H10,H0
Vertical Diffuse Angle(10%,50%,80%,100%): V33.8,V17.1,V10,V1
Luminaire Efficacy Rating (LER): 100.66
Max. Intensity: 2876.23 cd
S/MH(C0/C180): 0.29

Total Rated Lamp Lumens: 599.6 lm
Efficiency: 100%
Upward Ratio: 0%
Central Intensity: 2867.98 cd
Pos of Max. Intensity: H90 V1
S/MH(C90/C270): 0.29

Picture Of Luminaire



Luminous Intensity Distribution Curve

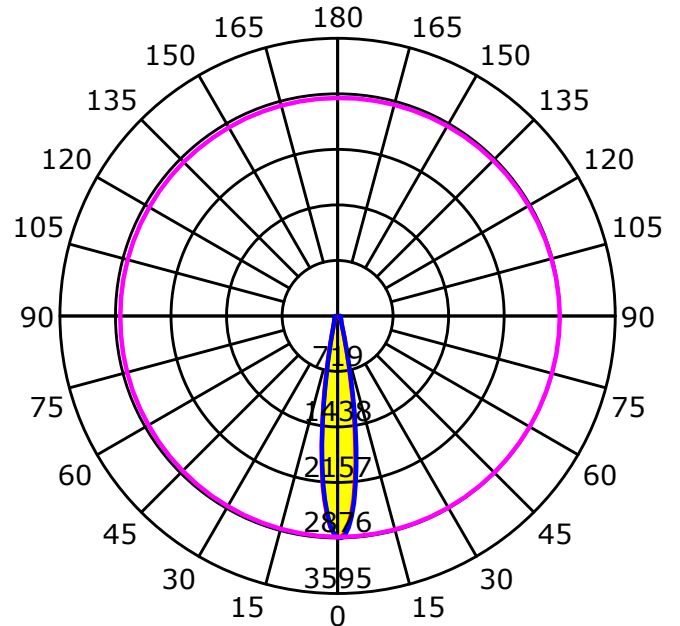

Unit: cd

Average Diffuse Angle(50%): 17.0°

— C0-C180 — C90-C270 — G1

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0



Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

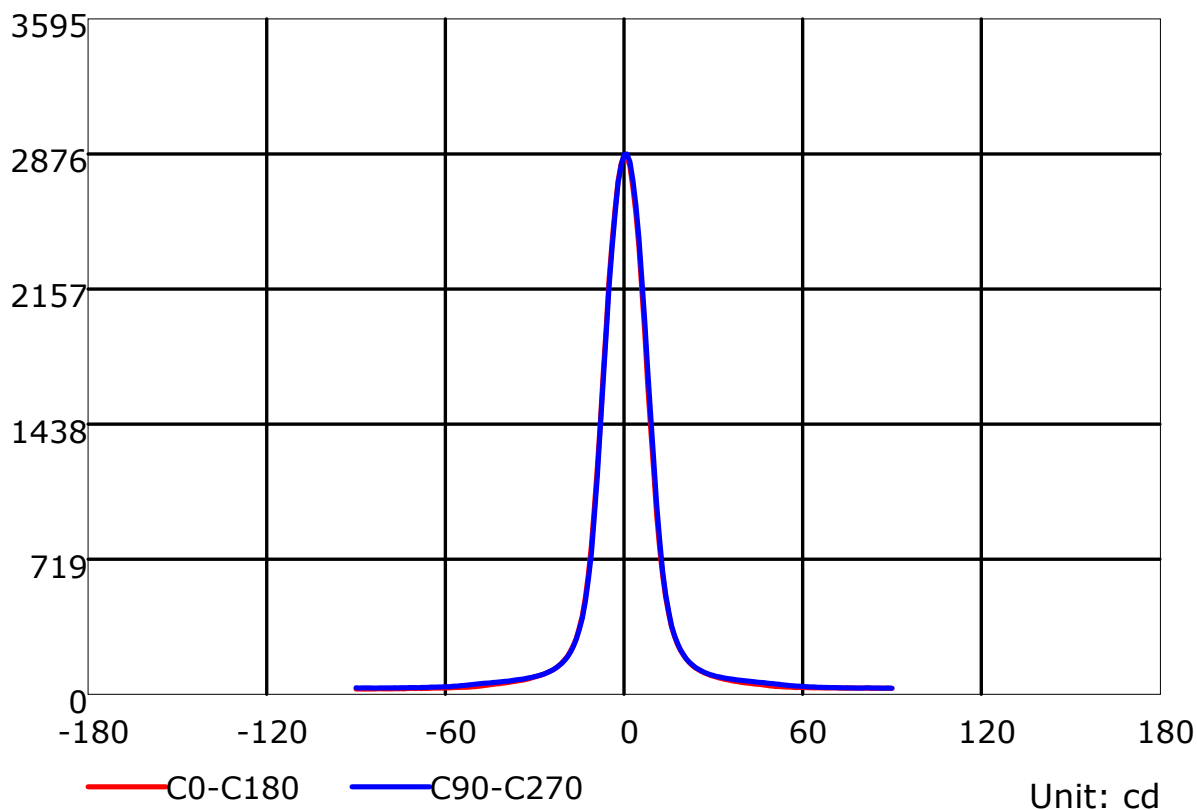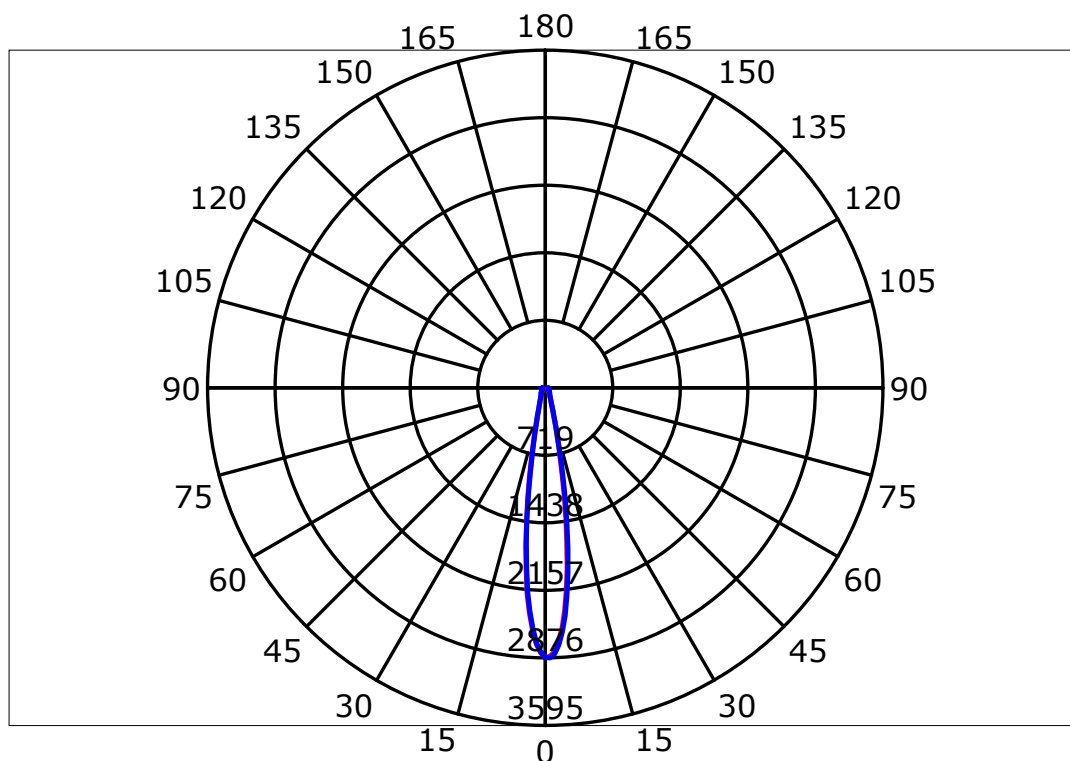

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

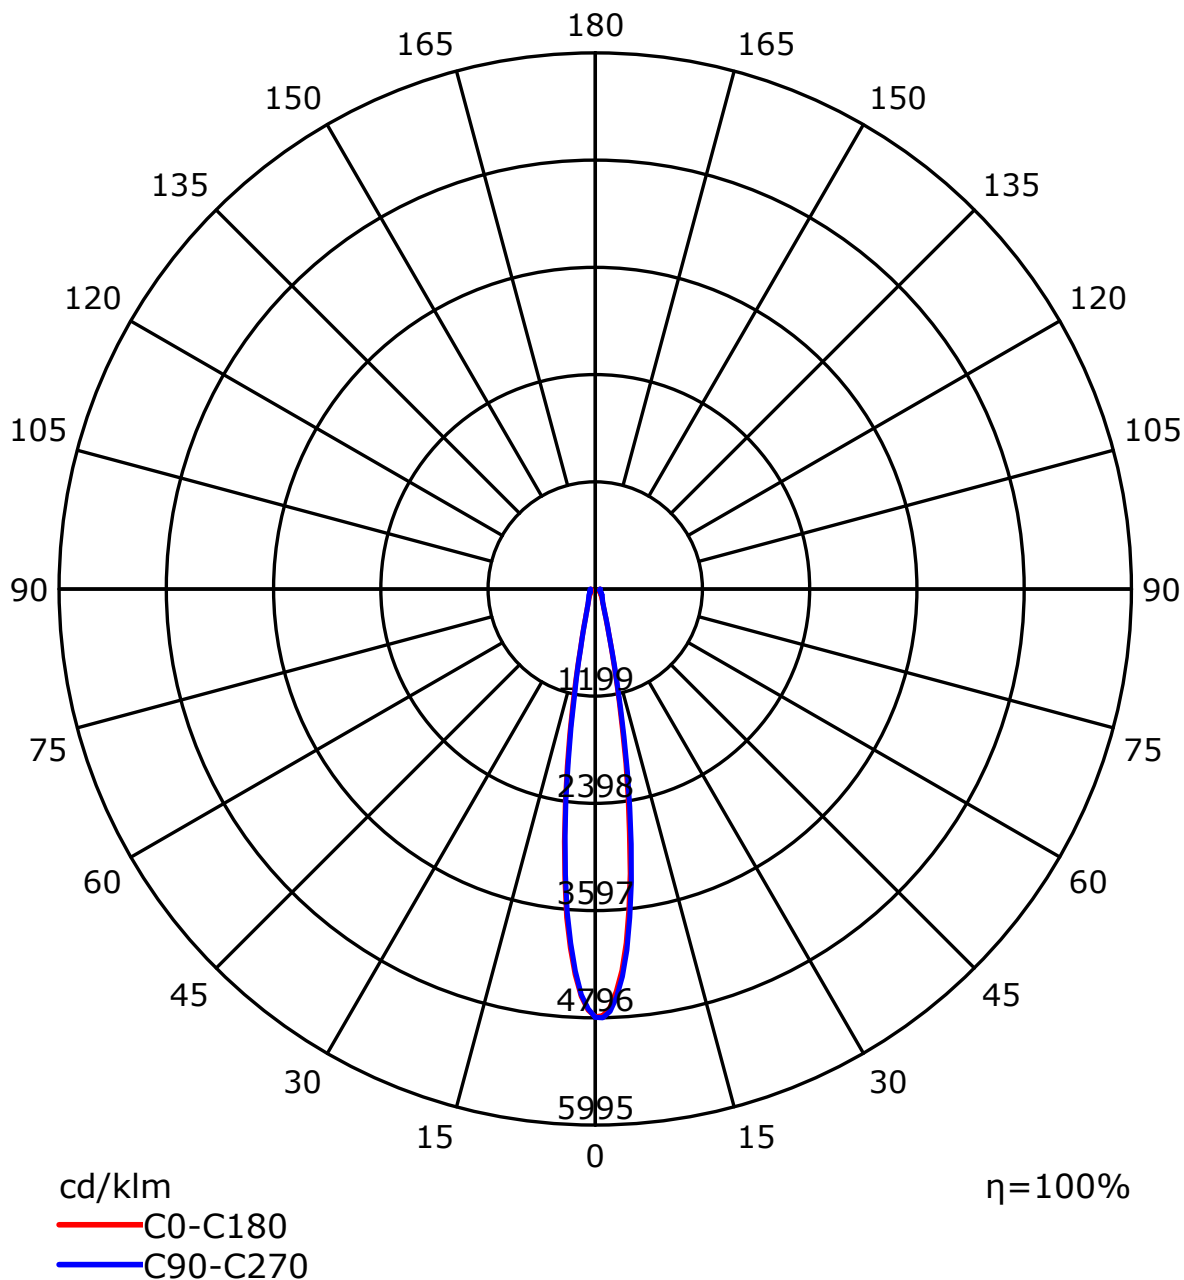

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	110	106	102	98	107	103	100	97	99	96	94	95	93	91	92	90	88	86
2	103	96	91	86	101	94	89	85	91	87	83	88	84	81	85	82	80	78
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	76	73	71
4	92	83	77	72	90	82	76	71	80	74	70	78	73	69	76	72	69	67
5	88	78	72	67	86	77	71	66	76	70	66	74	69	65	72	68	65	63
6	84	74	68	63	83	74	67	63	72	66	62	70	66	62	69	65	61	60
7	81	71	64	60	79	70	64	60	69	63	59	68	63	59	66	62	59	57
8	78	68	62	57	76	67	61	57	66	61	57	65	60	57	64	60	57	55
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53
10	72	63	57	53	71	62	57	53	62	57	53	61	56	53	60	56	53	52


Spacing Criteria (0-180): 0.29
Spacing Criteria (90-270): 0.29
Spacing Criteria (Diagonal): 0.29

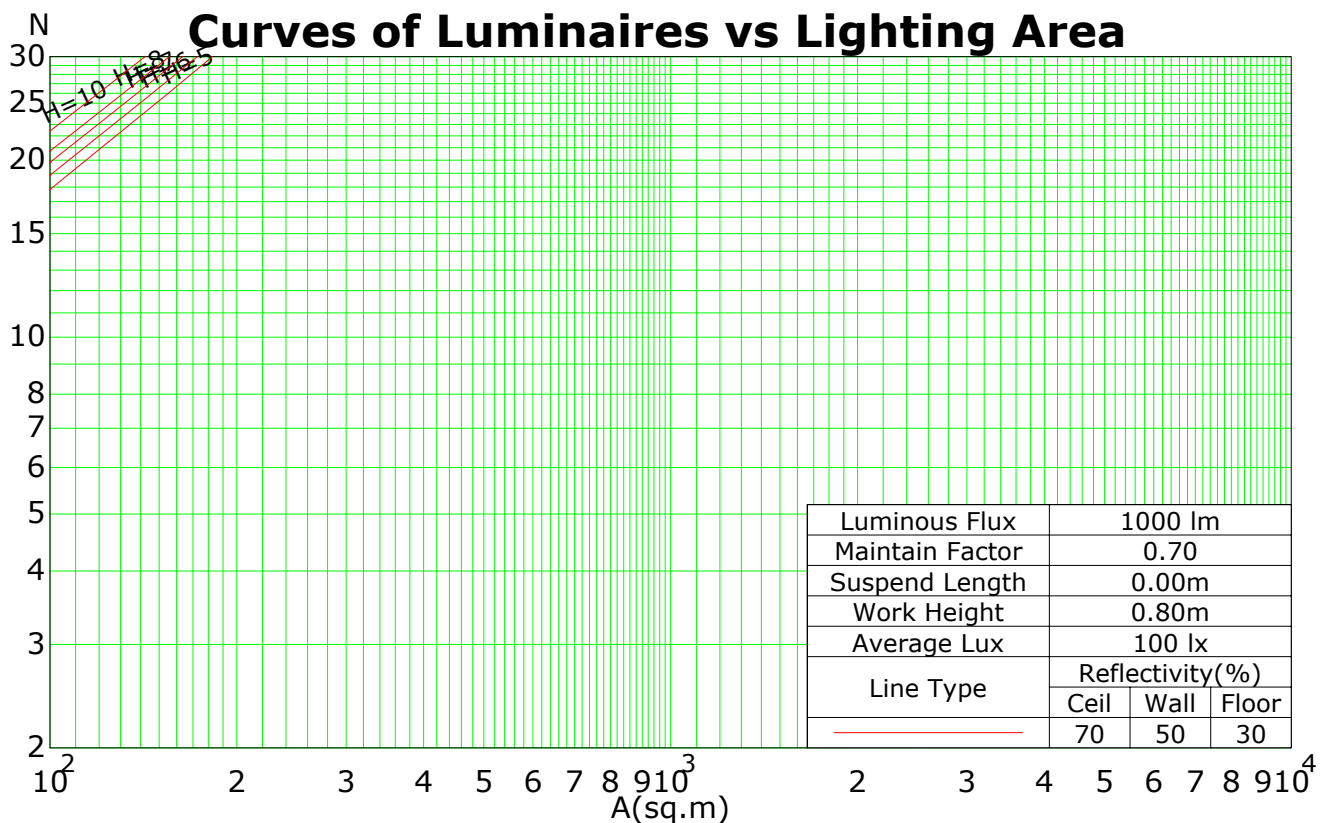

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Isocandela (rectangle)

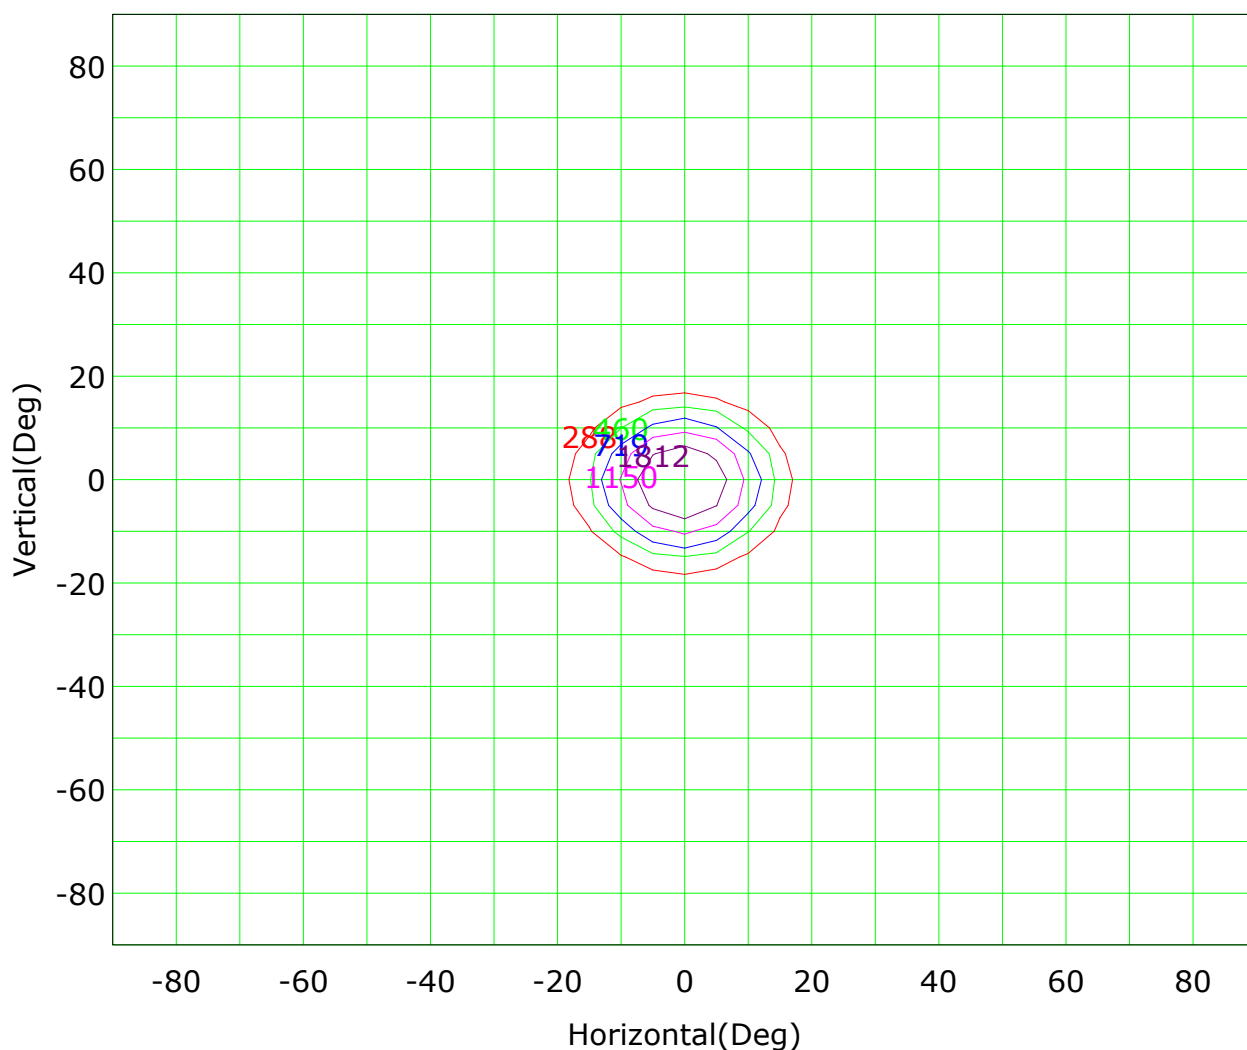


Imax (100%): 2876 cd

(10%): 288 cd	(16%): 460 cd
(25%): 719 cd	(40%): 1150 cd
(63%): 1812 cd	(100%): 2876 cd

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Isocandela (sphere)

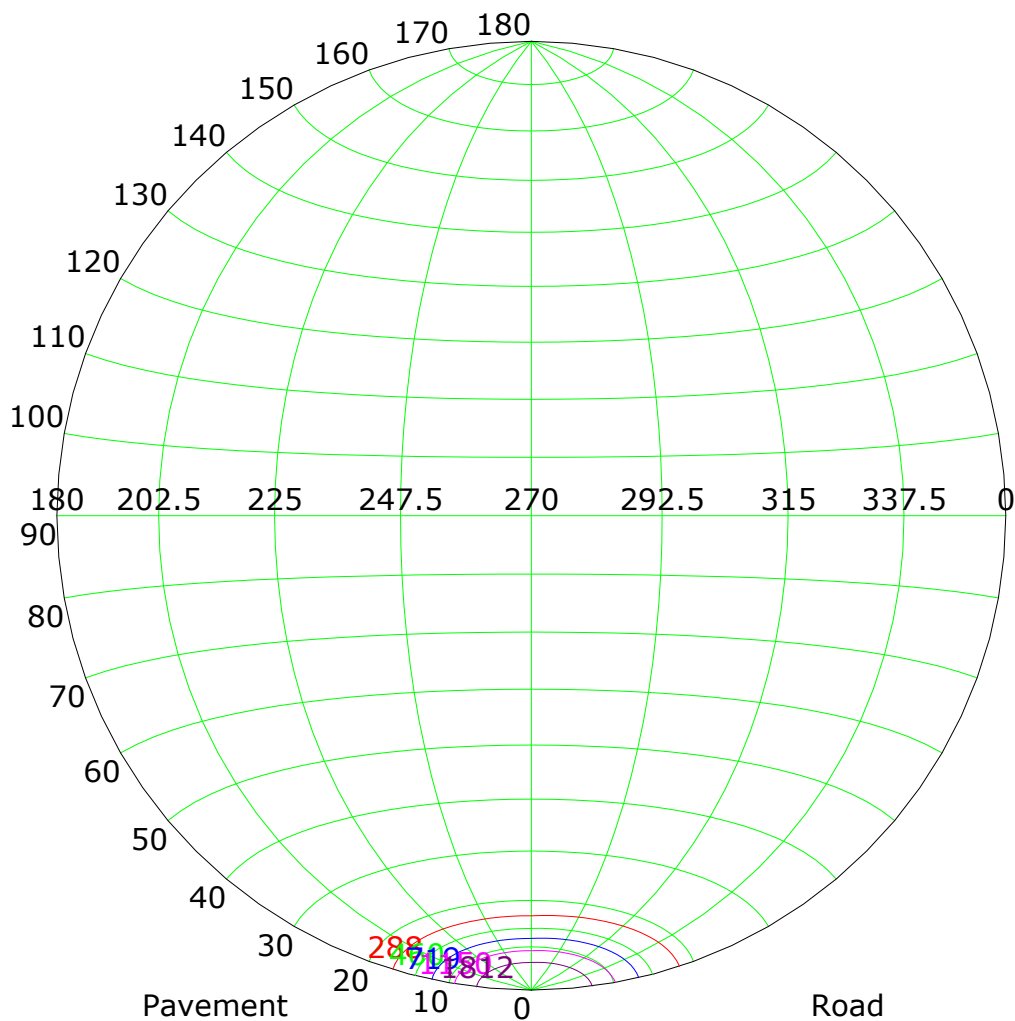


Imax (100%): 2876 cd

(10%): 288 cd
(25%): 719 cd
(63%): 1812 cd

(16%): 460 cd
(40%): 1150 cd
(100%): 2876 cd

IsoLux Plot

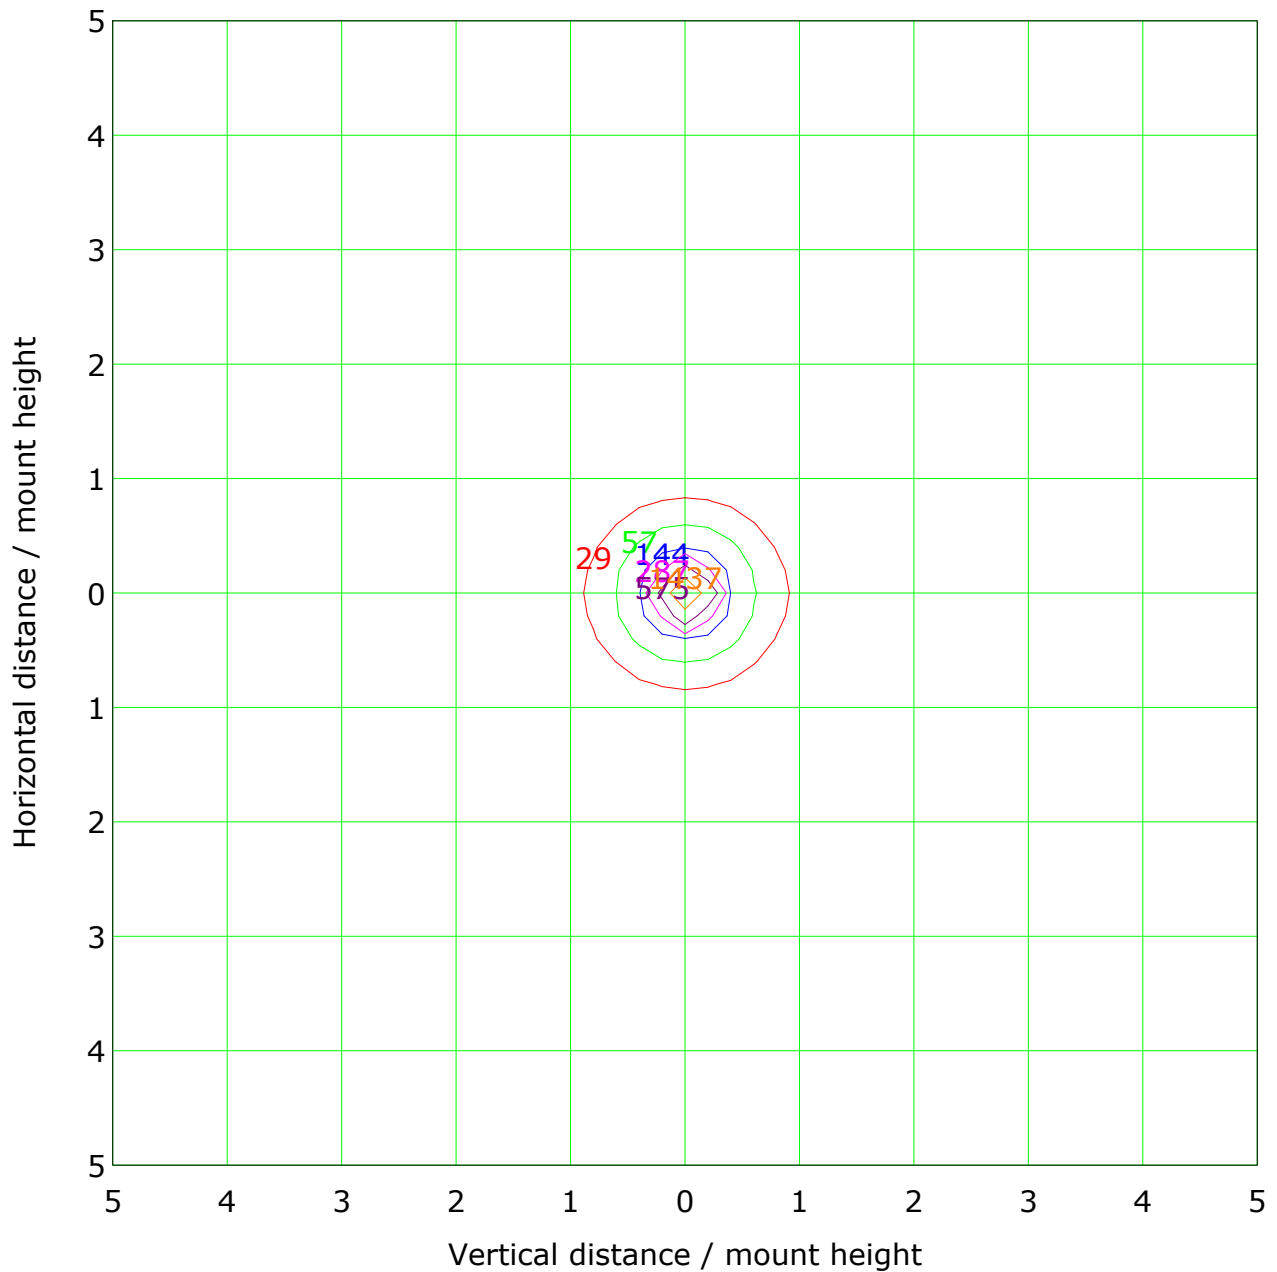

Mounting Height: 1.0m Max Lux(100%): 2874.9 lx


(1%): 28.7 lx	(2%): 57.5 lx
(5%): 143.7 lx	(10%): 287.5 lx
(20%): 575.0 lx	(50%): 1437.5 lx
(100%): 2874.9 lx	

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Roadway CU Curve

Efficiency(%)


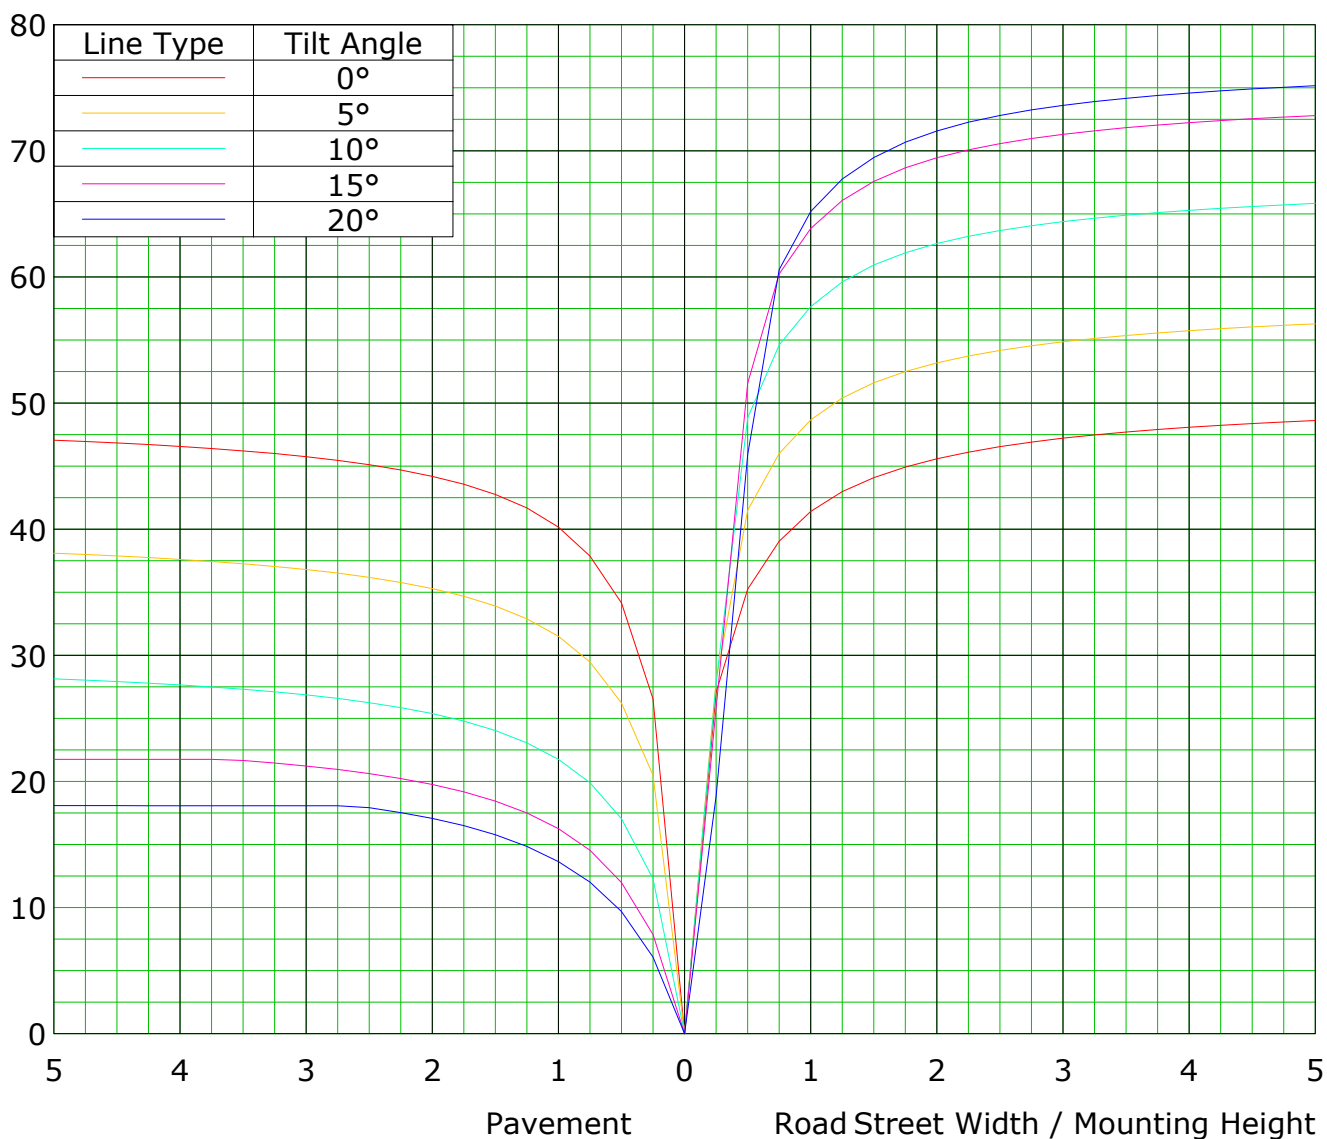


C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

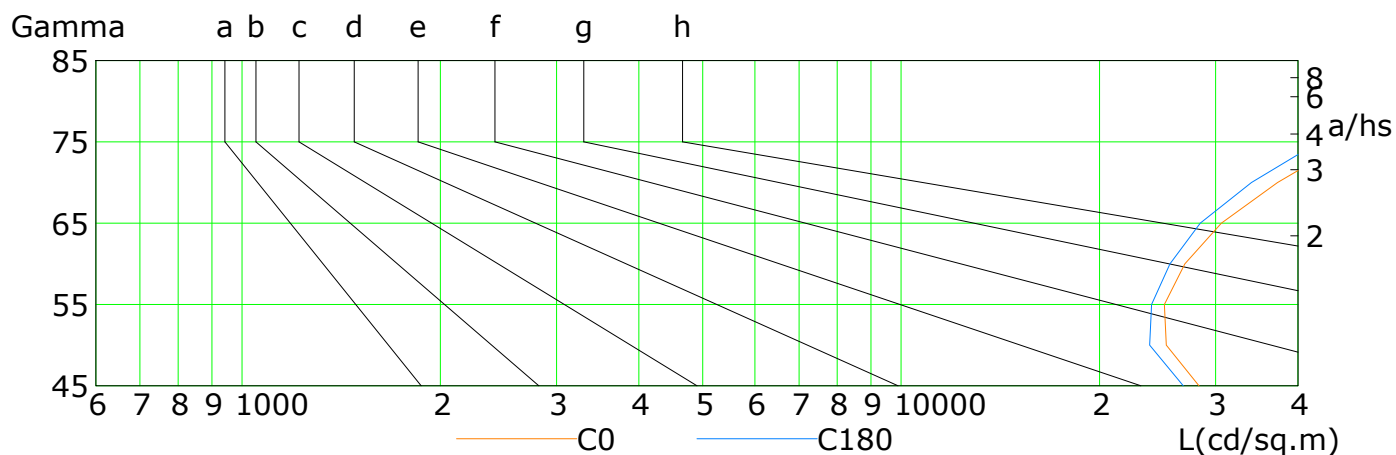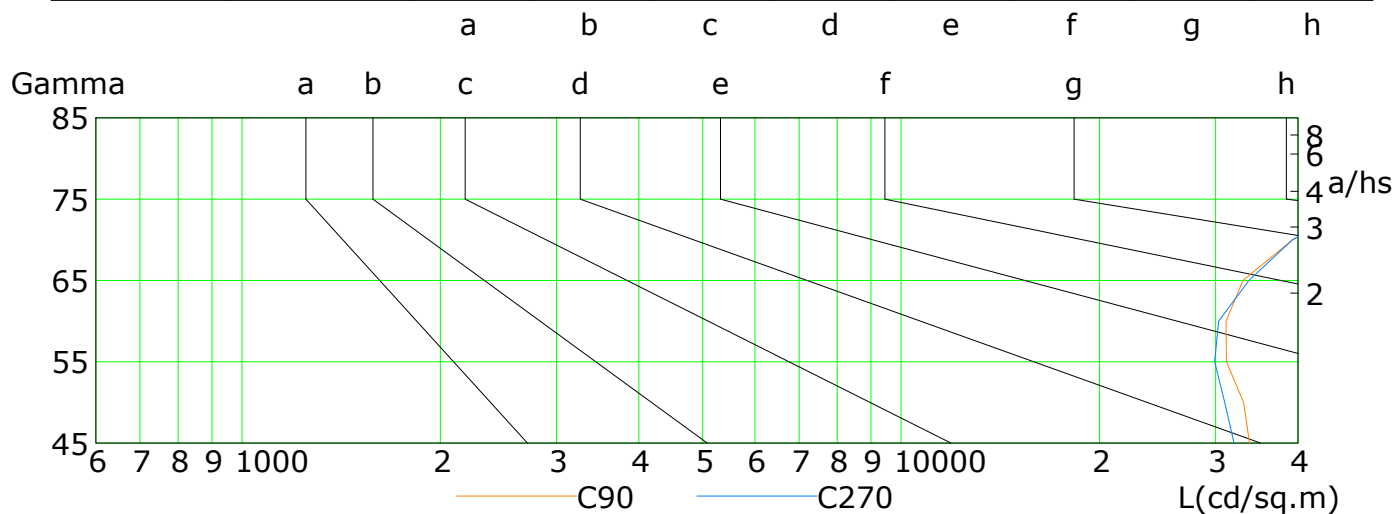

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	28300	25252	25088	26938	30610	37250	47353	69748	138414
C90	33781	33088	31168	31102	33017	39240	50354	72261	143973
C180	26788	23819	23992	25584	28431	33996	43052	63338	122290
C270	31998	30976	29904	30325	33708	39240	49982	74221	145076

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 8.443 m


Humidity:

Inspector:

Illuminance at a Distance

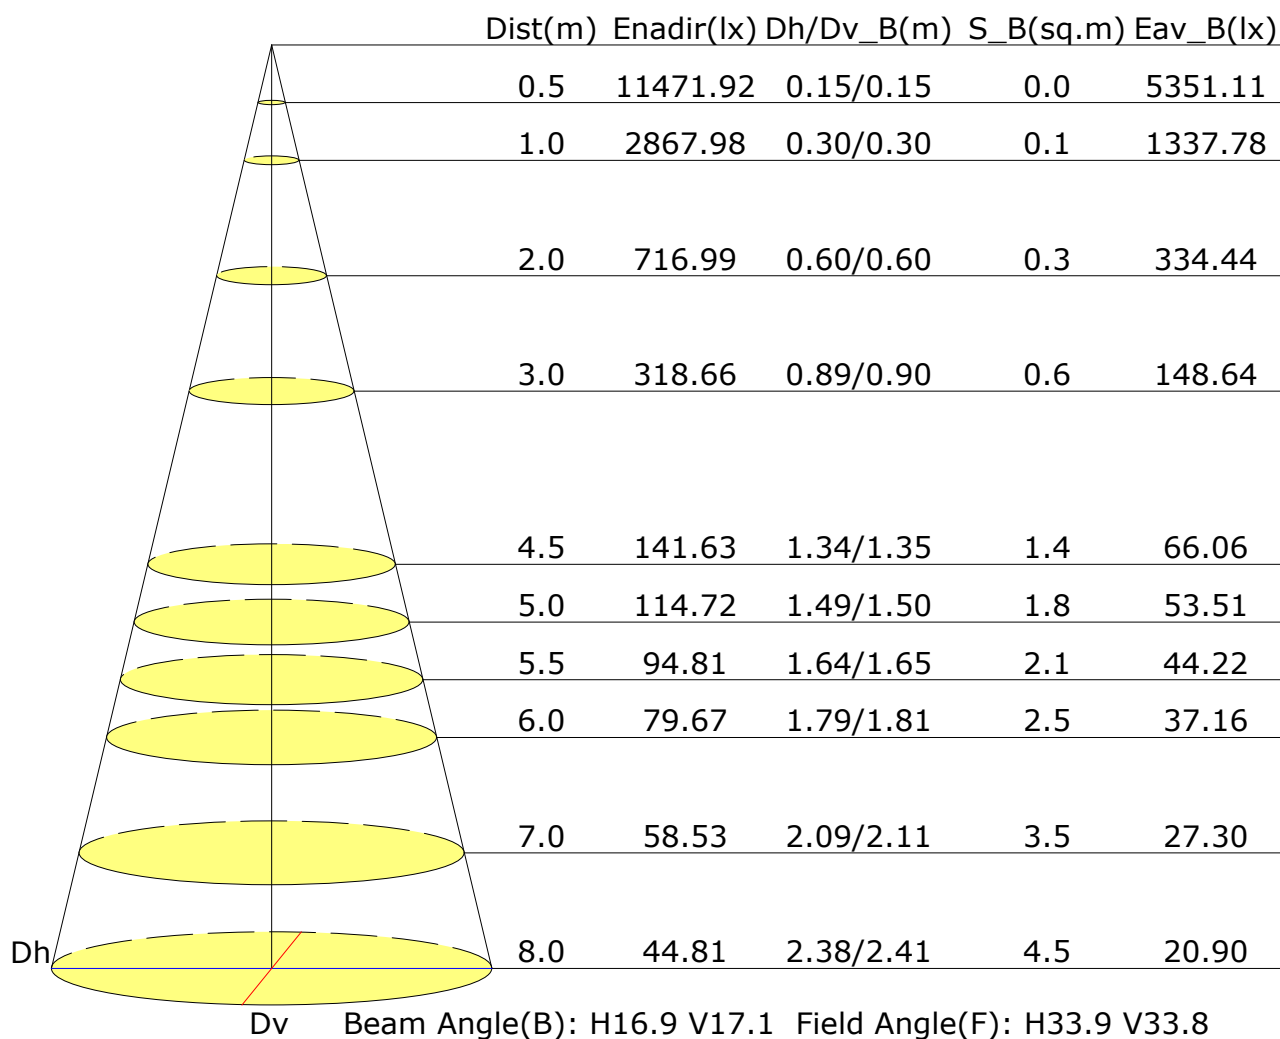

Vertical IsoLux Plot

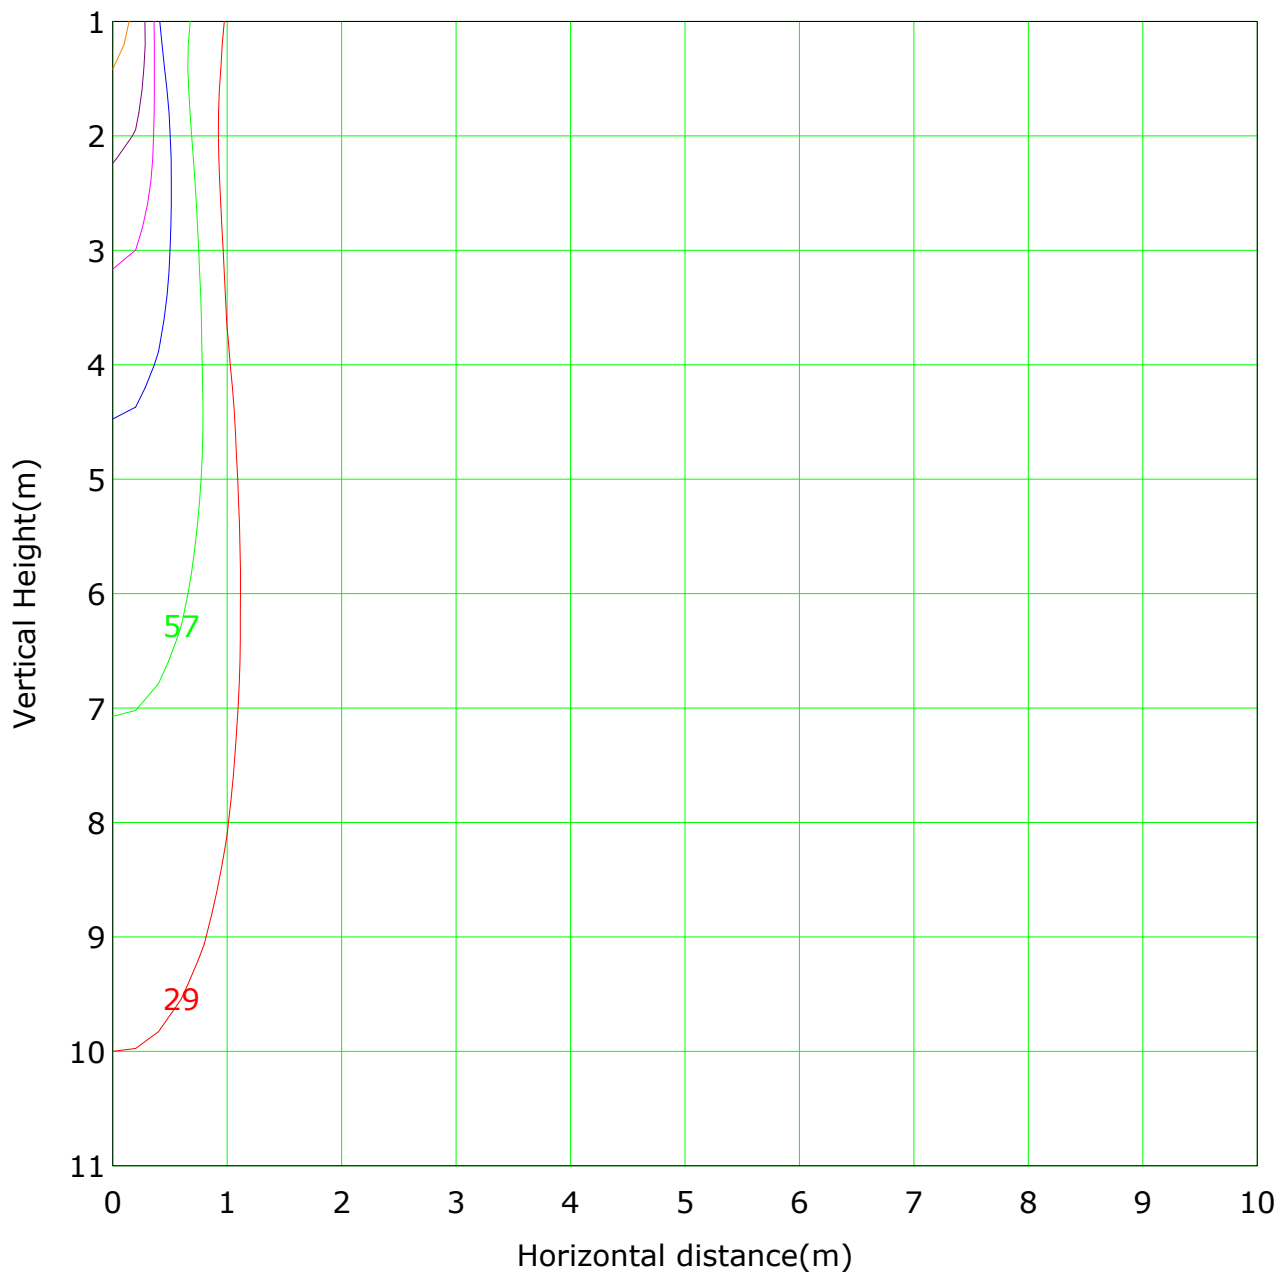

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 2868.0 lx


(1%): 28.7 lx	(2%): 57.4 lx
(5%): 143.4 lx	(10%): 286.8 lx
(20%): 573.6 lx	(50%): 1434.0 lx
(100%): 2868.0 lx	

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

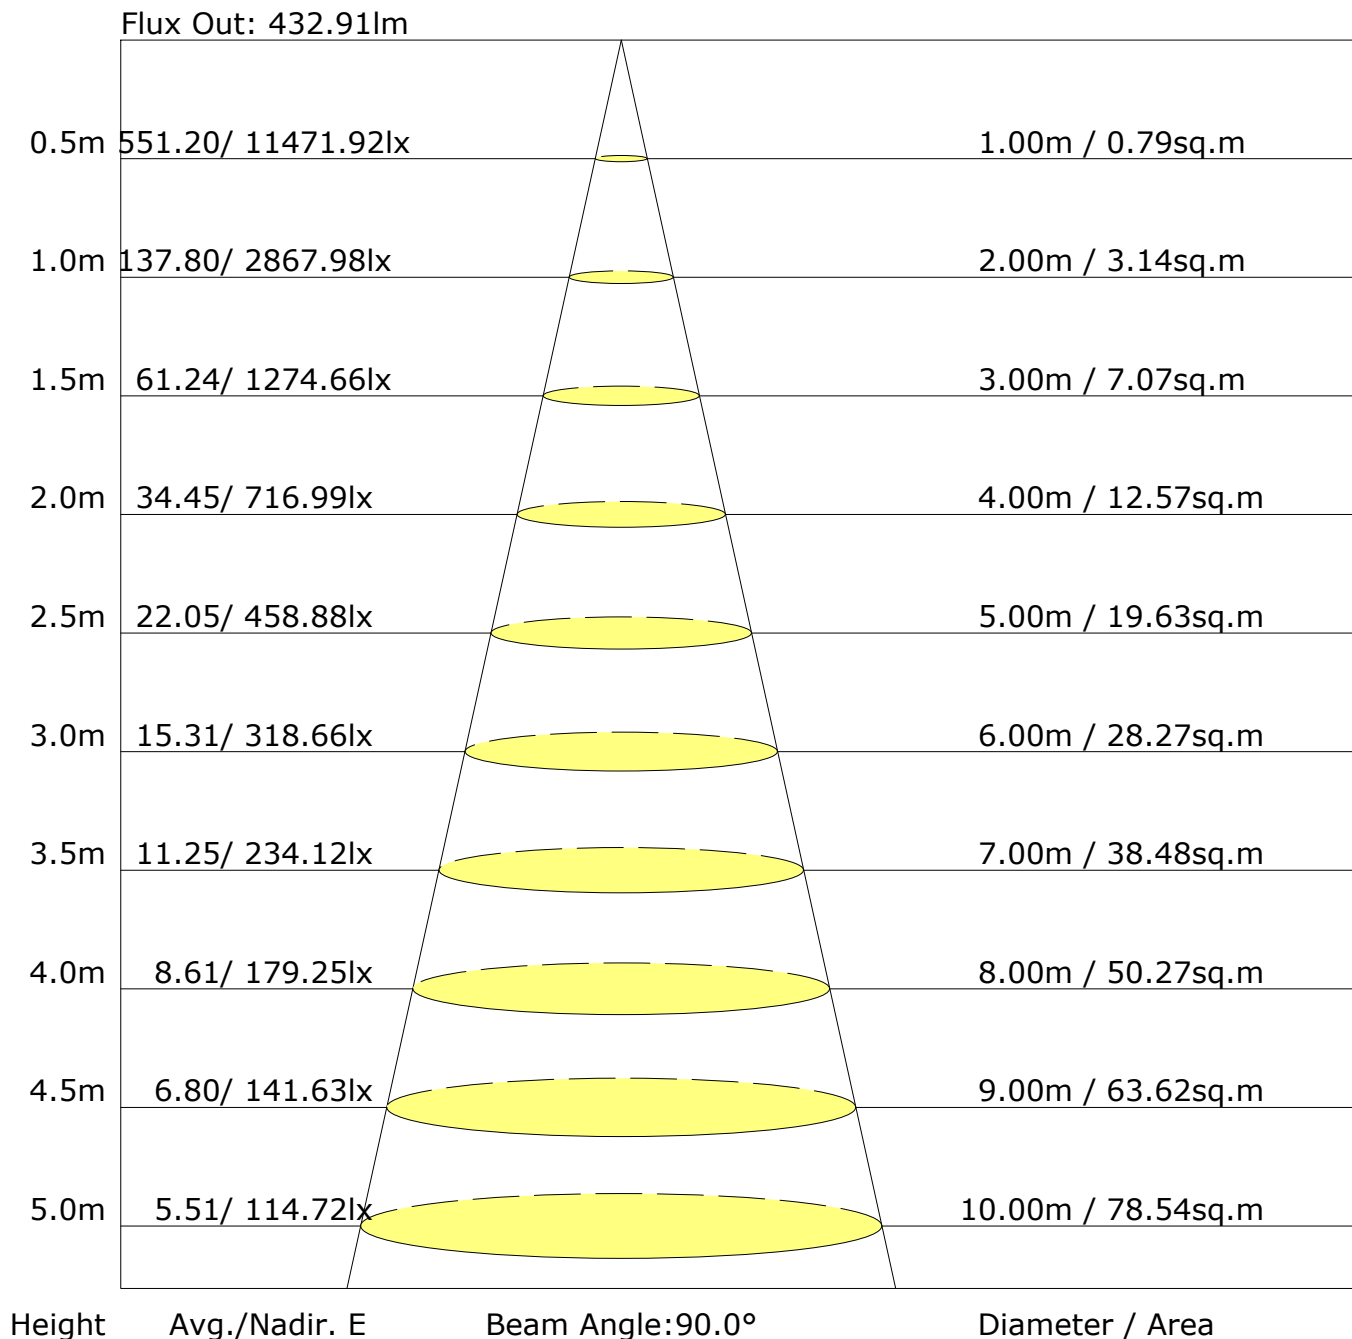

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	21.2	22.2	21.5	22.4	22.6	21.8	22.8	22.1	23.0	23.2
3H	23.8	24.8	24.1	25.0	25.3	24.3	25.2	24.6	25.5	25.7
4H	25.5	26.3	25.8	26.6	26.9	25.8	26.7	26.2	27.0	27.3
6H	27.3	28.2	27.7	28.5	28.8	27.6	28.5	28.0	28.8	29.1
8H	28.4	29.3	28.8	29.6	29.9	28.7	29.5	29.1	29.9	30.2
12H	29.7	30.5	30.0	30.8	31.1	30.0	30.8	30.3	31.1	31.4
X=4H Y=2H	22.2	23.1	22.5	23.4	23.7	22.6	23.5	23.0	23.8	24.1
3H	25.1	25.9	25.5	26.2	26.6	25.4	26.2	25.8	26.6	26.9
4H	26.9	27.6	27.3	28.0	28.3	27.2	27.9	27.6	28.2	28.6
6H	29.0	29.6	29.4	30.0	30.4	29.2	29.9	29.6	30.2	30.6
8H	30.2	30.8	30.6	31.2	31.6	30.4	31.0	30.8	31.4	31.8
12H	31.5	32.1	32.0	32.5	32.9	31.8	32.3	32.2	32.7	33.2
X=8H Y=4H	27.7	28.3	28.1	28.7	29.1	27.9	28.5	28.3	28.9	29.3
6H	30.1	30.6	30.5	31.0	31.5	30.2	30.7	30.7	31.2	31.6
8H	31.4	31.9	31.9	32.3	32.8	31.6	32.1	32.1	32.5	33.0
12H	33.0	33.4	33.5	33.9	34.4	33.2	33.6	33.7	34.1	34.6
X=12H Y=4H	27.9	28.5	28.4	28.9	29.3	28.1	28.7	28.6	29.1	29.5
6H	30.4	30.9	30.9	31.3	31.8	30.6	31.0	31.0	31.5	32.0
8H	31.9	32.3	32.4	32.8	33.3	32.1	32.5	32.6	33.0	33.5
Variations with the observer position at spacings:										
S=1.0H	+0.4/-0.4					+0.4/-0.4				
S=1.5H	+0.6/-0.8					+0.6/-0.8				
S=2.0H	+0.8/-1.1					+0.8/-1.1				

Calculate in accordance with CIE Pub.117. The table is revised with 600lm ($8\log(F/F_0) = -1.8$).

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM


	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	307	51.3
	FL (0°-30°)	186	31.0
	FM (30°-60°)	67	11.2
	FH (60°-80°)	36	6.1
	FVH (80°-90°)	18	3.0
	BACK LIGHT	292	48.7
	BL (0°-30°)	175	29.1
	BM (30°-60°)	66	10.9
	BH (60°-80°)	35	5.8
	BVH (80°-90°)	17	2.9
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U1 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U1 G1

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

LCS Graph

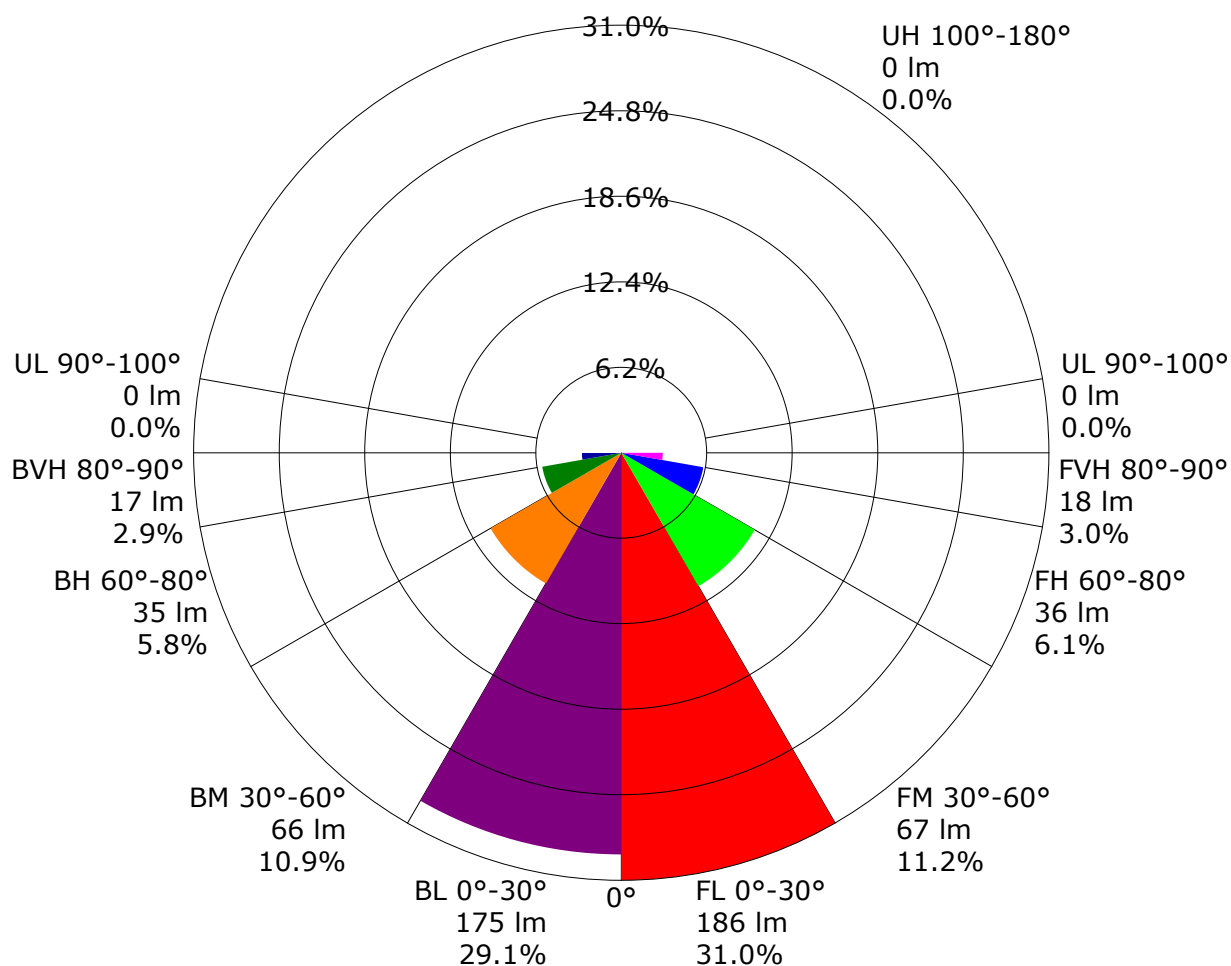

Back Light

Forward Light

Scale= MAX LCS%

Trapped Light:NA,NA

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 0.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.78	0.84	0.89	0.92	0.97	1.01	1.03	1.07	1.09	
	0.30		0.72	0.78	0.83	0.86	0.92	0.96	0.99	1.03	1.06	
	0.20		0.67	0.73	0.78	0.82	0.87	0.92	0.95	0.99	1.03	
0.50	0.50	0.20	0.76	0.82	0.86	0.89	0.94	0.97	0.99	1.03	1.05	
	0.30		0.71	0.77	0.81	0.84	0.90	0.93	0.96	0.99	1.02	
	0.20		0.67	0.73	0.77	0.80	0.86	0.89	0.92	0.96	0.99	
0.30	0.50	0.20	0.75	0.80	0.84	0.87	0.91	0.94	0.96	0.99	1.01	
	0.30		0.70	0.76	0.80	0.83	0.87	0.91	0.93	0.96	0.98	
	0.20		0.66	0.72	0.76	0.79	0.84	0.87	0.90	0.94	0.96	
0.00	0.00	0.00	0.65	0.70	0.73	0.76	0.81	0.84	0.86	0.89	0.91	
Rating:6W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 0.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.76	0.65	0.57	0.51	0.42	0.36	0.31	0.25	0.21	
	0.30		0.64	0.56	0.50	0.45	0.38	0.33	0.29	0.24	0.20	
	0.20		0.55	0.49	0.44	0.40	0.34	0.30	0.27	0.22	0.19	
0.50	0.50	0.20	0.73	0.62	0.54	0.48	0.40	0.38	0.30	0.24	0.20	
	0.30		0.62	0.54	0.48	0.43	0.36	0.31	0.28	0.23	0.19	
	0.20		0.54	0.48	0.43	0.39	0.33	0.29	0.26	0.22	0.19	
0.30	0.50	0.20	0.71	0.59	0.52	0.46	0.38	0.32	0.28	0.23	0.19	
	0.30		0.60	0.52	0.46	0.42	0.35	0.30	0.27	0.22	0.18	
	0.20		0.53	0.47	0.42	0.38	0.32	0.28	0.25	0.21	0.18	
0.00	0.00	0.00	0.40	0.35	0.31	0.28	0.24	0.21	0.19	0.15	0.13	
Rating:6W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 0.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.15	0.17	0.18	0.19	0.20	0.21	0.21	0.22	0.23	
	0.30		0.09	0.11	0.13	0.14	0.16	0.17	0.18	0.19	0.20	
	0.20		0.06	0.07	0.09	0.10	0.12	0.14	0.15	0.17	0.18	
0.50	0.50	0.20	0.14	0.16	0.17	0.18	0.19	0.20	0.21	0.21	0.22	
	0.30		0.09	0.11	0.13	0.14	0.15	0.16	0.17	0.19	0.19	
	0.20		0.06	0.07	0.09	0.10	0.12	0.13	0.15	0.16	0.17	
0.30	0.50	0.20	0.14	0.15	0.17	0.17	0.18	0.19	0.20	0.20	0.21	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19	
	0.20		0.06	0.07	0.09	0.10	0.12	0.13	0.14	0.16	0.17	
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Rating:6W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	2857.3	2.7	2.7	0.46	0.46
1.0-2.0	2809.7	8.1	10.8	1.35	1.80
2.0-3.0	2712.4	13.0	23.8	2.16	3.96
3.0-4.0	2570.4	17.2	41.0	2.87	6.83
4.0-5.0	2395.8	20.6	61.6	3.44	10.27
5.0-6.0	2181.7	22.9	84.5	3.82	14.10
6.0-7.0	1941.2	24.1	108.6	4.02	18.11
7.0-8.0	1690.0	24.2	132.8	4.03	22.15
8.0-9.0	1436.9	23.3	156.1	3.88	26.03
9.0-10.0	1200.5	21.7	177.8	3.62	29.66
10.0-11.0	981.5	19.6	197.4	3.27	32.93
11.0-12.0	792.9	17.3	214.8	2.89	35.82
12.0-13.0	643.9	15.3	230.1	2.55	38.37
13.0-14.0	523.4	13.4	243.5	2.23	40.60
14.0-15.0	431.7	11.9	255.3	1.98	42.58
15.0-16.0	362.2	10.6	265.9	1.77	44.35
16.0-17.0	307.4	9.6	275.5	1.60	45.95
17.0-18.0	266.4	8.8	284.3	1.47	47.41
18.0-19.0	233.7	8.1	292.4	1.36	48.77
19.0-20.0	207.1	7.6	300.0	1.26	50.03
20.0-21.0	186.0	7.1	307.1	1.19	51.22
21.0-22.0	168.4	6.8	313.9	1.13	52.35
22.0-23.0	153.9	6.5	320.4	1.08	53.43
23.0-24.0	141.9	6.2	326.6	1.03	54.46
24.0-25.0	131.7	6.0	332.6	1.00	55.46
25.0-26.0	123.2	5.8	338.4	0.97	56.43
26.0-27.0	115.5	5.7	344.0	0.94	57.38
27.0-28.0	109.0	5.5	349.6	0.92	58.30
28.0-29.0	103.5	5.4	355.0	0.90	59.20
29.0-30.0	98.4	5.3	360.3	0.89	60.09
30.0-31.0	94.0	5.2	365.5	0.87	60.96
31.0-32.0	89.9	5.1	370.7	0.86	61.82
32.0-33.0	86.2	5.1	375.8	0.85	62.66
33.0-34.0	82.8	5.0	380.8	0.84	63.50
34.0-35.0	79.8	5.0	385.7	0.83	64.33
35.0-36.0	77.3	4.9	390.6	0.82	65.15

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	74.8	4.9	395.5	0.81	65.96
37.0-38.0	72.5	4.8	400.4	0.81	66.77
38.0-39.0	70.1	4.8	405.1	0.80	67.56
39.0-40.0	67.7	4.7	409.9	0.79	68.35
40.0-41.0	65.9	4.7	414.6	0.78	69.13
41.0-42.0	64.0	4.7	419.2	0.78	69.91
42.0-43.0	62.3	4.6	423.8	0.77	70.68
43.0-44.0	60.6	4.6	428.4	0.76	71.44
44.0-45.0	58.8	4.5	432.9	0.75	72.20
45.0-46.0	57.0	4.5	437.4	0.74	72.94
46.0-47.0	55.4	4.4	441.8	0.73	73.67
47.0-48.0	53.5	4.3	446.1	0.72	74.40
48.0-49.0	51.6	4.2	450.3	0.71	75.10
49.0-50.0	49.9	4.2	454.5	0.69	75.80
50.0-51.0	48.4	4.1	458.6	0.68	76.48
51.0-52.0	47.1	4.0	462.6	0.67	77.15
52.0-53.0	45.6	4.0	466.6	0.66	77.82
53.0-54.0	44.2	3.9	470.5	0.65	78.46
54.0-55.0	43.2	3.9	474.4	0.64	79.11
55.0-56.0	42.1	3.8	478.2	0.63	79.74
56.0-57.0	41.0	3.7	481.9	0.63	80.37
57.0-58.0	40.1	3.7	485.6	0.62	80.98
58.0-59.0	39.3	3.7	489.3	0.61	81.60
59.0-60.0	38.7	3.7	492.9	0.61	82.21
60.0-61.0	38.1	3.6	496.6	0.61	82.81
61.0-62.0	37.5	3.6	500.2	0.60	83.41
62.0-63.0	37.1	3.6	503.8	0.60	84.02
63.0-64.0	36.7	3.6	507.4	0.60	84.62
64.0-65.0	36.3	3.6	511.0	0.60	85.22
65.0-66.0	35.7	3.6	514.5	0.59	85.81
66.0-67.0	35.3	3.5	518.1	0.59	86.40
67.0-68.0	35.1	3.6	521.6	0.59	86.99
68.0-69.0	34.8	3.6	525.2	0.59	87.59
69.0-70.0	34.7	3.6	528.8	0.59	88.18
70.0-71.0	34.6	3.6	532.3	0.60	88.78
71.0-72.0	34.4	3.6	535.9	0.60	89.38

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G0.0	2868.0	2872.7	2868.0	2872.7	2868.0					
G1.0	2862.1	2876.2	2824.1	2814.7	2862.1					
G2.0	2810.9	2834.8	2733.3	2721.9	2810.9					
G3.0	2702.1	2740.4	2589.9	2566.0	2702.1					
G4.0	2564.8	2605.6	2412.3	2381.7	2564.8					
G5.0	2383.9	2431.5	2211.4	2175.1	2383.9					
G6.0	2159.0	2213.6	1955.4	1923.4	2159.0					
G7.0	1921.7	1982.5	1707.3	1666.5	1921.7					
G8.0	1648.6	1727.7	1444.2	1421.7	1648.6					
G9.0	1411.5	1480.8	1203.2	1157.6	1411.5					
G10.0	1184.3	1241.5	983.8	941.7	1184.3					
G11.0	954.4	1011.1	788.8	746.6	954.4					
G12.0	775.8	820.4	636.0	609.8	775.8					
G13.0	637.1	656.7	517.9	497.2	637.1					
G14.0	517.9	533.1	420.4	407.2	517.9					
G15.0	430.2	442.7	356.1	346.3	430.2					
G16.0	359.5	365.4	300.4	297.3	359.5					
G17.0	308.1	311.9	261.0	255.7	308.1					
G18.0	266.9	271.8	231.1	224.9	266.9					
G19.0	234.0	237.4	203.2	200.2	234.0					
G20.0	207.9	210.7	183.7	180.0	207.9					
G21.0	186.8	187.9	166.9	164.3	186.8					
G22.0	168.2	170.4	151.3	151.1	168.2					
G23.0	153.7	157.1	140.3	139.5	153.7					
G24.0	141.4	144.0	129.2	130.1	141.4					
G25.0	131.7	134.1	122.1	121.1	131.7					
G26.0	122.5	125.9	114.2	114.4	122.5					
G27.0	114.4	116.7	108.1	108.1	114.4					
G28.0	108.3	111.2	102.2	103.4	108.3					
G29.0	101.7	105.6	97.3	98.5	101.7					
G30.0	96.8	100.6	92.2	94.7	96.8					
G31.0	92.4	96.0	88.4	90.7	92.4					
G32.0	87.4	93.0	82.8	88.2	87.4					
G33.0	83.6	89.7	80.0	84.9	83.6					
G34.0	79.7	86.5	76.3	81.8	79.7					
G35.0	76.8	84.0	73.6	79.9	76.8					
G36.0	73.5	81.9	70.7	77.7	73.5					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G37.0	70.5	79.4	68.9	75.5	70.5					
G38.0	68.9	77.4	66.3	73.0	68.9					
G39.0	65.1	75.6	63.8	70.3	65.1					
G40.0	62.9	73.5	61.3	69.2	62.9					
G41.0	61.3	71.7	59.3	67.7	61.3					
G42.0	59.5	70.2	56.5	66.2	59.5					
G43.0	57.1	68.5	55.5	64.6	57.1					
G44.0	55.3	67.1	52.9	63.7	55.3					
G45.0	54.1	64.6	51.2	61.2	54.1					
G46.0	52.3	63.4	49.0	60.1	52.3					
G47.0	49.5	62.4	47.3	59.1	49.5					
G48.0	48.1	59.9	44.5	57.4	48.1					
G49.0	46.0	58.2	42.7	55.9	46.0					
G50.0	43.9	57.5	41.4	53.8	43.9					
G51.0	42.6	55.0	40.7	52.4	42.6					
G52.0	42.2	54.0	39.2	50.7	42.2					
G53.0	40.6	51.2	38.3	48.6	40.6					
G54.0	39.7	49.8	37.9	47.3	39.7					
G55.0	38.9	48.3	37.2	46.4	38.9					
G56.0	38.5	46.3	36.8	44.0	38.5					
G57.0	37.3	45.7	35.9	43.5	37.3					
G58.0	36.4	44.2	35.8	41.8	36.4					
G59.0	36.8	44.0	34.6	40.5	36.8					
G60.0	36.4	42.0	34.6	41.0	36.4					
G61.0	36.0	41.0	33.5	40.0	36.0					
G62.0	35.5	40.2	34.1	39.3	35.5					
G63.0	35.5	39.6	33.3	39.0	35.5					
G64.0	34.6	39.4	33.8	38.8	34.6					
G65.0	35.0	37.7	32.5	38.5	35.0					
G66.0	34.8	37.6	31.6	37.5	34.8					
G67.0	34.7	36.9	31.8	37.3	34.7					
G68.0	34.1	37.5	31.4	36.7	34.1					
G69.0	34.5	36.4	32.5	35.8	34.5					
G70.0	34.5	36.3	31.4	36.3	34.5					
G71.0	34.5	36.2	31.8	36.0	34.5					
G72.0	33.8	35.0	31.7	36.5	33.8					
G73.0	34.1	35.1	31.2	35.5	34.1					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Unit: cd

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector: