

Test Time: 2026-04-21 10:25



Luminaire Manufacturer: NORDECOR
Luminaire Description: 80089
Luminous Width (mm): 71
Current: 0.082 A
Power Factor: 0.467

Luminous Length (mm): 71
Voltage: 220.5 V
Power: 8.47 W

CIE Class: Direct
Measurement Flux: 779.9 lm
Downward Ratio: 100%
Horizontal Diffuse Angle(10%,50%,80%
Vertical Diffuse Angle(10%,50%,80%,1
Luminaire Efficacy Rating (LER): 92.12
Max. Intensity: 4197.05 cd
S/MH(C0/C180): 0.31

Total Rated Lamp Lumens: 779.9 lm
Efficiency: 100%
Upward Ratio: 0%
0%): H36.1,H18,H10.8,H1
): V35.6,V17.8,V10.7,V0
Central Intensity: 4193.37 cd
Pos of Max. Intensity: H180 V1
S/MH(C90/C270): 0.31

Luminous Intensity Distribution Curve

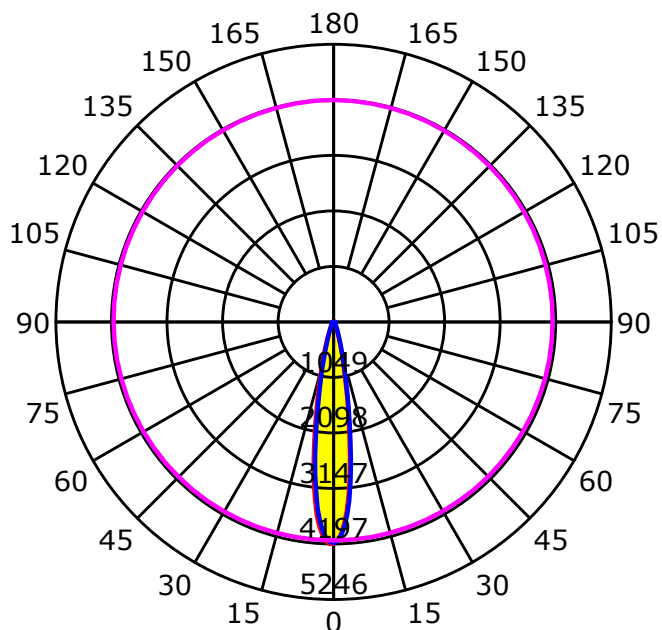



Average Diffuse Angle(50%): 17.9°

— C0-C180 — C90-C270 — G1

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve

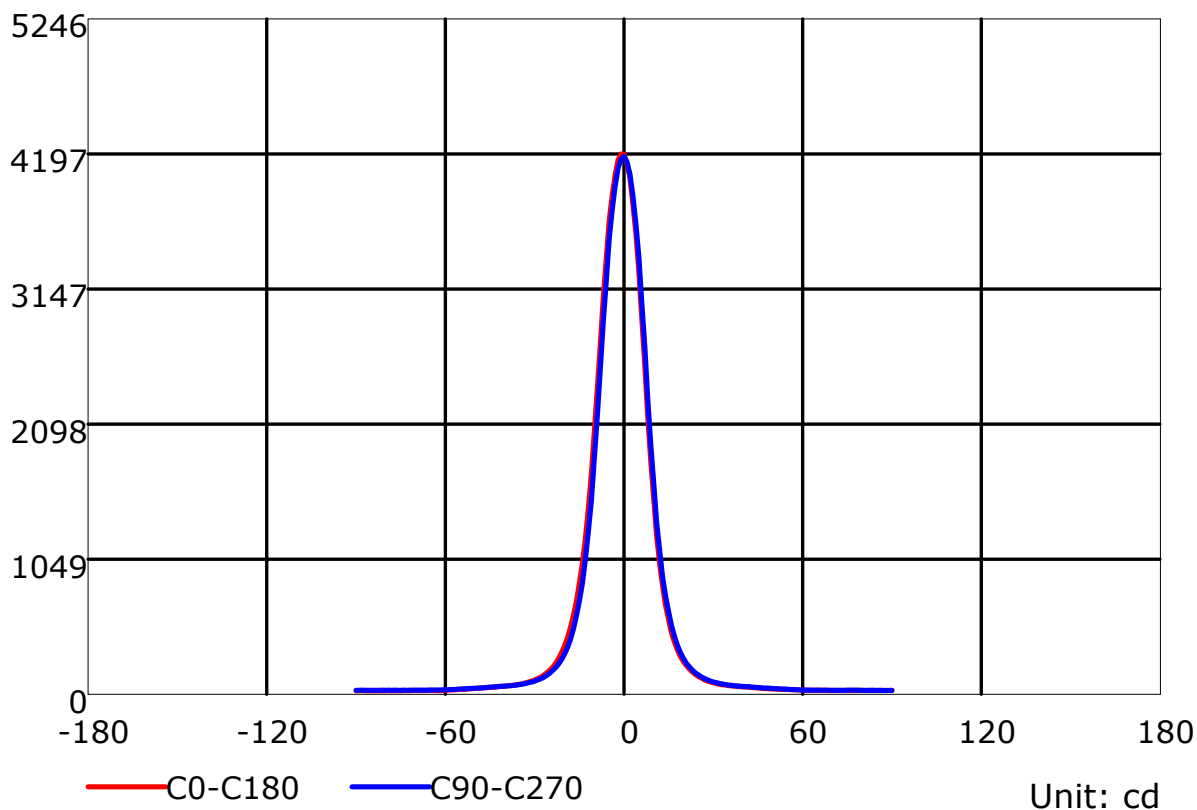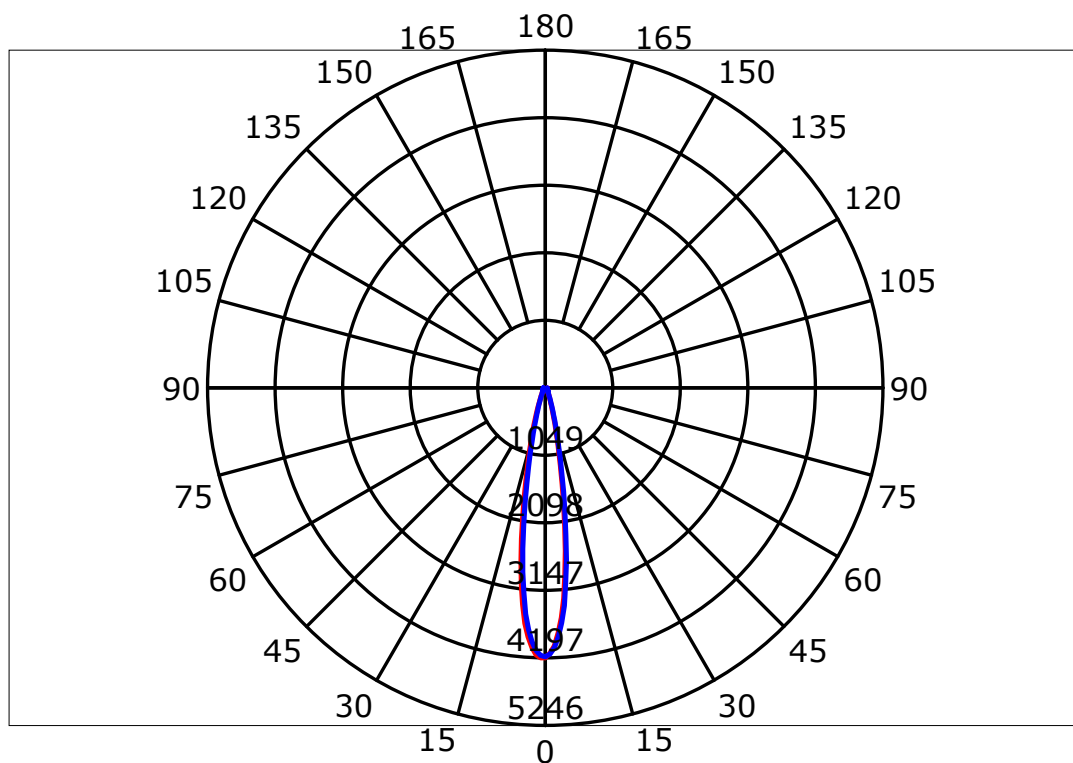

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

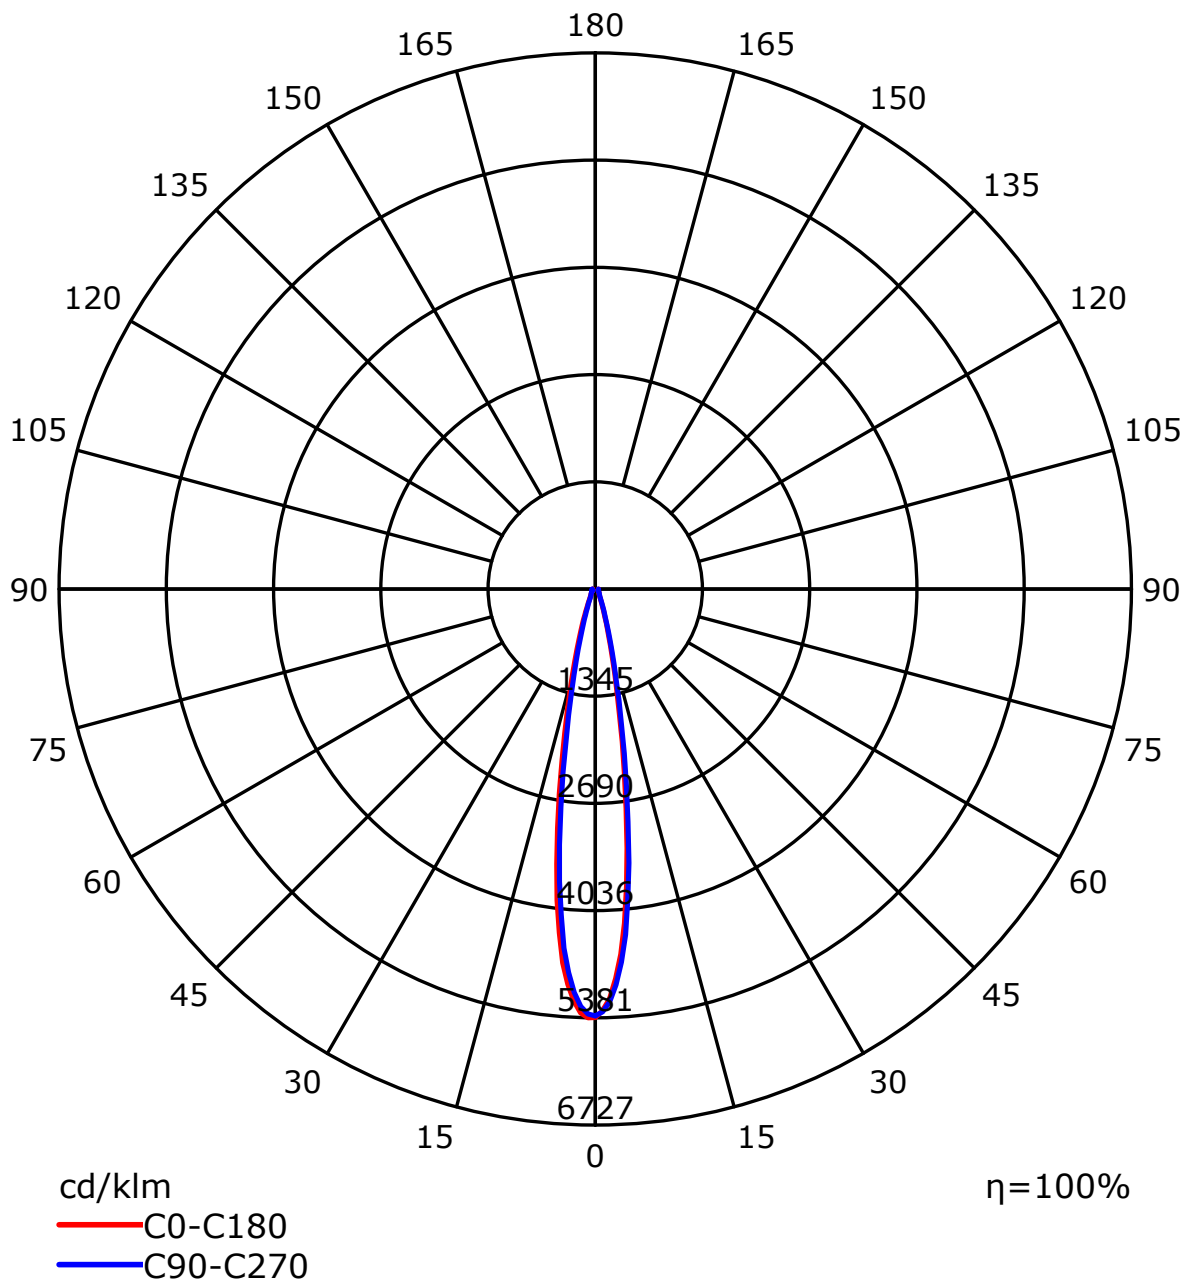


C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	91	89
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78
4	96	89	83	79	95	87	82	78	85	81	77	83	79	76	81	78	75	74
5	93	84	79	74	91	83	78	74	82	77	73	80	76	73	78	75	72	71
6	89	81	75	71	88	80	75	71	78	74	70	77	73	70	76	72	69	68
7	86	78	72	68	85	77	72	68	76	71	67	74	70	67	73	70	67	65
8	83	75	69	66	82	74	69	65	73	69	65	72	68	65	71	67	65	63
9	81	72	67	63	80	72	67	63	71	66	63	70	66	63	69	66	63	62
10	79	70	65	62	78	70	65	62	69	64	61	68	64	61	68	64	61	60


Spacing Criteria (0-180): 0.31
Spacing Criteria (90-270): 0.31
Spacing Criteria (Diagonal): 0.31

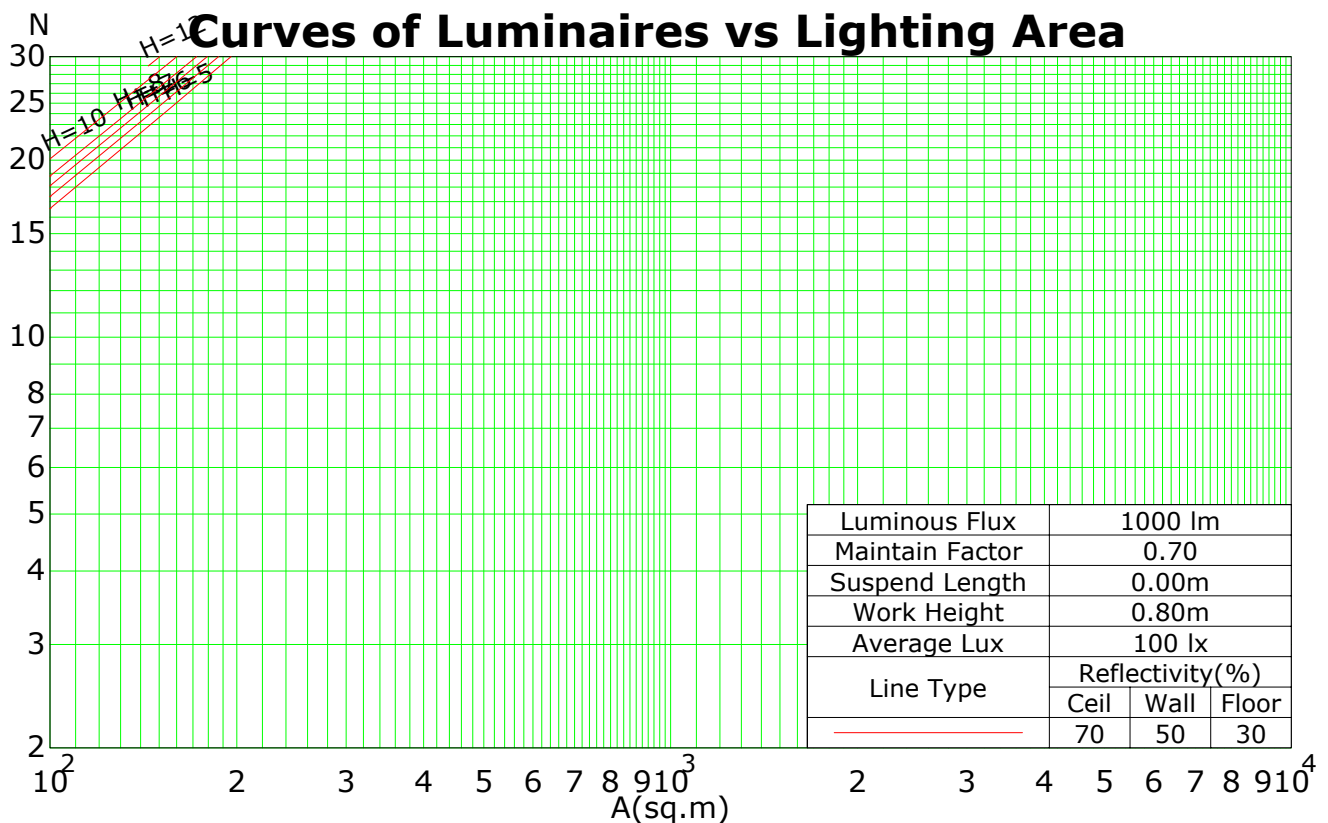

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:


Isocandela (rectangle)

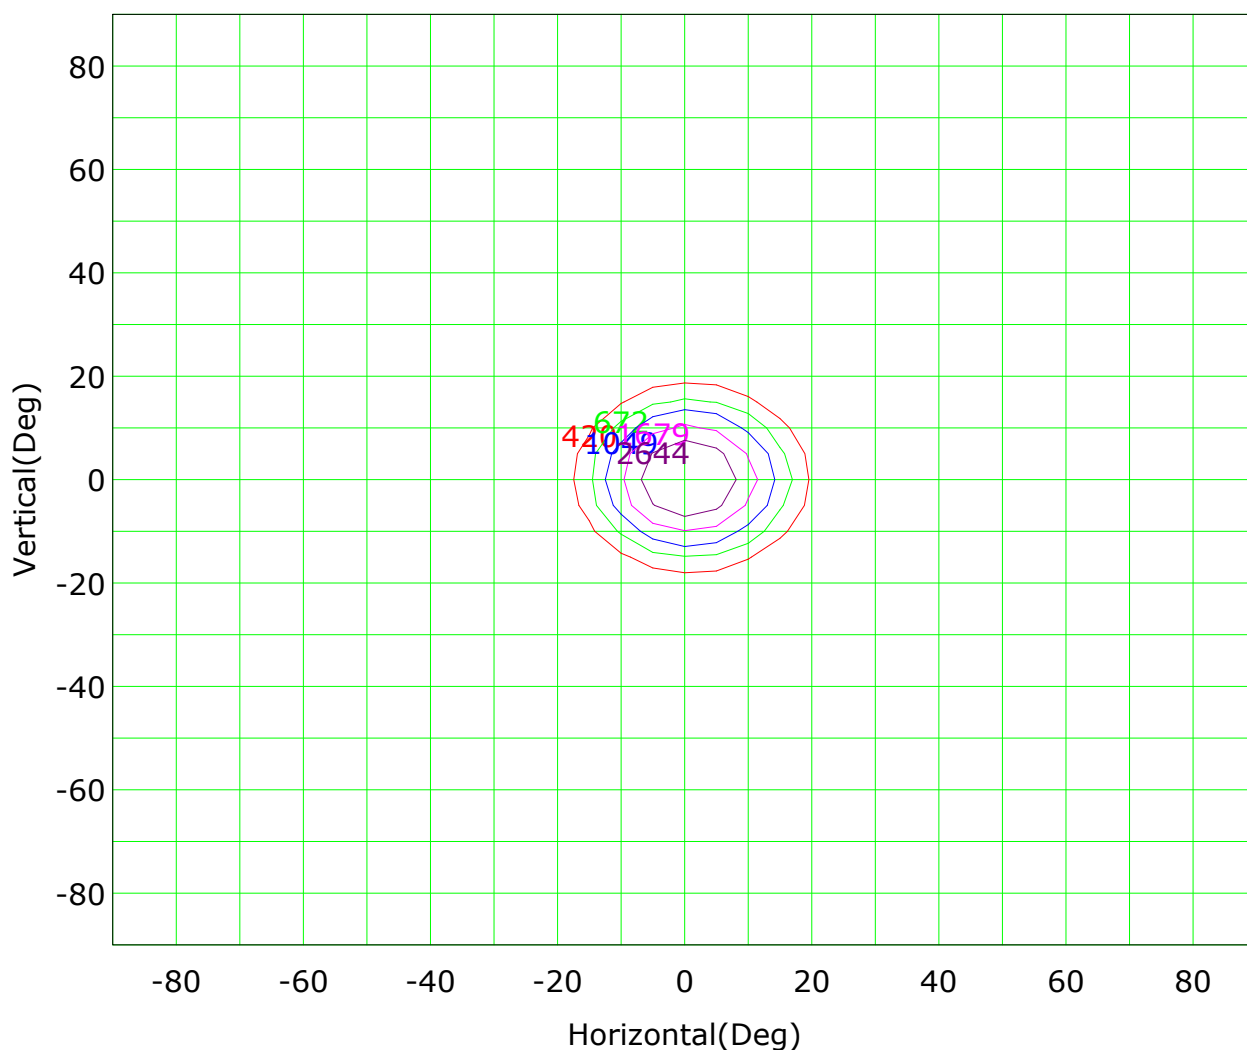

(10%): 420 cd
(25%): 1049 cd
(63%): 2644 cd

(16%): 672 cd
(40%): 1679 cd
(100%): 4197 cd

Isocandela (sphere)

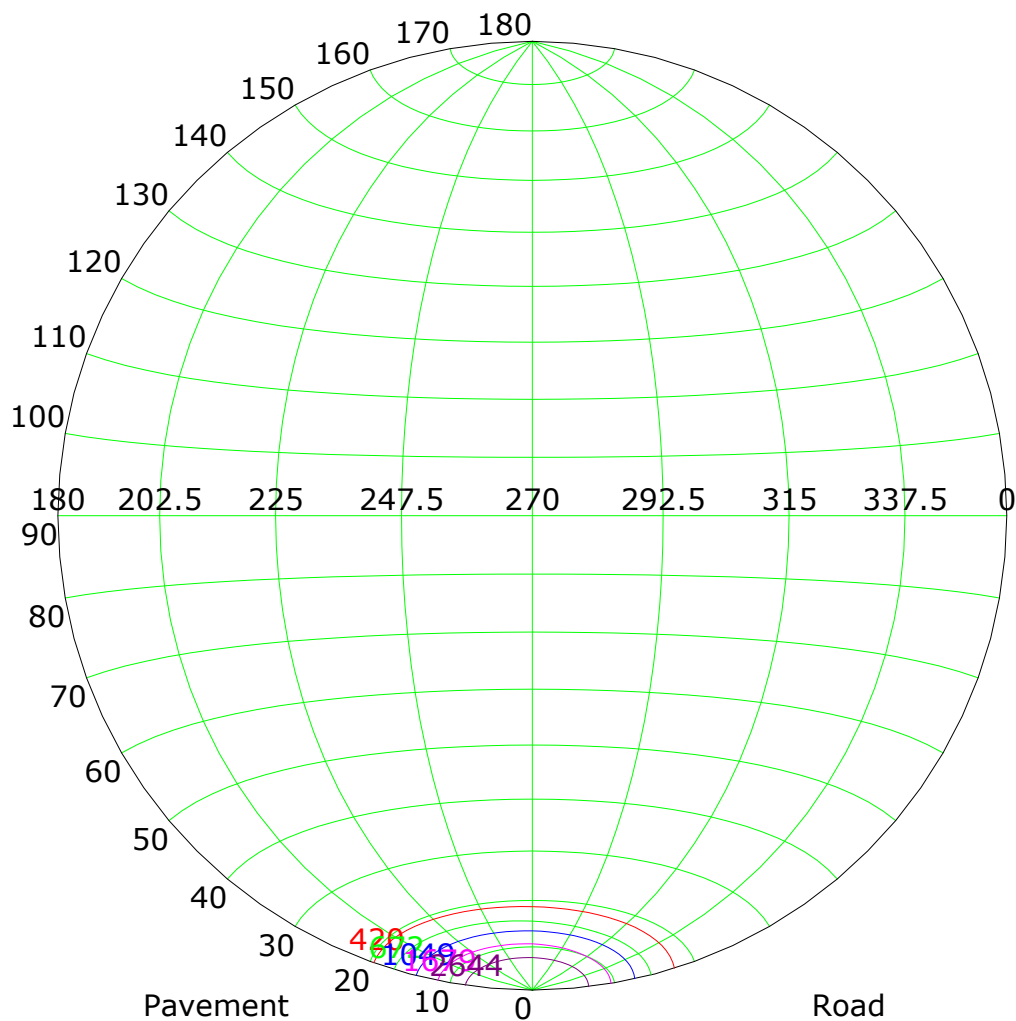

Imax (100%): 4197 cd


(10%): 420 cd
(25%): 1049 cd
(63%): 2644 cd

(16%): 672 cd
(40%): 1679 cd
(100%): 4197 cd

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

IsoLux Plot

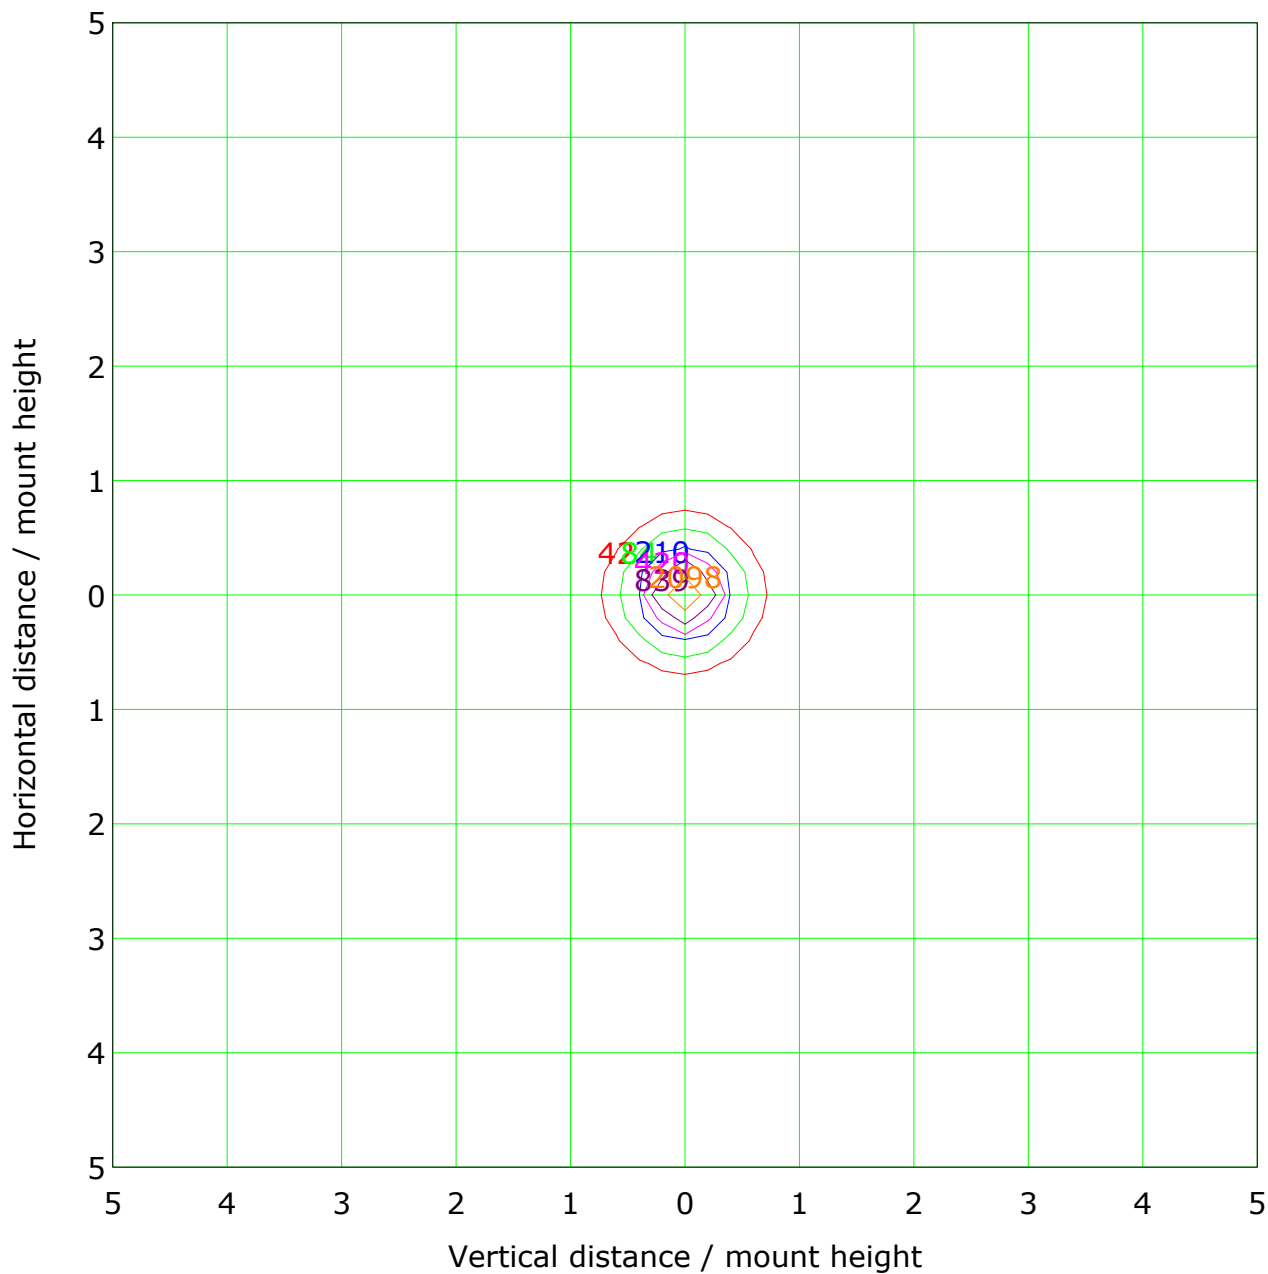

Mounting Height: 1.0m Max Lux(100%): 4195.1 lx


(1%): 42.0 lx	(2%): 83.9 lx
(5%): 209.8 lx	(10%): 419.5 lx
(20%): 839.0 lx	(50%): 2097.6 lx
(100%): 4195.1 lx	

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Roadway CU Curve

Efficiency(%)


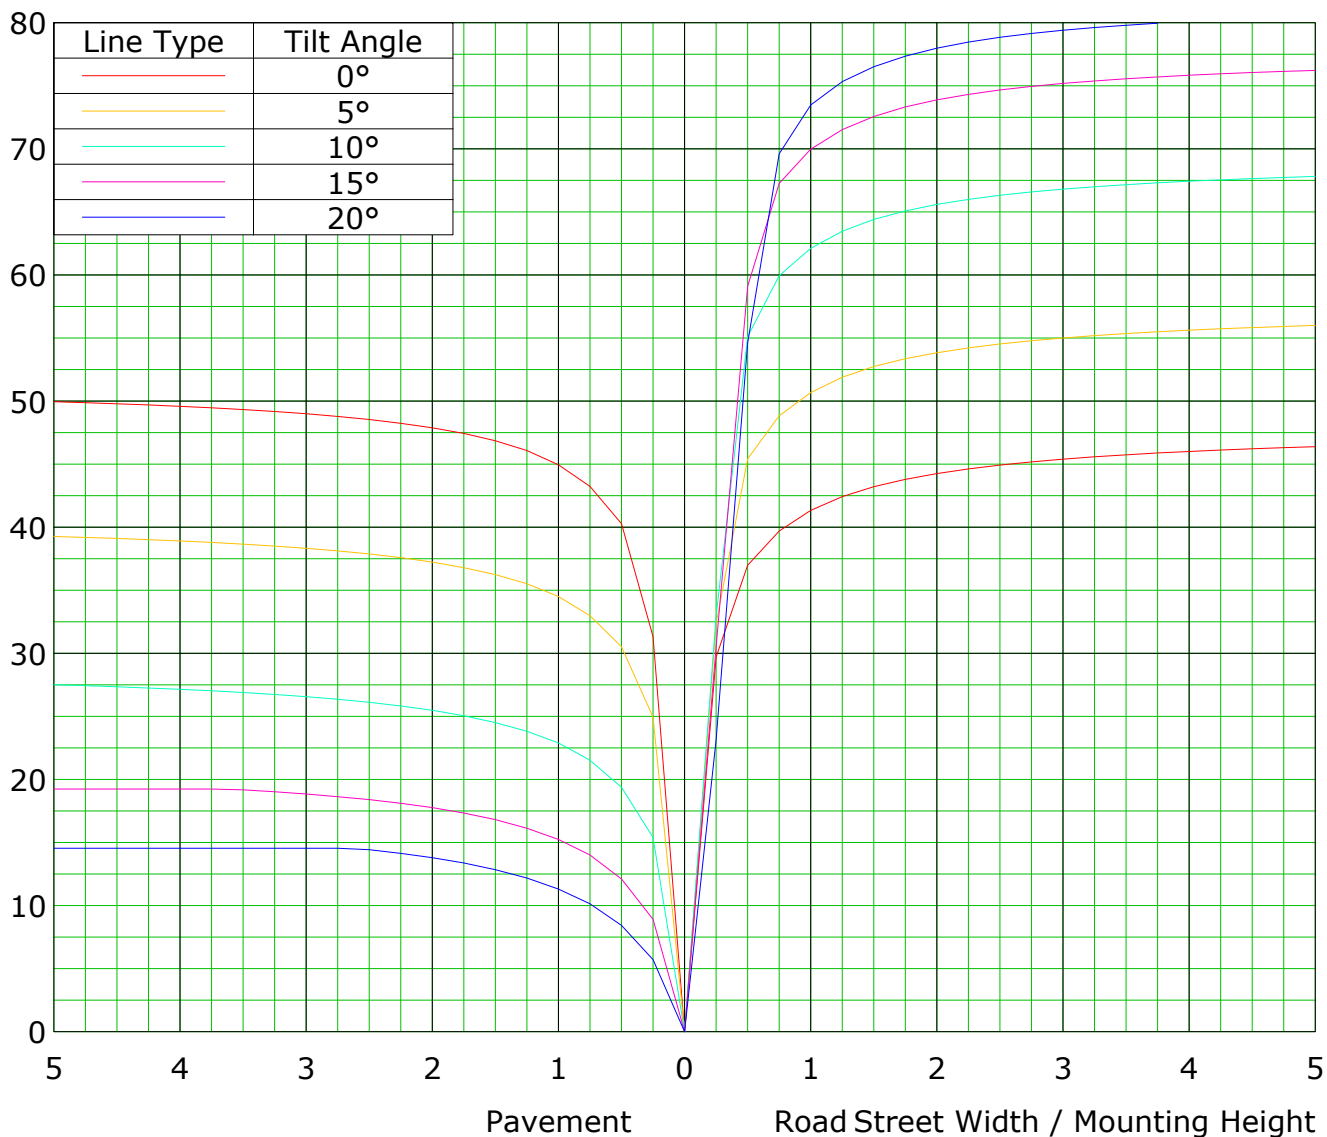


C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

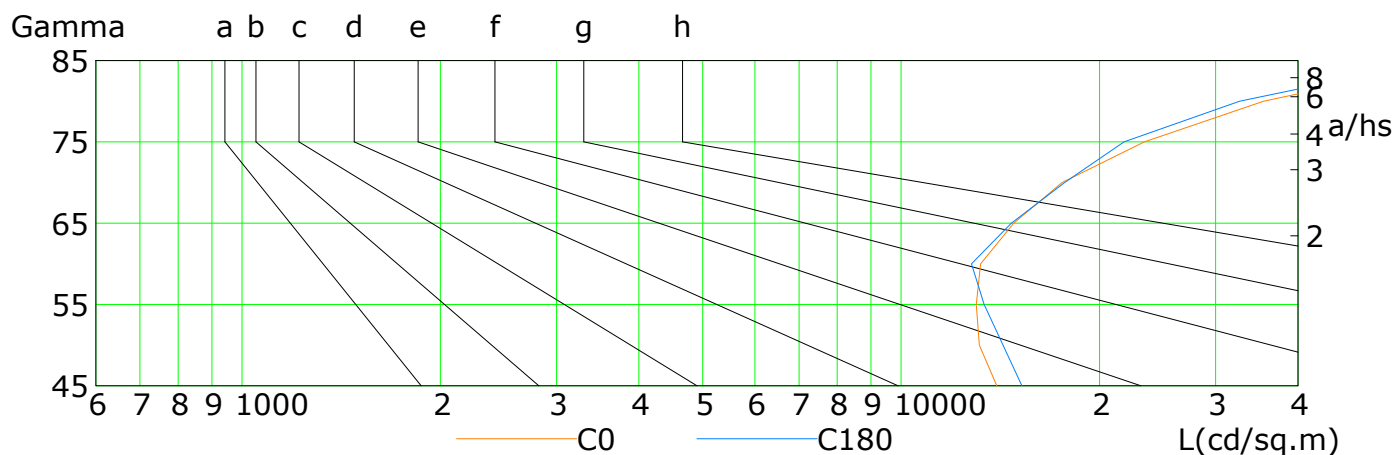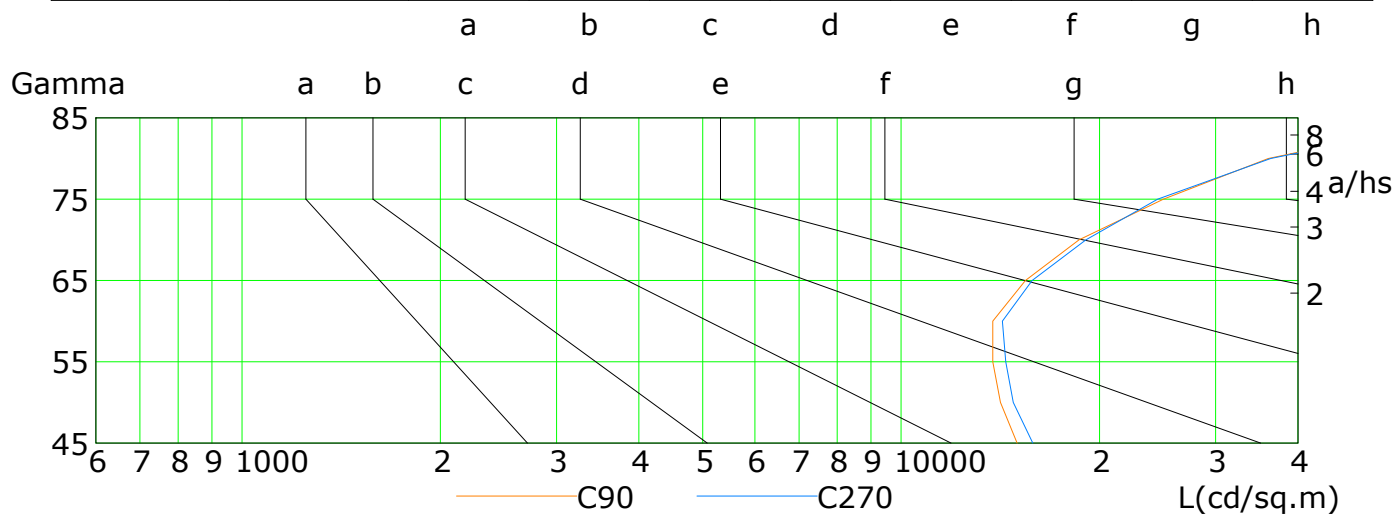

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	13965	13141	13004	13204	14819	17551	23392	35471	68578
C90	14995	14150	13775	13775	15434	18618	25002	36065	70080
C180	15253	14273	13367	12787	14697	17702	21790	32627	64413
C270	15839	14798	14408	14243	15804	19071	24504	36362	71560

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 8.443 m


Humidity:

Inspector:

Illuminance at a Distance

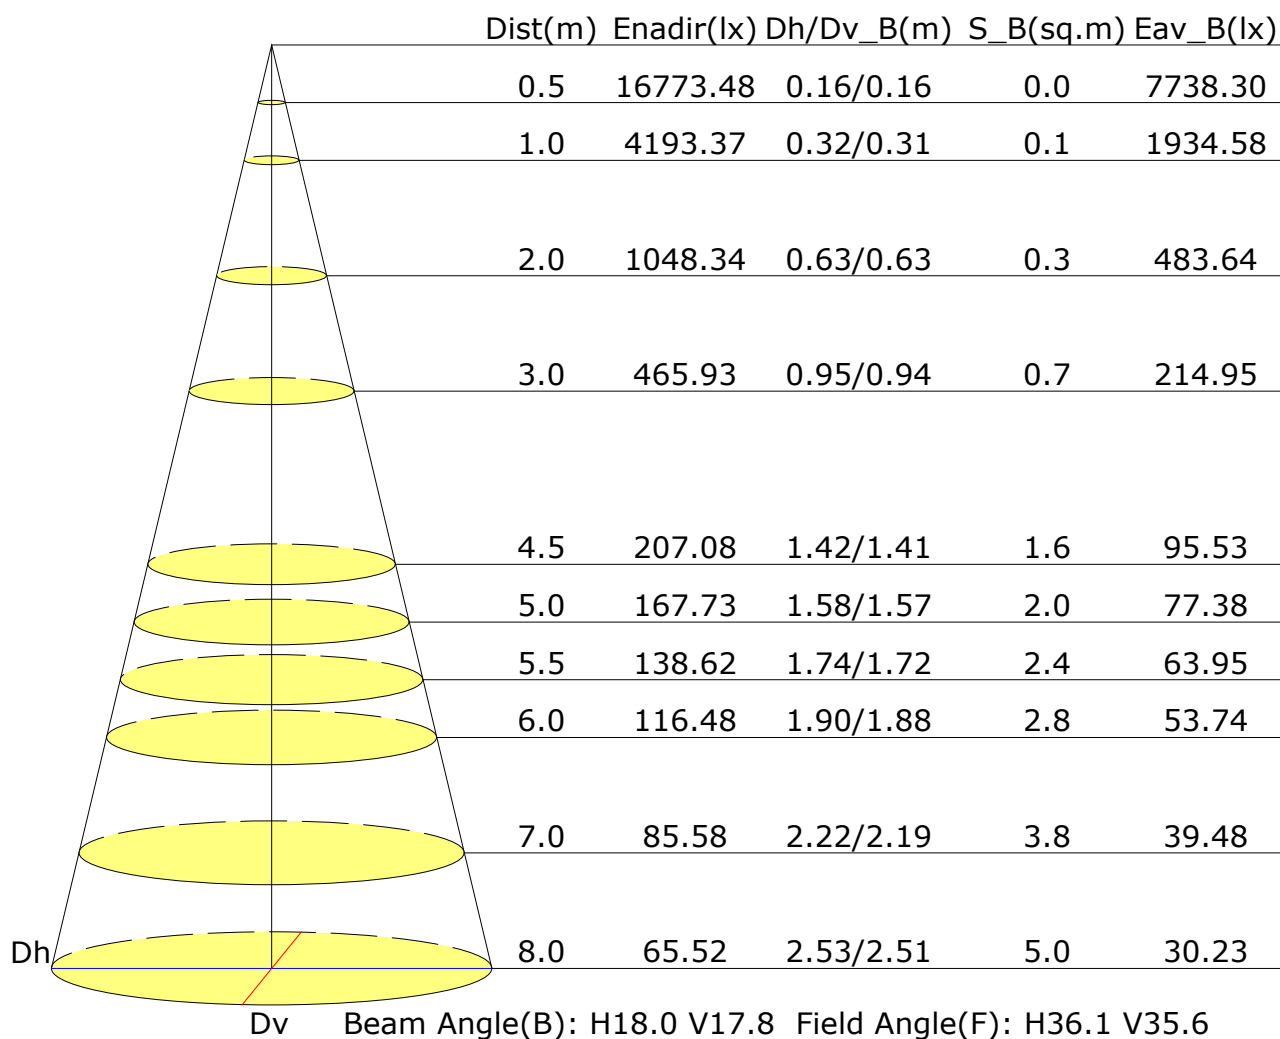

Vertical IsoLux Plot

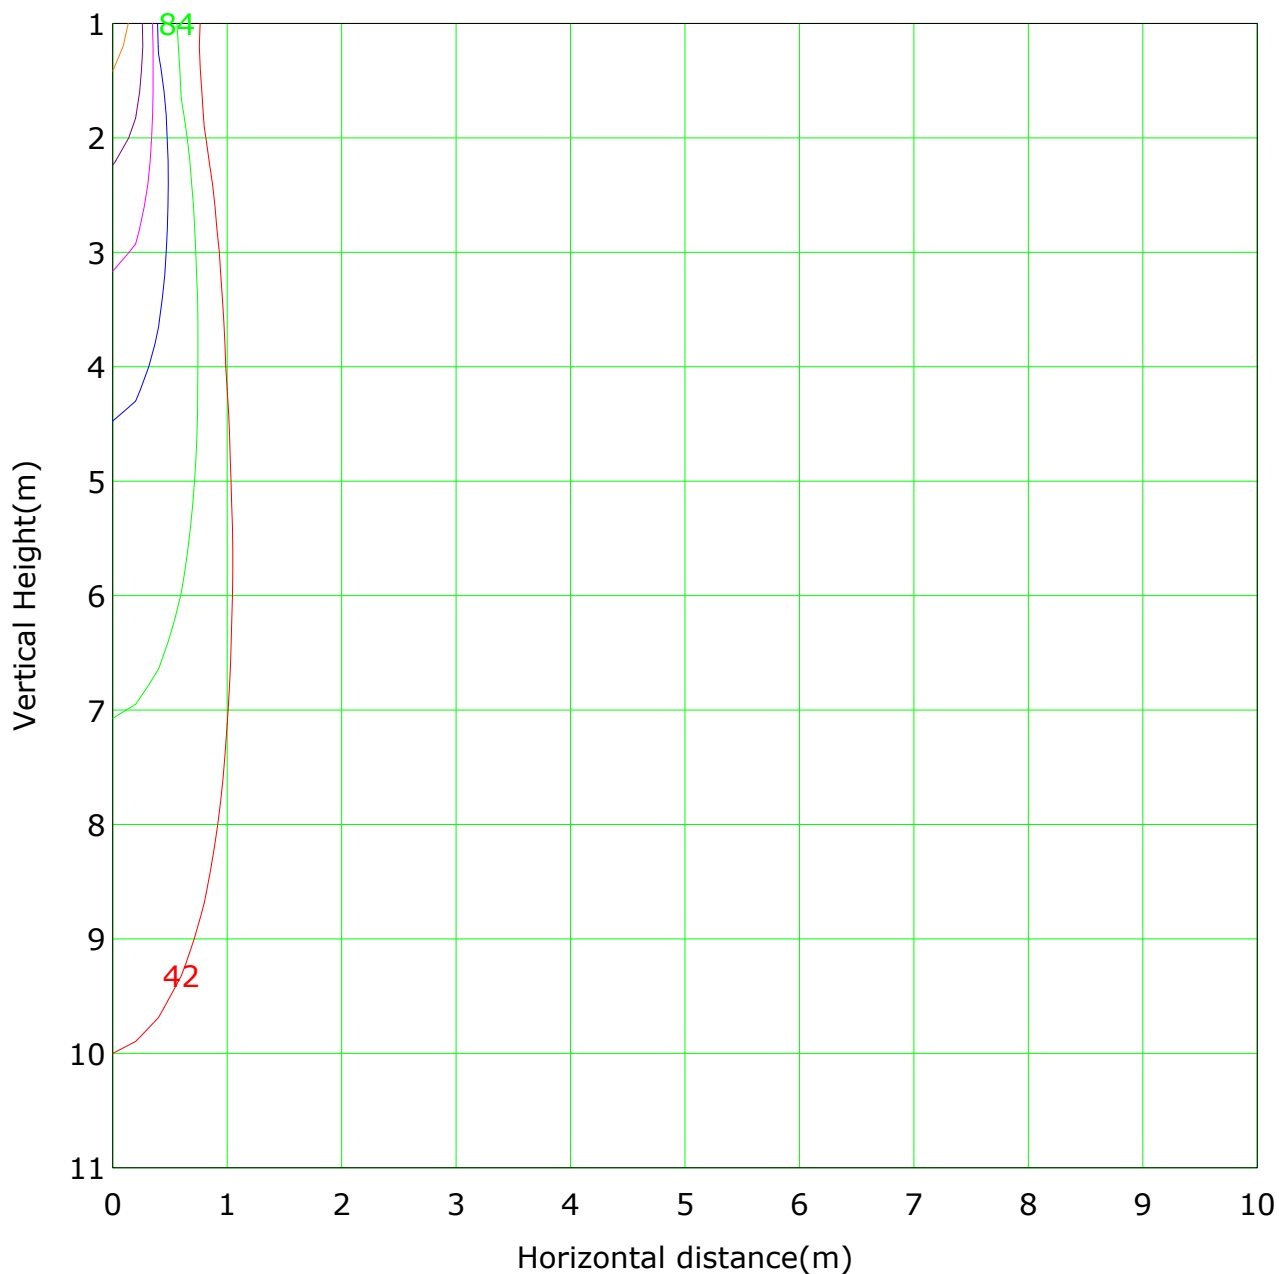


Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 4193.4 lx
— (1%): 41.9 lx — (2%): 83.9 lx
— (5%): 209.7 lx — (10%): 419.3 lx
— (20%): 838.7 lx — (50%): 2096.7 lx
— (100%): 4193.4 lx

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

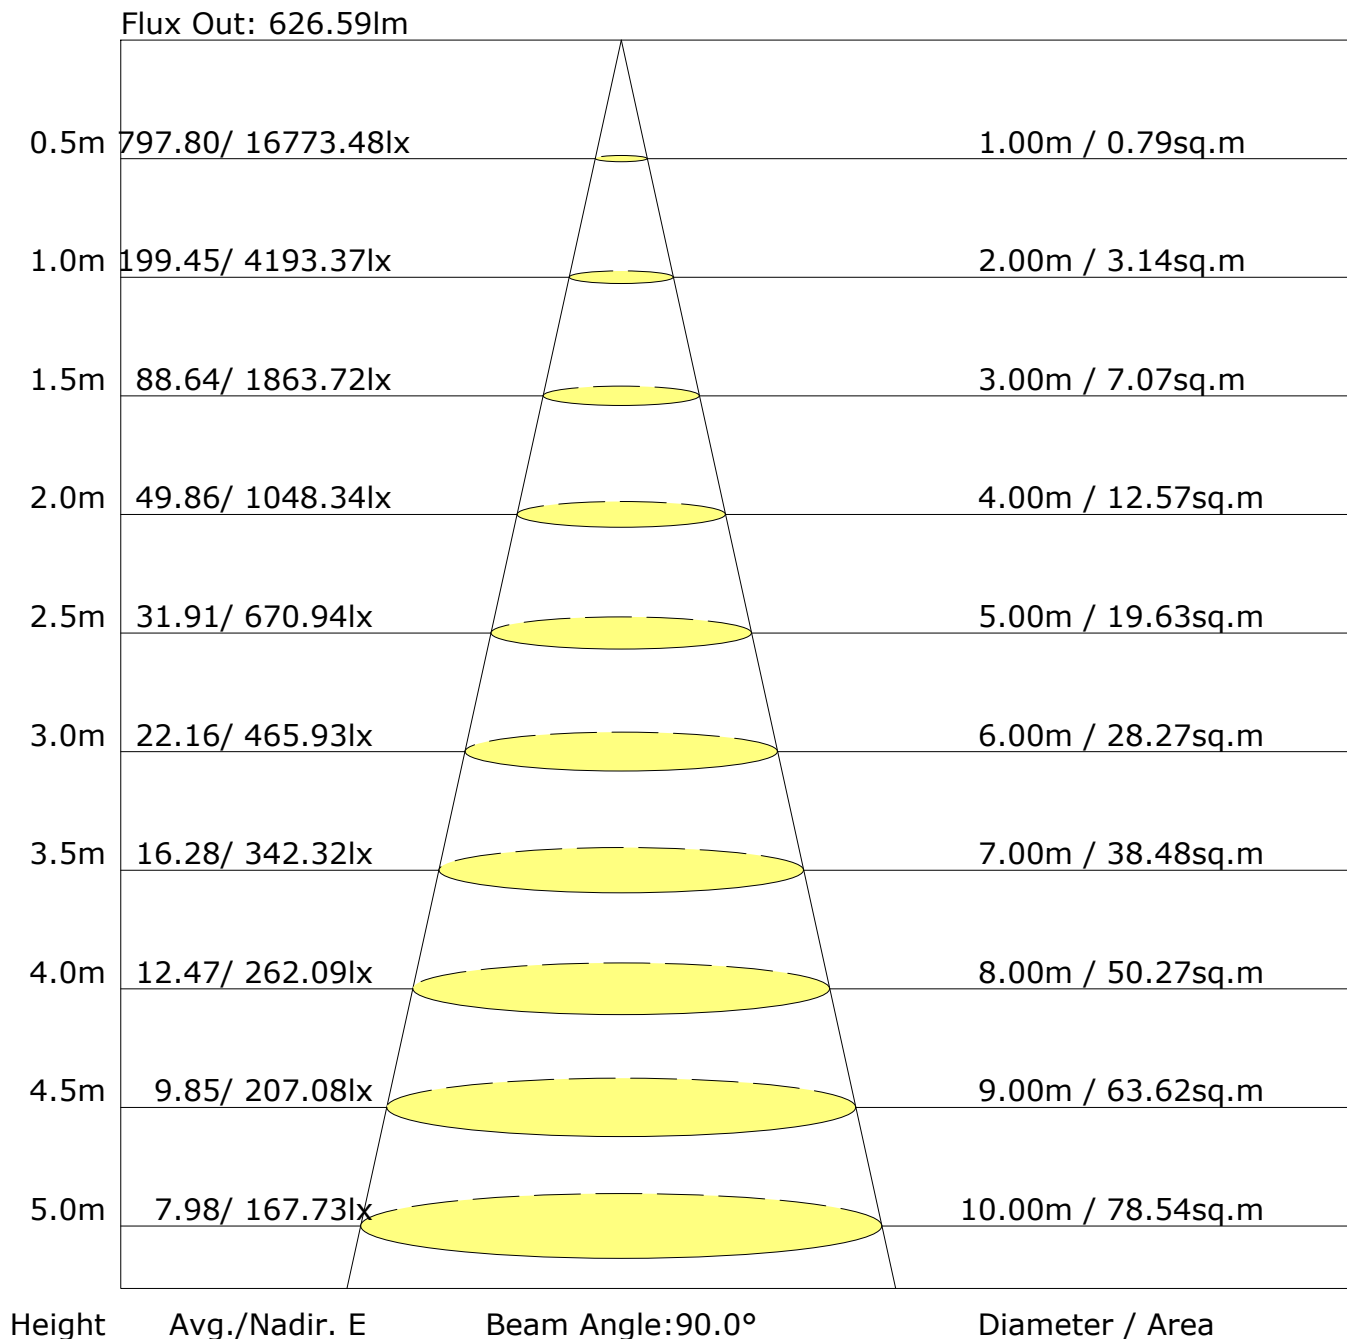

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	17.6	18.4	17.8	18.6	18.8	17.8	18.7	18.1	18.9	19.1
3H	20.1	20.9	20.4	21.2	21.4	20.4	21.2	20.7	21.4	21.7
4H	21.8	22.5	22.1	22.8	23.1	22.0	22.8	22.4	23.1	23.3
6H	23.7	24.5	24.1	24.7	25.0	24.0	24.7	24.3	25.0	25.3
8H	24.8	25.5	25.2	25.8	26.1	25.1	25.8	25.4	26.1	26.4
12H	26.1	26.8	26.5	27.1	27.4	26.3	27.0	26.7	27.3	27.7
X=4H Y=2H	18.5	19.3	18.8	19.5	19.8	18.7	19.5	19.0	19.7	20.0
3H	21.4	22.1	21.7	22.4	22.7	21.6	22.3	21.9	22.6	22.9
4H	23.2	23.8	23.6	24.2	24.5	23.4	24.0	23.8	24.4	24.7
6H	25.4	25.9	25.8	26.3	26.7	25.6	26.1	26.0	26.5	26.9
8H	26.6	27.1	27.0	27.5	27.9	26.8	27.3	27.2	27.7	28.1
12H	27.9	28.4	28.4	28.8	29.3	28.1	28.6	28.6	29.0	29.5
X=8H Y=4H	24.0	24.6	24.5	25.0	25.4	24.2	24.7	24.6	25.1	25.5
6H	26.5	26.9	26.9	27.3	27.8	26.6	27.1	27.1	27.5	27.9
8H	27.8	28.2	28.3	28.7	29.2	28.0	28.4	28.5	28.9	29.3
12H	29.4	29.8	29.9	30.3	30.8	29.6	30.0	30.1	30.4	30.9
X=12H Y=4H	24.3	24.8	24.7	25.2	25.6	24.4	24.9	24.9	25.3	25.7
6H	26.8	27.2	27.3	27.7	28.1	27.0	27.4	27.4	27.8	28.3
8H	28.3	28.7	28.8	29.1	29.6	28.5	28.8	29.0	29.3	29.8
Variations with the observer position at spacings:										
S=1.0H	+0.4/-0.4					+0.4/-0.4				
S=1.5H	+0.6/-0.8					+0.6/-0.8				
S=2.0H	+0.8/-1.2					+0.8/-1.1				

Calculate in accordance with CIE Pub.117. The table is revised with 780lm ($8\log(F/F_0) = -0.9$).

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM


	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	371	47.6
	FL (0°-30°)	260	33.4
	FM (30°-60°)	61	7.8
	FH (60°-80°)	33	4.2
	FVH (80°-90°)	17	2.2
	BACK LIGHT	409	52.4
	BL (0°-30°)	297	38.1
	BM (30°-60°)	64	8.2
	BH (60°-80°)	32	4.1
	BVH (80°-90°)	16	2.1
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U1 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U1 G1

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

LCS Graph

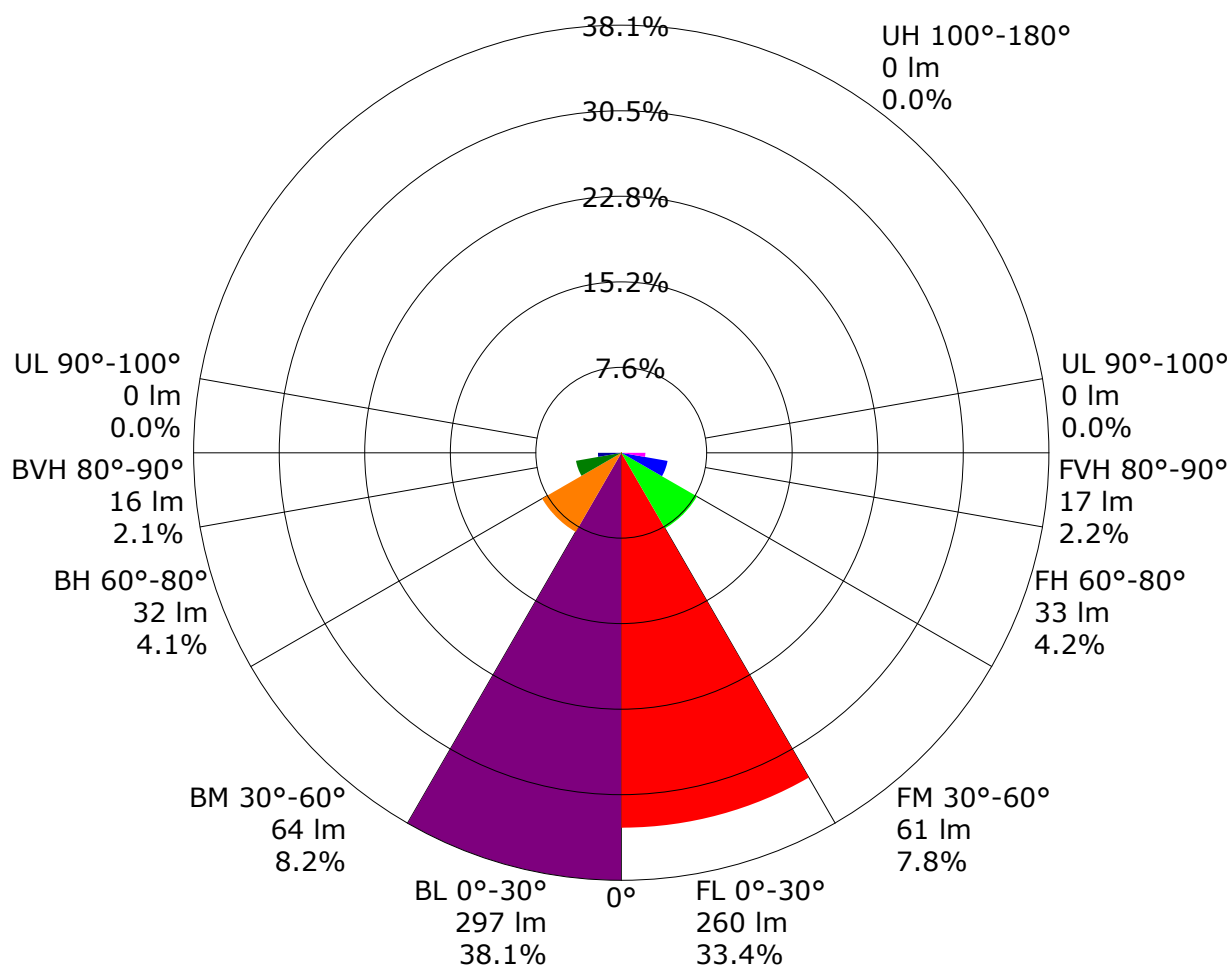

Back Light

Forward Light

Scale= MAX LCS%

Trapped Light:NA,NA

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 0.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.86	0.91	0.95	0.98	1.02	1.05	1.08	1.11	1.13	
	0.30		0.80	0.86	0.90	0.93	0.98	1.01	1.04	1.07	1.10	
	0.20		0.77	0.82	0.86	0.89	0.94	0.98	1.00	1.04	1.07	
0.50	0.50	0.20	0.84	0.89	0.93	0.96	0.99	1.02	1.04	1.06	1.08	
	0.30		0.80	0.85	0.88	0.91	0.96	0.99	1.01	1.04	1.06	
	0.20		0.76	0.81	0.85	0.88	0.92	0.96	0.98	1.01	1.04	
0.30	0.50	0.20	0.83	0.88	0.91	0.93	0.97	0.99	1.00	1.03	1.04	
	0.30		0.79	0.84	0.87	0.90	0.93	0.96	0.98	1.00	1.02	
	0.20		0.76	0.81	0.84	0.87	0.91	0.93	0.96	0.99	1.01	
0.00	0.00	0.00	0.74	0.78	0.82	0.84	0.87	0.90	0.92	0.94	0.96	
Rating:8W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 0.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.66	0.56	0.49	0.43	0.35	0.30	0.26	0.21	0.18	
	0.30		0.55	0.48	0.42	0.38	0.32	0.28	0.24	0.20	0.17	
	0.20		0.47	0.42	0.38	0.34	0.29	0.26	0.23	0.19	0.16	
0.50	0.50	0.20	0.63	0.53	0.46	0.41	0.33	0.32	0.25	0.20	0.17	
	0.30		0.53	0.46	0.41	0.37	0.31	0.26	0.23	0.19	0.16	
	0.20		0.46	0.41	0.36	0.33	0.28	0.24	0.22	0.18	0.15	
0.30	0.50	0.20	0.61	0.50	0.44	0.39	0.31	0.27	0.23	0.19	0.16	
	0.30		0.52	0.44	0.39	0.35	0.29	0.25	0.22	0.18	0.15	
	0.20		0.45	0.40	0.35	0.32	0.27	0.23	0.21	0.17	0.15	
0.00	0.00	0.00	0.32	0.27	0.24	0.22	0.18	0.16	0.14	0.12	0.10	
Rating:8W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 0.50									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.14	0.16	0.17	0.18	0.19	0.20	0.21	0.22	0.22	
	0.30		0.09	0.11	0.13	0.14	0.16	0.17	0.18	0.19	0.20	
	0.20		0.06	0.08	0.10	0.11	0.13	0.15	0.16	0.17	0.18	
0.50	0.50	0.20	0.13	0.15	0.16	0.17	0.19	0.20	0.20	0.21	0.21	
	0.30		0.09	0.11	0.13	0.14	0.15	0.17	0.18	0.19	0.20	
	0.20		0.06	0.08	0.09	0.11	0.13	0.14	0.15	0.17	0.18	
0.30	0.50	0.20	0.13	0.15	0.16	0.17	0.18	0.19	0.19	0.20	0.21	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19	
	0.20		0.06	0.08	0.09	0.11	0.12	0.14	0.15	0.16	0.17	
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Rating:8W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	4170.2	4.0	4.0	0.51	0.51
1.0-2.0	4114.0	11.8	15.8	1.51	2.03
2.0-3.0	3997.1	19.1	34.9	2.45	4.48
3.0-4.0	3820.9	25.6	60.5	3.28	7.76
4.0-5.0	3595.5	30.9	91.4	3.97	11.72
5.0-6.0	3304.6	34.7	126.2	4.45	16.18
6.0-7.0	2971.0	36.9	163.0	4.73	20.91
7.0-8.0	2615.4	37.4	200.5	4.80	25.71
8.0-9.0	2249.4	36.5	236.9	4.68	30.38
9.0-10.0	1911.5	34.6	271.5	4.44	34.82
10.0-11.0	1597.4	31.9	303.5	4.09	38.91
11.0-12.0	1325.3	29.0	332.4	3.72	42.63
12.0-13.0	1106.3	26.3	358.7	3.37	45.99
13.0-14.0	918.7	23.5	382.2	3.02	49.01
14.0-15.0	766.2	21.0	403.3	2.70	51.71
15.0-16.0	643.0	18.8	422.1	2.42	54.12
16.0-17.0	539.6	16.8	438.9	2.15	56.28
17.0-18.0	456.1	15.0	453.9	1.93	58.21
18.0-19.0	386.7	13.5	467.4	1.73	59.93
19.0-20.0	329.9	12.1	479.5	1.55	61.48
20.0-21.0	284.9	10.9	490.4	1.40	62.88
21.0-22.0	247.7	10.0	500.4	1.28	64.16
22.0-23.0	216.9	9.1	509.5	1.17	65.33
23.0-24.0	191.2	8.4	517.8	1.07	66.40
24.0-25.0	169.8	7.7	525.6	0.99	67.39
25.0-26.0	152.4	7.2	532.8	0.92	68.31
26.0-27.0	137.0	6.7	539.5	0.86	69.17
27.0-28.0	123.9	6.3	545.7	0.80	69.98
28.0-29.0	113.6	5.9	551.7	0.76	70.74
29.0-30.0	104.8	5.7	557.3	0.73	71.46
30.0-31.0	97.2	5.4	562.7	0.69	72.16
31.0-32.0	91.0	5.2	568.0	0.67	72.83
32.0-33.0	85.4	5.0	573.0	0.65	73.47
33.0-34.0	80.7	4.9	577.9	0.63	74.10
34.0-35.0	76.5	4.8	582.6	0.61	74.71
35.0-36.0	72.9	4.6	587.3	0.60	75.30

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	69.9	4.6	591.8	0.58	75.89
37.0-38.0	67.4	4.5	596.3	0.58	76.46
38.0-39.0	65.2	4.5	600.8	0.57	77.03
39.0-40.0	63.2	4.4	605.2	0.57	77.60
40.0-41.0	61.3	4.4	609.5	0.56	78.16
41.0-42.0	59.8	4.3	613.9	0.56	78.72
42.0-43.0	58.0	4.3	618.2	0.55	79.27
43.0-44.0	56.0	4.2	622.4	0.54	79.81
44.0-45.0	54.3	4.2	626.6	0.54	80.35
45.0-46.0	52.6	4.1	630.7	0.53	80.87
46.0-47.0	50.6	4.0	634.7	0.52	81.39
47.0-48.0	48.9	4.0	638.7	0.51	81.90
48.0-49.0	47.7	3.9	642.6	0.50	82.40
49.0-50.0	46.3	3.9	646.5	0.50	82.89
50.0-51.0	45.0	3.8	650.3	0.49	83.38
51.0-52.0	43.6	3.7	654.0	0.48	83.86
52.0-53.0	42.3	3.7	657.7	0.47	84.33
53.0-54.0	41.0	3.6	661.3	0.46	84.80
54.0-55.0	39.9	3.6	664.9	0.46	85.25
55.0-56.0	38.7	3.5	668.4	0.45	85.70
56.0-57.0	37.5	3.4	671.8	0.44	86.14
57.0-58.0	36.4	3.4	675.2	0.43	86.57
58.0-59.0	35.4	3.3	678.5	0.42	87.00
59.0-60.0	34.5	3.3	681.7	0.42	87.41
60.0-61.0	33.4	3.2	684.9	0.41	87.82
61.0-62.0	32.7	3.1	688.1	0.40	88.23
62.0-63.0	32.5	3.2	691.2	0.41	88.63
63.0-64.0	32.3	3.2	694.4	0.41	89.04
64.0-65.0	32.3	3.2	697.6	0.41	89.45
65.0-66.0	32.2	3.2	700.8	0.41	89.86
66.0-67.0	32.0	3.2	704.0	0.41	90.27
67.0-68.0	31.9	3.2	707.3	0.41	90.69
68.0-69.0	31.7	3.2	710.5	0.41	91.10
69.0-70.0	31.5	3.2	713.7	0.41	91.52
70.0-71.0	31.4	3.2	717.0	0.42	91.93
71.0-72.0	31.3	3.3	720.2	0.42	92.35

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G0.0	4193.4	4177.5	4193.4	4177.5	4193.4					
G1.0	4125.9	4137.4	4197.0	4159.7	4125.9					
G2.0	4013.1	4041.0	4150.7	4087.1	4013.1					
G3.0	3816.1	3878.9	4037.9	3952.1	3816.1					
G4.0	3583.3	3659.9	3876.2	3762.8	3583.3					
G5.0	3283.9	3397.1	3671.6	3528.9	3283.9					
G6.0	2924.6	3044.2	3381.5	3205.1	2924.6					
G7.0	2554.9	2702.3	3072.0	2884.0	2554.9					
G8.0	2165.1	2300.5	2717.3	2527.6	2165.1					
G9.0	1814.4	1944.7	2369.1	2156.8	1814.4					
G10.0	1516.7	1635.7	2031.0	1823.6	1516.7					
G11.0	1228.3	1333.5	1708.7	1501.8	1228.3					
G12.0	1012.5	1115.8	1440.7	1260.7	1012.5					
G13.0	843.7	911.9	1213.9	1051.2	843.7					
G14.0	687.9	760.1	1018.2	862.5	687.9					
G15.0	577.6	639.0	861.5	722.5	577.6					
G16.0	475.4	532.3	723.9	611.7	475.4					
G17.0	403.5	448.4	613.8	507.8	403.5					
G18.0	344.8	379.4	521.0	429.8	344.8					
G19.0	292.8	322.0	439.8	363.7	292.8					
G20.0	254.0	278.3	375.7	312.8	254.0					
G21.0	223.8	240.5	323.6	270.8	223.8					
G22.0	195.9	213.3	278.1	235.8	195.9					
G23.0	174.4	188.9	241.3	207.8	174.4					
G24.0	155.0	167.7	209.7	184.7	155.0					
G25.0	139.1	151.4	187.1	164.0	139.1					
G26.0	126.8	136.1	166.8	147.6	126.8					
G27.0	114.4	123.2	148.6	132.7	114.4					
G28.0	104.3	113.2	133.5	121.6	104.3					
G29.0	97.2	103.8	122.6	112.5	97.2					
G30.0	90.3	96.9	111.6	103.1	90.3					
G31.0	84.5	91.2	103.5	96.6	84.5					
G32.0	79.0	85.0	96.4	91.6	79.0					
G33.0	75.6	80.8	89.9	85.0	75.6					
G34.0	72.4	76.5	84.4	80.7	72.4					
G35.0	69.6	73.0	78.6	77.0	69.6					
G36.0	66.4	69.7	75.5	73.2	66.4					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G37.0	64.3	67.5	71.7	70.7	64.3					
G38.0	62.4	65.4	68.8	68.1	62.4					
G39.0	61.0	64.1	66.0	65.9	61.0					
G40.0	58.4	62.1	63.8	64.4	58.4					
G41.0	56.6	60.3	62.2	62.9	56.6					
G42.0	55.3	60.0	59.7	61.2	55.3					
G43.0	53.3	57.0	57.9	59.5	53.3					
G44.0	51.9	54.8	55.9	57.9	51.9					
G45.0	49.8	53.5	54.4	56.5	49.8					
G46.0	48.2	51.6	53.1	53.8	48.2					
G47.0	45.6	49.4	51.1	52.0	45.6					
G48.0	44.8	49.4	49.0	50.0	44.8					
G49.0	43.2	47.4	47.7	49.7	43.2					
G50.0	42.6	45.8	46.3	48.0	42.6					
G51.0	41.8	44.7	43.8	46.8	41.8					
G52.0	41.3	43.1	42.3	45.5	41.3					
G53.0	39.4	42.2	40.3	44.5	39.4					
G54.0	37.7	41.4	39.7	42.6	37.7					
G55.0	37.6	39.8	38.7	41.7	37.6					
G56.0	36.2	38.5	37.2	40.1	36.2					
G57.0	35.9	38.0	35.4	38.4	35.9					
G58.0	34.3	36.8	34.8	37.5	34.3					
G59.0	33.9	35.4	33.7	36.8	33.9					
G60.0	33.3	34.7	32.2	35.9	33.3					
G61.0	32.5	33.3	30.4	34.8	32.5					
G62.0	32.9	33.5	29.7	34.2	32.9					
G63.0	32.1	33.4	30.5	33.9	32.1					
G64.0	31.2	32.9	30.8	33.9	31.2					
G65.0	31.6	32.9	31.3	33.7	31.6					
G66.0	31.7	33.1	30.7	32.5	31.7					
G67.0	31.8	32.2	30.9	32.9	31.8					
G68.0	31.4	32.6	30.5	32.6	31.4					
G69.0	31.0	32.1	30.5	32.5	31.0					
G70.0	30.3	32.1	30.5	32.9	30.3					
G71.0	30.8	32.2	29.9	32.8	30.8					
G72.0	31.0	31.6	29.5	32.6	31.0					
G73.0	30.5	31.2	29.0	32.2	30.5					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Unit: cd

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector: