

Report No.:

Test Time: 2026-04-14 17:07

Luminaire Property


Luminaire Manufacturer: NORDDECOR
Luminaire Description: 80097
Luminous Width (mm): 75
Current: 0.116 A
Power Factor: 0.460

Luminous Length (mm): 75
Voltage: 220.3 V
Power: 11.81 W


Photometric Results

CIE Class: Direct	Total Rated Lamp Lumens: 1344.4 lm
Measurement Flux: 1344.4 lm	Efficiency: 100%
Downward Ratio: 100%	Upward Ratio: 0%
Horizontal Diffuse Angle(10%,50%,80%,100%): H52.5,H34.4,H22.3,H0	
Vertical Diffuse Angle(10%,50%,80%,100%): V52.2,V33.7,V21,V1	
Luminaire Efficacy Rating (LER): 113.89	Central Intensity: 3588.51 cd
Max. Intensity: 3588.52 cd	Pos of Max. Intensity: H0 V0
S/MH(C0/C180): 0.57	S/MH(C90/C270): 0.56

Picture Of Luminaire



Luminous Intensity Distribution Curve

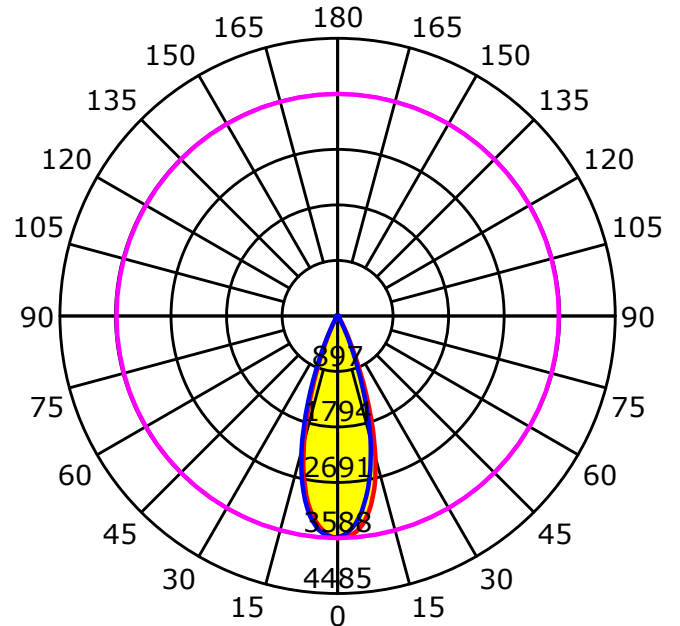

Unit: cd

Average Diffuse Angle(50%): 34.1°

— C0-C180 — C90-C270 — G0

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0



Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

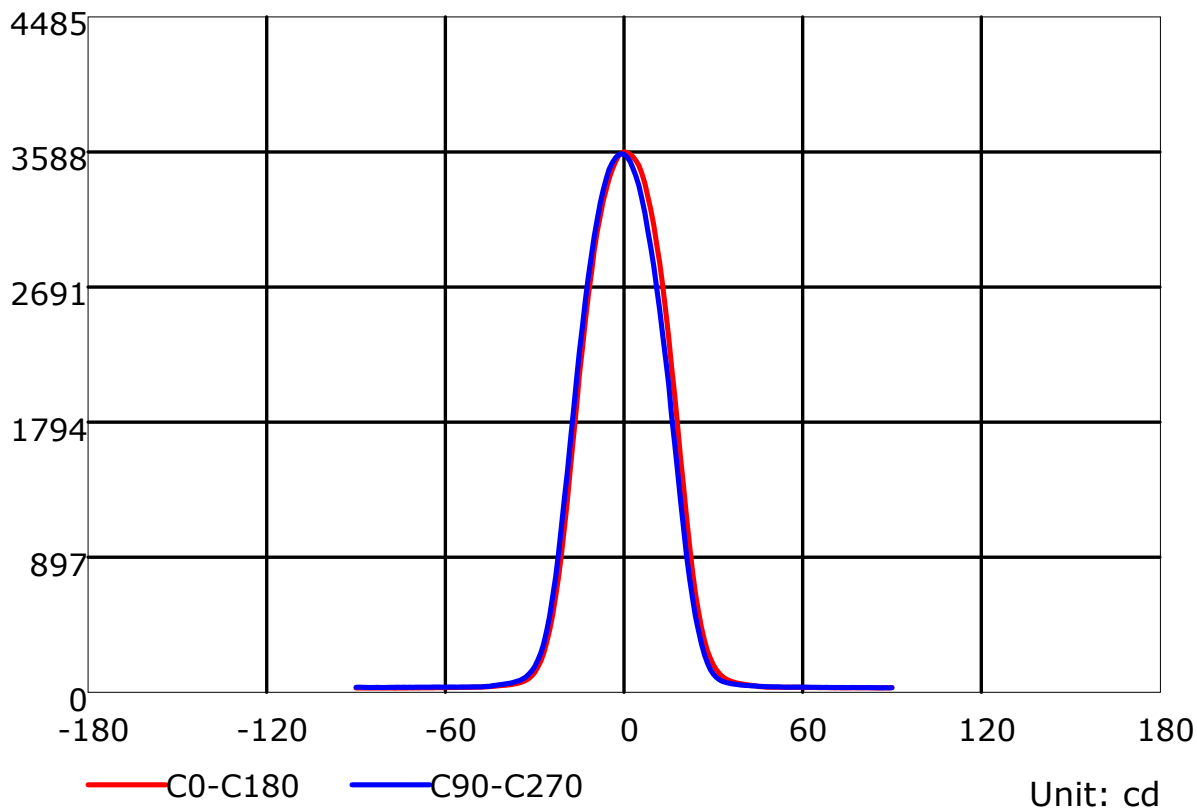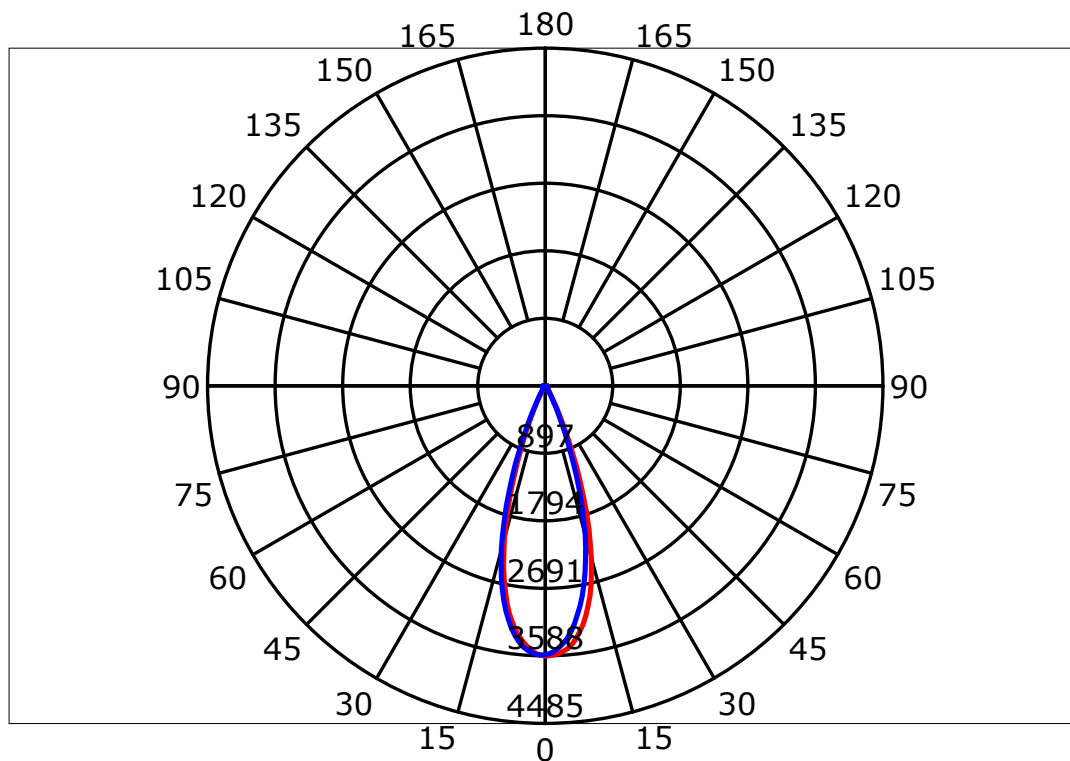

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

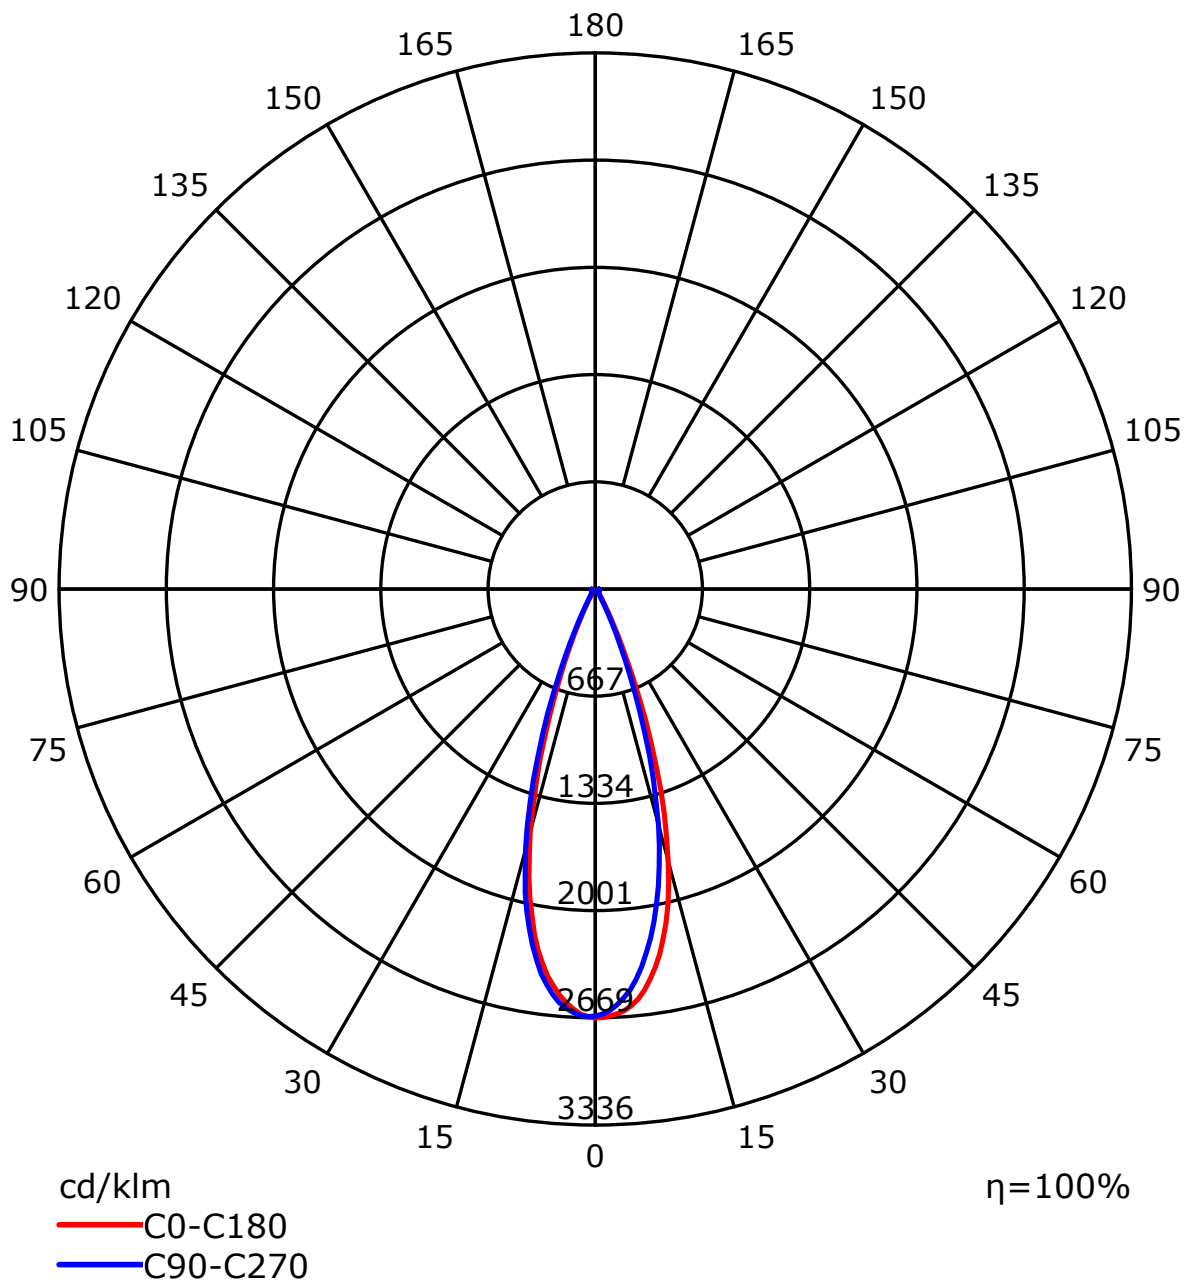


C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	104	110	108	105	103	103	101	100	100	98	97	96	95	94	92
2	108	103	99	95	105	101	97	94	98	95	92	95	92	90	92	90	88	86
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	86	83	82
4	99	92	87	83	97	91	86	82	89	85	81	87	83	80	85	82	79	78
5	95	88	82	78	94	87	82	78	85	81	77	83	80	77	82	79	76	75
6	92	84	78	75	90	83	78	74	82	77	74	80	76	73	79	76	73	72
7	88	80	75	71	87	80	75	71	79	74	71	77	73	71	76	73	70	69
8	85	77	72	69	84	77	72	68	76	71	68	75	71	68	74	70	68	66
9	83	74	69	66	82	74	69	66	73	69	66	72	68	65	72	68	65	64
10	80	72	67	64	79	71	67	64	71	66	63	70	66	63	69	66	63	62


Spacing Criteria (0-180): 0.57
Spacing Criteria (90-270): 0.56
Spacing Criteria (Diagonal): 0.53

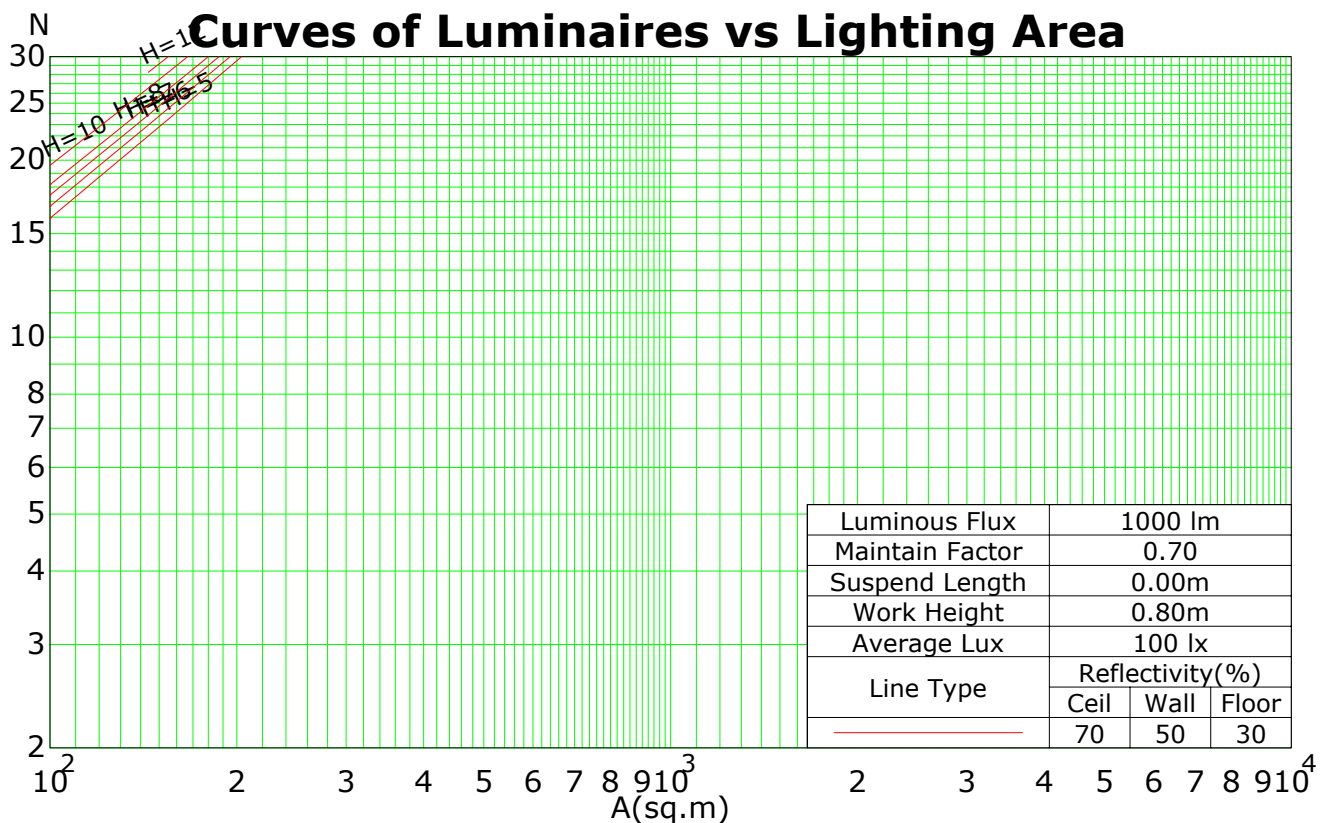

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Isocandela (rectangle)

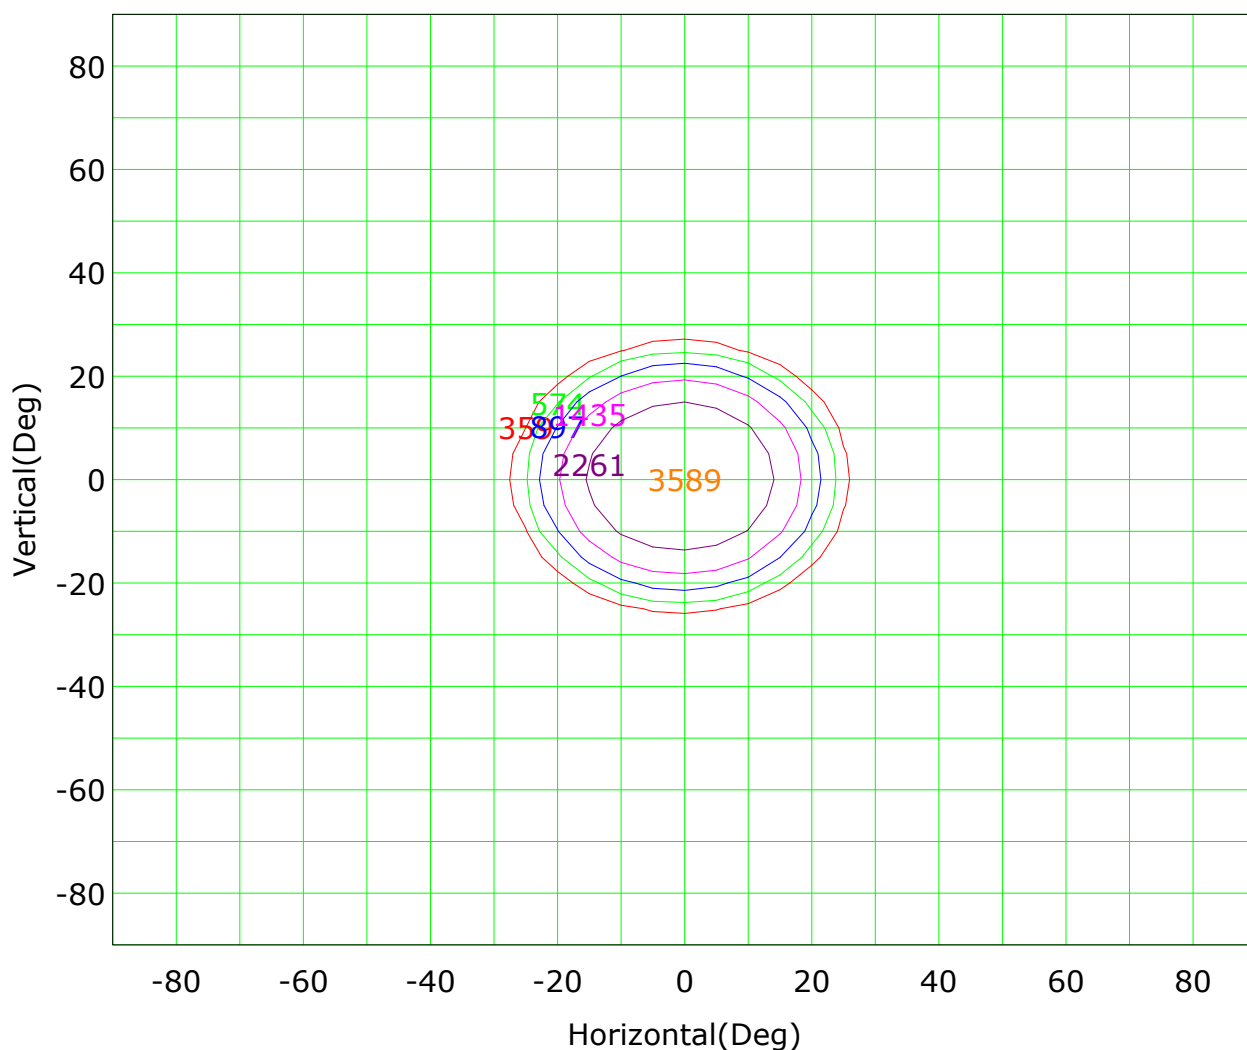


Imax (100%): 3589 cd

(10%): 359 cd
(25%): 897 cd
(63%): 2261 cd

(16%): 574 cd
(40%): 1435 cd
(100%): 3589 cd

Isocandela (sphere)

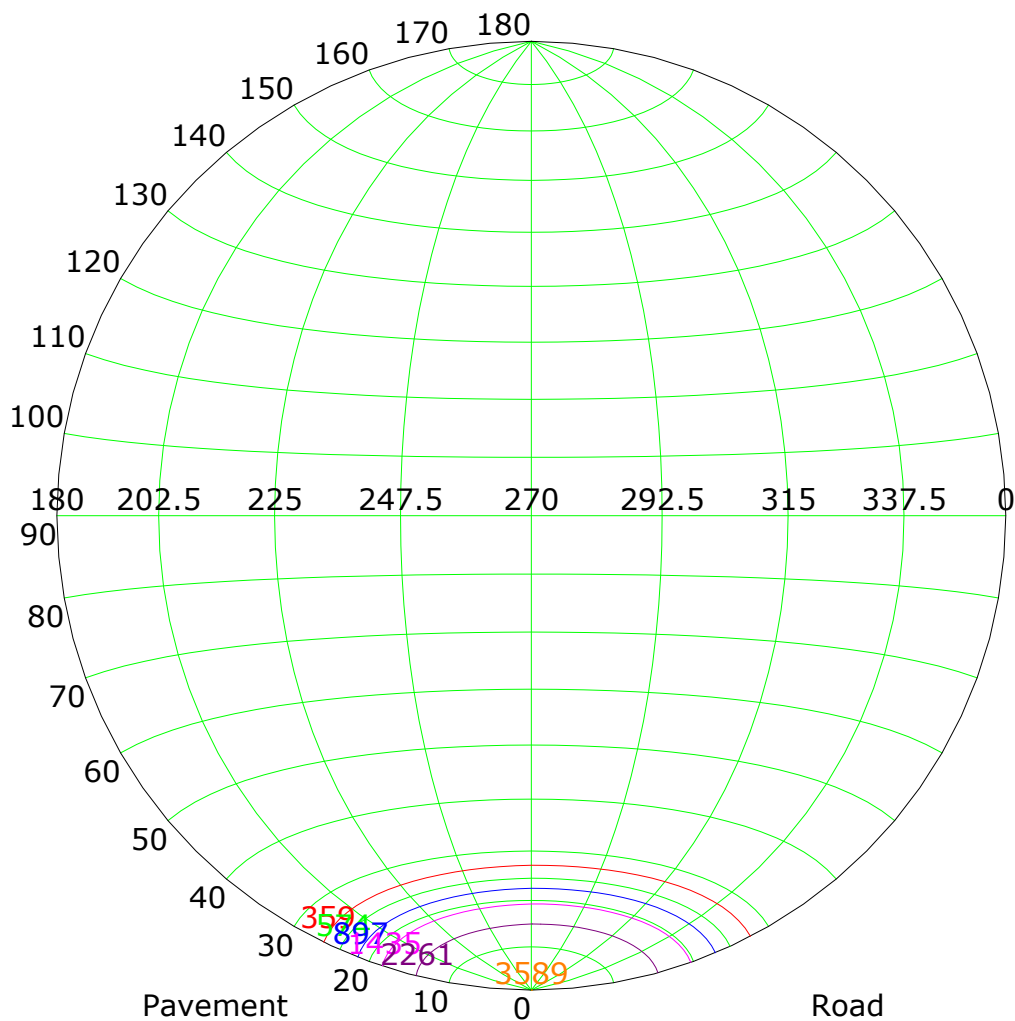

Imax (100%): 3589 cd


— (10%): 359 cd
— (25%): 897 cd
— (63%): 2261 cd

— (16%): 574 cd
— (40%): 1435 cd
— (100%): 3589 cd

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

IsoLux Plot

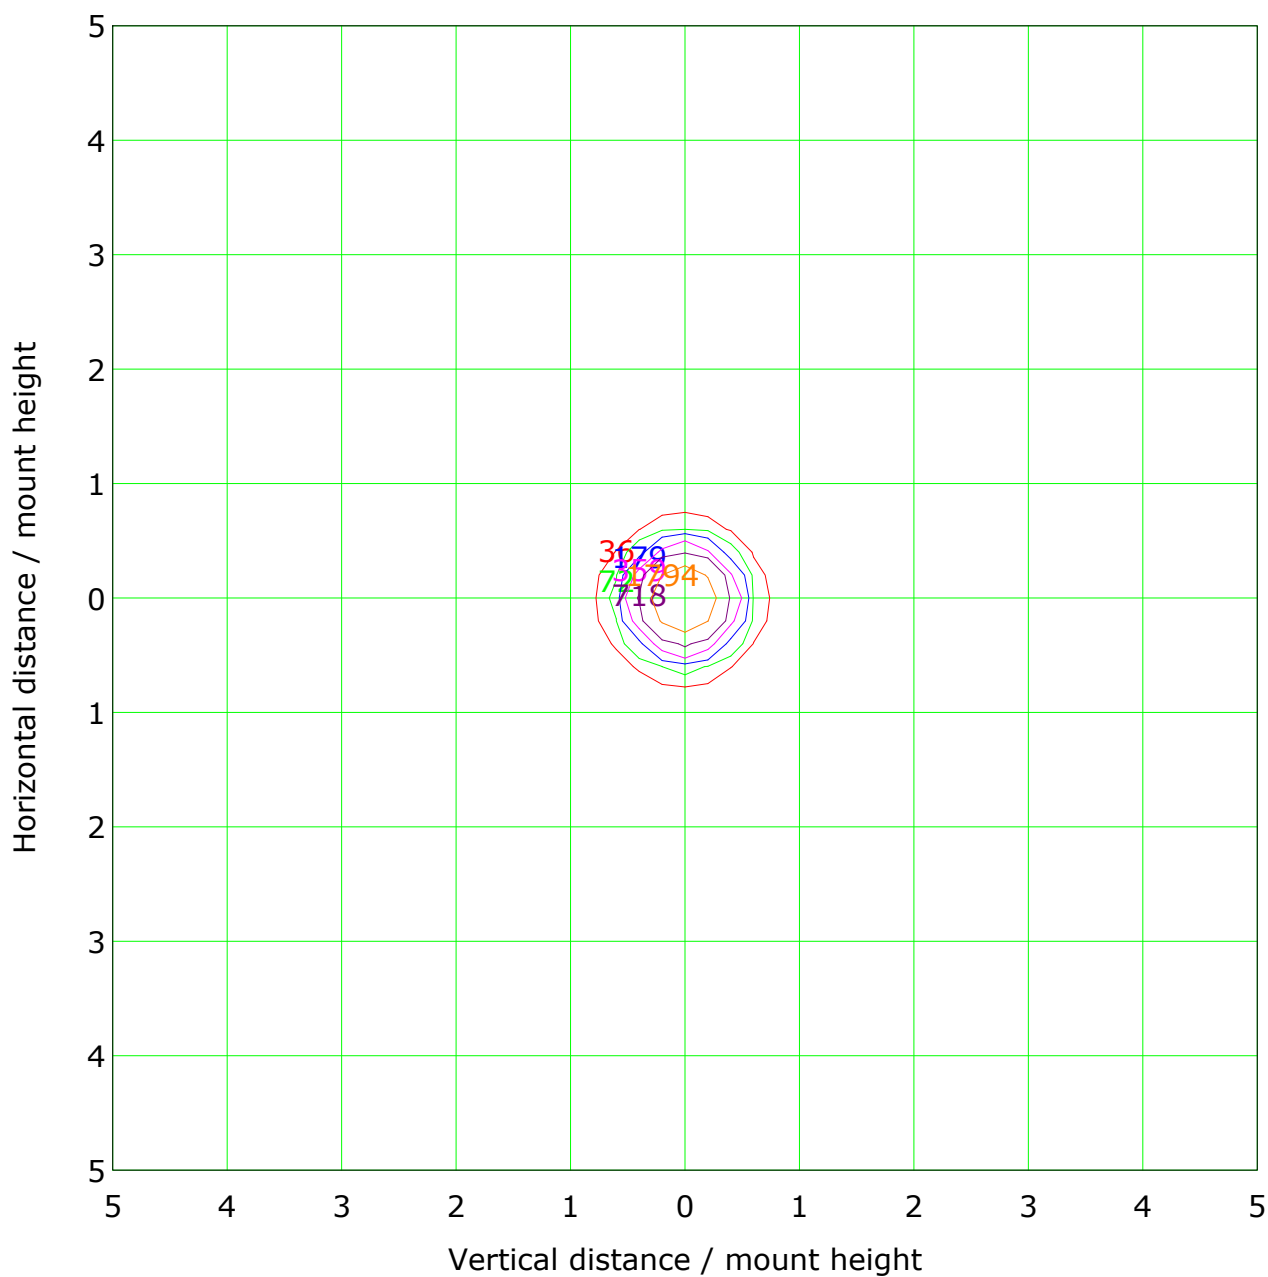

Mounting Height: 1.0m Max Lux(100%): 3588.5 lx

(1%): 35.9 lx	(2%): 71.8 lx
(5%): 179.4 lx	(10%): 358.9 lx
(20%): 717.7 lx	(50%): 1794.3 lx
(100%): 3588.5 lx	

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L


Distance: 8.443 m

Humidity:

Inspector:

Roadway CU Curve

Efficiency(%)

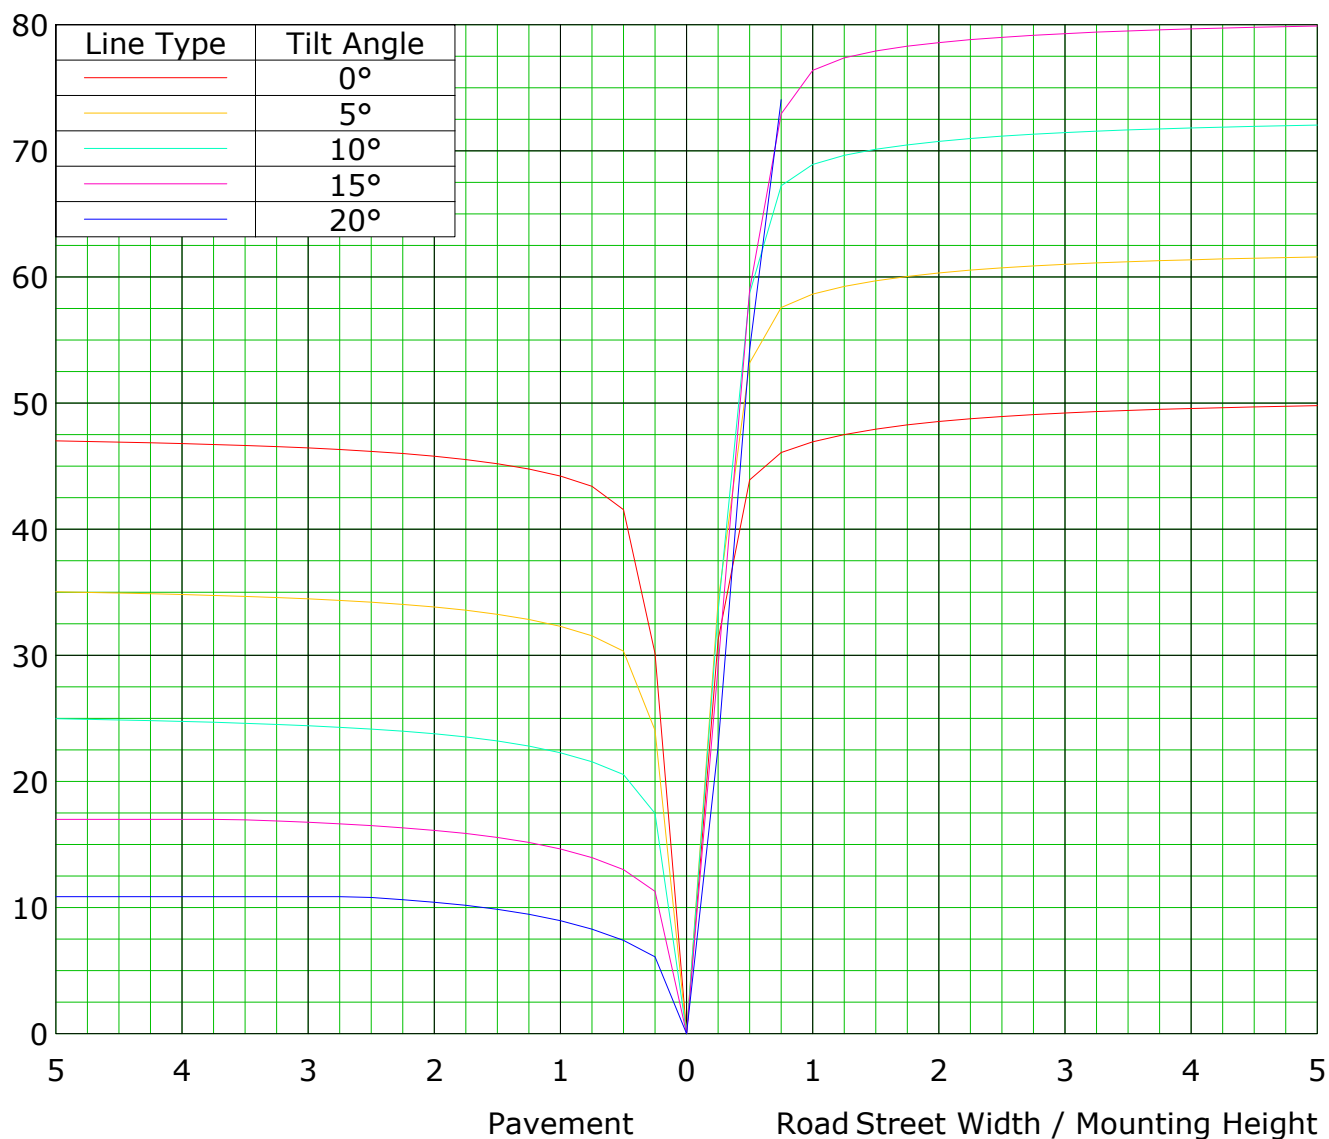

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L



Distance: 8.443 m

Humidity:

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

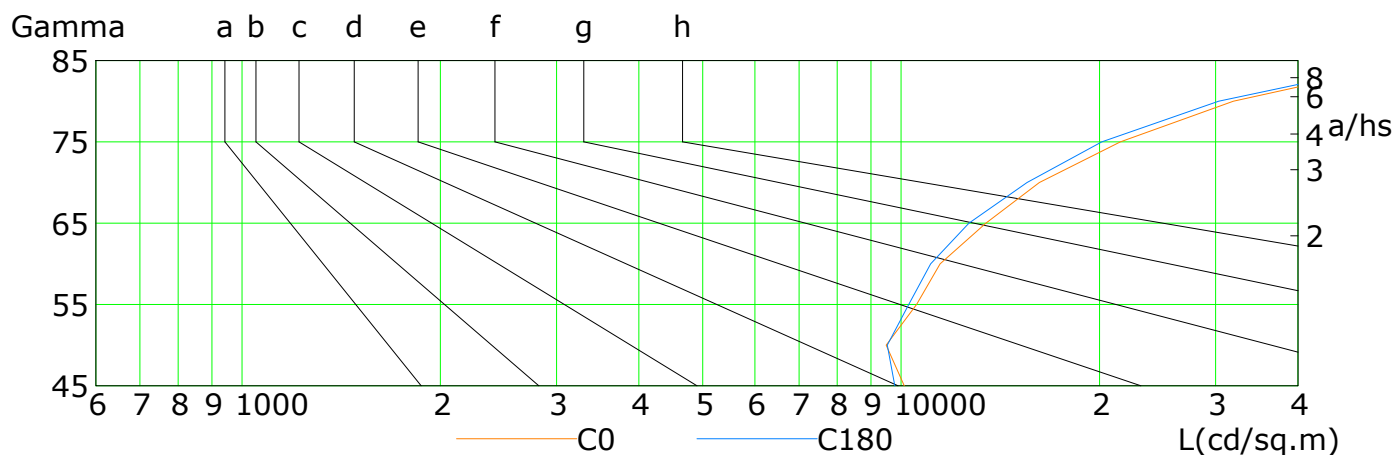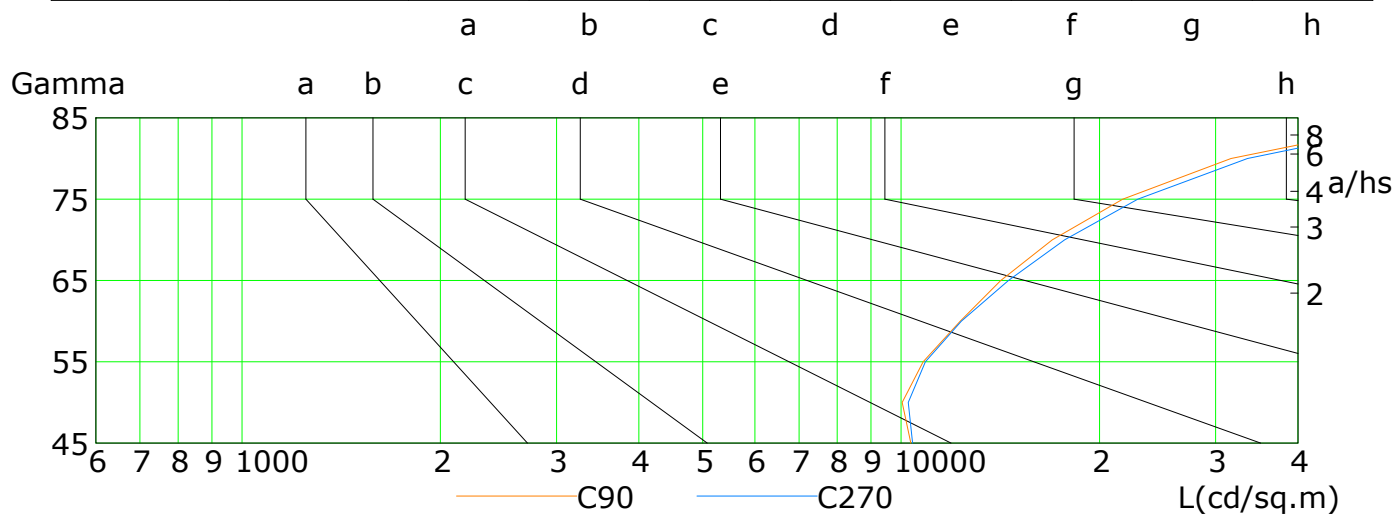

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	10112	9492	10557	11460	13448	16207	21506	31922	60663
C90	10343	10037	10802	12299	14164	16955	21685	31655	63335
C180	9783	9528	10272	11086	12674	15526	20160	30314	59051
C270	10409	10253	10882	12345	14551	17704	22859	33529	66272

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 8.443 m


Humidity:

Inspector:

Illuminance at a Distance

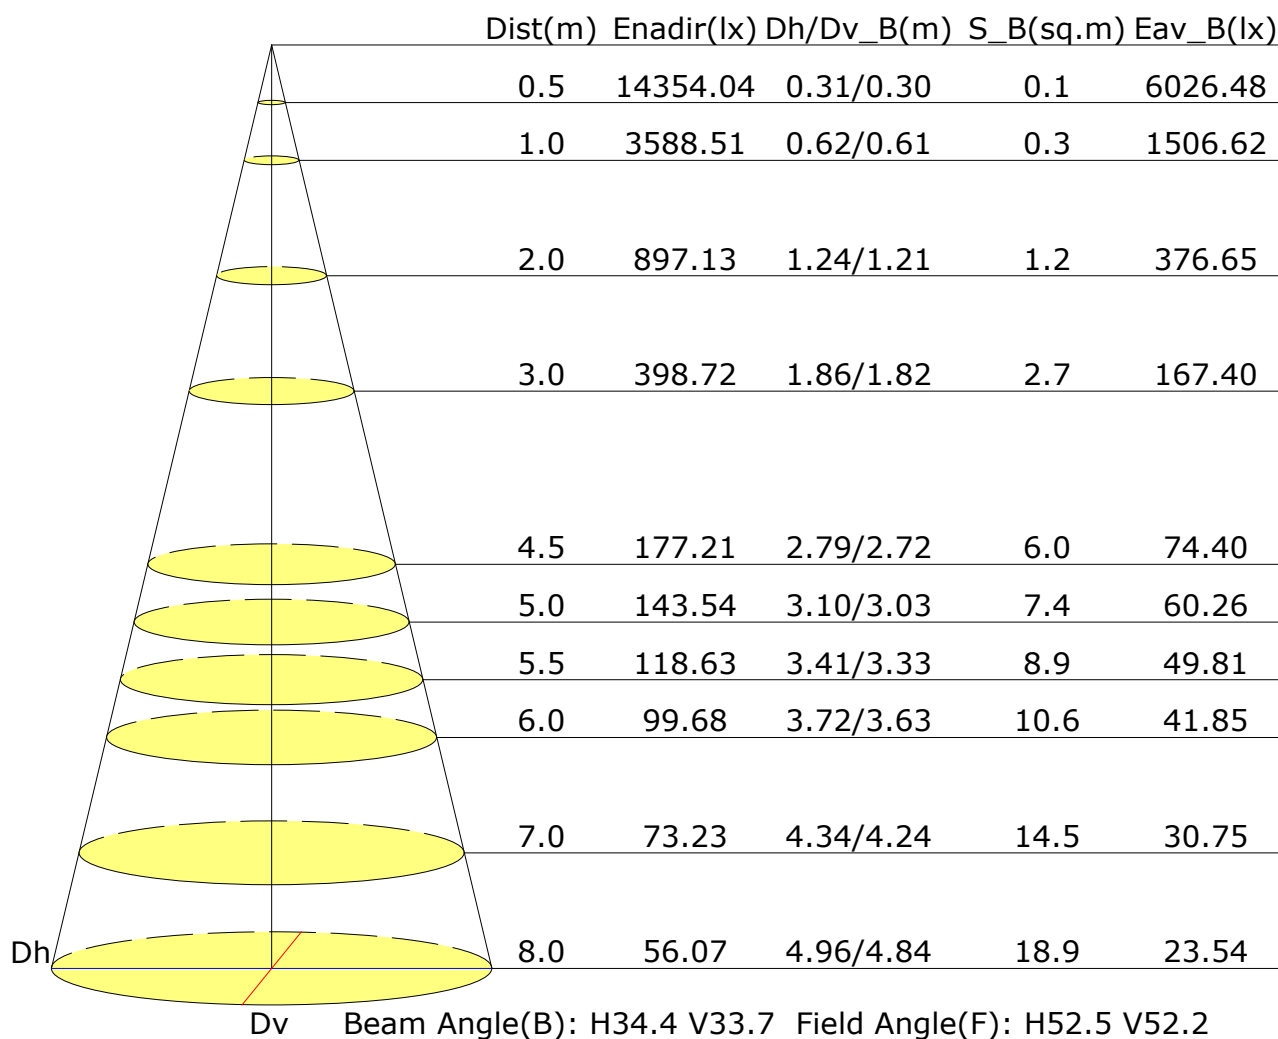


Vertical IsoLux Plot

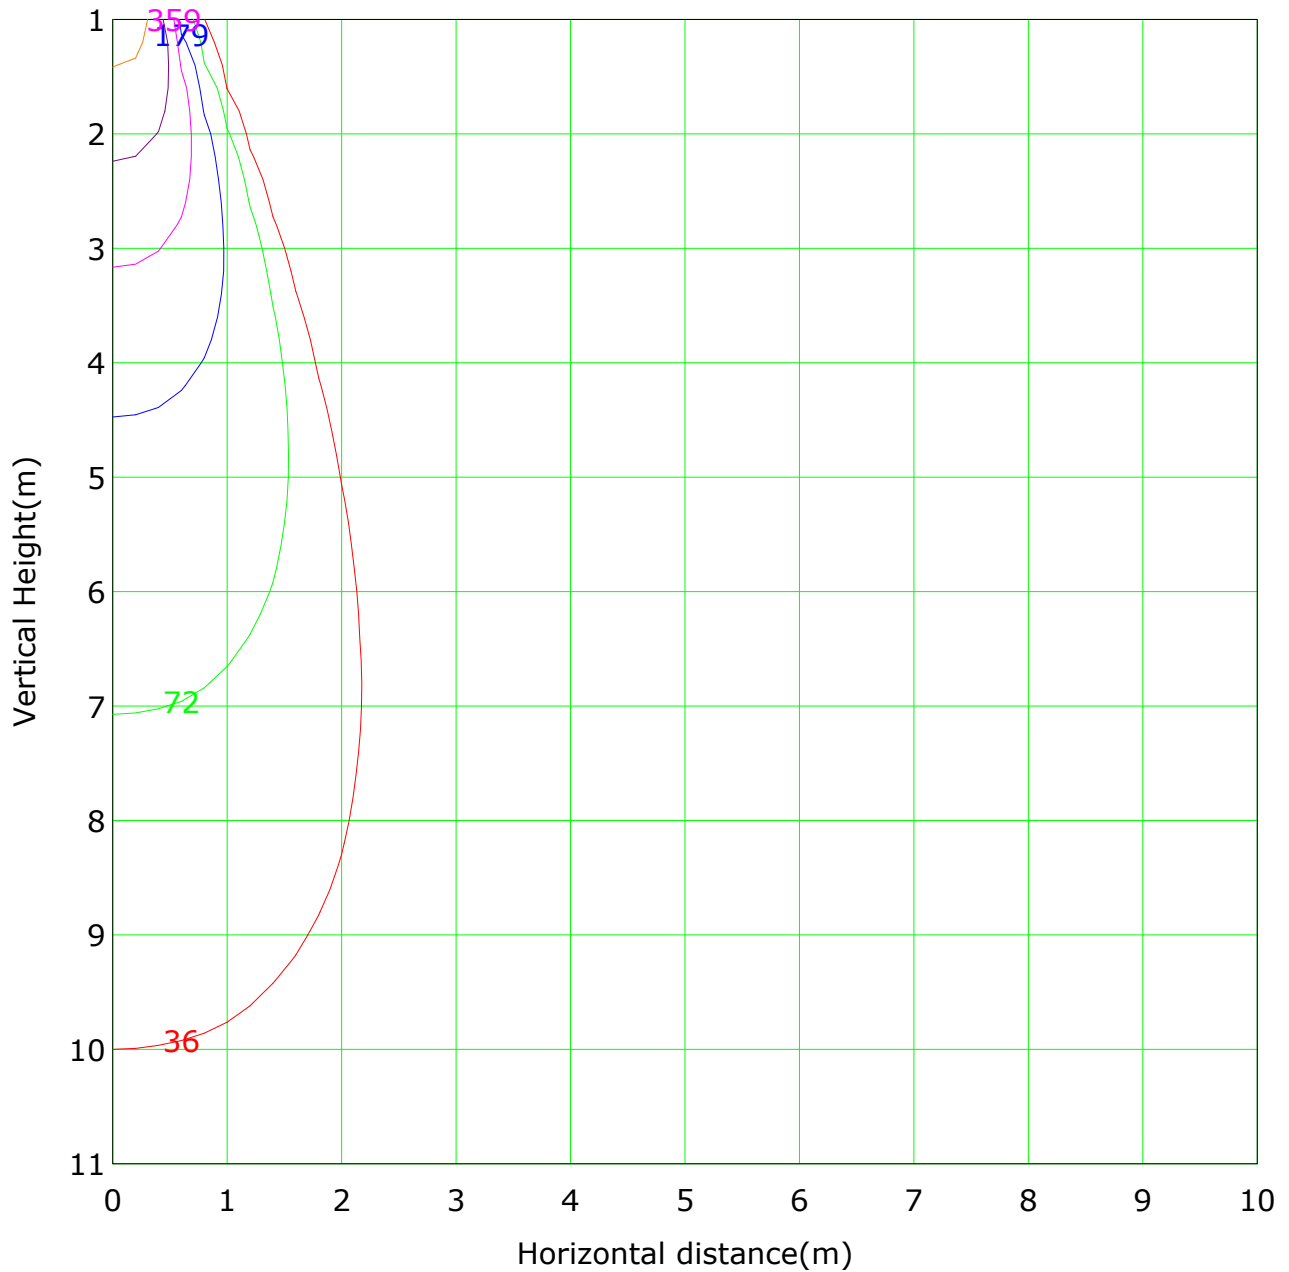

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 3588.5 lx
— (1%): 35.9 lx — (2%): 71.8 lx
— (5%): 179.4 lx — (10%): 358.9 lx
— (20%): 717.7 lx — (50%): 1794.3 lx
— (100%): 3588.5 lx

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

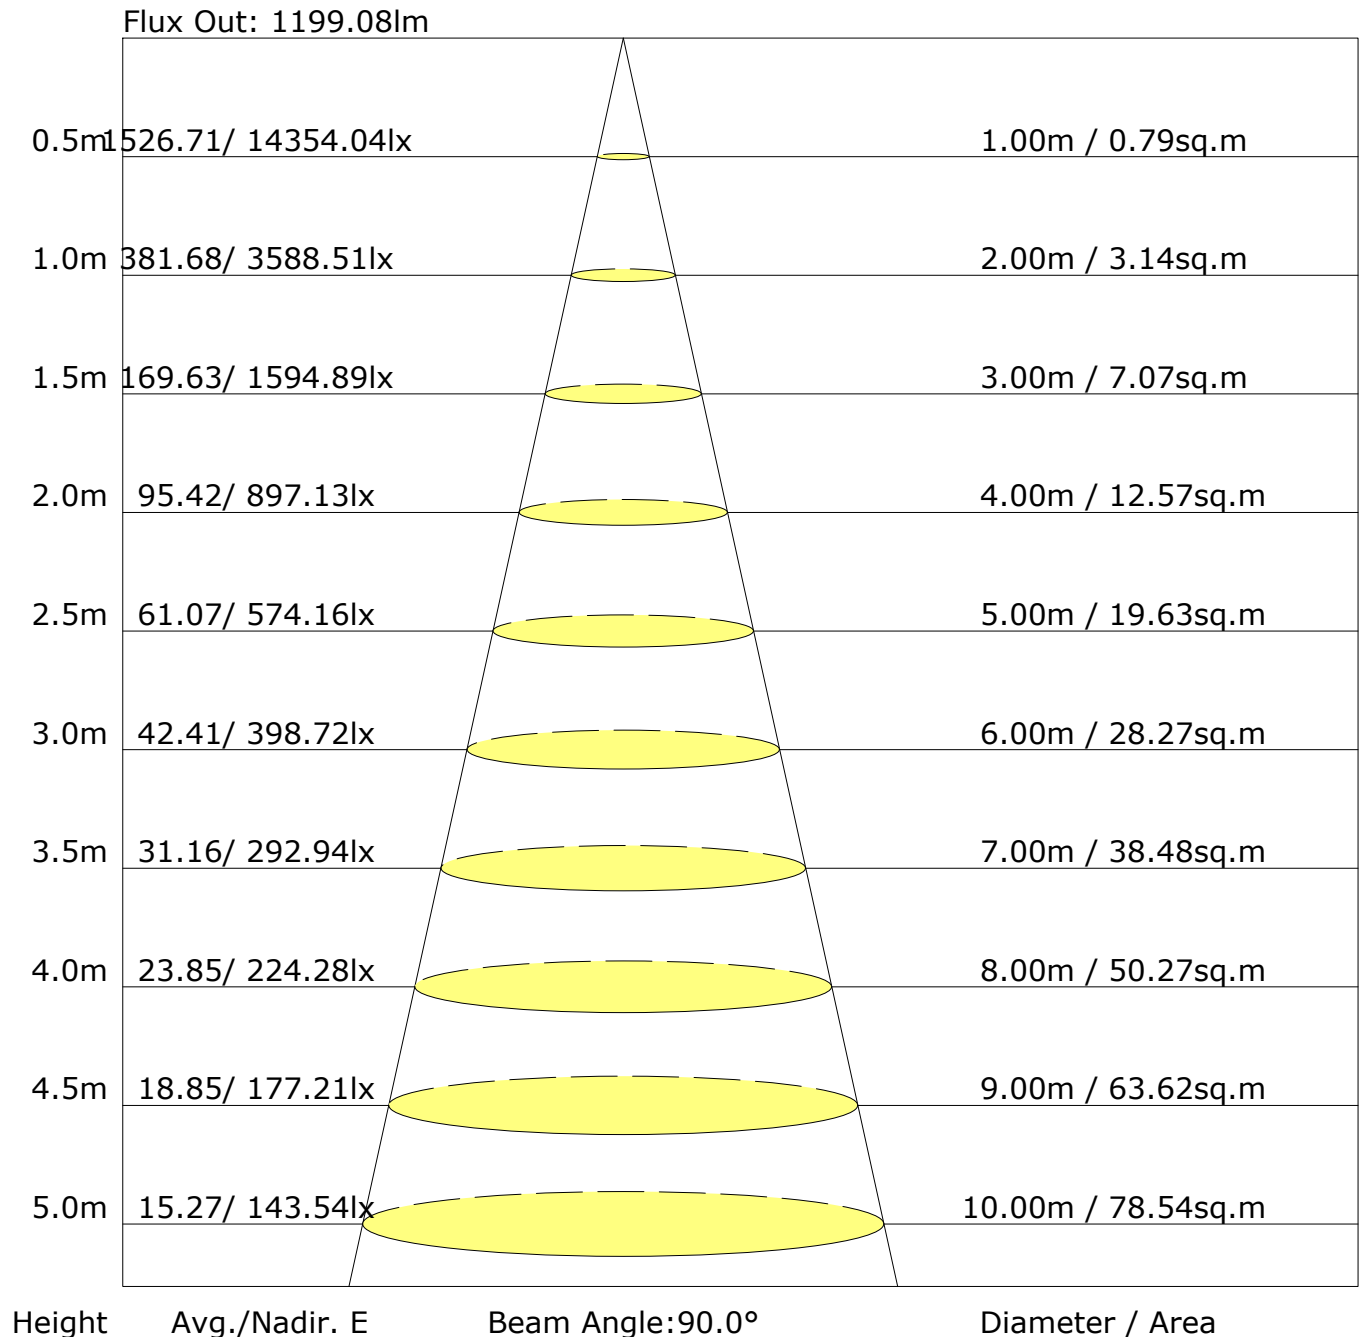

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	15.0	15.8	15.2	15.9	16.2	15.1	15.9	15.4	16.1	16.3
3H	17.8	18.5	18.1	18.8	19.0	18.0	18.8	18.3	19.0	19.2
4H	19.5	20.2	19.8	20.4	20.7	19.8	20.5	20.1	20.7	21.0
6H	21.5	22.1	21.8	22.4	22.7	21.8	22.4	22.1	22.7	23.0
8H	22.6	23.2	22.9	23.5	23.8	22.9	23.5	23.2	23.8	24.1
12H	23.9	24.5	24.2	24.8	25.1	24.2	24.8	24.5	25.1	25.4
X=4H Y=2H	16.0	16.7	16.4	17.0	17.3	16.1	16.8	16.4	17.1	17.4
3H	19.1	19.7	19.5	20.0	20.3	19.3	19.9	19.7	20.2	20.5
4H	21.0	21.5	21.4	21.9	22.2	21.2	21.8	21.6	22.1	22.5
6H	23.1	23.6	23.6	24.0	24.4	23.4	23.9	23.8	24.3	24.6
8H	24.4	24.8	24.8	25.2	25.6	24.6	25.1	25.0	25.5	25.9
12H	25.7	26.1	26.2	26.5	27.0	26.0	26.4	26.4	26.8	27.2
X=8H Y=4H	21.8	22.3	22.2	22.7	23.1	22.0	22.5	22.4	22.9	23.3
6H	24.3	24.6	24.7	25.1	25.5	24.4	24.8	24.9	25.3	25.7
8H	25.7	26.0	26.1	26.4	26.9	25.9	26.2	26.3	26.6	27.1
12H	27.2	27.5	27.7	28.0	28.5	27.5	27.7	27.9	28.2	28.7
X=12H Y=4H	22.1	22.5	22.5	22.9	23.3	22.2	22.6	22.7	23.1	23.5
6H	24.6	25.0	25.1	25.4	25.9	24.8	25.1	25.3	25.6	26.0
8H	26.1	26.4	26.6	26.9	27.4	26.3	26.6	26.8	27.1	27.6
Variations with the observer position at spacings:										
S=1.0H	+0.4/-0.4					+0.4/-0.4				
S=1.5H	+0.6/-0.8					+0.6/-0.7				
S=2.0H	+0.8/-1.1					+0.8/-1.1				

Calculate in accordance with CIE Pub.117. The table is revised with 1344lm ($8\log(F/F_0) = 1.0$).

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM


	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	693	51.5
	FL (0°-30°)	584	43.4
	FM (30°-60°)	58	4.3
	FH (60°-80°)	33	2.5
	FVH (80°-90°)	17	1.3
	BACK LIGHT	652	48.5
	BL (0°-30°)	548	40.8
	BM (30°-60°)	55	4.1
	BH (60°-80°)	33	2.4
	BVH (80°-90°)	17	1.2
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B2 U1 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B2 U1 G1

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

LCS Graph

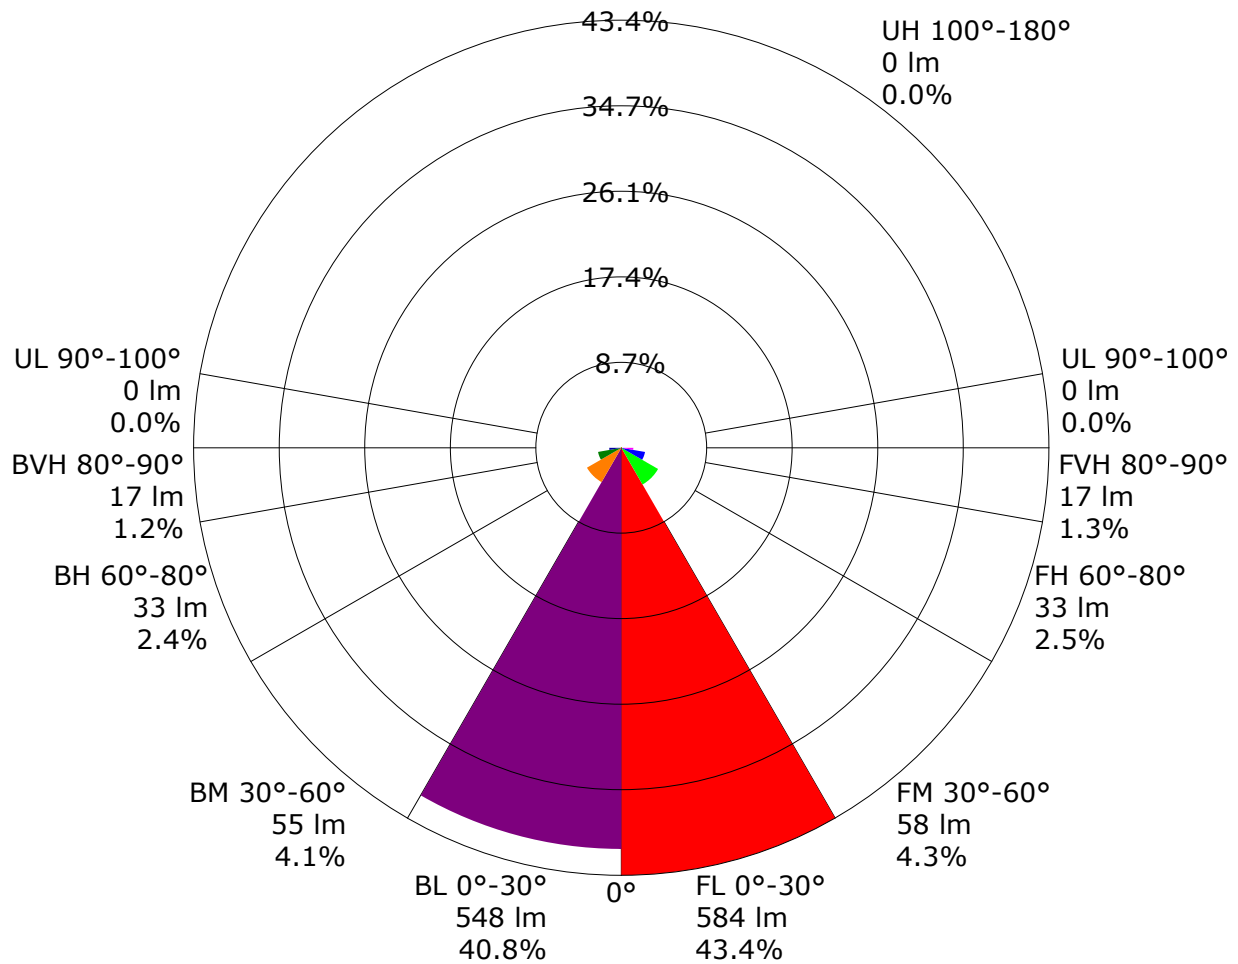

Back Light

Forward Light

Scale= MAX LCS%

Trapped Light:NA,NA

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.92	0.96	0.99	1.01	1.04	1.06	1.08	1.10	1.11	
	0.30		0.88	0.92	0.95	0.97	1.00	1.03	1.05	1.07	1.09	
	0.20		0.85	0.89	0.92	0.94	0.98	1.00	1.02	1.05	1.07	
0.50	0.50	0.20	0.91	0.94	0.97	0.98	1.01	1.03	1.04	1.06	1.07	
	0.30		0.87	0.91	0.93	0.95	0.98	1.00	1.02	1.04	1.05	
	0.20		0.85	0.88	0.91	0.93	0.96	0.98	1.00	1.02	1.04	
0.30	0.50	0.20	0.90	0.93	0.95	0.96	0.98	1.00	1.01	1.02	1.03	
	0.30		0.87	0.90	0.92	0.94	0.96	0.98	0.99	1.01	1.02	
	0.20		0.84	0.87	0.90	0.92	0.94	0.96	0.97	0.99	1.01	
0.00	0.00	0.00	0.83	0.86	0.88	0.89	0.91	0.92	0.94	0.95	0.96	
Rating:12W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.49	0.42	0.37	0.32	0.27	0.23	0.20	0.16	0.13	
	0.30		0.41	0.36	0.32	0.29	0.24	0.21	0.18	0.15	0.13	
	0.20		0.35	0.31	0.28	0.26	0.22	0.19	0.17	0.14	0.12	
0.50	0.50	0.20	0.47	0.39	0.34	0.30	0.25	0.25	0.18	0.15	0.12	
	0.30		0.40	0.34	0.30	0.27	0.23	0.19	0.17	0.14	0.12	
	0.20		0.34	0.30	0.27	0.25	0.21	0.18	0.16	0.13	0.11	
0.30	0.50	0.20	0.45	0.37	0.32	0.28	0.23	0.19	0.17	0.13	0.11	
	0.30		0.38	0.33	0.29	0.26	0.21	0.18	0.16	0.13	0.11	
	0.20		0.33	0.29	0.26	0.23	0.20	0.17	0.15	0.12	0.10	
0.00	0.00	0.00	0.19	0.16	0.14	0.13	0.11	0.09	0.08	0.07	0.06	
Rating:12W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.12	0.14	0.15	0.17	0.18	0.19	0.20	0.21	0.21	
	0.30		0.09	0.11	0.12	0.14	0.15	0.17	0.18	0.19	0.20	
	0.20		0.06	0.08	0.10	0.11	0.13	0.15	0.16	0.17	0.18	
0.50	0.50	0.20	0.12	0.14	0.15	0.16	0.17	0.18	0.19	0.20	0.20	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19	
	0.20		0.06	0.08	0.10	0.11	0.13	0.14	0.15	0.17	0.18	
0.30	0.50	0.20	0.11	0.13	0.14	0.15	0.17	0.18	0.18	0.19	0.19	
	0.30		0.08	0.10	0.12	0.13	0.14	0.16	0.16	0.18	0.18	
	0.20		0.06	0.08	0.10	0.11	0.13	0.14	0.15	0.16	0.17	
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Rating:12W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3578.0	3.4	3.4	0.25	0.25
1.0-2.0	3566.3	10.2	13.7	0.76	1.02
2.0-3.0	3542.2	16.9	30.6	1.26	2.28
3.0-4.0	3507.2	23.5	54.1	1.75	4.02
4.0-5.0	3462.5	29.8	83.9	2.22	6.24
5.0-6.0	3404.0	35.8	119.7	2.66	8.90
6.0-7.0	3331.4	41.4	161.0	3.08	11.98
7.0-8.0	3244.3	46.4	207.4	3.45	15.43
8.0-9.0	3144.5	51.0	258.4	3.79	19.22
9.0-10.0	3033.5	54.9	313.3	4.08	23.30
10.0-11.0	2905.1	58.1	371.4	4.32	27.62
11.0-12.0	2766.3	60.5	431.9	4.50	32.12
12.0-13.0	2619.5	62.2	494.0	4.62	36.75
13.0-14.0	2454.1	62.8	556.9	4.67	41.42
14.0-15.0	2279.9	62.6	619.5	4.66	46.08
15.0-16.0	2092.8	61.3	680.8	4.56	50.64
16.0-17.0	1895.4	59.0	739.8	4.39	55.03
17.0-18.0	1703.9	56.2	796.0	4.18	59.21
18.0-19.0	1503.5	52.3	848.3	3.89	63.10
19.0-20.0	1304.7	47.8	896.1	3.55	66.65
20.0-21.0	1120.7	43.0	939.1	3.20	69.85
21.0-22.0	943.7	37.9	977.0	2.82	72.67
22.0-23.0	785.2	32.9	1010.0	2.45	75.12
23.0-24.0	645.1	28.2	1038.2	2.10	77.22
24.0-25.0	521.8	23.7	1061.9	1.76	78.99
25.0-26.0	420.8	19.9	1081.8	1.48	80.46
26.0-27.0	335.4	16.4	1098.2	1.22	81.69
27.0-28.0	265.7	13.5	1111.7	1.00	82.69
28.0-29.0	212.9	11.1	1122.8	0.83	83.51
29.0-30.0	170.8	9.2	1132.0	0.69	84.20
30.0-31.0	139.0	7.7	1139.8	0.58	84.78
31.0-32.0	116.0	6.6	1146.4	0.49	85.27
32.0-33.0	98.4	5.8	1152.2	0.43	85.70
33.0-34.0	85.5	5.2	1157.4	0.38	86.09
34.0-35.0	75.8	4.7	1162.1	0.35	86.44
35.0-36.0	68.9	4.4	1166.5	0.33	86.76

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	63.9	4.2	1170.6	0.31	87.07
37.0-38.0	59.4	4.0	1174.6	0.29	87.37
38.0-39.0	55.5	3.8	1178.4	0.28	87.65
39.0-40.0	52.6	3.7	1182.1	0.27	87.92
40.0-41.0	50.3	3.6	1185.7	0.27	88.19
41.0-42.0	48.2	3.5	1189.2	0.26	88.45
42.0-43.0	46.0	3.4	1192.6	0.25	88.70
43.0-44.0	43.9	3.3	1195.9	0.25	88.95
44.0-45.0	41.6	3.2	1199.1	0.24	89.19
45.0-46.0	39.6	3.1	1202.2	0.23	89.42
46.0-47.0	38.0	3.0	1205.2	0.22	89.64
47.0-48.0	36.8	3.0	1208.2	0.22	89.86
48.0-49.0	36.0	3.0	1211.1	0.22	90.08
49.0-50.0	35.6	3.0	1214.1	0.22	90.30
50.0-51.0	35.3	3.0	1217.1	0.22	90.53
51.0-52.0	35.1	3.0	1220.1	0.22	90.75
52.0-53.0	34.8	3.0	1223.1	0.23	90.98
53.0-54.0	34.5	3.0	1226.2	0.23	91.20
54.0-55.0	34.4	3.1	1229.2	0.23	91.43
55.0-56.0	34.1	3.1	1232.3	0.23	91.66
56.0-57.0	34.1	3.1	1235.4	0.23	91.89
57.0-58.0	34.1	3.2	1238.6	0.23	92.13
58.0-59.0	34.1	3.2	1241.8	0.24	92.36
59.0-60.0	33.7	3.2	1245.0	0.24	92.60
60.0-61.0	33.3	3.2	1248.1	0.24	92.84
61.0-62.0	33.5	3.2	1251.4	0.24	93.08
62.0-63.0	33.2	3.2	1254.6	0.24	93.32
63.0-64.0	32.9	3.2	1257.8	0.24	93.56
64.0-65.0	32.7	3.2	1261.1	0.24	93.80
65.0-66.0	32.5	3.2	1264.3	0.24	94.04
66.0-67.0	32.4	3.3	1267.6	0.24	94.28
67.0-68.0	32.4	3.3	1270.8	0.24	94.53
68.0-69.0	32.2	3.3	1274.1	0.24	94.77
69.0-70.0	32.0	3.3	1277.4	0.24	95.02
70.0-71.0	31.8	3.3	1280.7	0.24	95.26
71.0-72.0	31.7	3.3	1284.0	0.25	95.50

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G0.0	3588.5	3573.6	3588.5	3573.6	3588.5					
G1.0	3586.0	3556.4	3580.3	3577.5	3586.0					
G2.0	3574.4	3528.1	3558.9	3568.9	3574.4					
G3.0	3557.9	3482.5	3519.5	3547.5	3557.9					
G4.0	3533.0	3429.3	3471.8	3515.8	3533.0					
G5.0	3498.4	3365.5	3412.7	3473.8	3498.4					
G6.0	3447.6	3280.6	3341.8	3411.7	3447.6					
G7.0	3381.9	3186.2	3264.9	3336.2	3381.9					
G8.0	3296.9	3070.0	3166.4	3252.2	3296.9					
G9.0	3207.6	2957.6	3062.8	3142.2	3207.6					
G10.0	3101.8	2829.7	2937.6	3029.1	3101.8					
G11.0	2976.7	2686.4	2781.6	2897.7	2976.7					
G12.0	2852.8	2539.6	2636.9	2758.7	2852.8					
G13.0	2707.1	2378.9	2474.3	2607.8	2707.1					
G14.0	2537.3	2215.7	2283.7	2428.1	2537.3					
G15.0	2359.0	2048.1	2107.0	2260.0	2359.0					
G16.0	2162.8	1838.7	1893.2	2073.6	2162.8					
G17.0	1979.2	1658.1	1693.0	1864.6	1979.2					
G18.0	1781.2	1475.3	1500.0	1679.9	1781.2					
G19.0	1560.2	1274.8	1284.9	1471.6	1560.2					
G20.0	1366.0	1091.5	1096.8	1291.8	1366.0					
G21.0	1170.3	913.1	925.3	1110.8	1170.3					
G22.0	979.1	760.5	766.3	924.3	979.1					
G23.0	811.2	633.3	639.7	767.0	811.2					
G24.0	657.1	506.5	512.4	633.7	657.1					
G25.0	537.9	410.6	412.3	503.9	537.9					
G26.0	434.3	325.7	332.9	409.0	434.3					
G27.0	348.0	252.4	258.7	322.0	348.0					
G28.0	278.0	197.8	207.0	261.4	278.0					
G29.0	227.4	152.2	167.3	212.1	227.4					
G30.0	181.8	122.1	132.6	171.1	181.8					
G31.0	151.2	100.2	110.4	142.9	151.2					
G32.0	125.6	84.4	92.1	121.1	125.6					
G33.0	106.4	74.0	80.7	102.7	106.4					
G34.0	92.1	67.2	71.1	89.7	92.1					
G35.0	80.8	61.7	64.3	79.7	80.8					
G36.0	73.4	58.4	59.5	73.5	73.4					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G37.0	68.0	55.2	56.2	67.3	68.0					
G38.0	62.1	52.1	51.6	62.6	62.1					
G39.0	58.2	49.8	49.3	58.6	58.2					
G40.0	54.2	47.7	47.3	56.2	54.2					
G41.0	51.8	46.1	46.0	53.1	51.8					
G42.0	48.9	44.9	44.0	50.6	48.9					
G43.0	46.1	43.4	42.5	47.4	46.1					
G44.0	43.4	42.7	40.3	45.1	43.4					
G45.0	40.2	41.1	38.9	41.4	40.2					
G46.0	37.6	40.2	37.2	40.0	37.6					
G47.0	36.2	38.7	35.8	38.4	36.2					
G48.0	35.0	38.1	35.2	36.8	35.0					
G49.0	34.7	37.2	34.5	36.5	34.7					
G50.0	34.3	36.3	34.5	37.1	34.3					
G51.0	34.6	36.4	33.0	36.5	34.6					
G52.0	34.3	36.3	33.8	35.9	34.3					
G53.0	33.7	35.1	33.3	36.0	33.7					
G54.0	33.7	34.7	33.7	35.6	33.7					
G55.0	34.1	34.8	33.1	35.1	34.1					
G56.0	33.7	34.8	32.2	35.0	33.7					
G57.0	33.9	35.1	32.6	35.5	33.9					
G58.0	34.1	34.6	32.0	35.4	34.1					
G59.0	33.9	35.1	32.0	36.0	33.9					
G60.0	32.2	34.6	31.2	34.7	32.2					
G61.0	32.5	34.8	31.6	34.8	32.5					
G62.0	32.8	34.3	31.3	35.6	32.8					
G63.0	32.1	33.8	30.9	35.1	32.1					
G64.0	32.1	33.8	30.3	35.1	32.1					
G65.0	32.0	33.7	30.1	34.6	32.0					
G66.0	31.8	33.0	30.7	34.1	31.8					
G67.0	32.0	32.9	30.3	34.2	32.0					
G68.0	31.3	33.1	30.4	34.8	31.3					
G69.0	31.6	32.5	29.6	34.5	31.6					
G70.0	31.2	32.6	29.9	34.1	31.2					
G71.0	30.8	32.4	29.6	33.7	30.8					
G72.0	31.0	32.1	30.0	34.1	31.0					
G73.0	30.7	32.2	29.6	33.4	30.7					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Unit: cd

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector: