

Test Time: 2026-05-16 16:48



Luminaire Manufacturer: NORDECOR
Luminaire Description: 80098
Luminous Width (mm): 80
Current: 0.104 A
Power Factor: 0.501

Luminous Length (mm): 80
Voltage: 220.3 V
Power: 11.48 W

CIE Class: Direct
Measurement Flux: 1100.4 lm
Downward Ratio: 100%
Horizontal Diffuse Angle(10%,50%,80%
Vertical Diffuse Angle(10%,50%,80%,1
Luminaire Efficacy Rating (LER): 95.90
Max. Intensity: 3273.32 cd
S/MH(C0/C180): 0.52

Total Rated Lamp Lumens: 1100.4 lm
Efficiency: 100%
Upward Ratio: 0%
0%): H49,H30.8,H18.2,H1
) : V49.9,V31.6,V19.2,V1
Central Intensity: 3266.89 cd
Pos of Max. Intensity: H0 V1
S/MH(C90/C270): 0.53

Luminous Intensity Distribution Curve

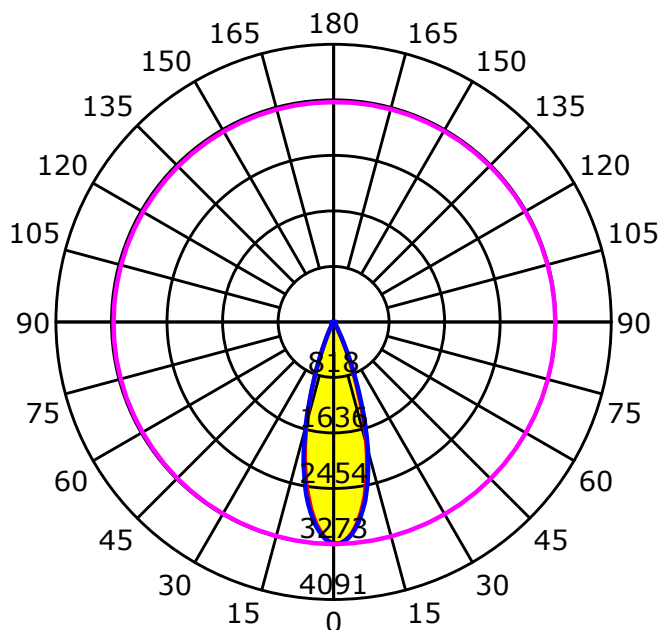



Average Diffuse Angle(50%): 31.2°

— C0-C180 — C90-C270 — G1

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve

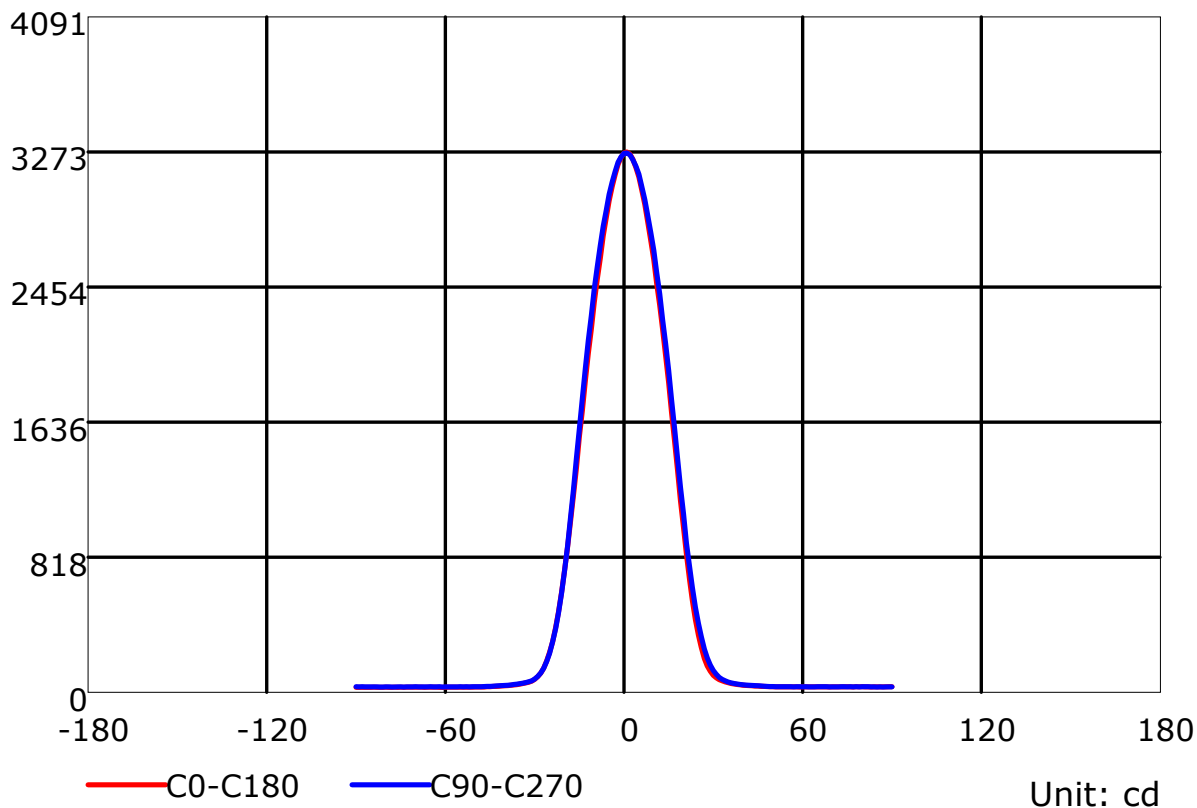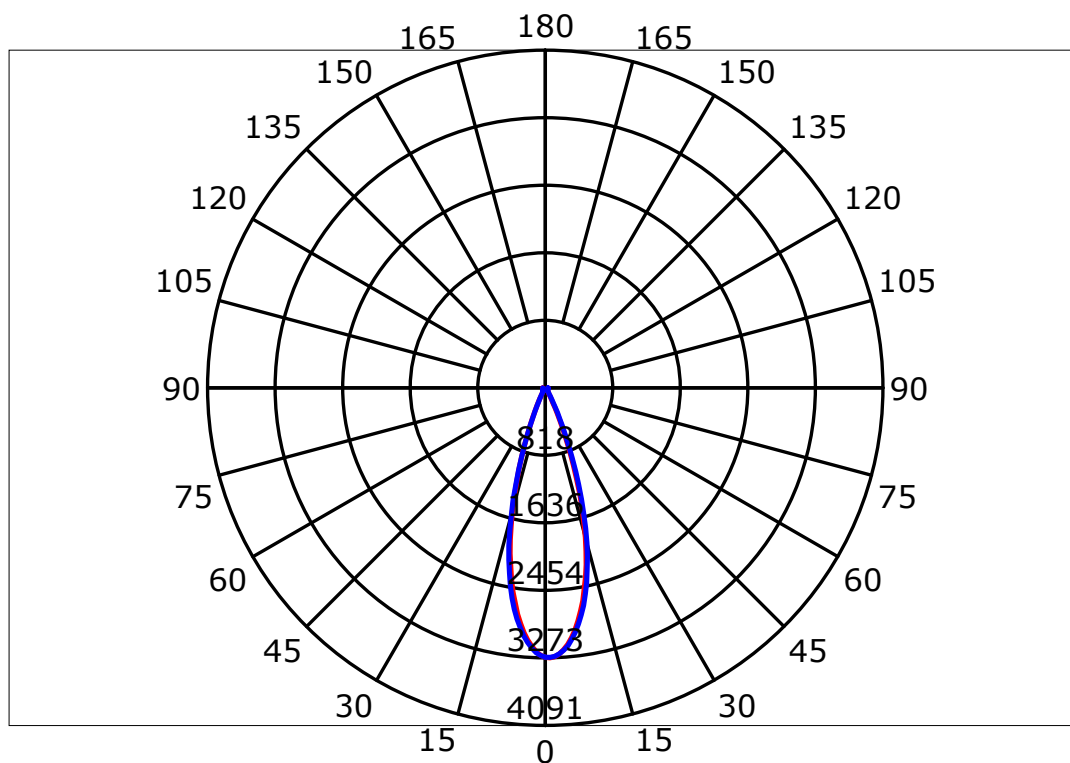

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

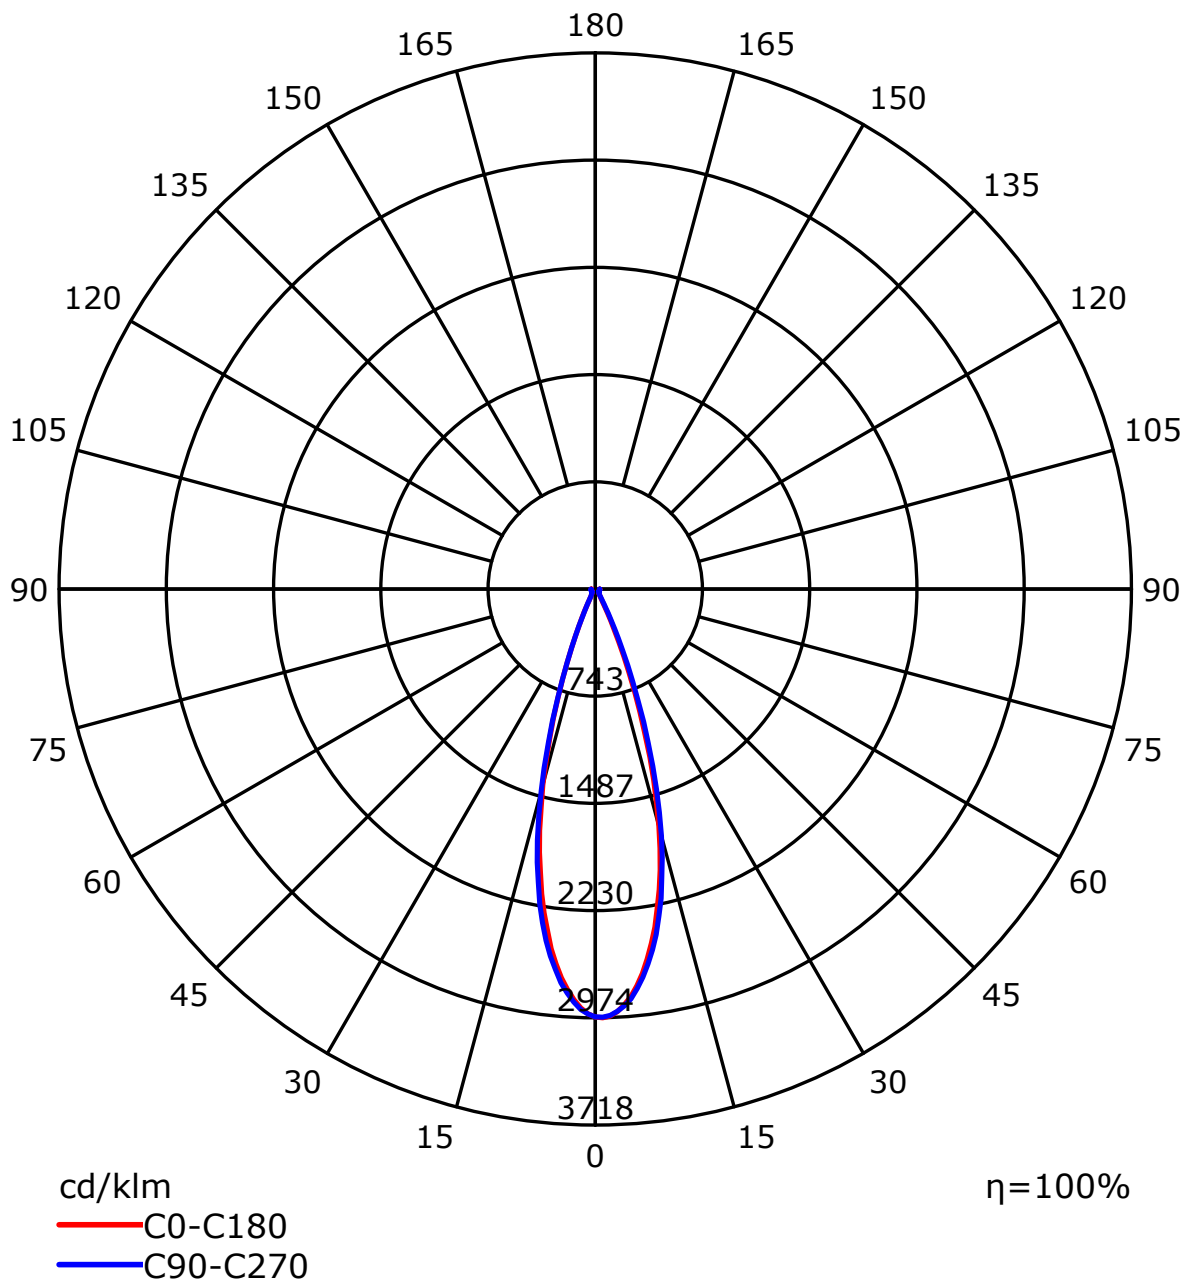


C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91
2	107	102	97	94	105	100	96	93	97	93	91	94	91	89	91	89	87	85
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	81
4	98	91	86	82	96	90	85	81	88	83	80	86	82	79	84	81	78	77
5	94	87	81	77	93	86	81	77	84	80	76	82	79	76	81	78	75	74
6	91	83	78	74	90	82	77	73	81	76	73	79	75	72	78	75	72	71
7	88	80	74	71	87	79	74	70	78	73	70	77	73	70	76	72	69	68
8	85	77	71	68	84	76	71	68	75	71	67	74	70	67	73	70	67	66
9	82	74	69	65	81	73	69	65	73	68	65	72	68	65	71	67	65	64
10	80	71	67	63	79	71	66	63	70	66	63	70	66	63	69	65	63	62


Spacing Criteria (0-180): 0.52
Spacing Criteria (90-270): 0.53
Spacing Criteria (Diagonal): 0.50

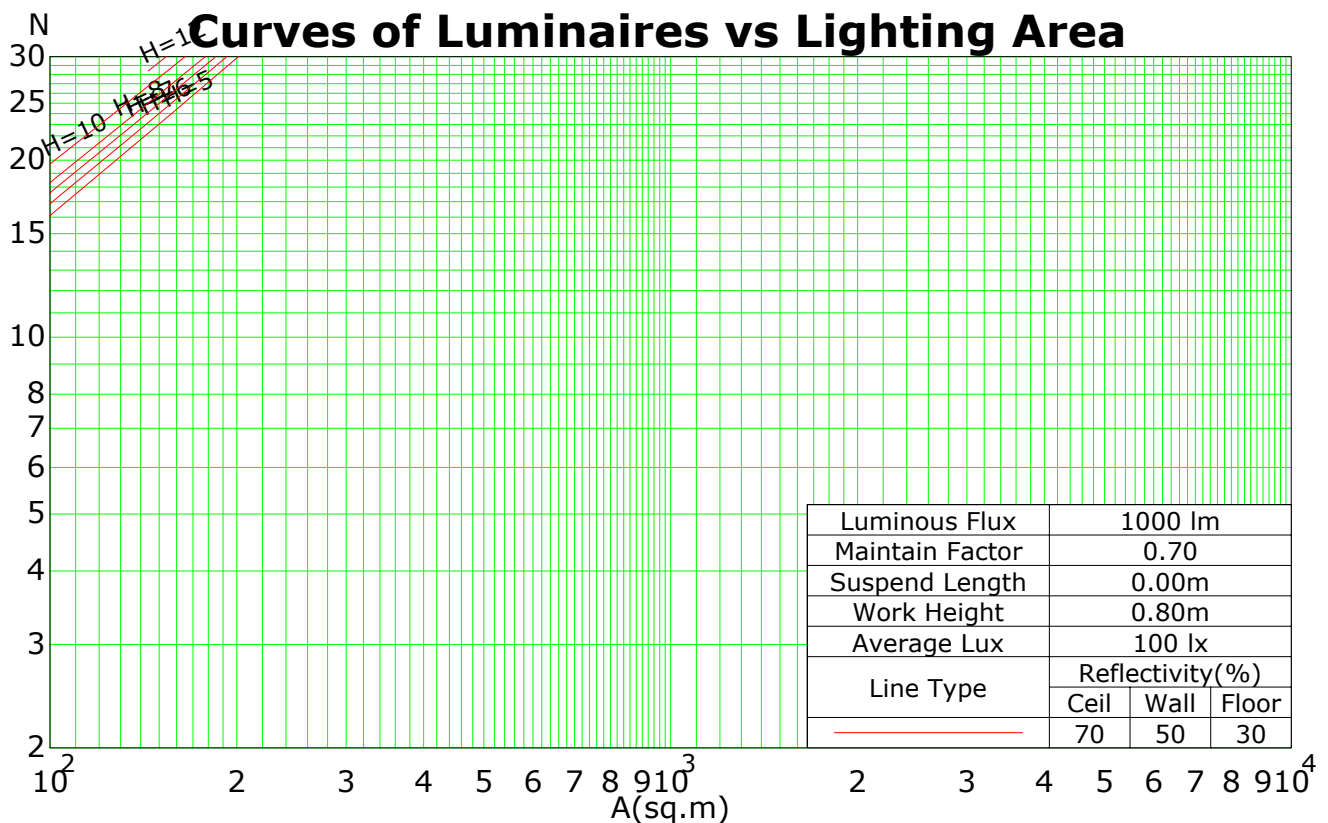

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Isocandela (rectangle)

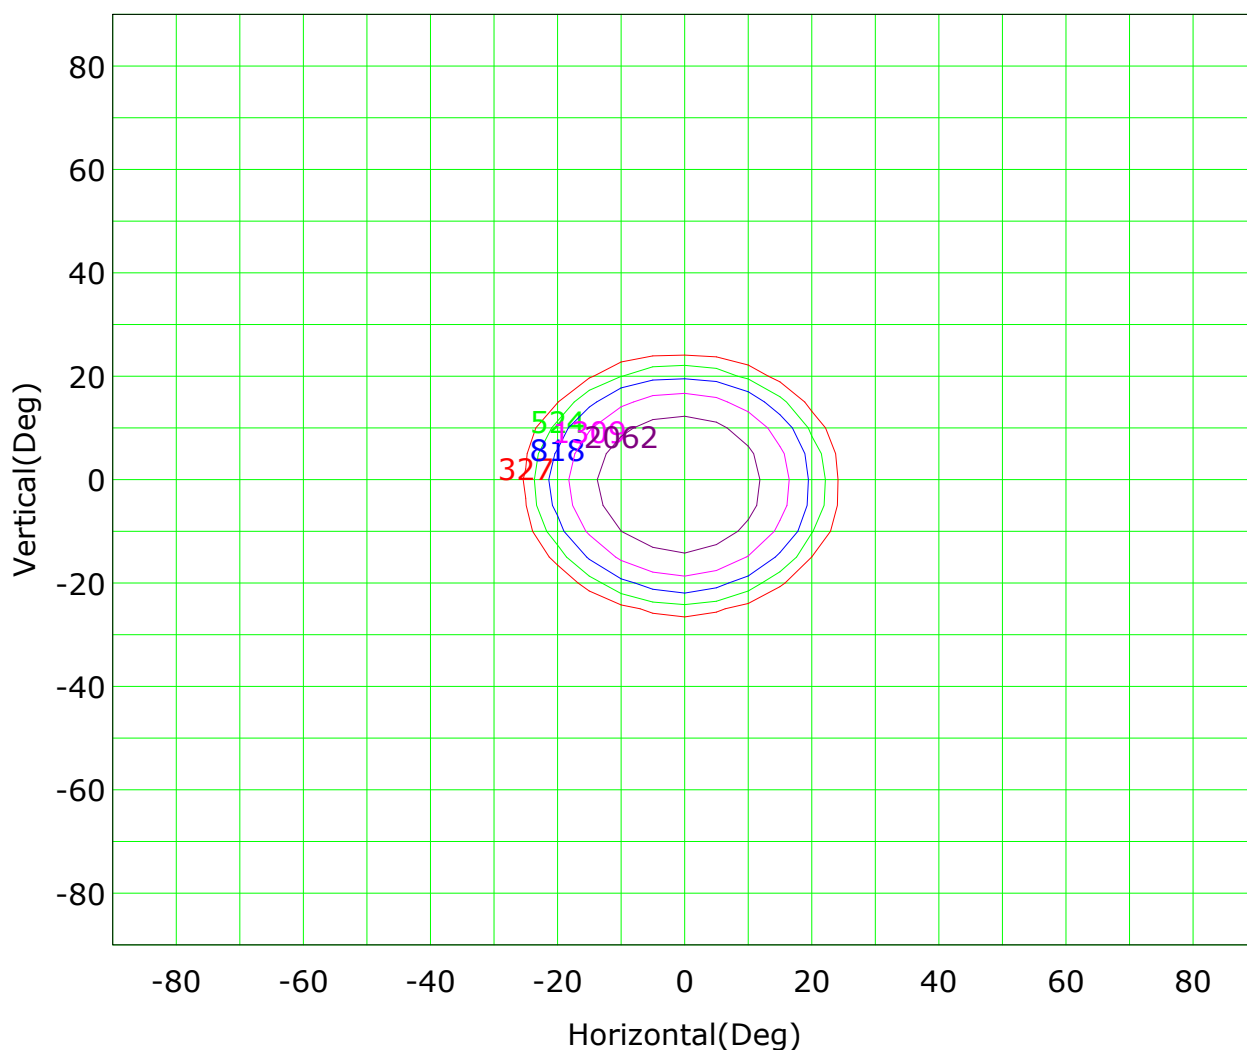


Imax (100%): 3273 cd

(10%): 327 cd	(16%): 524 cd
(25%): 818 cd	(40%): 1309 cd
(63%): 2062 cd	(100%): 3273 cd

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Isocandela (sphere)

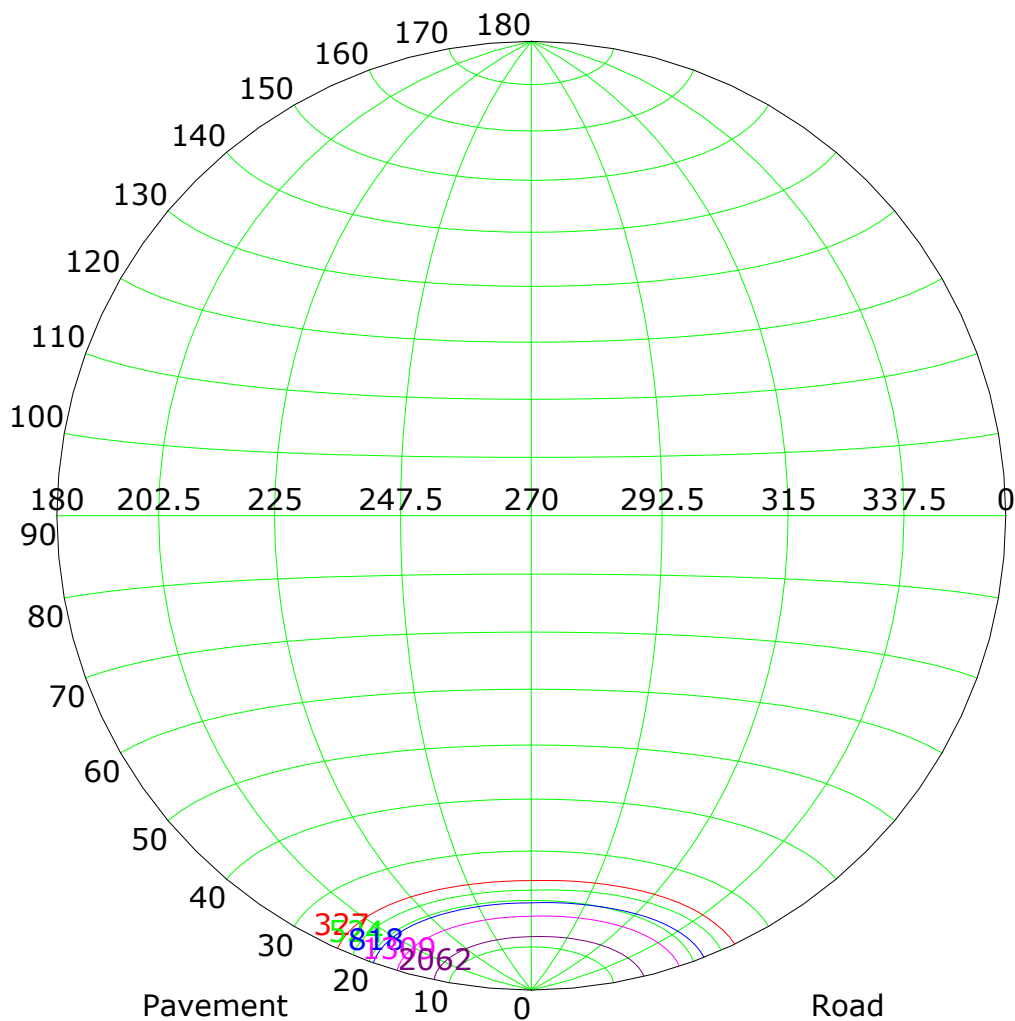


Imax (100%): 3273 cd

(10%): 327 cd
(25%): 818 cd
(63%): 2062 cd

(16%): 524 cd
(40%): 1309 cd
(100%): 3273 cd

IsoLux Plot

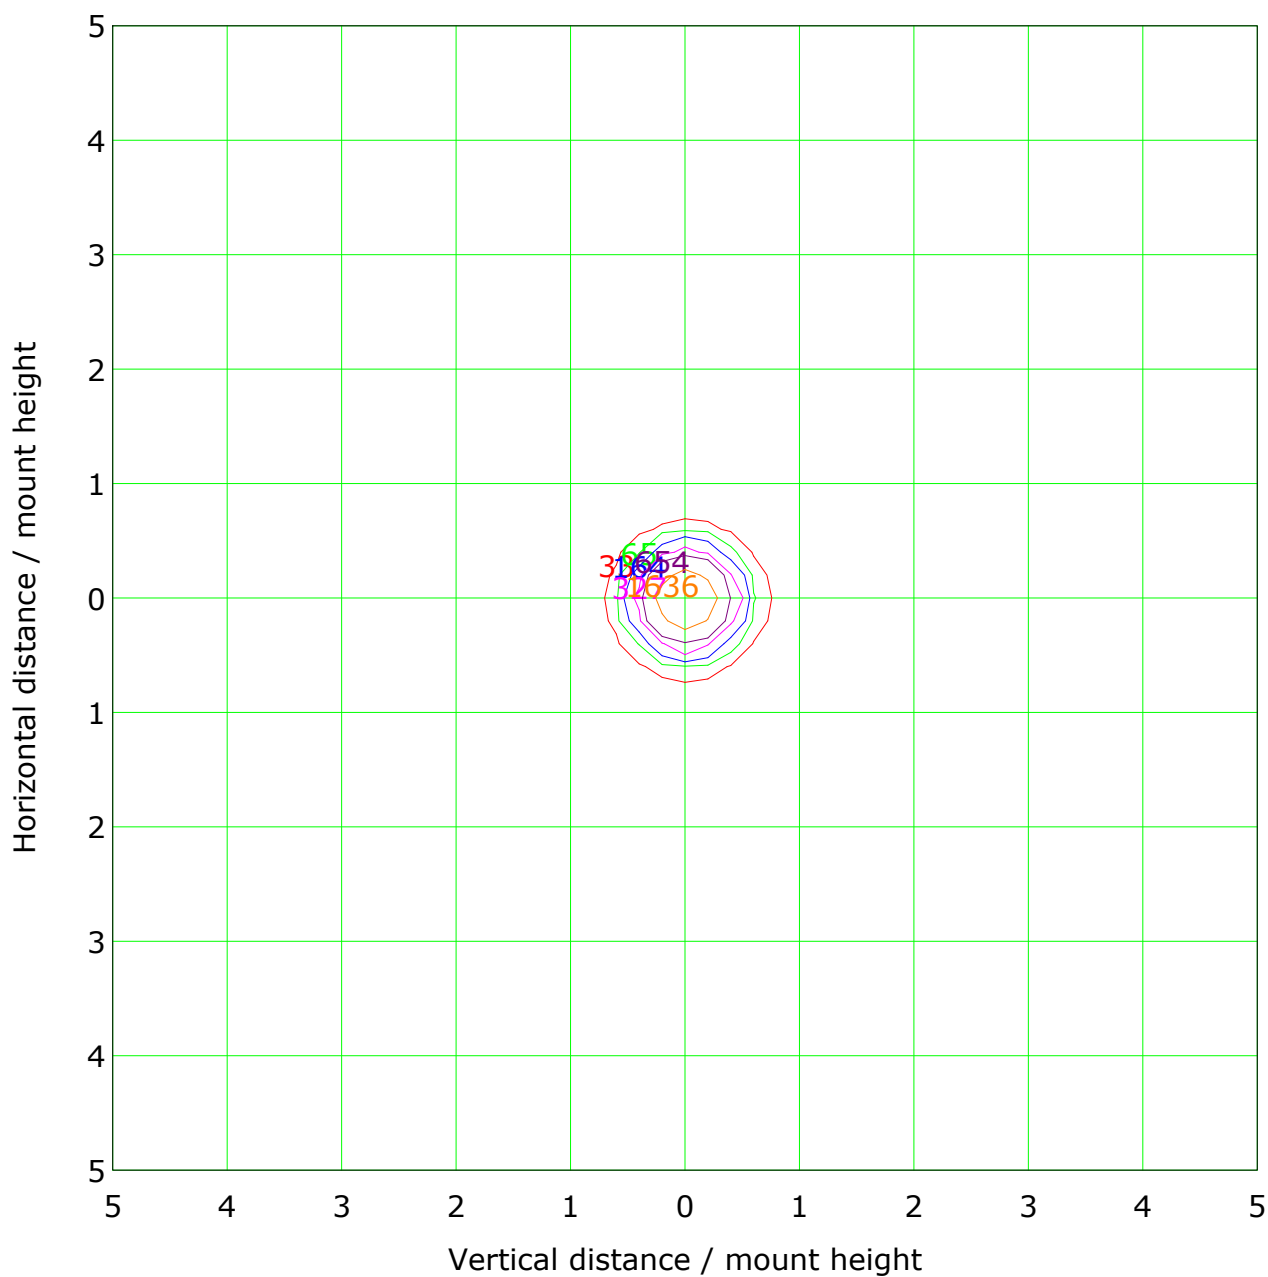

Mounting Height: 1.0m Max Lux(100%): 3271.8 lx


(1%): 32.7 lx	(2%): 65.4 lx
(5%): 163.6 lx	(10%): 327.2 lx
(20%): 654.4 lx	(50%): 1635.9 lx
(100%): 3271.8 lx	

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Roadway CU Curve

Efficiency(%)


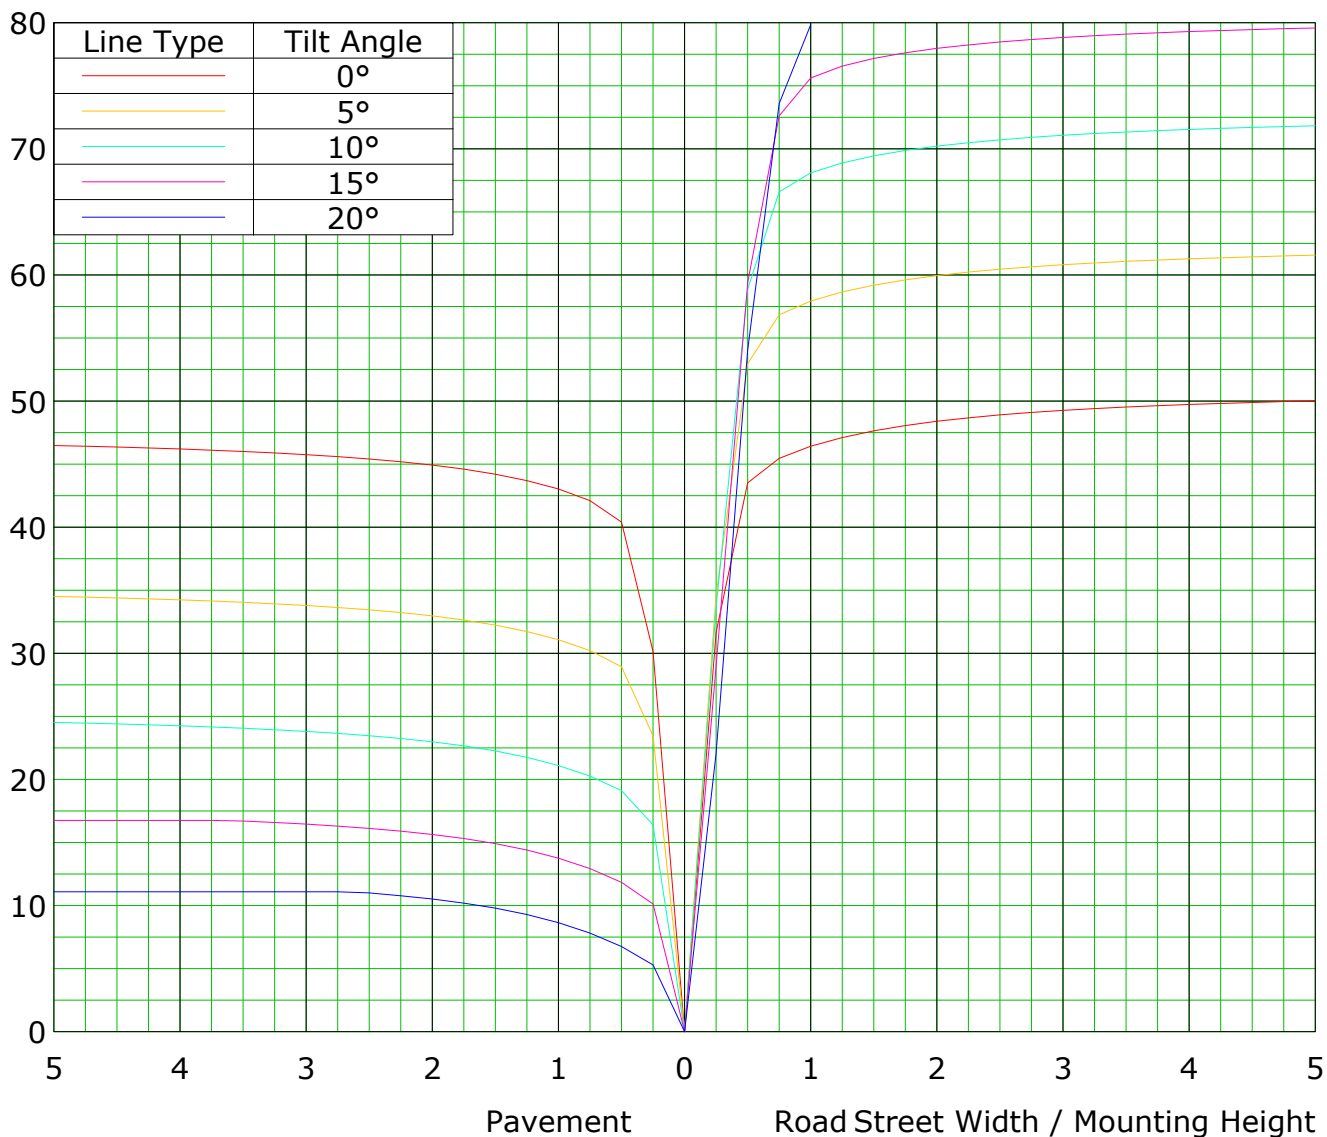


C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

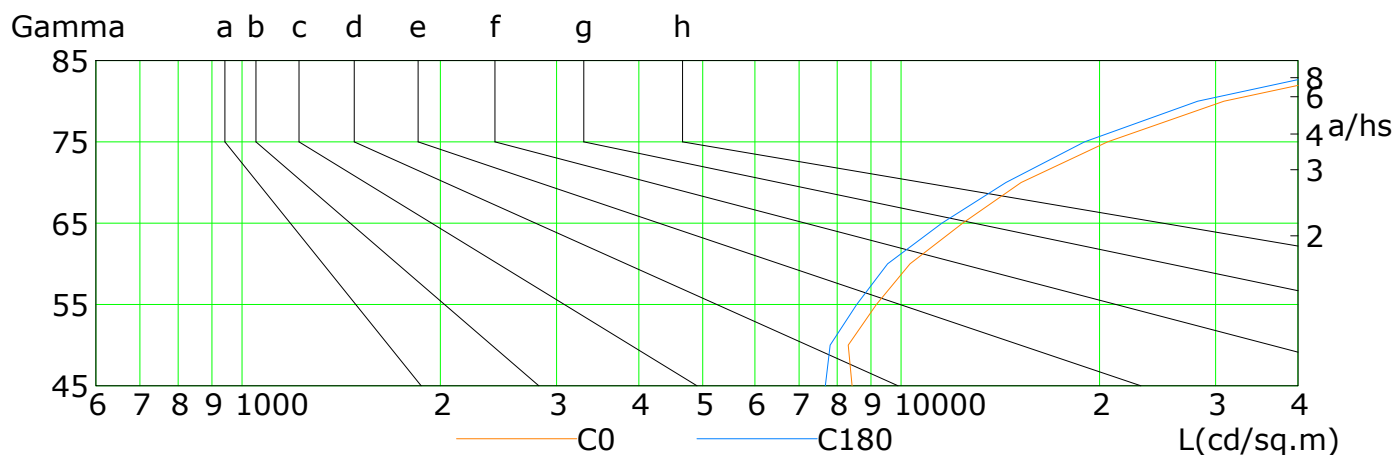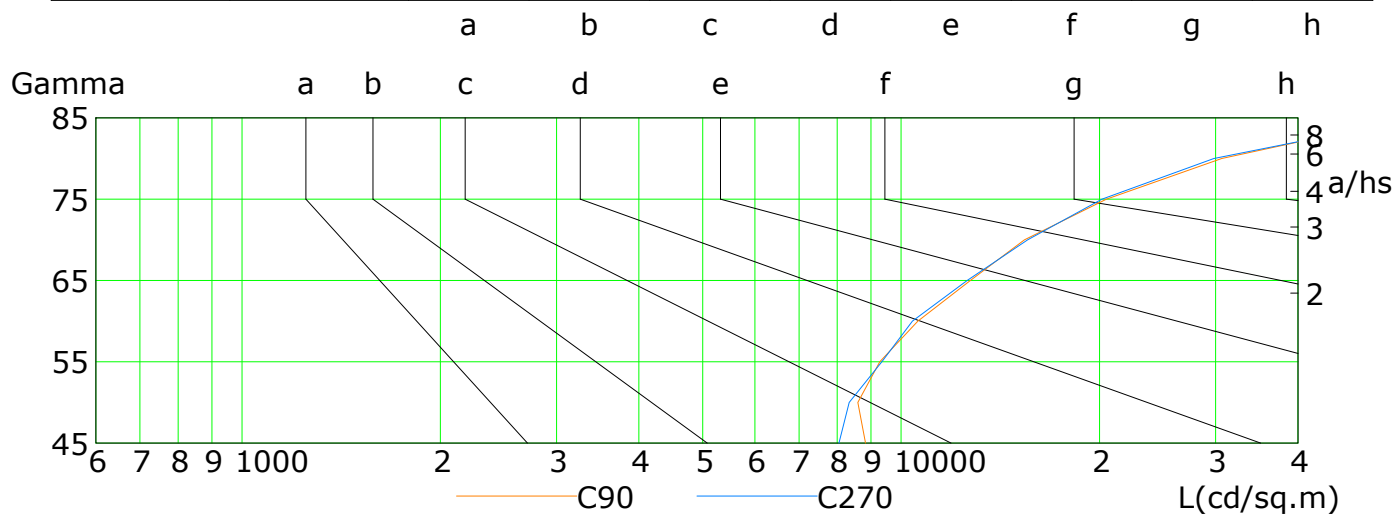

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	8423	8311	9172	10316	12400	15204	20562	30881	59663
C90	8830	8598	9278	10603	12737	15382	20484	30647	58946
C180	7672	7803	8565	9538	11528	14423	18980	28173	54482
C270	8048	8343	9349	10400	12593	15560	20170	29820	60596

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 8.443 m


Humidity:

Inspector:

Illuminance at a Distance

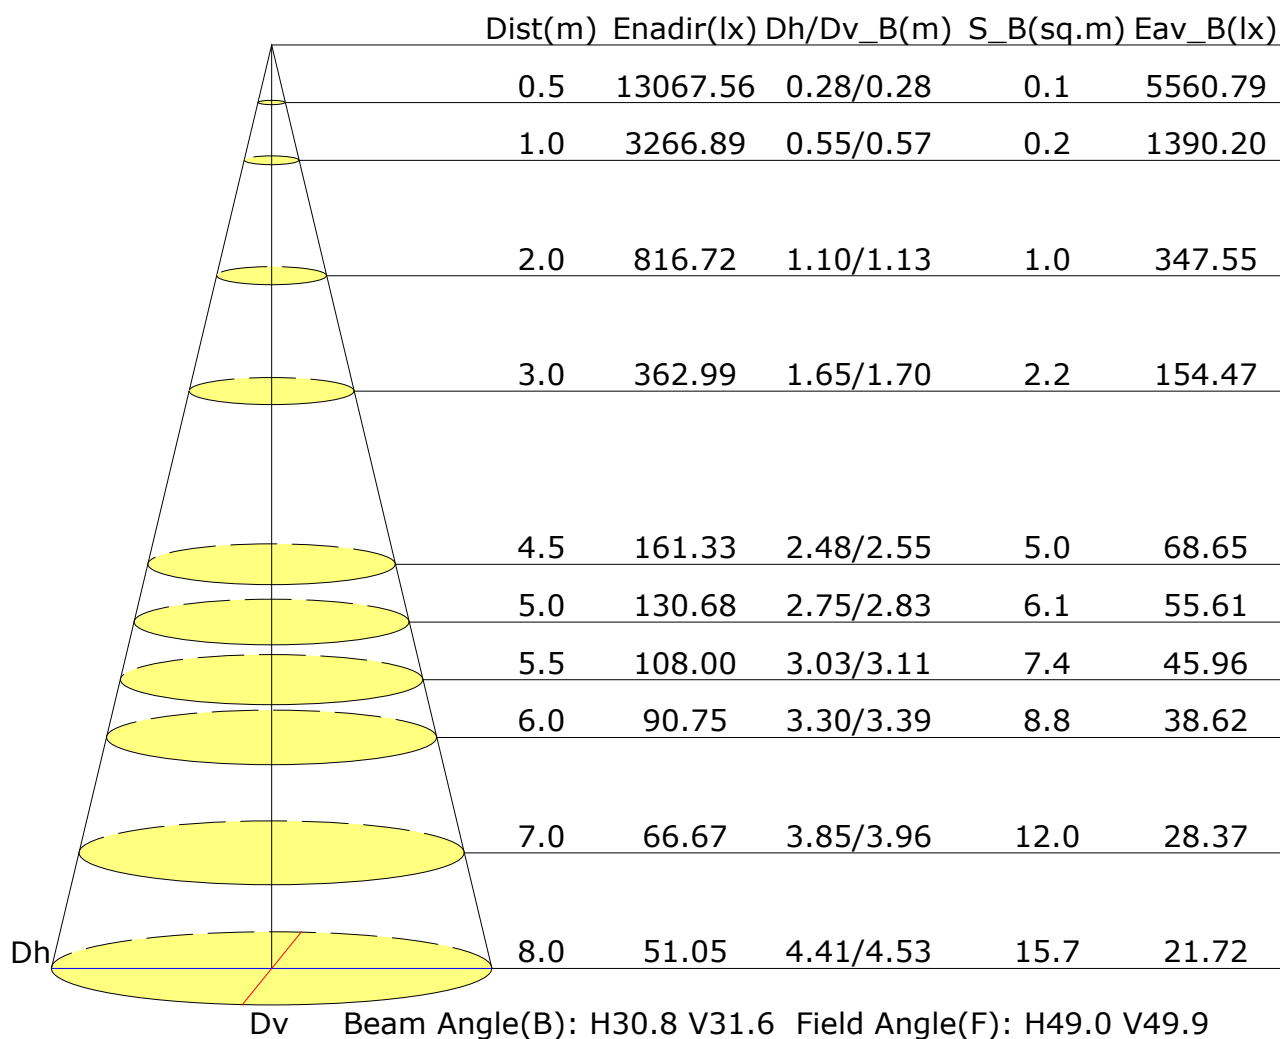


Vertical IsoLux Plot

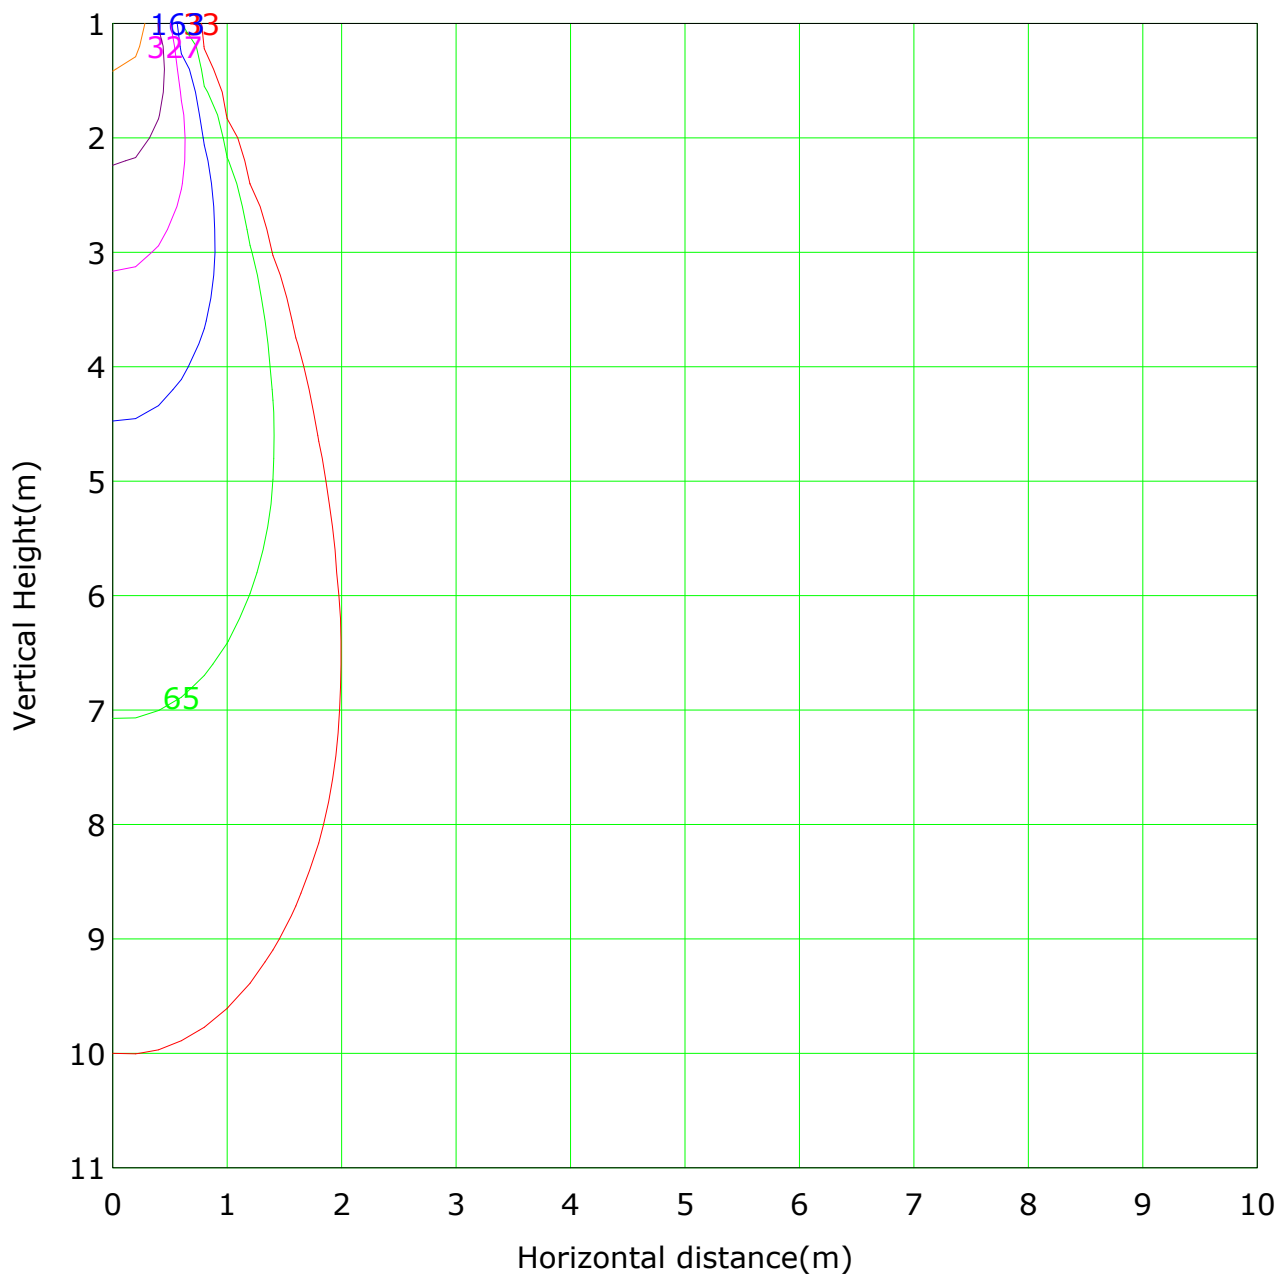

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 3266.9 lx
— (1%): 32.7 lx — (2%): 65.3 lx
— (5%): 163.3 lx — (10%): 326.7 lx
— (20%): 653.4 lx — (50%): 1633.4 lx
— (100%): 3266.9 lx

Inspector:

The Average Illuminance Effective Figure

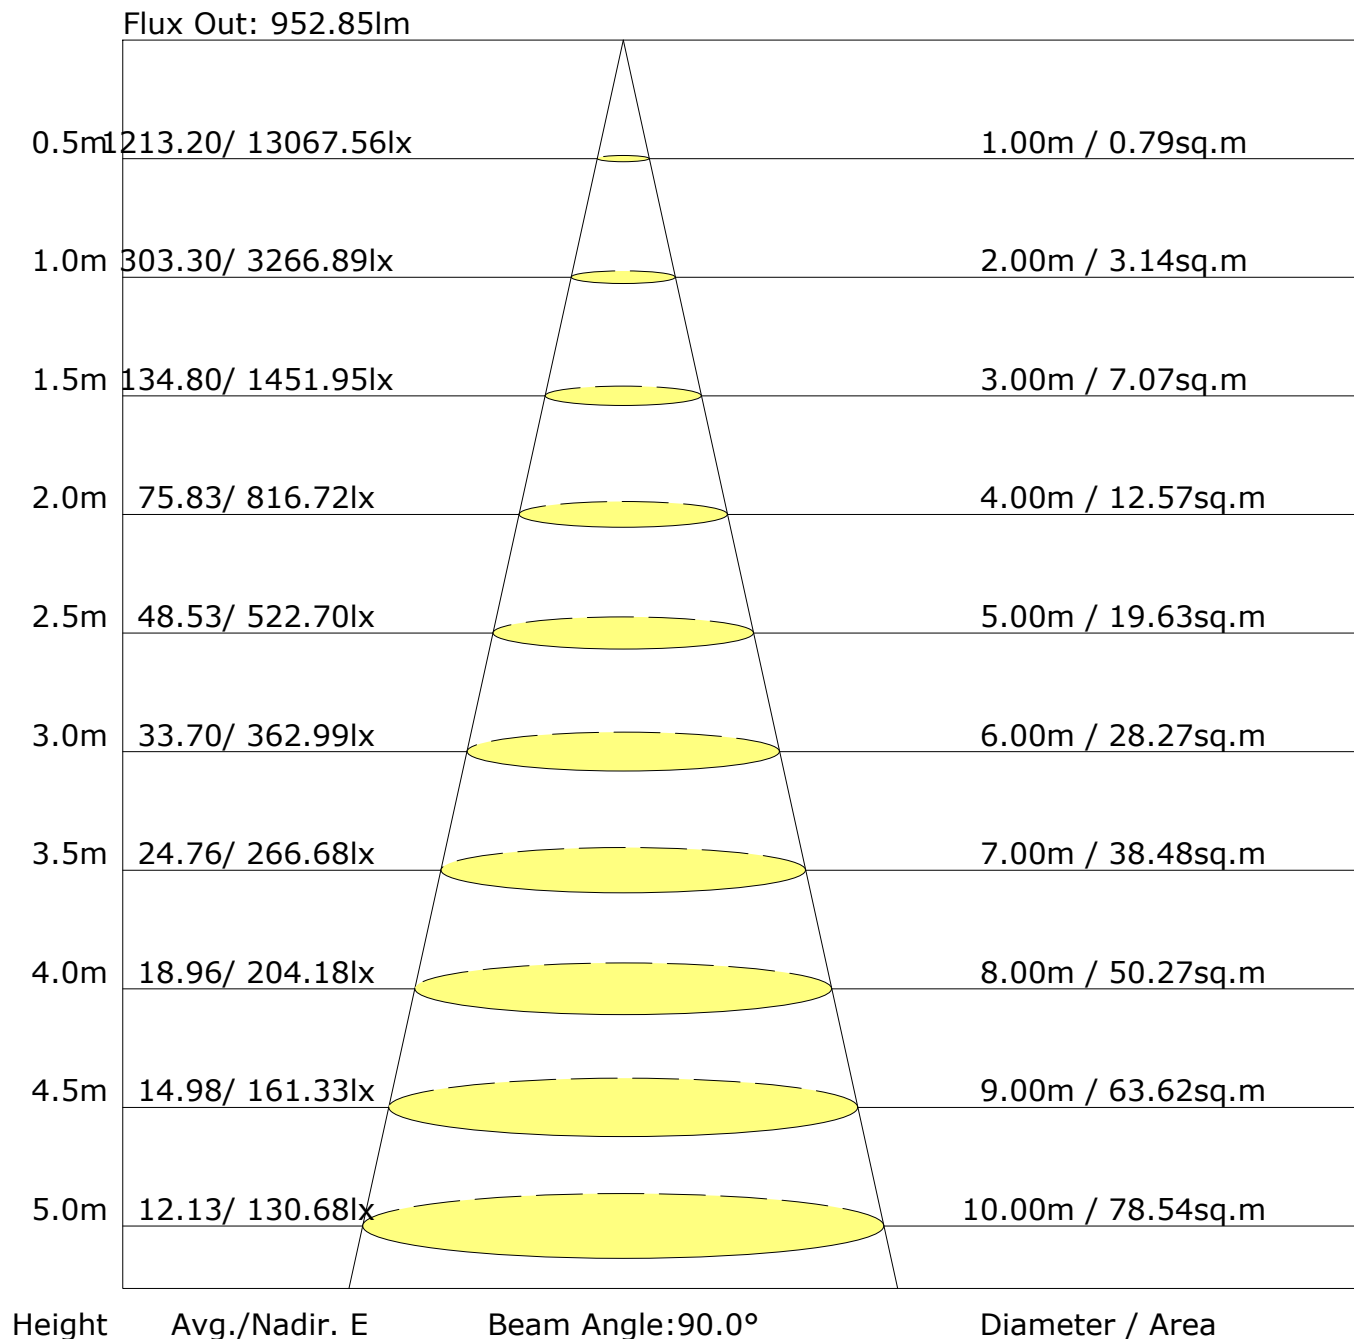

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	14.9	15.7	15.2	15.9	16.1	15.0	15.8	15.3	16.0	16.2
3H	18.1	18.9	18.4	19.1	19.4	18.2	19.0	18.5	19.2	19.4
4H	20.0	20.7	20.3	21.0	21.3	20.1	20.8	20.4	21.0	21.3
6H	22.1	22.8	22.5	23.1	23.4	22.1	22.8	22.5	23.1	23.4
8H	23.3	24.0	23.7	24.3	24.6	23.3	24.0	23.7	24.3	24.6
12H	24.6	25.3	25.0	25.6	25.9	24.6	25.3	25.0	25.6	25.9
X=4H Y=2H	16.1	16.8	16.4	17.1	17.4	16.2	16.9	16.5	17.1	17.4
3H	19.5	20.2	19.9	20.5	20.8	19.6	20.2	19.9	20.5	20.8
4H	21.5	22.1	21.9	22.5	22.8	21.6	22.1	22.0	22.5	22.8
6H	23.8	24.3	24.2	24.7	25.1	23.8	24.3	24.2	24.7	25.1
8H	25.1	25.5	25.5	25.9	26.3	25.1	25.5	25.5	25.9	26.3
12H	26.5	26.9	26.9	27.3	27.8	26.5	26.9	26.9	27.3	27.8
X=8H Y=4H	22.4	22.9	22.8	23.3	23.7	22.4	22.9	22.8	23.3	23.7
6H	24.9	25.3	25.4	25.8	26.2	24.9	25.3	25.4	25.8	26.2
8H	26.4	26.7	26.8	27.2	27.6	26.4	26.7	26.8	27.2	27.6
12H	28.0	28.3	28.5	28.8	29.3	28.0	28.3	28.5	28.8	29.3
X=12H Y=4H	22.6	23.1	23.1	23.5	23.9	22.7	23.1	23.1	23.5	23.9
6H	25.3	25.6	25.8	26.1	26.6	25.3	25.6	25.8	26.1	26.6
8H	26.8	27.1	27.3	27.6	28.1	26.8	27.1	27.3	27.6	28.1
Variations with the observer position at spacings:										
S=1.0H	+0.4/-0.4					+0.4/-0.4				
S=1.5H	+0.6/-0.7					+0.6/-0.8				
S=2.0H	+0.9/-1.1					+0.9/-1.1				

Calculate in accordance with CIE Pub.117. The table is revised with 1100lm ($8\log(F/F_0) = 0.3$).

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM


	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	572	52.0
	FL (0°-30°)	470	42.7
	FM (30°-60°)	49	4.5
	FH (60°-80°)	34	3.1
	FVH (80°-90°)	18	1.7
	BACK LIGHT	528	48.0
	BL (0°-30°)	431	39.2
	BM (30°-60°)	47	4.3
	BH (60°-80°)	33	3.0
	BVH (80°-90°)	18	1.6
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U1 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U1 G1

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

LCS Graph

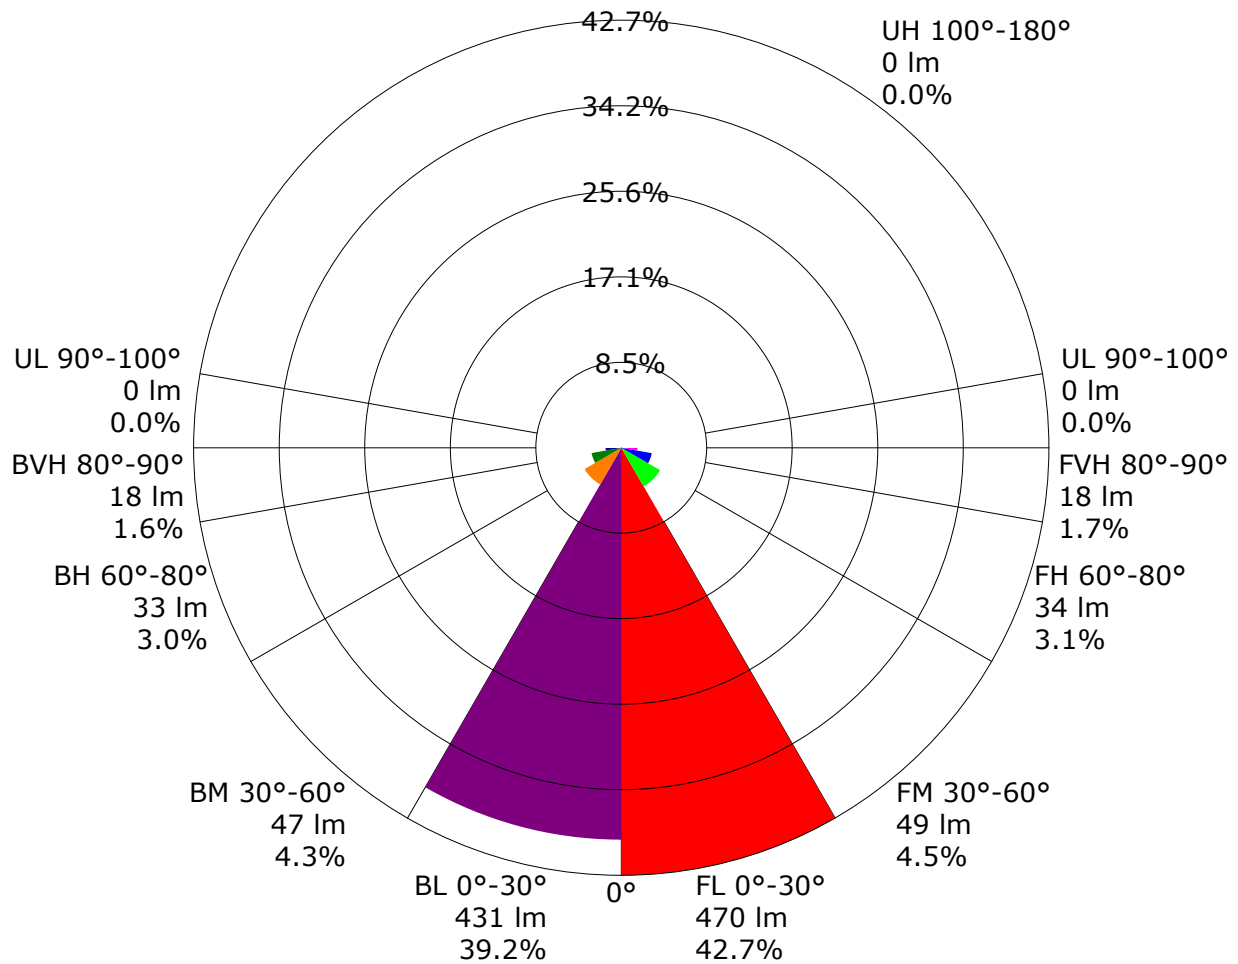

Back Light

Forward Light

Scale= MAX LCS%

Trapped Light:NA,NA

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.91	0.95	0.98	1.00	1.03	1.06	1.07	1.09	1.11	
	0.30		0.87	0.91	0.94	0.96	1.00	1.02	1.04	1.07	1.09	
	0.20		0.84	0.88	0.91	0.93	0.97	0.99	1.01	1.04	1.06	
0.50	0.50	0.20	0.90	0.93	0.96	0.98	1.00	1.02	1.04	1.06	1.07	
	0.30		0.86	0.90	0.92	0.94	0.97	0.99	1.01	1.03	1.05	
	0.20		0.84	0.87	0.90	0.92	0.95	0.97	0.99	1.01	1.03	
0.30	0.50	0.20	0.89	0.92	0.94	0.95	0.98	0.99	1.00	1.02	1.03	
	0.30		0.86	0.89	0.91	0.93	0.95	0.97	0.98	1.00	1.01	
	0.20		0.83	0.86	0.89	0.90	0.93	0.95	0.97	0.99	1.00	
0.00	0.00	0.00	0.82	0.84	0.86	0.88	0.90	0.91	0.93	0.94	0.95	
Rating:11W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.51	0.44	0.39	0.34	0.28	0.24	0.21	0.17	0.14	
	0.30		0.43	0.38	0.34	0.30	0.26	0.22	0.20	0.16	0.14	
	0.20		0.37	0.33	0.30	0.27	0.23	0.21	0.18	0.15	0.13	
0.50	0.50	0.20	0.49	0.41	0.36	0.32	0.27	0.27	0.20	0.16	0.13	
	0.30		0.41	0.36	0.32	0.29	0.24	0.21	0.18	0.15	0.13	
	0.20		0.36	0.32	0.29	0.26	0.22	0.19	0.17	0.14	0.12	
0.30	0.50	0.20	0.46	0.39	0.34	0.30	0.25	0.21	0.18	0.15	0.12	
	0.30		0.40	0.34	0.30	0.27	0.23	0.20	0.17	0.14	0.12	
	0.20		0.35	0.31	0.28	0.25	0.21	0.18	0.16	0.13	0.11	
0.00	0.00	0.00	0.21	0.18	0.16	0.15	0.12	0.11	0.10	0.08	0.07	
Rating:11W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.12	0.14	0.16	0.17	0.18	0.19	0.20	0.21	0.21	
	0.30		0.09	0.11	0.12	0.14	0.15	0.17	0.18	0.19	0.20	
	0.20		0.06	0.08	0.10	0.11	0.13	0.15	0.16	0.17	0.18	
0.50	0.50	0.20	0.12	0.14	0.15	0.16	0.18	0.18	0.19	0.20	0.20	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19	
	0.20		0.06	0.08	0.10	0.11	0.13	0.14	0.15	0.17	0.18	
0.30	0.50	0.20	0.12	0.13	0.15	0.16	0.17	0.18	0.18	0.19	0.20	
	0.30		0.08	0.10	0.12	0.13	0.15	0.16	0.17	0.18	0.18	
	0.20		0.06	0.08	0.10	0.11	0.13	0.14	0.15	0.16	0.17	
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Rating:11W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3261.6	3.1	3.1	0.28	0.28
1.0-2.0	3244.5	9.3	12.4	0.85	1.13
2.0-3.0	3210.1	15.4	27.8	1.40	2.53
3.0-4.0	3159.6	21.2	48.9	1.92	4.45
4.0-5.0	3097.5	26.7	75.6	2.42	6.87
5.0-6.0	3019.8	31.7	107.3	2.88	9.75
6.0-7.0	2929.1	36.4	143.7	3.30	13.06
7.0-8.0	2826.2	40.5	184.1	3.68	16.73
8.0-9.0	2711.2	43.9	228.1	3.99	20.73
9.0-10.0	2589.4	46.9	275.0	4.26	24.99
10.0-11.0	2451.6	49.0	324.0	4.45	29.44
11.0-12.0	2306.7	50.4	374.4	4.58	34.02
12.0-13.0	2158.4	51.2	425.6	4.66	38.68
13.0-14.0	1995.6	51.1	476.7	4.64	43.32
14.0-15.0	1827.0	50.2	526.9	4.56	47.88
15.0-16.0	1652.8	48.4	575.3	4.40	52.28
16.0-17.0	1473.7	45.9	621.2	4.17	56.45
17.0-18.0	1300.9	42.9	664.1	3.90	60.35
18.0-19.0	1128.5	39.3	703.4	3.57	63.92
19.0-20.0	962.6	35.2	738.6	3.20	67.12
20.0-21.0	811.5	31.2	769.8	2.83	69.95
21.0-22.0	671.6	27.0	796.8	2.45	72.41
22.0-23.0	549.4	23.1	819.8	2.10	74.50
23.0-24.0	442.5	19.4	839.2	1.76	76.26
24.0-25.0	351.5	16.0	855.1	1.45	77.71
25.0-26.0	278.7	13.2	868.3	1.20	78.91
26.0-27.0	218.1	10.7	879.0	0.97	79.88
27.0-28.0	170.2	8.6	887.6	0.78	80.66
28.0-29.0	136.0	7.1	894.7	0.65	81.31
29.0-30.0	110.1	5.9	900.7	0.54	81.85
30.0-31.0	91.8	5.1	905.8	0.46	82.31
31.0-32.0	79.0	4.5	910.3	0.41	82.72
32.0-33.0	70.0	4.1	914.4	0.37	83.10
33.0-34.0	63.6	3.9	918.3	0.35	83.45
34.0-35.0	58.4	3.6	921.9	0.33	83.78
35.0-36.0	54.0	3.4	925.3	0.31	84.09

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	50.8	3.3	928.7	0.30	84.39
37.0-38.0	48.1	3.2	931.9	0.29	84.68
38.0-39.0	45.6	3.1	935.0	0.28	84.97
39.0-40.0	43.8	3.1	938.0	0.28	85.24
40.0-41.0	42.3	3.0	941.0	0.27	85.52
41.0-42.0	41.2	3.0	944.0	0.27	85.79
42.0-43.0	40.1	3.0	947.0	0.27	86.06
43.0-44.0	38.9	2.9	949.9	0.27	86.33
44.0-45.0	37.8	2.9	952.8	0.26	86.59
45.0-46.0	36.9	2.9	955.7	0.26	86.85
46.0-47.0	36.0	2.9	958.6	0.26	87.11
47.0-48.0	35.1	2.8	961.4	0.26	87.37
48.0-49.0	34.4	2.8	964.3	0.26	87.63
49.0-50.0	34.1	2.8	967.1	0.26	87.89
50.0-51.0	33.7	2.9	970.0	0.26	88.15
51.0-52.0	33.4	2.9	972.8	0.26	88.41
52.0-53.0	33.5	2.9	975.7	0.26	88.67
53.0-54.0	33.5	3.0	978.7	0.27	88.94
54.0-55.0	33.4	3.0	981.7	0.27	89.21
55.0-56.0	33.2	3.0	984.7	0.27	89.48
56.0-57.0	33.0	3.0	987.7	0.27	89.76
57.0-58.0	33.0	3.1	990.7	0.28	90.04
58.0-59.0	33.0	3.1	993.8	0.28	90.32
59.0-60.0	32.8	3.1	996.9	0.28	90.60
60.0-61.0	32.7	3.1	1000.1	0.28	90.88
61.0-62.0	32.9	3.2	1003.2	0.29	91.17
62.0-63.0	33.0	3.2	1006.4	0.29	91.46
63.0-64.0	32.9	3.2	1009.7	0.29	91.75
64.0-65.0	33.1	3.3	1012.9	0.30	92.05
65.0-66.0	33.2	3.3	1016.2	0.30	92.35
66.0-67.0	33.1	3.3	1019.6	0.30	92.66
67.0-68.0	33.1	3.4	1022.9	0.31	92.96
68.0-69.0	32.9	3.4	1026.3	0.31	93.27
69.0-70.0	33.0	3.4	1029.7	0.31	93.57
70.0-71.0	33.0	3.4	1033.1	0.31	93.88
71.0-72.0	33.0	3.4	1036.5	0.31	94.20

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G0.0	3266.9	3265.4	3266.9	3265.4	3266.9					
G1.0	3273.3	3267.8	3242.3	3244.4	3273.3					
G2.0	3261.6	3256.4	3198.8	3211.7	3261.6					
G3.0	3230.1	3227.5	3137.9	3156.5	3230.1					
G4.0	3180.3	3188.8	3064.1	3091.4	3180.3					
G5.0	3121.7	3138.8	2978.4	3016.4	3121.7					
G6.0	3043.3	3064.8	2875.4	2919.7	3043.3					
G7.0	2956.0	2984.6	2766.2	2822.5	2956.0					
G8.0	2850.7	2889.5	2631.3	2708.9	2850.7					
G9.0	2738.7	2787.5	2504.1	2578.9	2738.7					
G10.0	2621.7	2678.8	2362.8	2443.1	2621.7					
G11.0	2477.7	2543.5	2201.9	2282.9	2477.7					
G12.0	2345.7	2414.8	2054.2	2133.0	2345.7					
G13.0	2200.8	2258.4	1892.6	1967.3	2200.8					
G14.0	2039.9	2112.1	1710.0	1783.9	2039.9					
G15.0	1875.9	1950.2	1548.5	1595.5	1875.9					
G16.0	1695.3	1773.2	1361.8	1421.7	1695.3					
G17.0	1520.7	1598.4	1193.2	1225.2	1520.7					
G18.0	1350.4	1422.6	1036.9	1059.8	1350.4					
G19.0	1158.8	1240.5	876.7	881.9	1158.8					
G20.0	996.2	1079.9	734.3	732.6	996.2					
G21.0	837.1	904.3	606.6	601.3	837.1					
G22.0	687.1	765.1	488.6	482.9	687.1					
G23.0	557.3	635.1	393.0	385.9	557.3					
G24.0	440.8	515.3	305.8	307.1	440.8					
G25.0	346.5	417.1	243.3	236.5	346.5					
G26.0	271.7	336.5	190.2	187.9	271.7					
G27.0	204.8	262.3	146.1	145.7	204.8					
G28.0	160.1	208.7	116.9	117.4	160.1					
G29.0	128.1	164.9	95.4	96.4	128.1					
G30.0	103.5	132.3	79.3	81.0	103.5					
G31.0	88.6	110.0	68.8	70.7	88.6					
G32.0	77.4	90.5	61.7	64.4	77.4					
G33.0	70.1	78.7	57.4	59.7	70.1					
G34.0	63.5	70.0	54.0	55.7	63.5					
G35.0	58.3	62.9	49.9	52.7	58.3					
G36.0	54.0	57.8	47.3	49.5	54.0					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G37.0	51.1	53.8	45.3	47.6	51.1					
G38.0	47.7	50.8	43.0	45.2	47.7					
G39.0	46.0	47.7	41.4	43.2	46.0					
G40.0	43.6	46.0	40.0	42.2	43.6					
G41.0	42.2	43.9	39.3	41.4	42.2					
G42.0	41.7	42.8	37.7	40.5	41.7					
G43.0	40.5	42.6	35.9	38.9	40.5					
G44.0	38.7	41.3	35.9	37.5	38.7					
G45.0	38.1	40.0	34.7	36.4	38.1					
G46.0	36.8	39.3	34.3	35.9	36.8					
G47.0	36.0	37.7	32.9	35.2	36.0					
G48.0	35.6	36.3	32.4	34.3	35.6					
G49.0	34.3	35.6	32.1	34.7	34.3					
G50.0	34.2	35.4	32.1	34.3	34.2					
G51.0	33.4	34.5	31.7	34.2	33.4					
G52.0	33.1	34.8	31.4	33.9	33.1					
G53.0	33.4	34.6	31.7	34.7	33.4					
G54.0	33.7	34.5	31.6	33.8	33.7					
G55.0	33.7	34.1	31.4	34.3	33.7					
G56.0	33.3	34.5	31.4	33.1	33.3					
G57.0	33.7	33.9	31.0	33.3	33.7					
G58.0	33.3	34.5	31.7	33.0	33.3					
G59.0	32.8	34.3	31.2	33.3	32.8					
G60.0	33.0	33.9	30.5	33.3	33.0					
G61.0	33.0	34.6	30.5	32.9	33.0					
G62.0	33.5	33.5	30.9	34.1	33.5					
G63.0	33.1	33.7	31.0	33.9	33.1					
G64.0	33.1	33.9	31.3	33.3	33.1					
G65.0	33.5	34.5	31.2	34.1	33.5					
G66.0	33.4	34.2	31.0	33.5	33.4					
G67.0	33.8	34.6	30.8	33.7	33.8					
G68.0	33.7	34.2	31.3	33.1	33.7					
G69.0	32.8	33.8	31.4	33.3	32.8					
G70.0	33.3	33.7	31.6	34.1	33.3					
G71.0	33.1	33.5	31.2	33.5	33.1					
G72.0	33.8	33.8	31.7	33.3	33.8					
G73.0	33.7	34.1	31.4	33.8	33.7					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Unit: cd

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector: