



Test Time: 2026-04-14 16:58

Luminaire Manufacturer: NORDECOR
Luminaire Description: 80081
Luminous Width (mm): 75
Current: 0.111 A
Power Factor: 0.495

Luminous Length (mm): 75
Voltage: 220.3 V
Power: 12.06 W



CIE Class: Direct	Total Rated Lamp Lumens: 1076.1 lm
Measurement Flux: 1076.1 lm	Efficiency: 100%
Downward Ratio: 100%	Upward Ratio: 0%
Horizontal Diffuse Angle(10%,50%,80%,100%): H49.4,H32.7,H20.1,H1	
Vertical Diffuse Angle(10%,50%,80%,100%): V50,V32.5,V20.2,V1	
Luminaire Efficacy Rating (LER): 89.28	Central Intensity: 3039.73 cd
Max. Intensity: 3043.92 cd	Pos of Max. Intensity: H180 V1
S/MH(C0/C180): 0.55	S/MH(C90/C270): 0.55

Luminous Intensity Distribution Curve

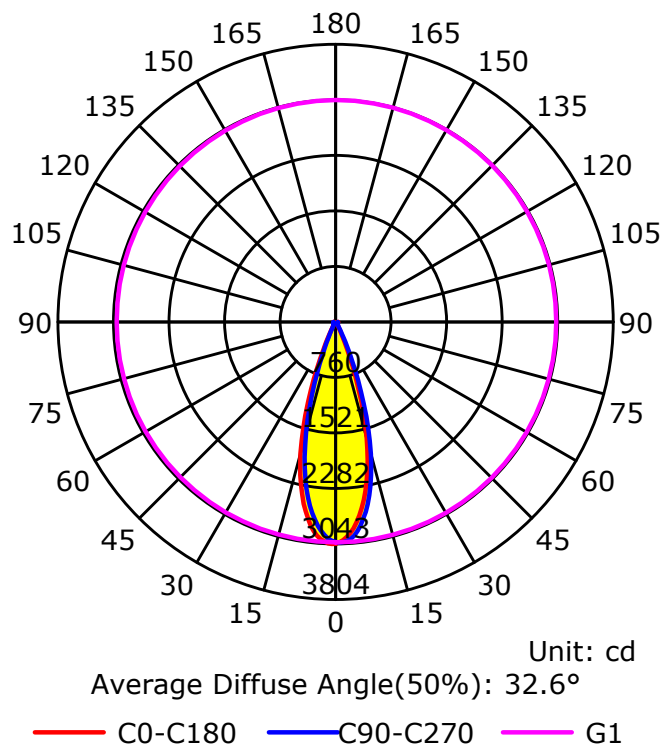

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve

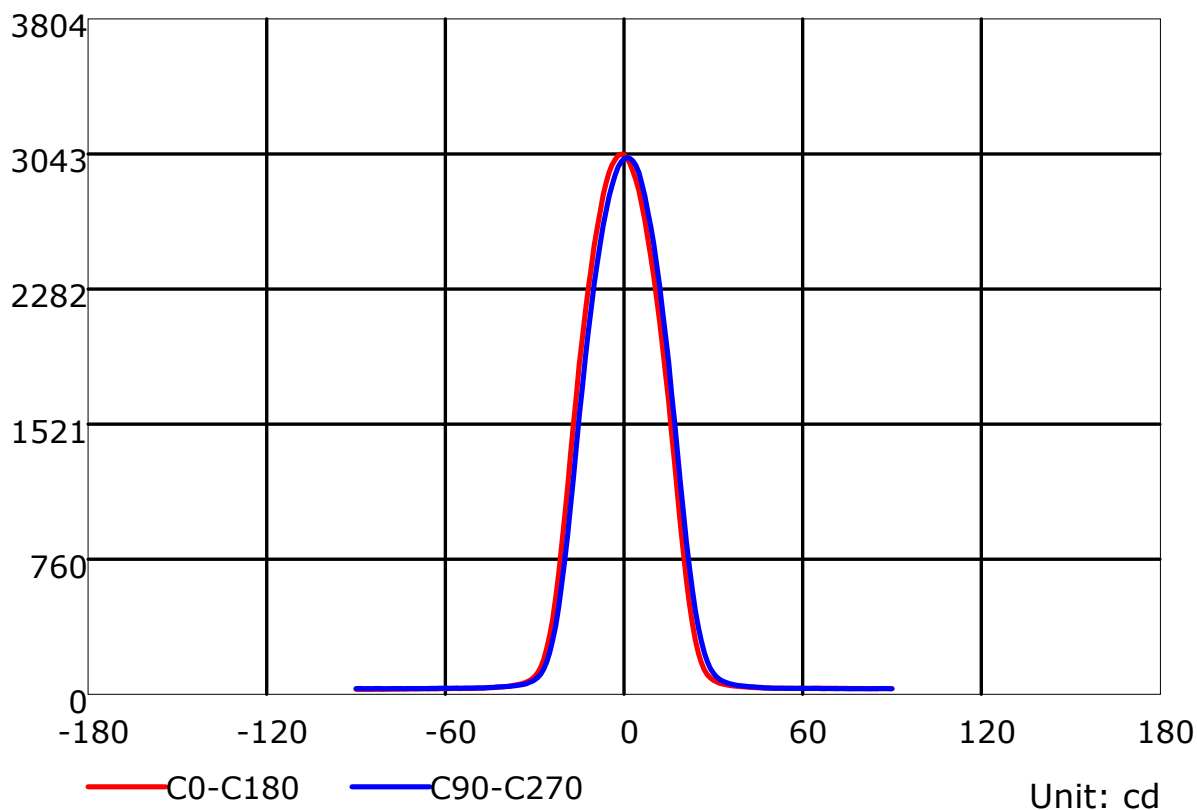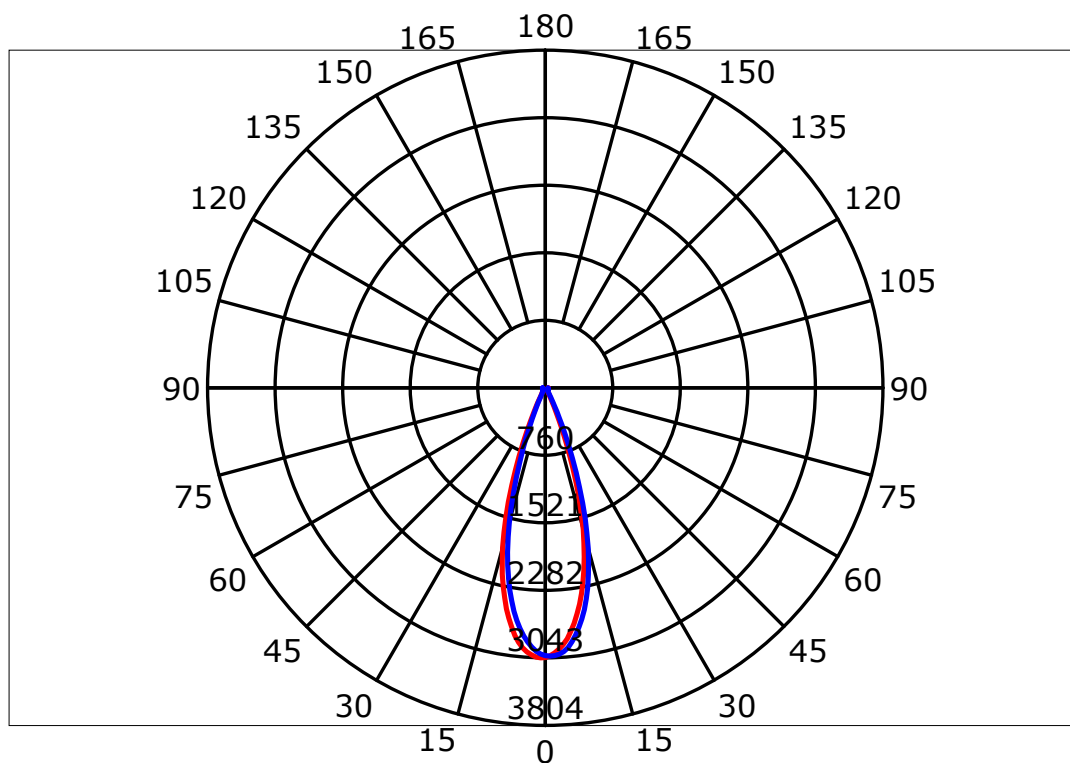

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

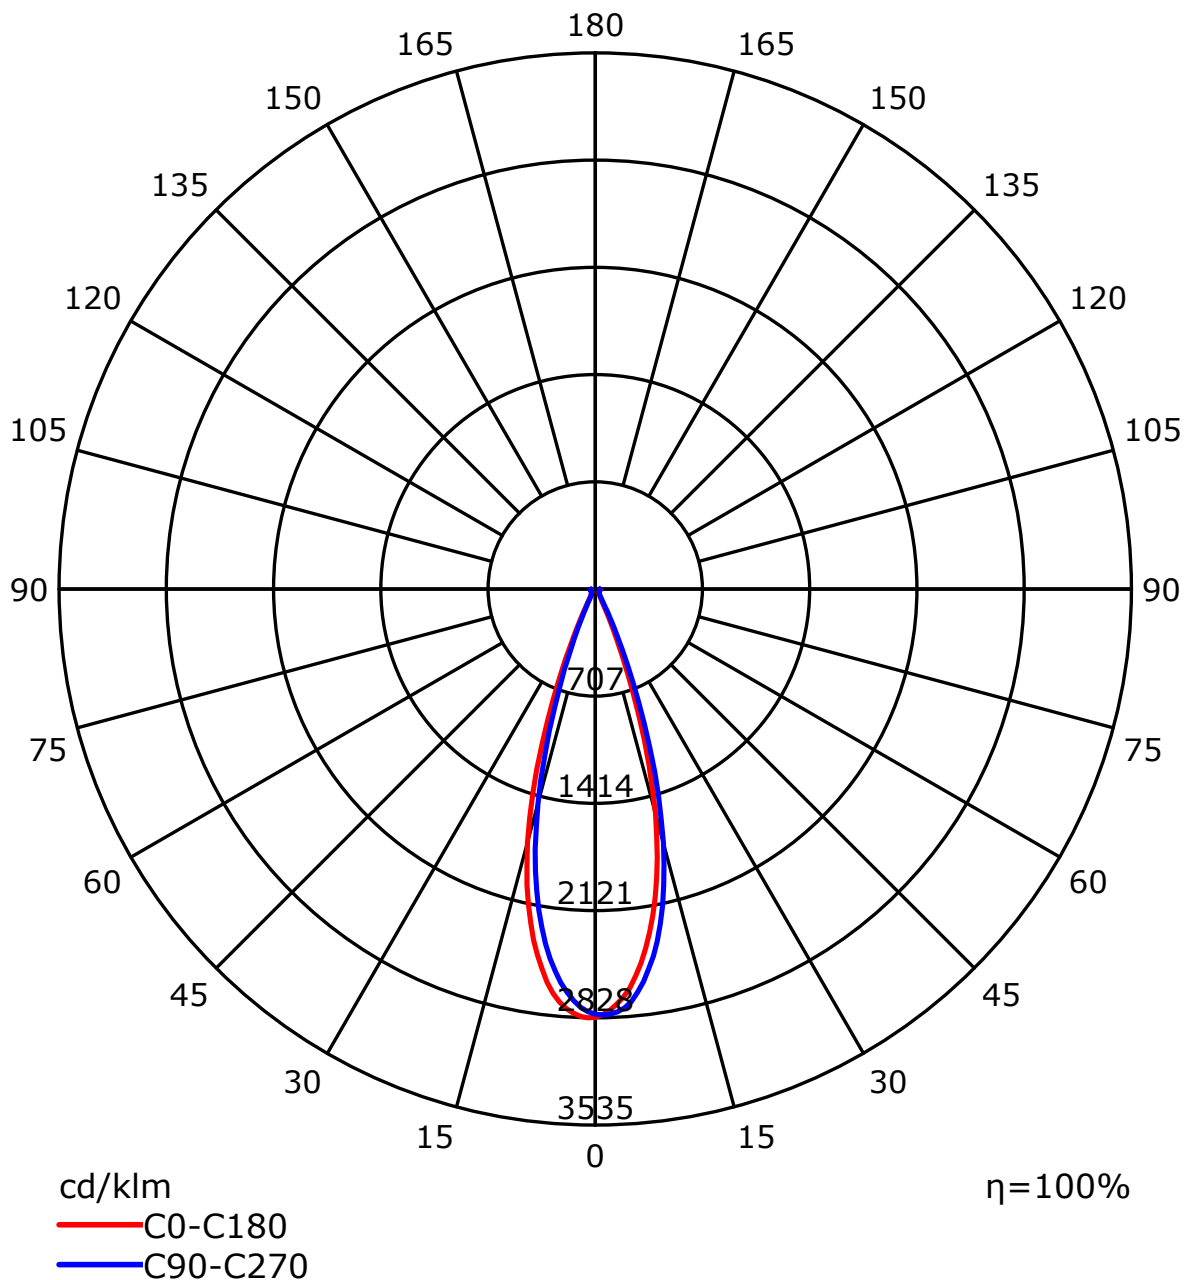


C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91
2	107	102	97	94	105	100	96	93	97	93	91	94	91	89	91	89	87	85
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80
4	98	91	85	81	96	90	85	81	87	83	80	86	82	79	84	81	78	77
5	94	86	81	77	93	86	80	77	84	79	76	82	78	75	81	77	75	73
6	91	83	77	73	89	82	77	73	80	76	73	79	75	72	78	74	72	70
7	88	79	74	70	86	79	74	70	78	73	70	76	72	69	75	72	69	68
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	67	65
9	82	74	68	65	81	73	68	65	72	68	65	71	67	65	71	67	64	63
10	79	71	66	63	79	71	66	63	70	66	63	69	65	62	69	65	62	61

Spacing Criteria (0-180): 0.55
Spacing Criteria (90-270): 0.55
Spacing Criteria (Diagonal): 0.51

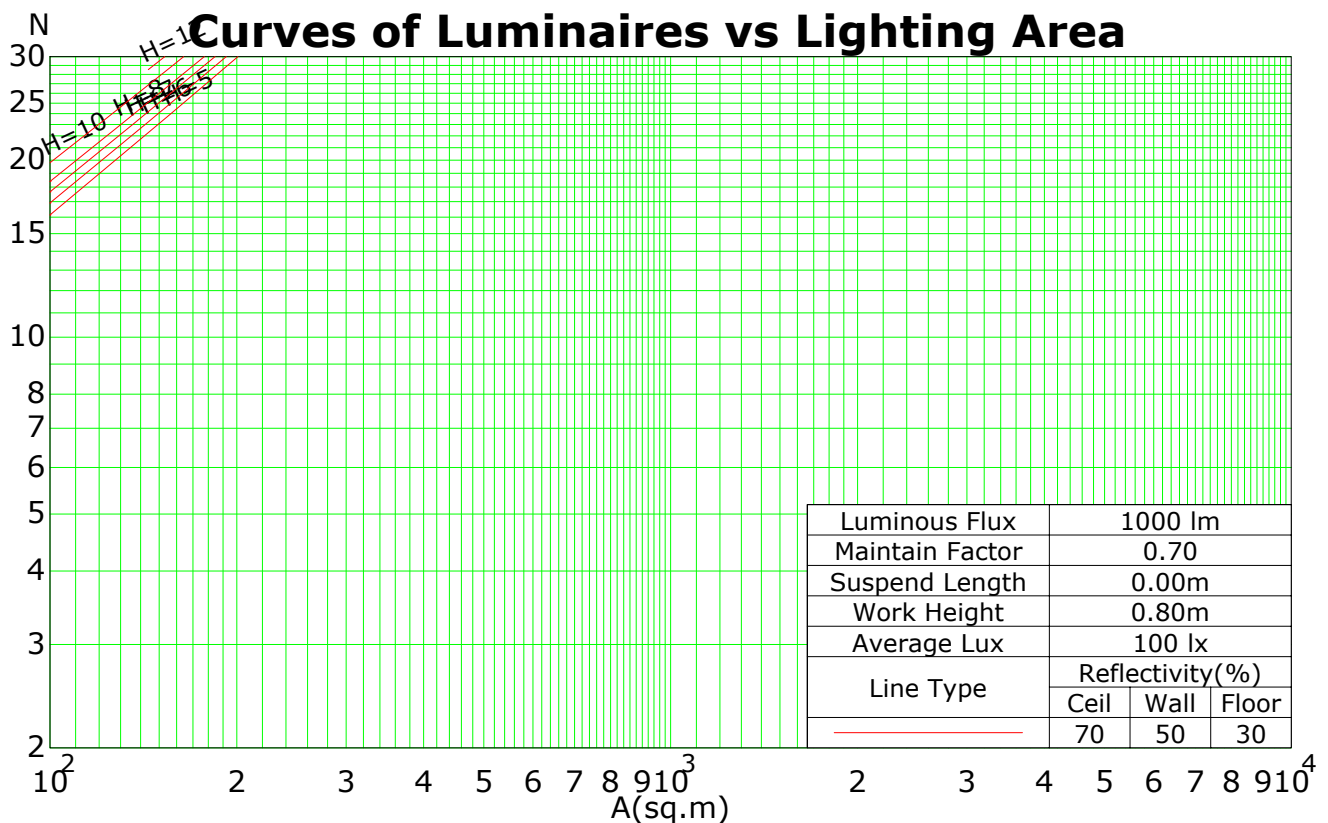

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:


Isocandela (rectangle)

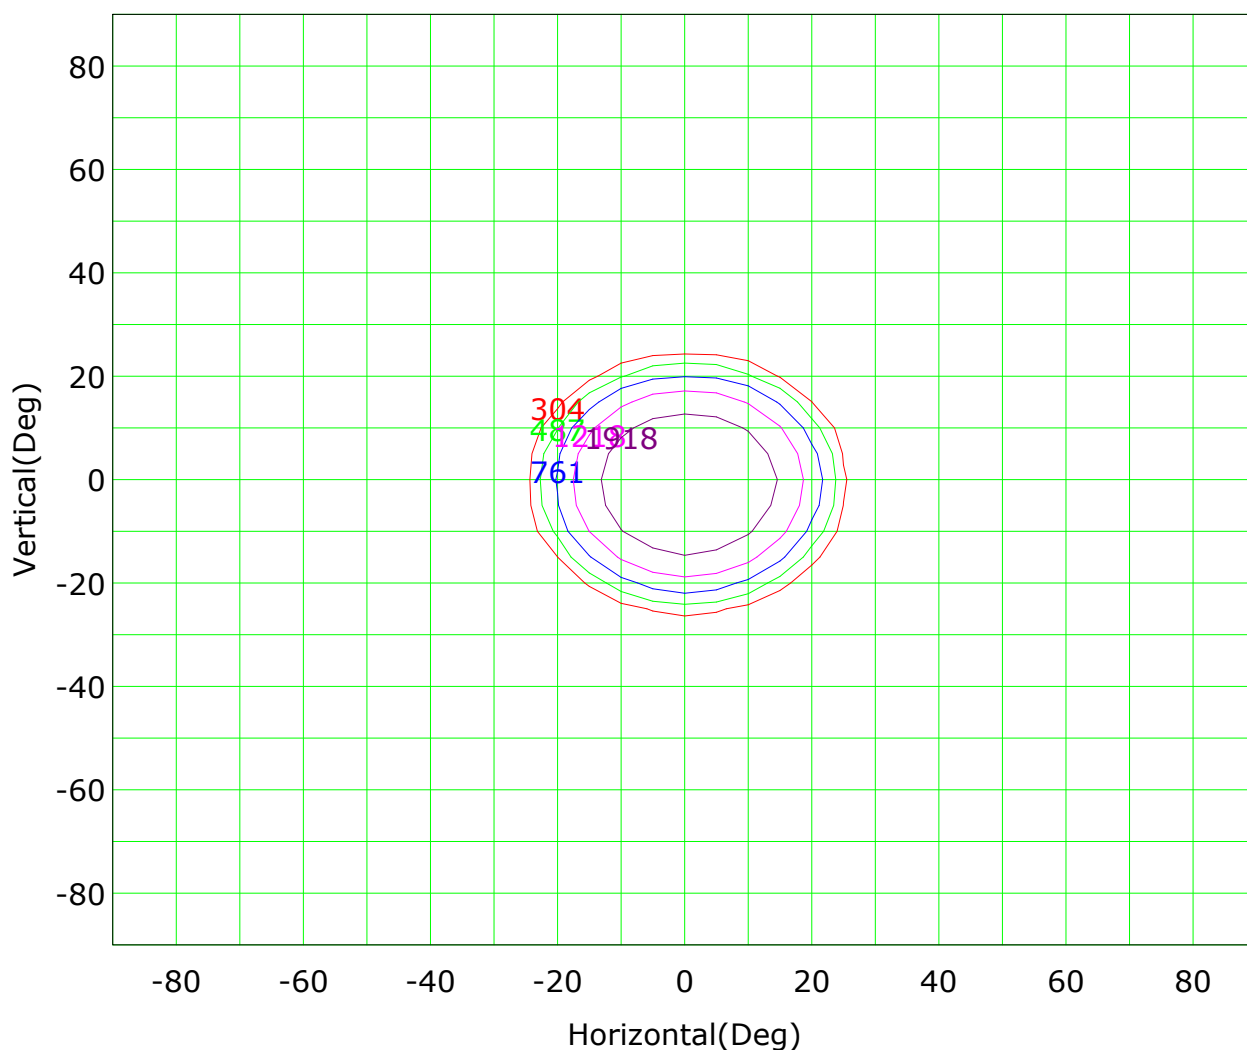

I_{max} (100%): 3044 cd

(10%): 304 cd	(16%): 487 cd
(25%): 761 cd	(40%): 1218 cd
(63%): 1918 cd	(100%): 3044 cd

Isocandela (sphere)

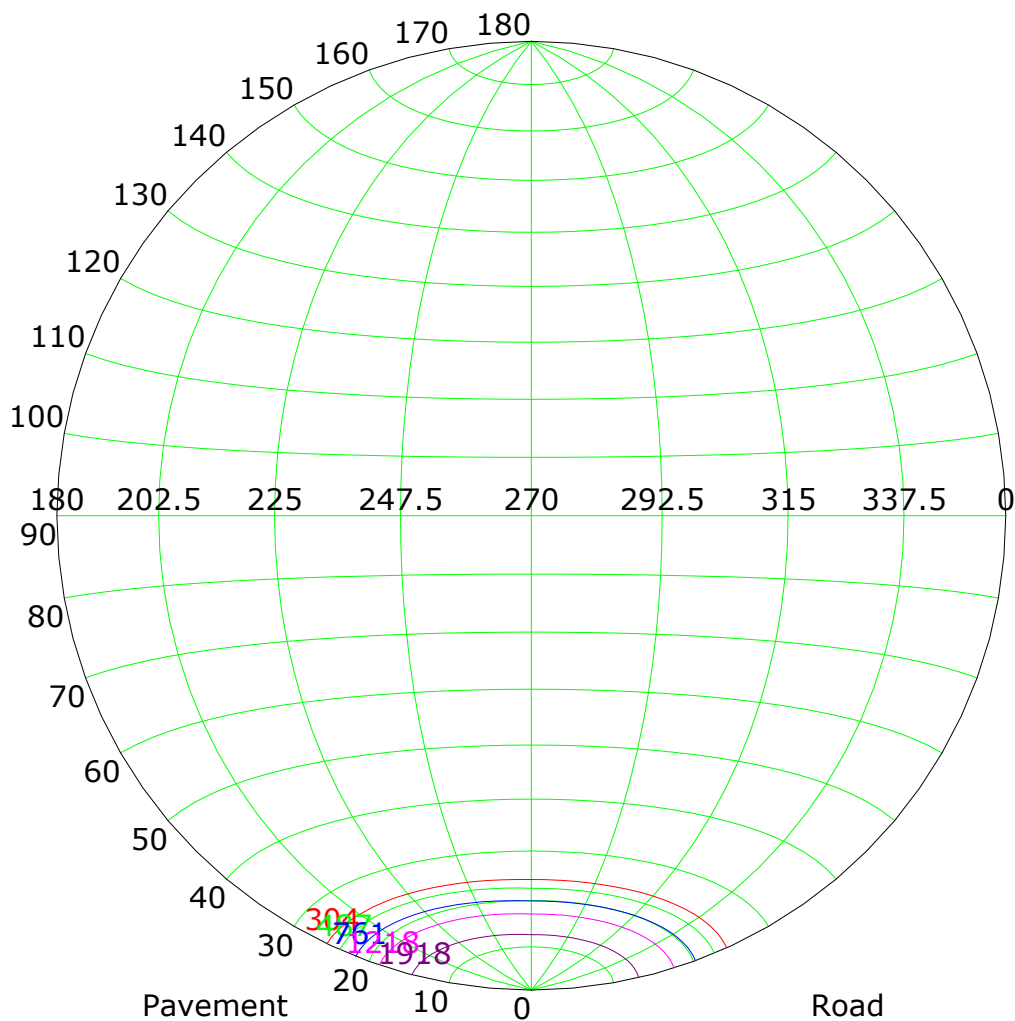

Imax (100%): 3044 cd


(10%): 304 cd
(25%): 761 cd
(63%): 1918 cd

(16%): 487 cd
(40%): 1218 cd
(100%): 3044 cd

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

IsoLux Plot

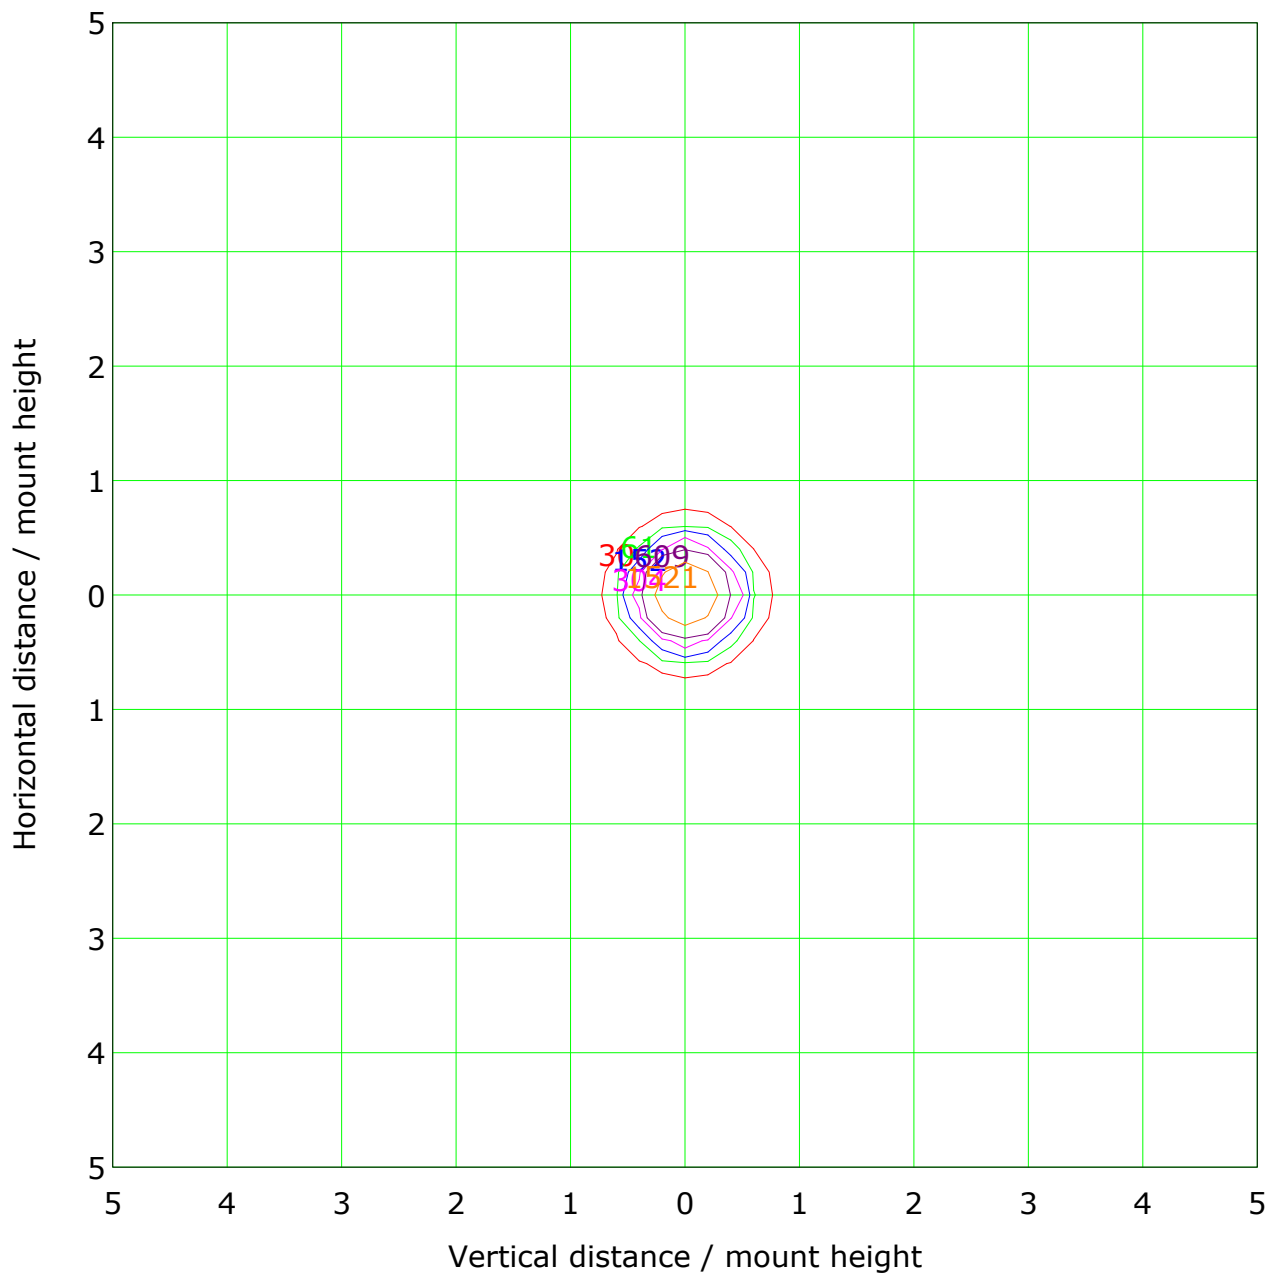

Mounting Height: 1.0m Max Lux(100%): 3042.5 lx


(1%): 30.4 lx	(2%): 60.9 lx
(5%): 152.1 lx	(10%): 304.3 lx
(20%): 608.5 lx	(50%): 1521.3 lx
(100%): 3042.5 lx	

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Roadway CU Curve

Efficiency(%)

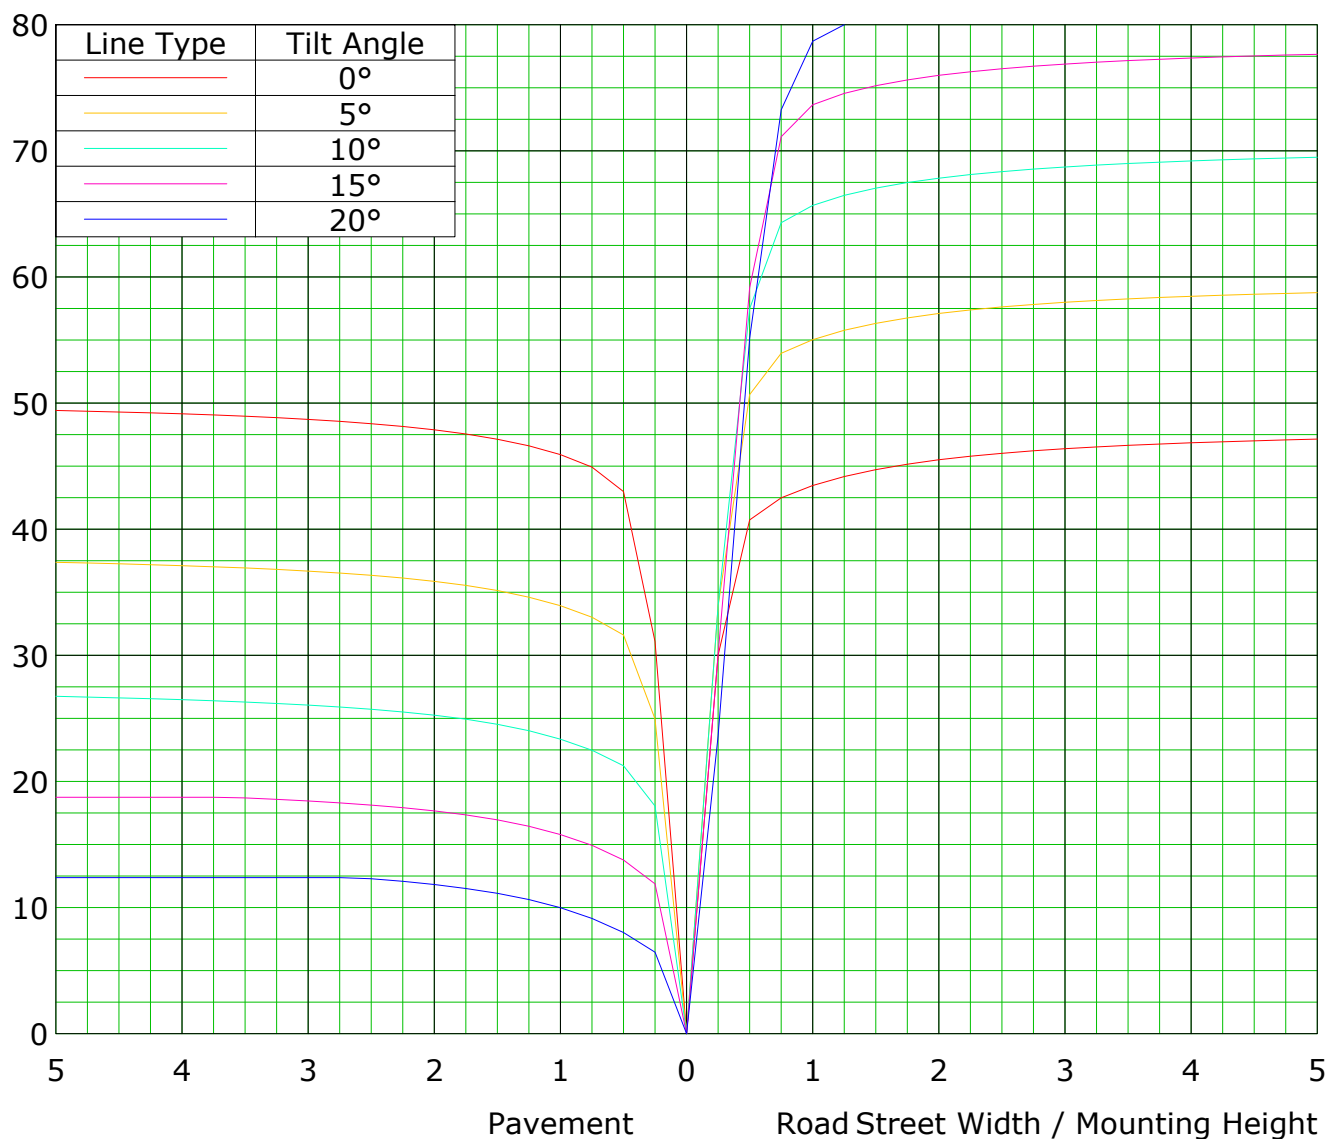

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L



Distance: 8.443 m

Humidity:

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

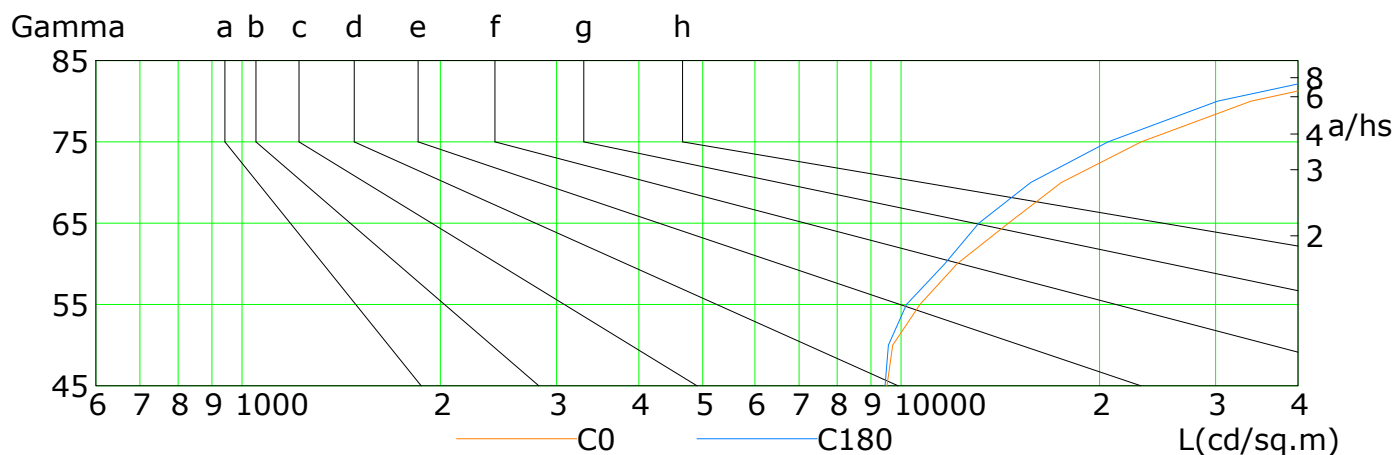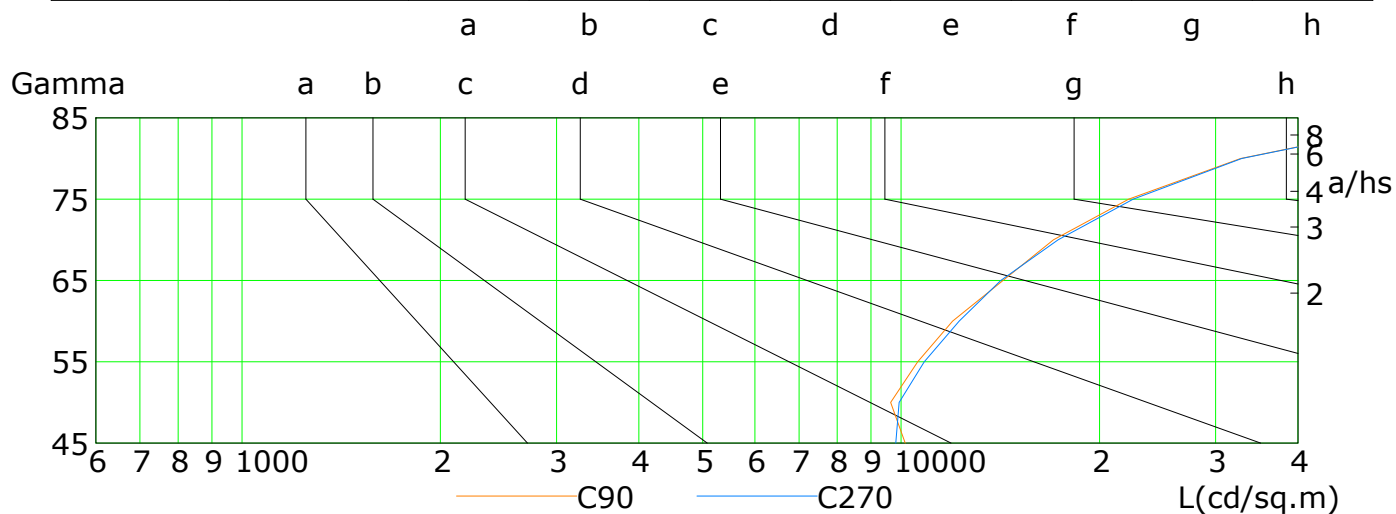

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	9519	9710	10678	12156	14551	17501	23127	33928	65211
C90	10145	9639	10597	11972	14273	17023	22138	32730	65211
C180	9453	9567	10191	11644	13116	15729	20606	30181	58256
C270	9815	9929	10842	12249	14164	17299	22495	32863	65477

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1600L

Distance: 8.443 m


Humidity:

Inspector:

Illuminance at a Distance

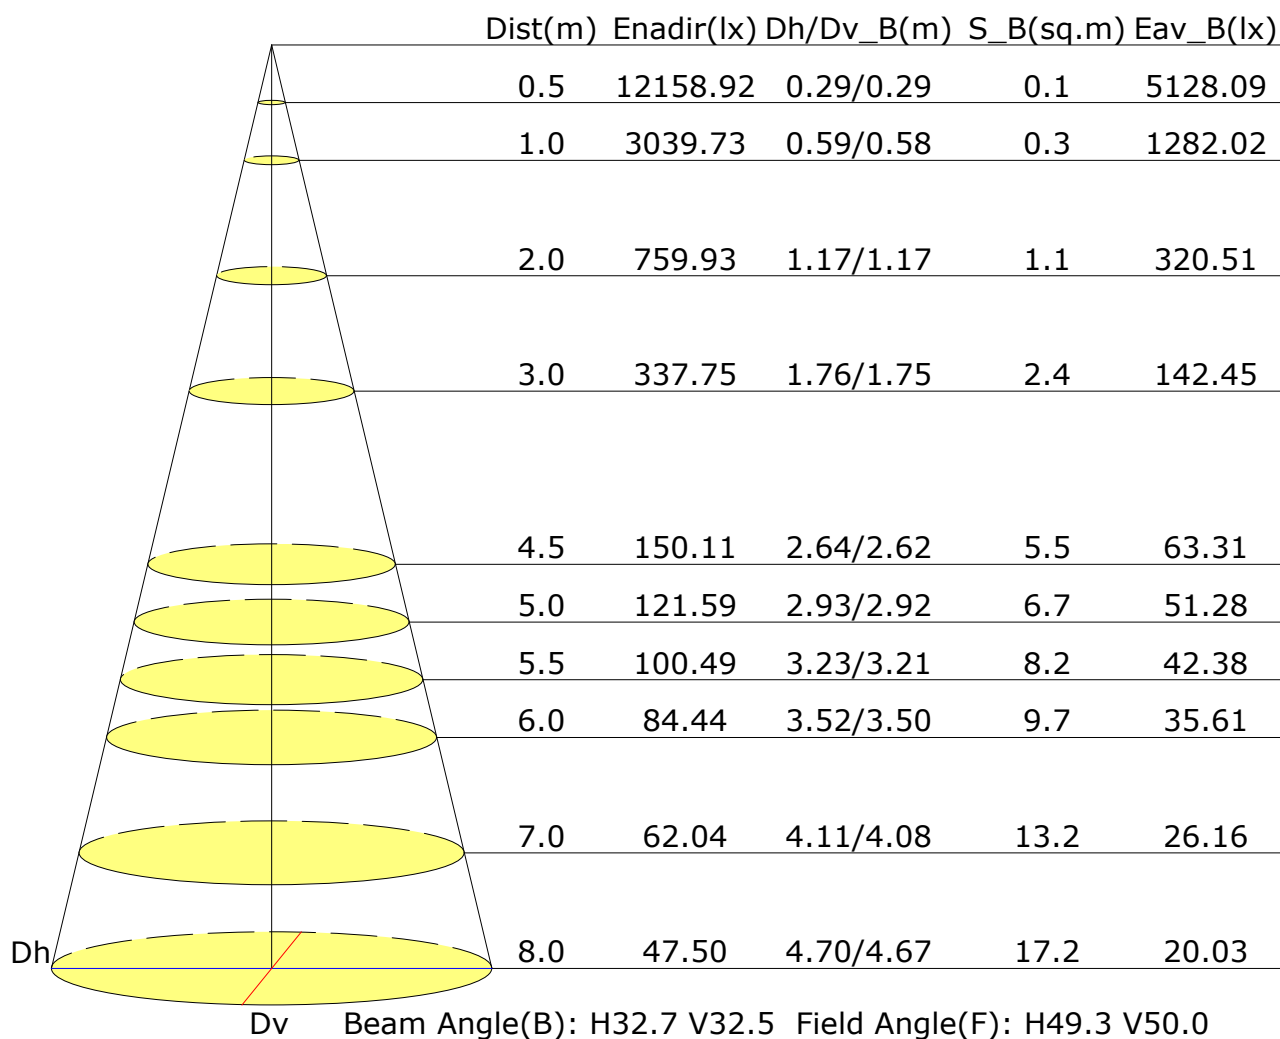

Vertical IsoLux Plot

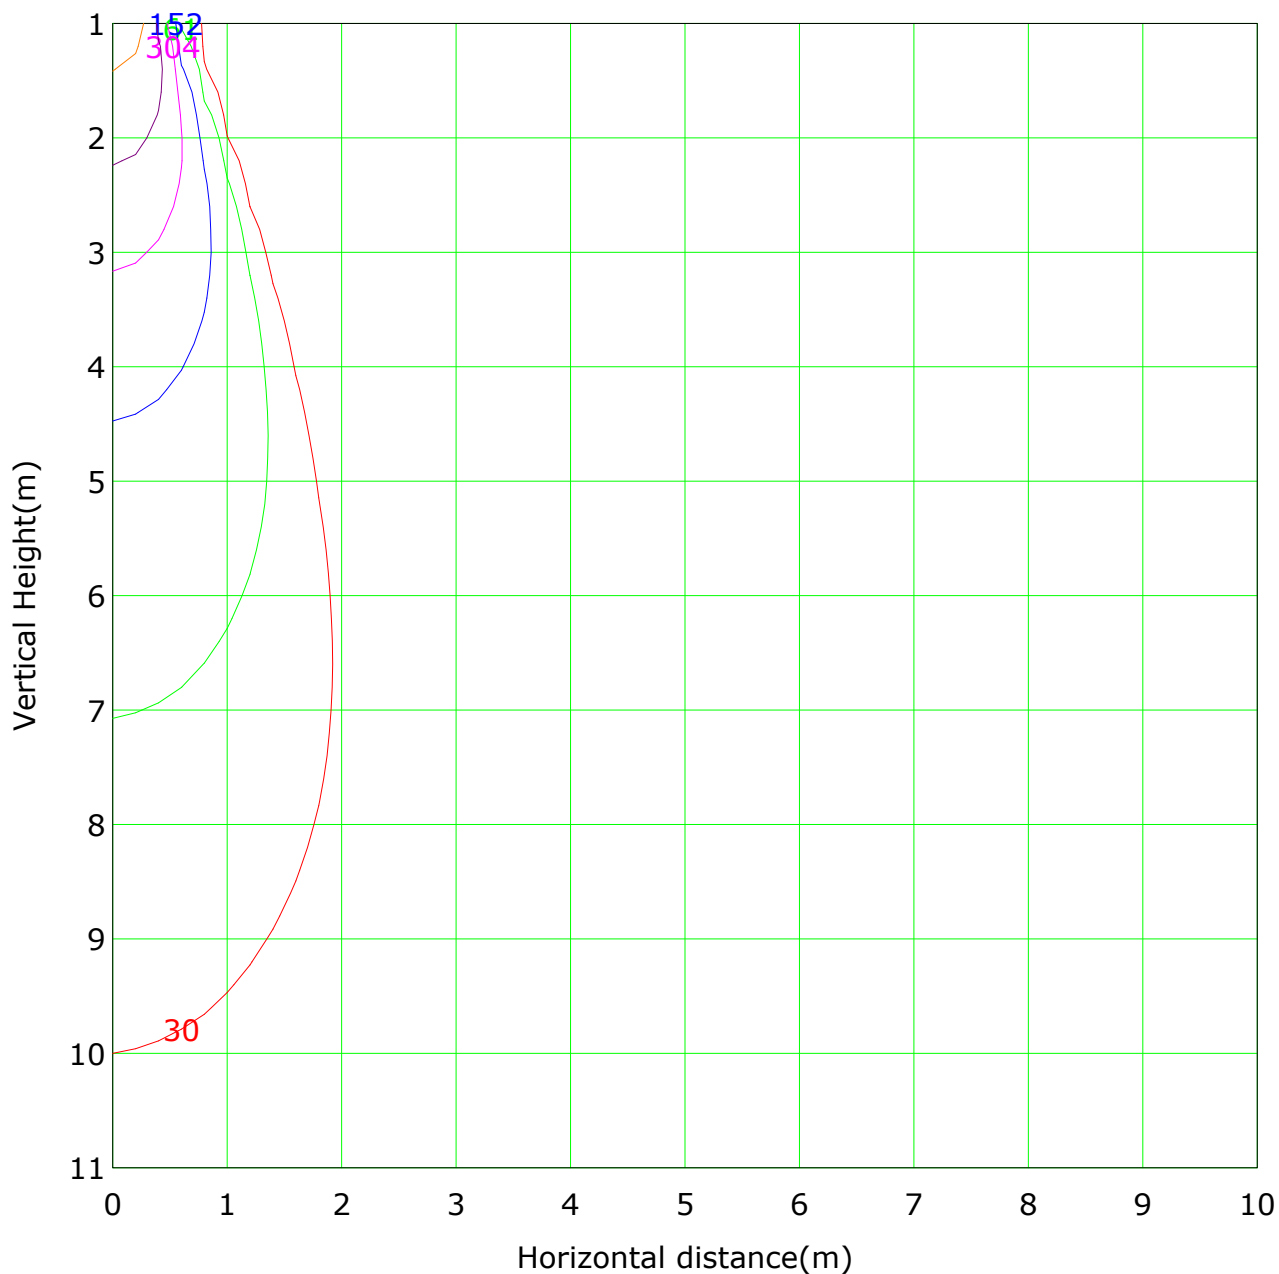

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 3039.7 lx

(1%): 30.4 lx	(2%): 60.8 lx
(5%): 152.0 lx	(10%): 304.0 lx
(20%): 607.9 lx	(50%): 1519.9 lx
(100%): 3039.7 lx	

C Plane (°): 0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-90.0: 1.0

Test Device: GPM-1600L


Distance: 8.443 m

Humidity:

Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

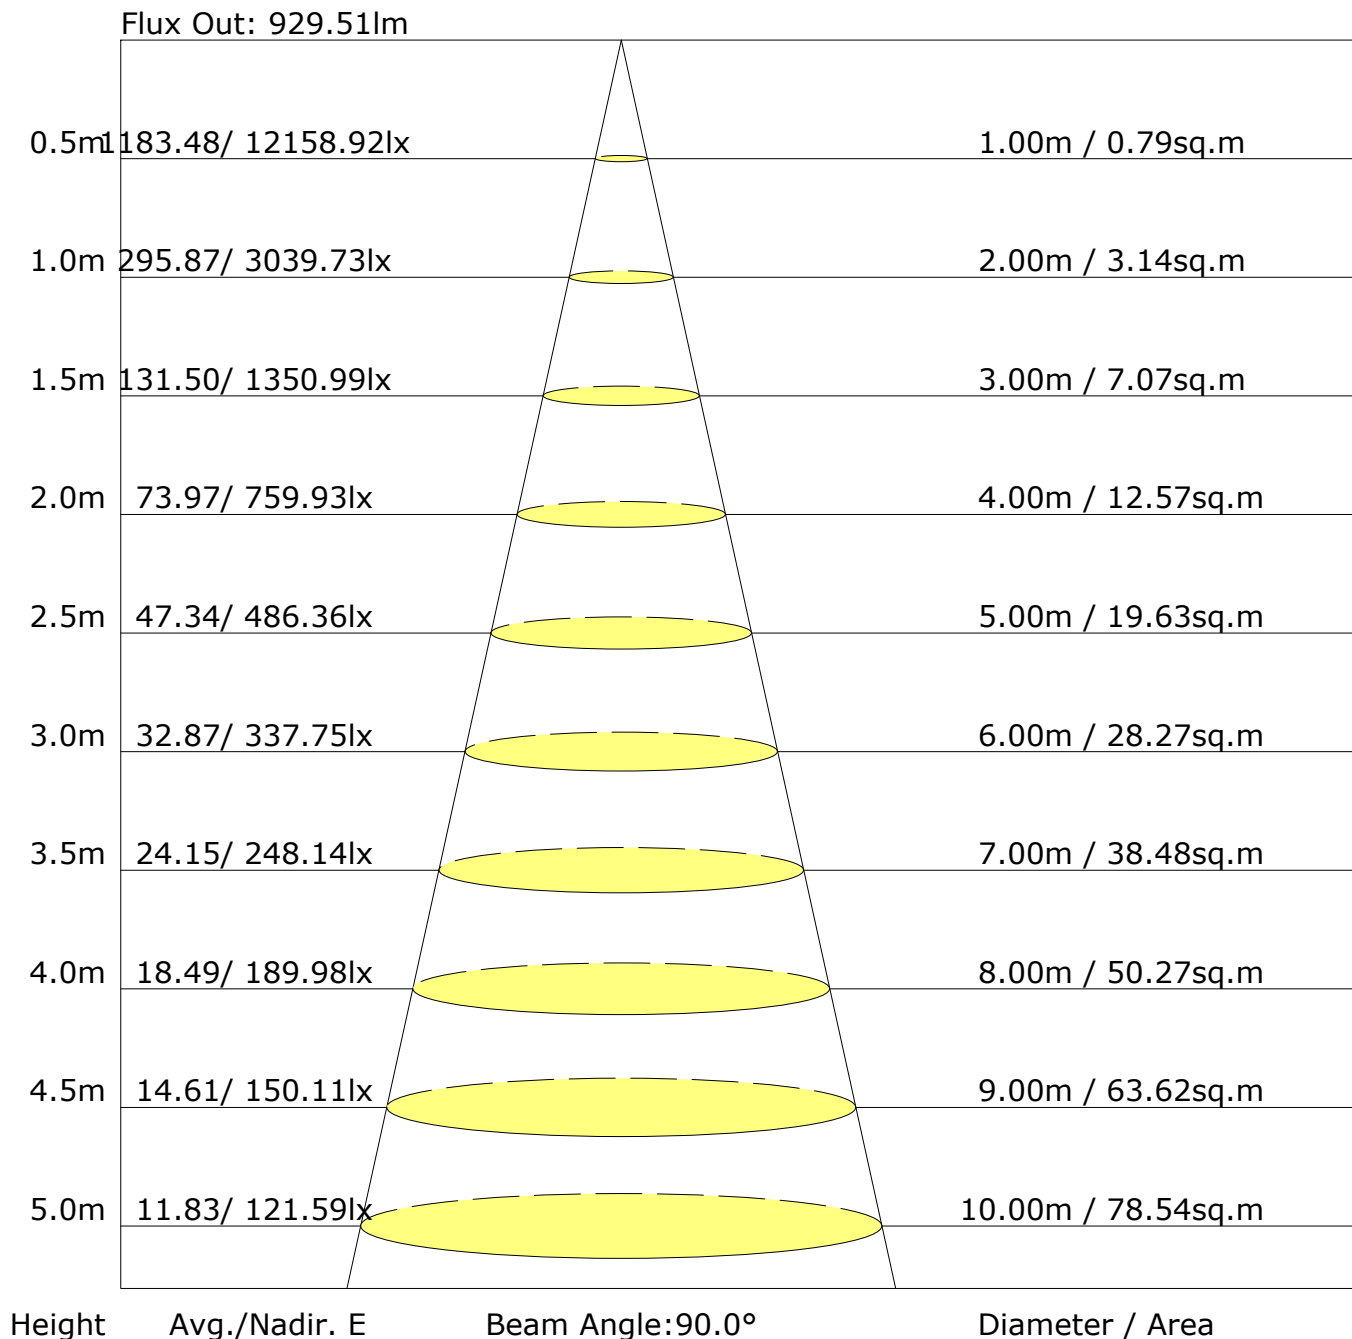

C Plane (°): 0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	15.6	16.4	15.8	16.6	16.8	15.6	16.4	15.9	16.6	16.8
3H	18.8	19.5	19.1	19.8	20.0	18.7	19.4	19.0	19.7	19.9
4H	20.6	21.3	20.9	21.6	21.8	20.5	21.2	20.8	21.4	21.7
6H	22.6	23.3	22.9	23.6	23.8	22.5	23.2	22.8	23.4	23.7
8H	23.7	24.4	24.1	24.7	25.0	23.6	24.3	24.0	24.6	24.9
12H	25.0	25.6	25.4	25.9	26.3	24.9	25.6	25.3	25.9	26.2
X=4H Y=2H	16.7	17.5	17.1	17.7	18.0	16.8	17.5	17.1	17.7	18.0
3H	20.1	20.8	20.5	21.1	21.4	20.0	20.7	20.4	21.0	21.3
4H	22.1	22.6	22.5	23.0	23.3	22.0	22.5	22.4	22.9	23.2
6H	24.2	24.8	24.7	25.1	25.5	24.2	24.7	24.6	25.0	25.4
8H	25.4	25.9	25.9	26.3	26.7	25.4	25.9	25.8	26.3	26.7
12H	26.8	27.3	27.3	27.7	28.1	26.8	27.2	27.2	27.6	28.1
X=8H Y=4H	22.9	23.4	23.3	23.7	24.2	22.8	23.3	23.2	23.7	24.1
6H	25.3	25.7	25.8	26.1	26.6	25.3	25.6	25.7	26.1	26.5
8H	26.7	27.1	27.2	27.5	28.0	26.7	27.0	27.1	27.5	27.9
12H	28.3	28.6	28.8	29.1	29.6	28.3	28.6	28.8	29.1	29.6
X=12H Y=4H	23.1	23.5	23.5	24.0	24.4	23.0	23.5	23.5	23.9	24.3
6H	25.7	26.0	26.1	26.5	26.9	25.6	26.0	26.1	26.4	26.9
8H	27.2	27.5	27.7	28.0	28.5	27.1	27.5	27.6	27.9	28.4
Variations with the observer position at spacings:										
S=1.0H	+0.4/-0.4					+0.4/-0.4				
S=1.5H	+0.6/-0.8					+0.6/-0.7				
S=2.0H	+0.8/-1.1					+0.9/-1.1				

Calculate in accordance with CIE Pub.117. The table is revised with 1076lm ($8\log(F/F_0) = 0.3$).

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM


	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	525	48.7
	FL (0°-30°)	424	39.4
	FM (30°-60°)	49	4.5
	FH (60°-80°)	34	3.2
	FVH (80°-90°)	18	1.6
	BACK LIGHT	552	51.3
	BL (0°-30°)	453	42.1
	BM (30°-60°)	49	4.6
	BH (60°-80°)	33	3.0
	BVH (80°-90°)	17	1.5
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U1 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U1 G1

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

LCS Graph

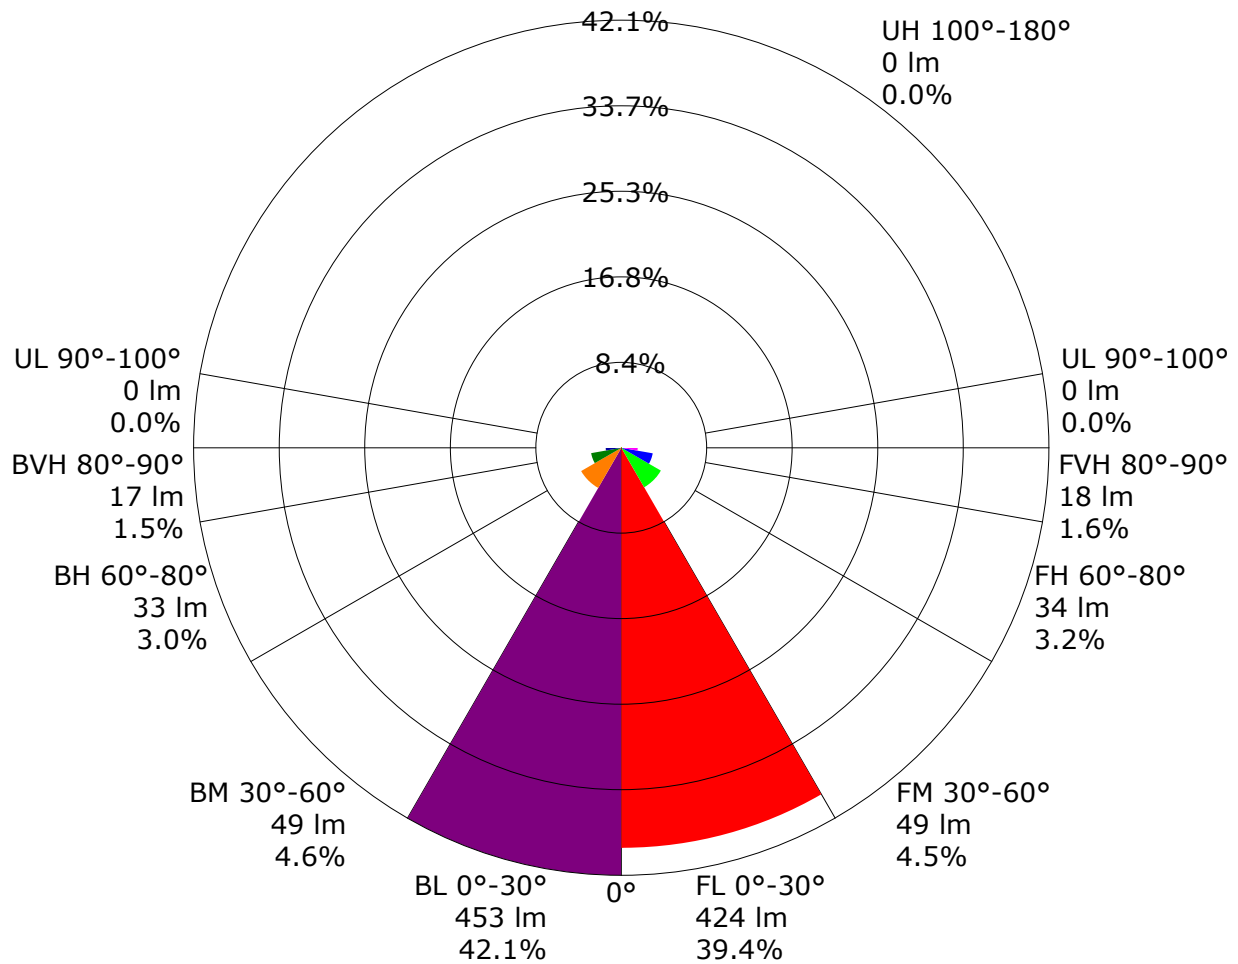

Back Light

Scale= MAX LCS%

Trapped Light:NA,NA

Forward Light

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.91	0.95	0.98	1.00	1.03	1.05	1.07	1.09	1.11	
	0.30		0.87	0.91	0.94	0.96	0.99	1.02	1.04	1.06	1.08	
	0.20		0.84	0.87	0.90	0.93	0.96	0.99	1.01	1.04	1.06	
0.50	0.50	0.20	0.90	0.93	0.96	0.97	1.00	1.02	1.03	1.05	1.07	
	0.30		0.86	0.89	0.92	0.94	0.97	0.99	1.01	1.03	1.05	
	0.20		0.83	0.87	0.89	0.91	0.95	0.97	0.99	1.01	1.03	
0.30	0.50	0.20	0.89	0.91	0.94	0.95	0.97	0.99	1.00	1.02	1.03	
	0.30		0.85	0.88	0.91	0.92	0.95	0.97	0.98	1.00	1.01	
	0.20		0.83	0.86	0.88	0.90	0.93	0.95	0.96	0.98	1.00	
0.00	0.00	0.00	0.82	0.84	0.86	0.88	0.90	0.91	0.92	0.94	0.95	
Rating:12W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.51	0.44	0.39	0.34	0.28	0.24	0.21	0.17	0.14	
	0.30		0.43	0.38	0.34	0.30	0.26	0.22	0.20	0.16	0.14	
	0.20		0.37	0.33	0.30	0.27	0.23	0.21	0.18	0.15	0.13	
0.50	0.50	0.20	0.49	0.41	0.36	0.32	0.26	0.27	0.20	0.16	0.13	
	0.30		0.41	0.36	0.32	0.29	0.24	0.21	0.18	0.15	0.13	
	0.20		0.36	0.32	0.29	0.26	0.22	0.19	0.17	0.14	0.12	
0.30	0.50	0.20	0.46	0.39	0.34	0.30	0.25	0.21	0.18	0.15	0.12	
	0.30		0.40	0.34	0.30	0.27	0.23	0.20	0.17	0.14	0.12	
	0.20		0.35	0.31	0.28	0.25	0.21	0.18	0.16	0.13	0.11	
0.00	0.00	0.00	0.21	0.18	0.16	0.15	0.12	0.11	0.10	0.08	0.07	
Rating:12W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.12	0.14	0.16	0.17	0.18	0.19	0.20	0.21	0.21	
	0.30		0.09	0.11	0.12	0.14	0.15	0.17	0.18	0.19	0.20	
	0.20		0.06	0.08	0.10	0.11	0.13	0.14	0.16	0.17	0.18	
0.50	0.50	0.20	0.12	0.14	0.15	0.16	0.18	0.18	0.19	0.20	0.20	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19	
	0.20		0.06	0.08	0.10	0.11	0.13	0.14	0.15	0.17	0.18	
0.30	0.50	0.20	0.12	0.13	0.15	0.15	0.17	0.18	0.18	0.19	0.20	
	0.30		0.08	0.10	0.12	0.13	0.14	0.16	0.16	0.18	0.18	
	0.20		0.06	0.08	0.10	0.11	0.12	0.14	0.15	0.16	0.17	
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Rating:12W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3025.3	2.9	2.9	0.27	0.27
1.0-2.0	3013.2	8.6	11.5	0.80	1.07
2.0-3.0	2989.0	14.3	25.8	1.33	2.40
3.0-4.0	2953.4	19.8	45.6	1.84	4.24
4.0-5.0	2907.4	25.0	70.6	2.32	6.56
5.0-6.0	2846.7	29.9	100.5	2.78	9.34
6.0-7.0	2772.9	34.4	135.0	3.20	12.54
7.0-8.0	2687.1	38.5	173.4	3.57	16.12
8.0-9.0	2590.7	42.0	215.4	3.90	20.02
9.0-10.0	2487.5	45.0	260.4	4.18	24.20
10.0-11.0	2371.9	47.4	307.8	4.40	28.61
11.0-12.0	2246.1	49.1	357.0	4.56	33.17
12.0-13.0	2112.5	50.1	407.1	4.66	37.83
13.0-14.0	1965.7	50.3	457.4	4.68	42.51
14.0-15.0	1814.5	49.8	507.2	4.63	47.14
15.0-16.0	1652.7	48.4	555.7	4.50	51.64
16.0-17.0	1480.3	46.1	601.8	4.28	55.92
17.0-18.0	1310.9	43.2	645.0	4.02	59.94
18.0-19.0	1136.1	39.5	684.5	3.67	63.61
19.0-20.0	965.4	35.3	719.9	3.28	66.90
20.0-21.0	811.1	31.1	751.0	2.89	69.79
21.0-22.0	665.7	26.8	777.8	2.49	72.28
22.0-23.0	537.0	22.5	800.3	2.09	74.37
23.0-24.0	427.3	18.7	819.0	1.74	76.11
24.0-25.0	333.4	15.2	834.2	1.41	77.52
25.0-26.0	261.1	12.3	846.5	1.15	78.67
26.0-27.0	203.8	10.0	856.5	0.93	79.59
27.0-28.0	159.2	8.1	864.5	0.75	80.34
28.0-29.0	127.9	6.7	871.2	0.62	80.96
29.0-30.0	105.1	5.7	876.9	0.53	81.49
30.0-31.0	89.1	5.0	881.8	0.46	81.95
31.0-32.0	77.8	4.5	886.3	0.41	82.37
32.0-33.0	69.2	4.1	890.4	0.38	82.74
33.0-34.0	63.0	3.8	894.2	0.35	83.10
34.0-35.0	58.2	3.6	897.8	0.34	83.43
35.0-36.0	54.4	3.5	901.3	0.32	83.76

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	51.5	3.4	904.6	0.31	84.07
37.0-38.0	48.9	3.3	907.9	0.30	84.37
38.0-39.0	46.8	3.2	911.1	0.30	84.67
39.0-40.0	45.1	3.1	914.2	0.29	84.96
40.0-41.0	43.6	3.1	917.3	0.29	85.25
41.0-42.0	42.3	3.1	920.4	0.29	85.54
42.0-43.0	41.3	3.1	923.5	0.28	85.82
43.0-44.0	40.1	3.0	926.5	0.28	86.10
44.0-45.0	39.1	3.0	929.5	0.28	86.38
45.0-46.0	38.2	3.0	932.5	0.28	86.66
46.0-47.0	37.0	2.9	935.4	0.27	86.93
47.0-48.0	36.1	2.9	938.4	0.27	87.20
48.0-49.0	35.7	2.9	941.3	0.27	87.47
49.0-50.0	35.3	2.9	944.2	0.27	87.75
50.0-51.0	34.9	3.0	947.2	0.27	88.02
51.0-52.0	34.6	3.0	950.1	0.28	88.30
52.0-53.0	34.7	3.0	953.2	0.28	88.58
53.0-54.0	34.6	3.0	956.2	0.28	88.86
54.0-55.0	34.2	3.1	959.3	0.28	89.15
55.0-56.0	34.1	3.1	962.3	0.29	89.43
56.0-57.0	34.2	3.1	965.5	0.29	89.72
57.0-58.0	34.1	3.2	968.6	0.29	90.02
58.0-59.0	33.9	3.2	971.8	0.29	90.31
59.0-60.0	33.8	3.2	975.0	0.30	90.61
60.0-61.0	33.7	3.2	978.2	0.30	90.91
61.0-62.0	33.6	3.2	981.4	0.30	91.21
62.0-63.0	33.3	3.2	984.7	0.30	91.51
63.0-64.0	33.0	3.2	987.9	0.30	91.81
64.0-65.0	33.2	3.3	991.2	0.31	92.12
65.0-66.0	33.1	3.3	994.5	0.31	92.42
66.0-67.0	32.9	3.3	997.8	0.31	92.73
67.0-68.0	32.8	3.3	1001.2	0.31	93.04
68.0-69.0	32.8	3.3	1004.5	0.31	93.35
69.0-70.0	32.7	3.4	1007.8	0.31	93.66
70.0-71.0	32.5	3.4	1011.2	0.31	93.97
71.0-72.0	32.4	3.4	1014.6	0.31	94.29

C Plane (°):0.0-360.0: 90.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G0.0	3039.7	3017.5	3039.7	3017.5	3039.7					
G1.0	3020.2	3023.4	3043.9	3000.2	3020.2					
G2.0	2991.4	3019.4	3035.1	2971.7	2991.4					
G3.0	2949.1	3005.8	3012.9	2926.8	2949.1					
G4.0	2899.2	2980.1	2983.9	2869.6	2899.2					
G5.0	2839.2	2939.6	2941.3	2806.0	2839.2					
G6.0	2758.2	2877.8	2883.8	2727.3	2758.2					
G7.0	2672.6	2808.1	2813.5	2641.9	2672.6					
G8.0	2572.0	2722.6	2722.7	2543.5	2572.0					
G9.0	2467.5	2637.3	2628.4	2431.6	2467.5					
G10.0	2353.4	2536.9	2530.0	2314.9	2353.4					
G11.0	2229.3	2420.5	2408.1	2181.8	2229.3					
G12.0	2097.4	2298.5	2288.0	2044.9	2097.4					
G13.0	1955.8	2158.1	2157.1	1899.8	1955.8					
G14.0	1801.5	2015.3	2007.7	1730.2	1801.5					
G15.0	1651.7	1871.3	1864.6	1573.6	1651.7					
G16.0	1470.7	1696.5	1689.4	1404.0	1470.7					
G17.0	1304.7	1537.1	1520.6	1219.0	1304.7					
G18.0	1128.9	1363.6	1352.4	1060.8	1128.9					
G19.0	949.7	1184.3	1159.4	889.5	949.7					
G20.0	789.6	1018.6	988.8	743.7	789.6					
G21.0	642.7	856.8	833.5	615.1	642.7					
G22.0	507.5	714.5	670.6	485.1	507.5					
G23.0	400.9	589.3	543.7	384.8	400.9					
G24.0	304.9	470.2	420.3	304.5	304.9					
G25.0	231.2	375.5	328.2	232.7	231.2					
G26.0	179.5	301.0	258.6	182.5	179.5					
G27.0	137.4	234.1	195.6	141.6	137.4					
G28.0	111.0	186.3	153.1	114.4	111.0					
G29.0	93.5	146.9	122.6	95.5	93.5					
G30.0	79.9	120.1	100.2	81.6	79.9					
G31.0	71.7	100.3	86.5	72.3	71.7					
G32.0	63.9	86.3	75.7	65.9	63.9					
G33.0	58.8	76.1	68.0	59.1	58.8					
G34.0	55.0	69.0	62.0	55.7	55.0					
G35.0	51.8	62.2	57.3	52.8	51.8					
G36.0	49.3	57.8	54.1	50.2	49.3					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G37.0	47.2	54.2	51.2	47.8	47.2					
G38.0	45.6	51.2	47.3	46.5	45.6					
G39.0	44.8	48.9	45.7	44.5	44.8					
G40.0	42.8	47.0	43.5	43.8	42.8					
G41.0	41.5	45.2	41.9	42.8	41.5					
G42.0	40.5	43.8	40.9	42.0	40.5					
G43.0	39.4	42.8	40.0	40.9	39.4					
G44.0	38.1	41.5	38.5	39.6	38.1					
G45.0	37.9	40.3	37.6	39.0	37.9					
G46.0	36.5	39.0	37.1	37.7	36.5					
G47.0	35.9	37.3	35.8	36.4	35.9					
G48.0	35.2	36.8	34.6	36.7	35.2					
G49.0	34.8	36.5	34.3	36.3	34.8					
G50.0	35.1	34.8	34.6	35.9	35.1					
G51.0	34.3	34.8	33.5	35.9	34.3					
G52.0	34.7	35.0	33.0	35.6	34.7					
G53.0	35.0	34.7	33.9	35.5	35.0					
G54.0	34.2	34.5	33.5	35.1	34.2					
G55.0	34.5	34.2	32.9	35.0	34.5					
G56.0	34.5	33.9	32.9	35.2	34.5					
G57.0	34.3	33.9	33.8	34.8	34.3					
G58.0	34.2	34.2	32.8	34.7	34.2					
G59.0	34.3	33.4	32.6	35.0	34.3					
G60.0	34.2	33.7	32.8	34.5	34.2					
G61.0	33.8	33.5	32.5	34.6	33.8					
G62.0	33.9	33.5	32.0	35.0	33.9					
G63.0	33.9	33.4	31.0	33.9	33.9					
G64.0	34.5	33.4	30.7	33.5	34.5					
G65.0	34.6	33.9	31.2	33.7	34.6					
G66.0	34.5	32.6	31.4	33.3	34.5					
G67.0	34.5	32.4	31.7	33.0	34.5					
G68.0	33.8	33.0	31.0	32.8	33.8					
G69.0	34.6	33.0	30.9	32.9	34.6					
G70.0	33.7	32.8	30.3	33.3	33.7					
G71.0	34.3	31.7	30.9	32.9	34.3					
G72.0	33.8	32.4	30.4	33.1	33.8					
G73.0	33.4	32.9	30.4	32.6	33.4					

C Plane (°):0.0-360.0: 90.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector:

Unit: cd

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector: